


**MASTER FUNCTIONAL SERVICING  
REPORT**

**RANGEVIEW OFFICIAL PLAN  
AMENDMENT**

**CITY OF MISSISSAUGA  
PROJECT 2020-4938**

**JULY 2024**

Revision	Description	Prepared		Checked	
		By	Date	By	Date
4	Fifth Submission (OPA Submission) revised for the Region of Peel	Ishraque Chandan	July 2024	Koryun Shabbikian Ming Gao	May 2024
3	Fourth Submission (OPA Submission)	Ishraque Chandan	May 2024	Koryun Shabbikian	May 2024
2	Third Submission (DMP Submission)	Ishraque Chandan	April 2024	Koryun Shabbikian	April 2024
1	Second Submission	Ishraque Chandan	September 2023	Heather Milukow	September 2023
0	First Submission	Ishraque Chandan	November 2022	Heather Milukow	November 2022



**SCHAEFFERS**  
CONSULTING ENGINEERS

6 Ronrose Road  
Concord, Ontario L4K 4R3

---

## Table of Contents

	<u>PAGE</u>
<b>1 INTRODUCTION .....</b>	<b>5</b>
1.1 Objective and Location.....	5
1.2 Existing Site Conditions.....	5
1.3 Background Studies and Documentation .....	6
1.4 Proposed Development.....	6
<b>2 WATER SUPPLY SERVICING .....</b>	<b>10</b>
2.1 Existing Water Supply Servicing .....	10
2.2 Water Supply Servicing Design Criteria .....	12
2.3 Proposed Water Supply Servicing Plan.....	14
2.3.1 Interim Scenario .....	14
2.3.2 Ultimate Scenario .....	14
2.4 Water Demands .....	19
2.5 Hydraulic Modeling.....	19
2.6 Water Age Analysis.....	21
<b>3 SANITARY SERVICING.....</b>	<b>22</b>
3.1 Existing Sanitary Servicing .....	22
3.2 Background Information .....	22
3.3 Sanitary Design Criteria .....	23
3.4 Proposed Sanitary Servicing Plan .....	23
3.4.1 Sanitary Spine Servicing .....	23
3.4.2 Ultimate Conditions .....	25
3.4.3 Sanitary Demand .....	25
3.5 Downstream Capacity Analysis .....	25
<b>4 STORMWATER MANAGEMENT .....</b>	<b>30</b>
4.1 Existing Condition & Stormwater Infrastructure .....	30
4.2 Stormwater Management Criteria .....	32
4.3 Proposed Stormwater Management Plan.....	34
4.3.1 Allowable Release Rates .....	35
4.3.2 Quantity Control.....	37
4.3.3 Quality Control.....	38
4.3.4 Water Balance and Volumetric Controls .....	42
4.3.5 Interim Conditions.....	44
<b>5 CLOSING REMARKS .....</b>	<b>48</b>

**List of Tables**

	<u>PAGE</u>
Table 1-1: Estimated Population.....	7
Table 2-1: Summary of Water Demands – Rangeview Development.....	19
Table 2-2: Summary of Modelled System Pressures.....	20
Table 2-3: Pressure Range (MDD plus Fire Flow Scenario).....	21
Table 3-1 Sanitary Demand .....	25
Table 4-1 City of Mississauga IDF Curve .....	32
Table 4-2 Allowable Release Rate for Site Plans .....	36
Table 4-3 Storage Summary .....	38
Table 4-4 Summary of Retention Targets.....	42

**List of Figures**

	<u>PAGE</u>
Figure 1.1: Location Plan.....	8
Figure 1.2: Development Plan .....	9
Figure 2.1: Existing Water Supply Services .....	11
Figure 2.2: Interim Water Supply – Option 1 .....	16
Figure 2.3 Interim Water Supply – Option 2 .....	17
Figure 2.4: Ultimate Water Supply Services .....	18
Figure 3.1: Existing Sanitary Servicing.....	27
Figure 3.2: Interim Sanitary Servicing.....	28
Figure 3.3: Ultimate Sanitary Servicing .....	29
Figure 4.1 Pre-Development Drainage & Existing Storm Servicing.....	31
Figure 4.2 Proposed Storm Drainage Plan.....	45
Figure 4.3 Interim Storm Servicing .....	46
Figure 4.4 Ultimate Storm Servicing.....	47

## Appendices

- Appendix A: Background Information
- Appendix B: Water Supply Support Information
- Appendix C: Sanitary Servicing Support Information
- Appendix D: Stormwater Management Support Information
- Appendix E: Engineering Drawings

# 1 INTRODUCTION

## 1.1 Objective and Location

Schaeffer and Associates Ltd. (SCE) has been retained to prepare a Master Functional Servicing Report (MFSR) to facilitate the design of the proposed municipal roads and infrastructure to service the Rangeview Development on Lakeshore Road East and Lakefront Promenade, in the City of Mississauga, Region of Peel. The proposed development herein referred to as 'Rangeview Development' falls within the jurisdictional boundary of the Credit Valley Conservation Authority (CVC).

The subject site is approximately 25.7 ha including public roadways and is bound by Lakeshore Road to the northwest, Hydro Rd. to the northeast, East Avenue to the southwest, and Lakeview Park and Douglas Kennedy Park to the southeast. A location plan is provided in **Figure 1.1**. The majority of the site currently consists of employment land. The master plan proposes future right-of-way (ROW), residential site plans, and park areas. The following sections of this report provide strategic information regarding the municipal servicing of the proposed re-developments.

## 1.2 Existing Site Conditions

Existing site conditions were reviewed using previous planning documents for the subject site. Under existing conditions, the site's land use is predominantly commercial and industrial employment lands. The site land area is also mostly paved impervious spaces (commercial and industrial) with some grassed landscaped areas within the municipal ROW. The site generally grades southwest, ultimately discharging to Lake Ontario. There is a small portion of the subject area that discharges northerly to Lakeshore Road East.

A preliminary geotechnical and hydrogeological investigation was completed by DS Consultants Ltd (Dated September 22, 2023). This investigation revealed that the predominant underlying soils consist of silty clay till and clayey silt till. Based on the monitoring program carried out for the study, water levels were observed at depths within the range of 1.57 m to 1.64 meters as well as some dry readings in boreholes. As such, the proposed low-impact development (LID) should consider groundwater levels. Please see **Appendix A** for the preliminary geotechnical and hydrogeological report.

### 1.3 Background Studies and Documentation

The following material has been reviewed in order to identify environmental compliance, existing topography, target release rates, and stormwater management criteria, which govern the proposed development within the area of the subject land and form the basis of this report.

- *Development Requirements Manual*, Transportation and Works Department, City of Mississauga, dated November 2020
- *Stormwater Management Criteria*, Credit Valley Conservation, dated August 2012.
- *Lakeview Village Functional Servicing Report*, Lakeview Community Partners Ltd., dated June 2021.
- *Lakeview Village Drainage Drawings*, Urbantech., dated October 2022.

### 1.4 Proposed Development

Based on the current development plans for the site, the following development features have been considered:

- Twenty-eight (28) site plan catchments with a mix of residential units;
- Nine (9) Park Blocks;
- Additional public right of way (ROW);

The specific design of each of the proposed blocks is subject to change in the future; however, this report intends to establish the servicing requirements of the study area such that the aforementioned developments may be supported by existing infrastructure and to verify if there will be any requirements for necessary infrastructure improvements in the future. The details of the proposed servicing scheme are provided in the remainder of the report. Refer to **Figure 1.2** for the development plan (ultimate full buildout scenario with all site areas participating).

Access to the subject site is currently provided from Lakeshore Road East, Hydro Road, East Avenue, Lakefront Promenade, and Rangeview Road. It should be noted that the proposed development includes the existing public roads; Rangeview Road, Lakefront Promenade, and East Avenue. It is to be noted that road widening is proposed on Rangeview Road and East Avenue as per the Lakeview master plan. Refer to the memorandum entitled, “*Rangeview Development – Servicing Alternatives Memorandum*”, by SCE (April 2024), for further details regarding the road

widening of Rangeview Road and East Avenue. As shown in **Figure 1.2**, three (3) additional municipal ROWs are proposed, one of the proposed municipal ROW is north of Rangeview Road, parallel to Lakeshore Rd. East, connecting to East Avenue and Hydro Road (Street L). While the second proposed municipal ROW runs parallel with Lakefront Promenade on the east side, connecting to Lakeshore Rd. East and the future Lakeview Village development (Ogden Ave). The third proposed ROW will intersect Rangeview Road and connect to the Lakeview Village development (Street G).


A summary of the approximate area of development and proposed unit count is presented in **Table 1-1** below. At the behest of the Region of Peel, a population density of 2.7 people/unit for apartments and 3.5 people/unit for townhouses was considered. The servicing sections below will discuss interim conditions based on cost sharing and participating land agreements and the ultimate condition in which all landowners are participating.

**Table 1-1: Estimated Population**

Parcel	Parcel Area (Gross)	Townhouses (Up to 4-Storey)	Apartment (4-Storeys +)	Equivalent Population*			
	ha	Units	Units	Commercial + Institutional persons	Townhouses persons	Apartments persons	Total persons
	21.94**	530	4770	502	1,856	12,890	15,248


\* The population estimate was performed based on Peel Region criteria and correspondence with Peel Region. [2.7 persons per apartment unit and 3.5 persons per townhouse unit]

\*\*Area excludes East Avenue and Hydro Road Right of Way

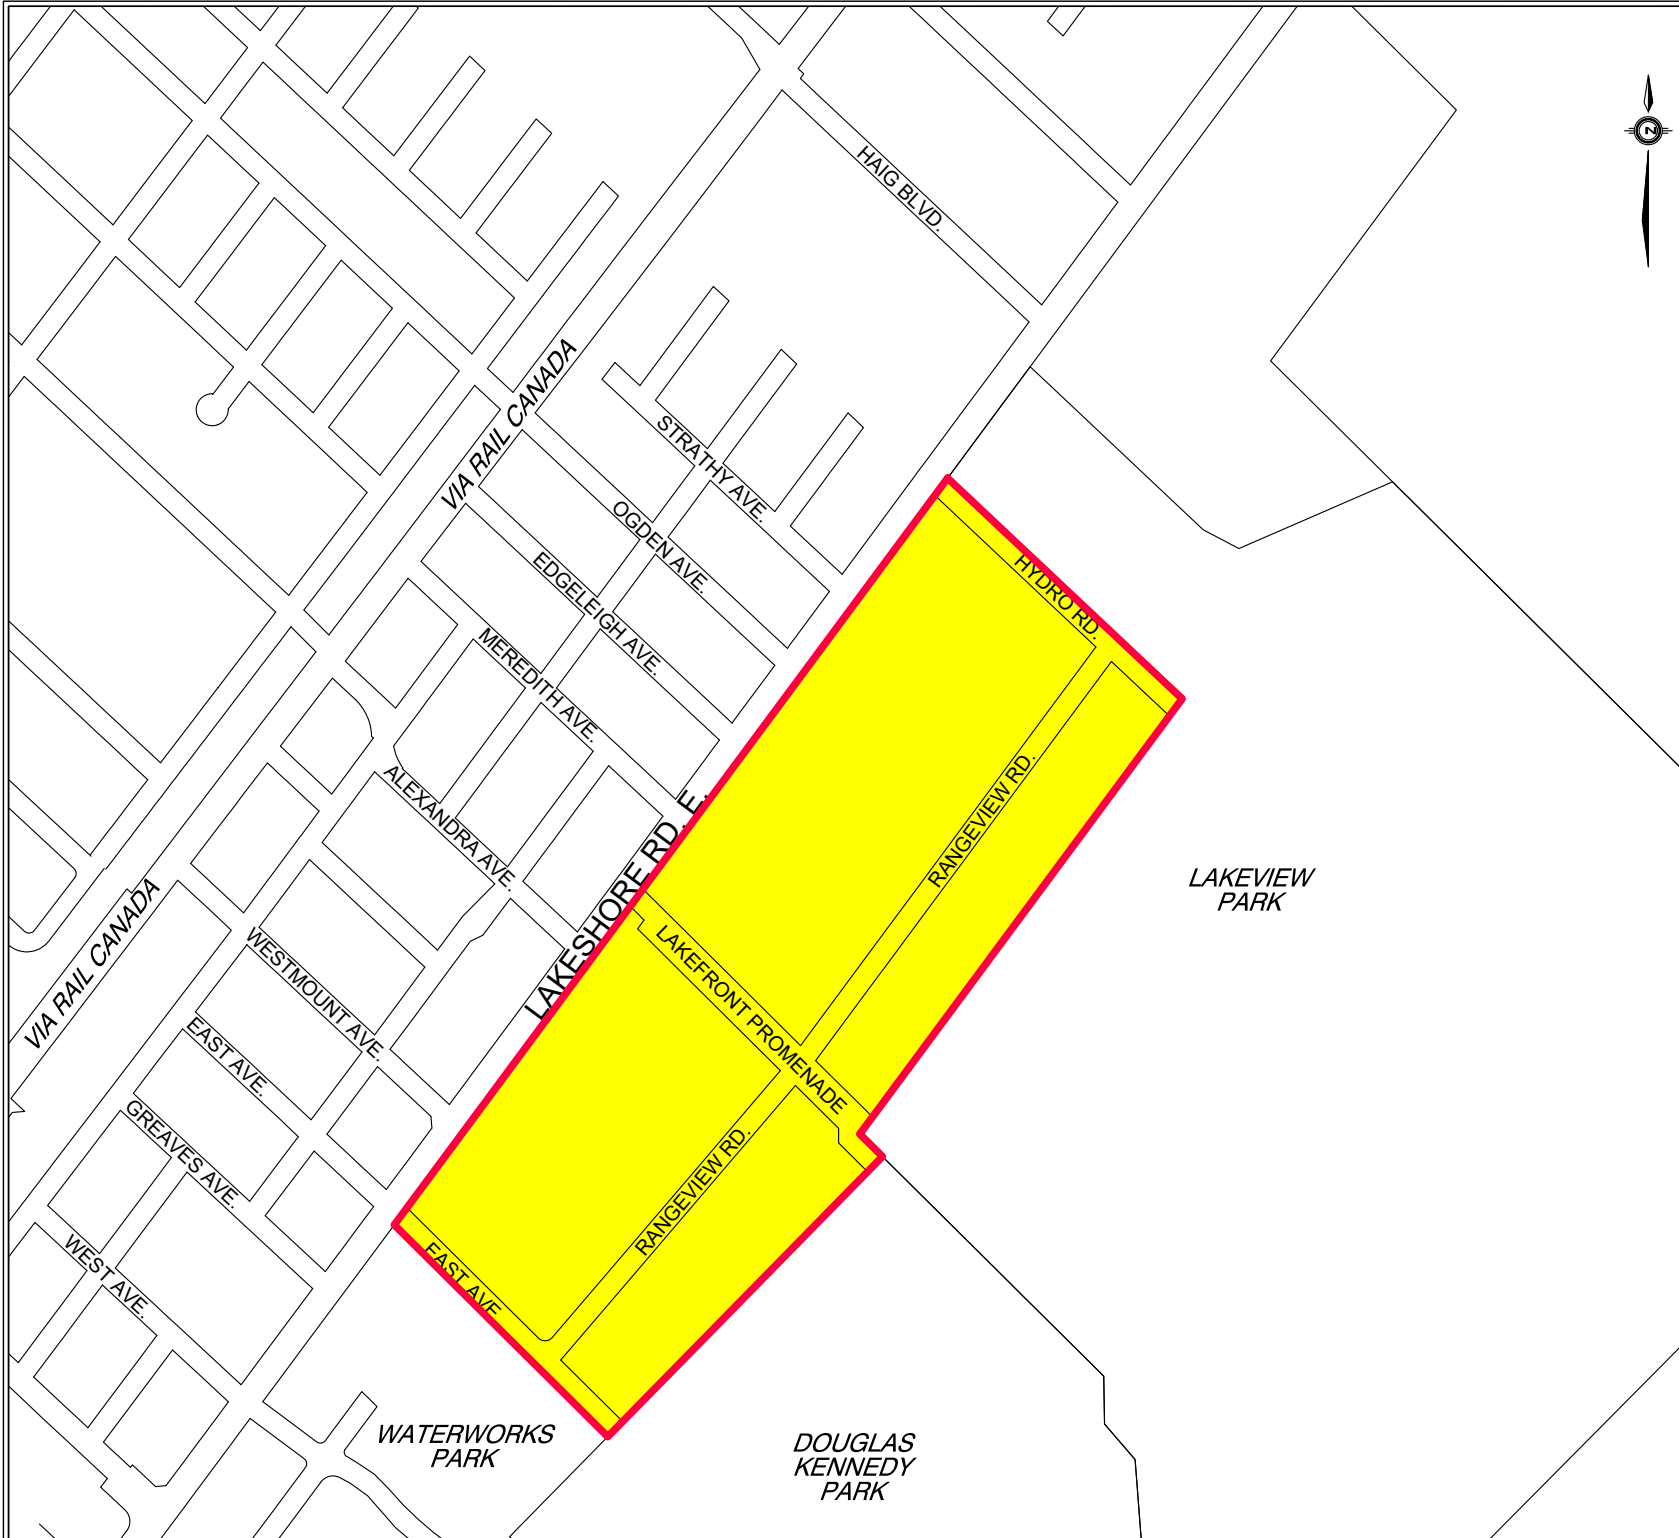

RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

 SUBJECT AREA


 **SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)


FIGURE 1.1  
LOCATION PLAN



RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

 SUBJECT AREA

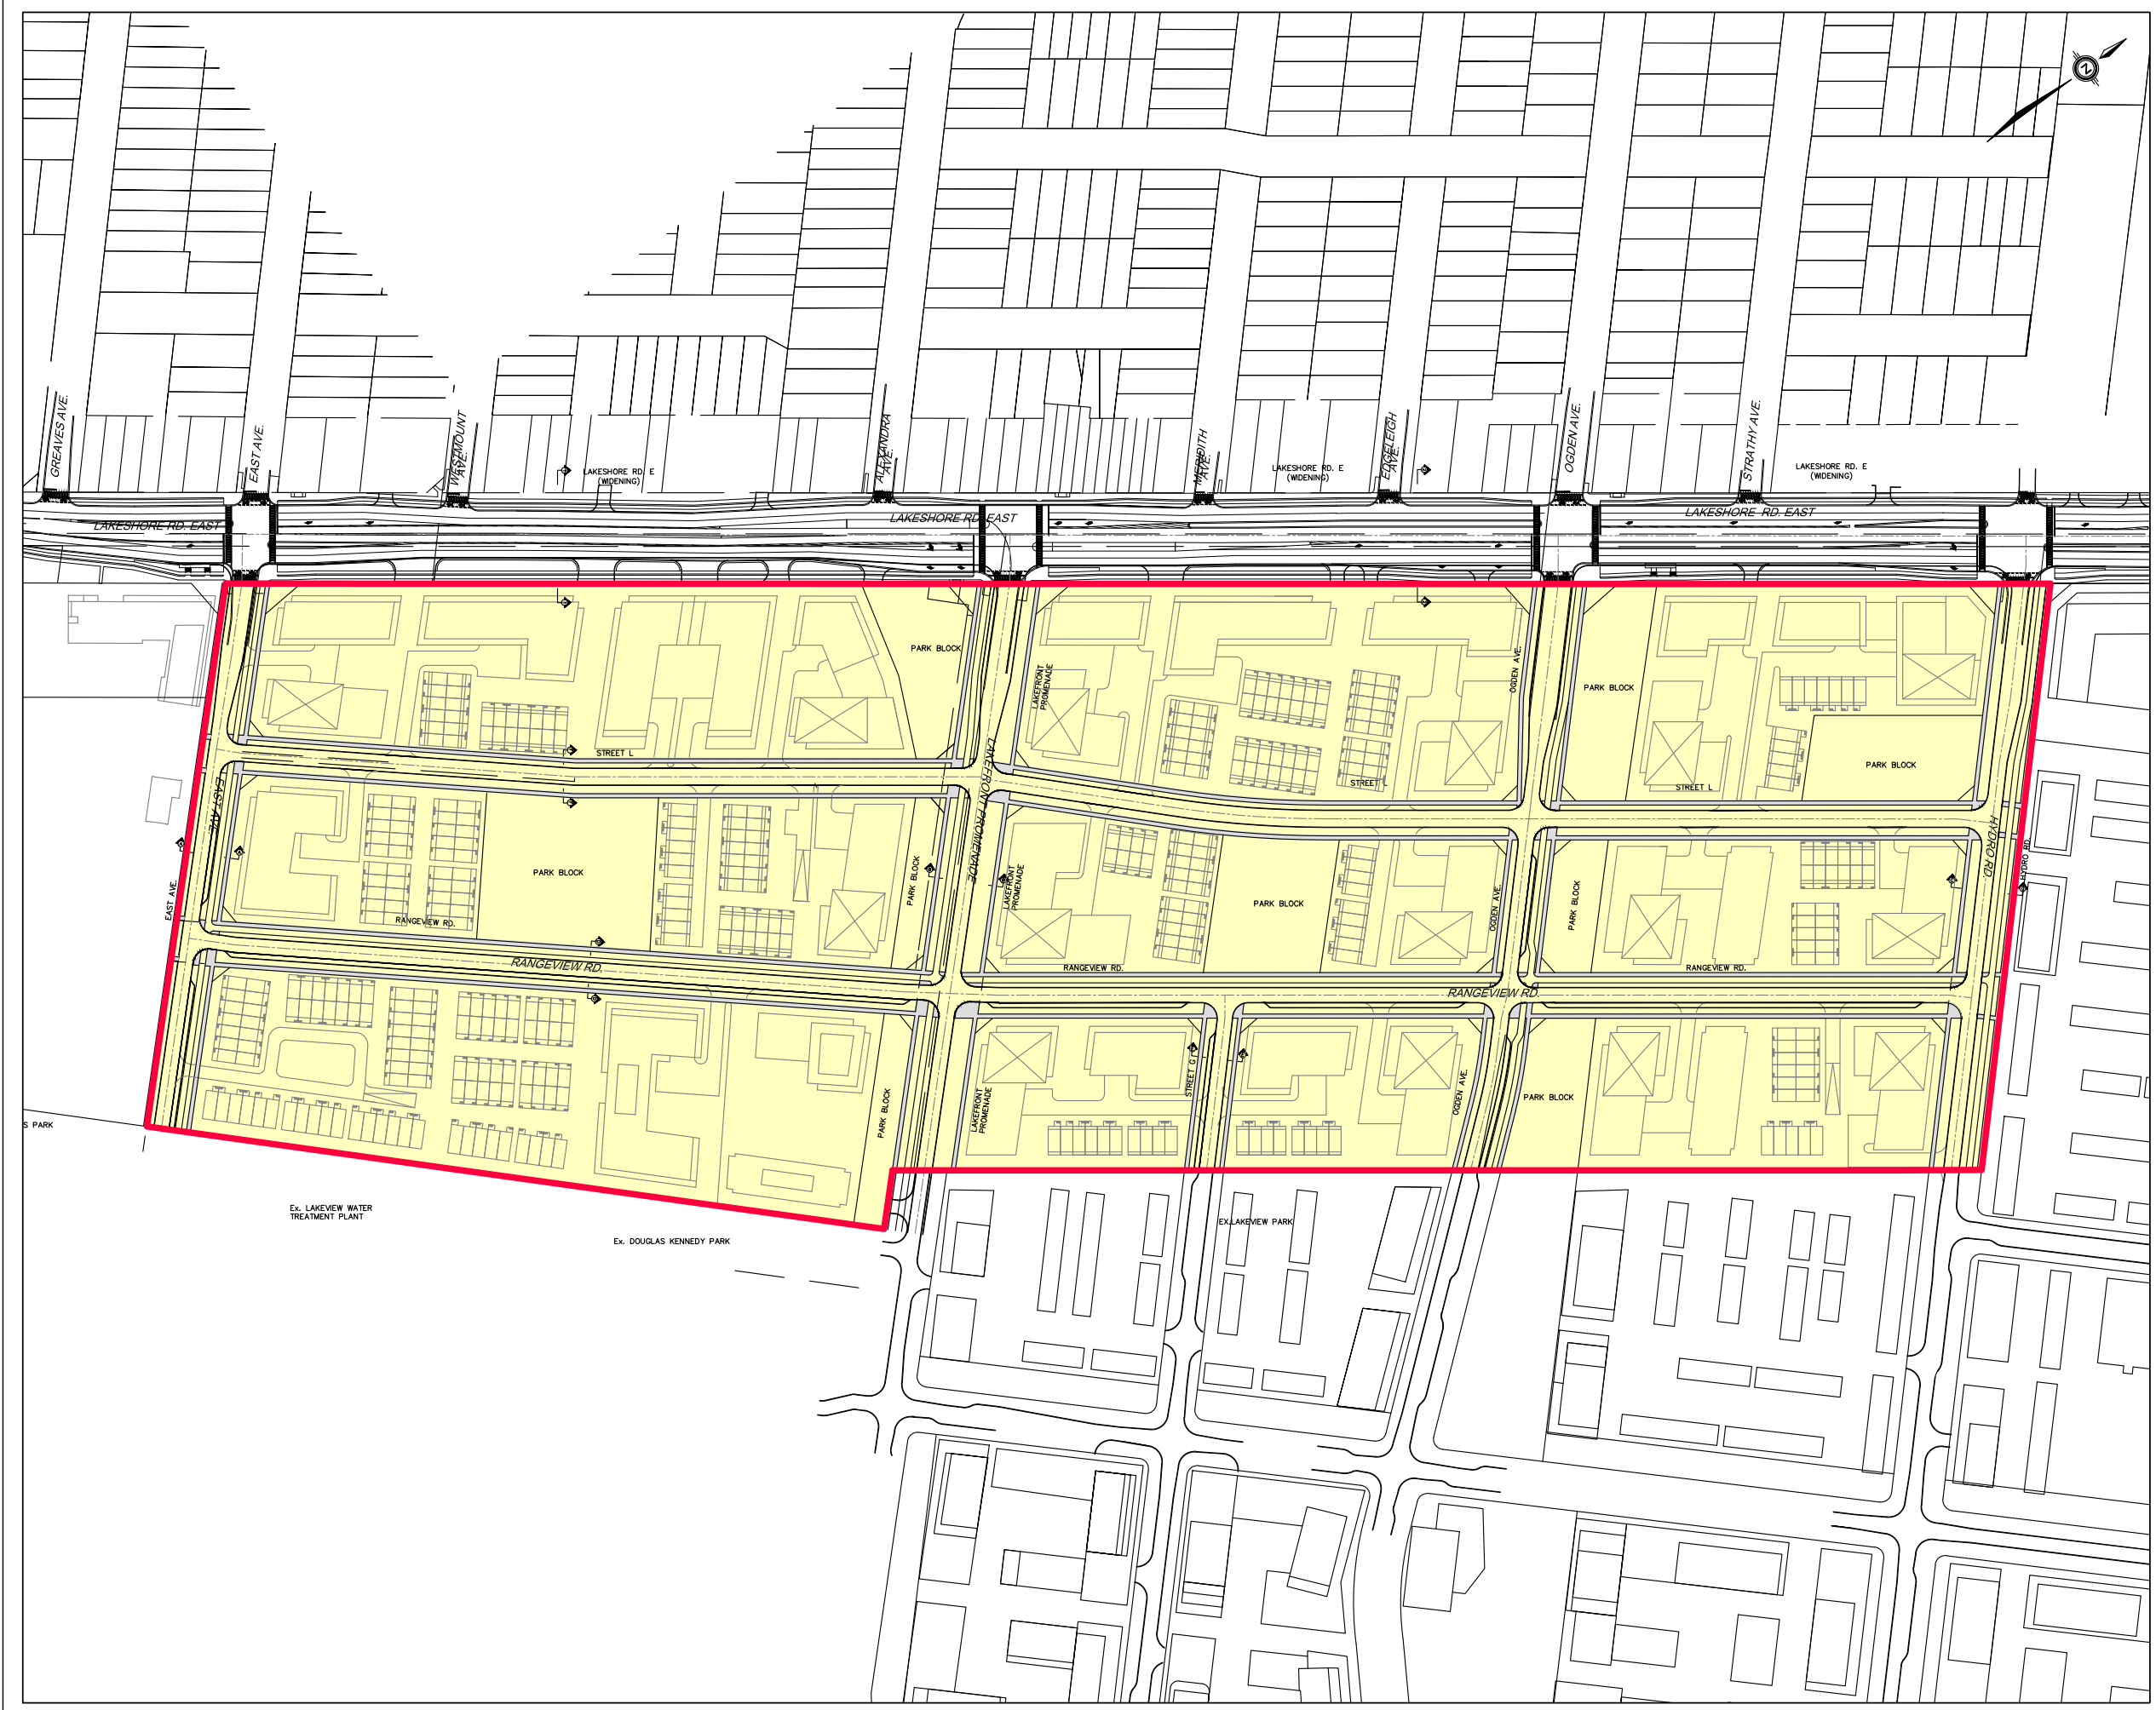


**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 1.2  
PROPOSED DEVELOPMENT PLAN

## 2 WATER SUPPLY SERVICING

### 2.1 Existing Water Supply Servicing

The subject site is located in the Region's Pressure District 1 (PD1). Existing water supply infrastructure proximate to the subject site includes:




- 600 mm diameter CPP along the south side of Lakeshore Road East;
- 300 mm diameter PVC along the north side of Lakeshore Road East;
- 2,400 mm diameter CPP watermain along Lakeshore Road East and Lakeshore Promenade;
- 300 mm diameter PVC watermains along East Avenue and Hydro Road;
- 900mm diameter CPP watermains along East Avenue;
- 1500mm diameter CPP watermains along East Avenue;
- 300 mm diameter PVC watermain along Rangeview Road from East Avenue to Lakefront Promenade; and,
- 250 mm diameter PVC watermain along Rangeview Road from Lakefront Promenade to Hydro Road.

The Lakeview Community, located to the south of the Rangeview development, is currently under construction. At the time the Rangeview development is to be constructed, it is expected that the water servicing infrastructure, including the 600 mm diameter watermains proposed along Lakefront Promenade and the 400mm watermain along Hydro Road, to service the Lakeview community will be constructed. **Figure 2.1** shows the existing watermain layout.



RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  EXISTING WATERMAIN
-  EXISTING WATERMAIN TO BE DECOMMISSIONED

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION



**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 2.1  
EXISTING WATER SUPPLY SERVICES

## 2.2 Water Supply Servicing Design Criteria

The following criteria were utilized in the design of the subject site's water distribution system:

- Region of Peel's Design, Specifications & Procedures Manual – Watermain Design Criteria (June 2010)
- Ministry of Environment, Conservation and Parks' (MECP) Design Guidelines for Drinking Water Systems (2019)
- City of Mississauga Development Requirements Manual (September 2016)
- Technical memorandum for the Lakeview Community development: "Lakeview Community – Water Modelling Methodology and Analysis" (TMIG, 2021) (Lakeview Community Technical Memorandum)
- E-mail correspondence with the Region

For fire flow demands, the Region's design guidelines do not provide a minimum fire flow demand for townhouses and apartment complexes. Furthermore, building construction and floor area data was not available, so Fire Underwriter Survey (FUS) methods could not be utilized to determine fire flow demands. As such, the City of Vaughan's Engineering Design Criteria & Standard Drawings (December 2020) were referenced for fire flow demand requirements. Once architectural plans become available, calculations shall be performed per FUS standards and the fire flow analysis shall be updated accordingly. For the Lakeview Community south of the subject site, fire flow demands were based on the technical memorandum for the Lakeview Community development, "Lakeview Community – Water Modelling Methodology and Analysis" (TMIG, 2021), and can be referred to in **Appendix B**.

- Equivalent population density of 3.5 persons per unit for townhouses and 2.7 persons per unit for apartments, per e-mail correspondence with the Region (refer to **Appendix B**);
- Equivalent population density of 175 persons per hectare for townhouses and 475 persons per hectare for apartments
- Average Day Demand of 280 L/capita/day for residential developments and 300 L/capita/day for institutional, commercial, and industrial (ICI) developments;

- For residential land use, the Maximum Day Demand and Peak Hour Demand peaking factors shall be 2.0 and 3.0, respectively;
- For commercial land use, the Maximum Day Demand and Peak Hour Demand peaking factors shall be 1.4 and 3.0, respectively;
- Minimum Fire Flow Demand of 317 L/s for multi-unit apartment buildings per City of Vaughan Engineering Design Criteria & Standard Drawings (December 2020)
- Fire Flow Demand of 300 L/s for all buildings within the Lakeview Community development per Technical Memorandum: Lakeview Community – Water Modelling Methodology and Analysis (TMIG, 2021)
- The system shall be designed to provide sufficient flow and pressure to meet the greater of the Fire Flow plus Maximum Day Demand, or the Peak Hourly Demand;
- The minimum pressure under any non-fire demand scenario shall not be less than 275 kPa (40 psi). The minimum residual pressure during the Fire Flow plus Maximum Day Demand scenario shall not be less than 140 kPa (20 psi) at any location in the water distribution system;
- Hazen-Williams coefficients below table:

Pipe Diameter (mm dia.)	Hazen-Williams ‘C’ Coefficient
150	100
200-250	110
300-600	120
Over 600	130

## 2.3 Proposed Water Supply Servicing Plan

### 2.3.1 Interim Scenario

Under the interim scenario, infrastructure cannot be built along the entirety of Street 'L' due to the presence of non-participating landowners within the Rangeview site. As a result, it is proposed to service the parcels fronting Rangeview Road via the watermain along Rangeview Road. Two (2) options are proposed for parcels fronting Lakeshore Road East. Option 1, parcels fronting Lakeshore Road East are proposed be serviced directly from the existing 600 mm diameter watermain along Lakeshore Road East, as per the existing servicing for the current buildings. Should the Region prefer parcels not connecting to the existing 600mm watermain, Option 2 proposes a new 300mm watermain on Lakeshore Road East. However, considering that the existing buildings are already connected to the existing 600mm watermain on Lakeshore, a similar servicing strategy for the new site plans is recommended. This approach would minimize the amount of infrastructure the region needs to maintain. Based on correspondence with the Region and City, the Region does not want parcels connecting to the existing 600mm watermain on Lakeshore Road East, therefore Option 2 is proposed. It is to be noted, there is an existing 300mm watermain on Lakeshore Rd E, located at the north side of the ROW. Servicing the proposed site plans from that watermain will create multiple long service connections crossing the Lakeshore Rd E and that might create some future challenges when BRT is constructed. Given the challenges connecting to the existing 300mm watermain at the north side of the ROW of Lakeshore Road East, Option 2 is proposed. It is recommended the proposed 300mm watermain be constructed before BRT works.

Water supply analysis of the interim water servicing scenario will be completed once the participating and non-participating landowners are confirmed. Refer to **Figure 2.2** and **Figure 2.3** depicting the proposed watermain layouts for interim scenario.

### 2.3.2 Ultimate Scenario





The water servicing of the ultimate buildout involves a proposed 300mm watermain along Lakeshore Road East and the proposed 300mm diameter watermain along Rangeview Road. The watermain on Rangeview Road are planned to connect to the existing 300mm watermain along East Avenue, the newly proposed 400 mm watermain along Lakefront Promenade, and the 400mm


watermain along Hydro Road for looping benefits. A watermain is also proposed on Street L to provide fire hydrant connections when the road is developed and is not necessitated for water supply demands. Furthermore, new watermains along Ogden Ave. and Street G are proposed to establish a looped system that integrates with the Lakeview Community development. Refer to **Figure 2.4** for the proposed watermain layout for the ultimate scenario.

Generally, connection to existing infrastructure was completed where feasible and permitted. Based on correspondence with the Region, service connections from the proposed site plans to the Region's watermains were not permitted. As such, service connections to the existing 600mm watermain on Lakeshore Road East or the future 600mm watermain on Rangeview Road are not proposed. A new watermain is proposed on Rangeview Road and the existing 250mm-300mm watermains are to be removed or relocated since the watermains are not sized sufficiently or the watermain requires relocation. Based on the water modelling analysis completed by the Region of Peel to service the development areas, including Rangeview development and Lakeview Village development area, a new 400mm watermain is proposed on Hydro Road. Moreover, the Region requires a new future 600 mm watermain along Rangeview Road, between East Avenue and Lakefront Promenade and a new 900 mm feeder mains along East Avenue, south of Rangeview Road.

RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  PROPOSED WATERMAIN
-  EXISTING WATERMAIN
-  DIRECTION OF SERVICE CONNECTION

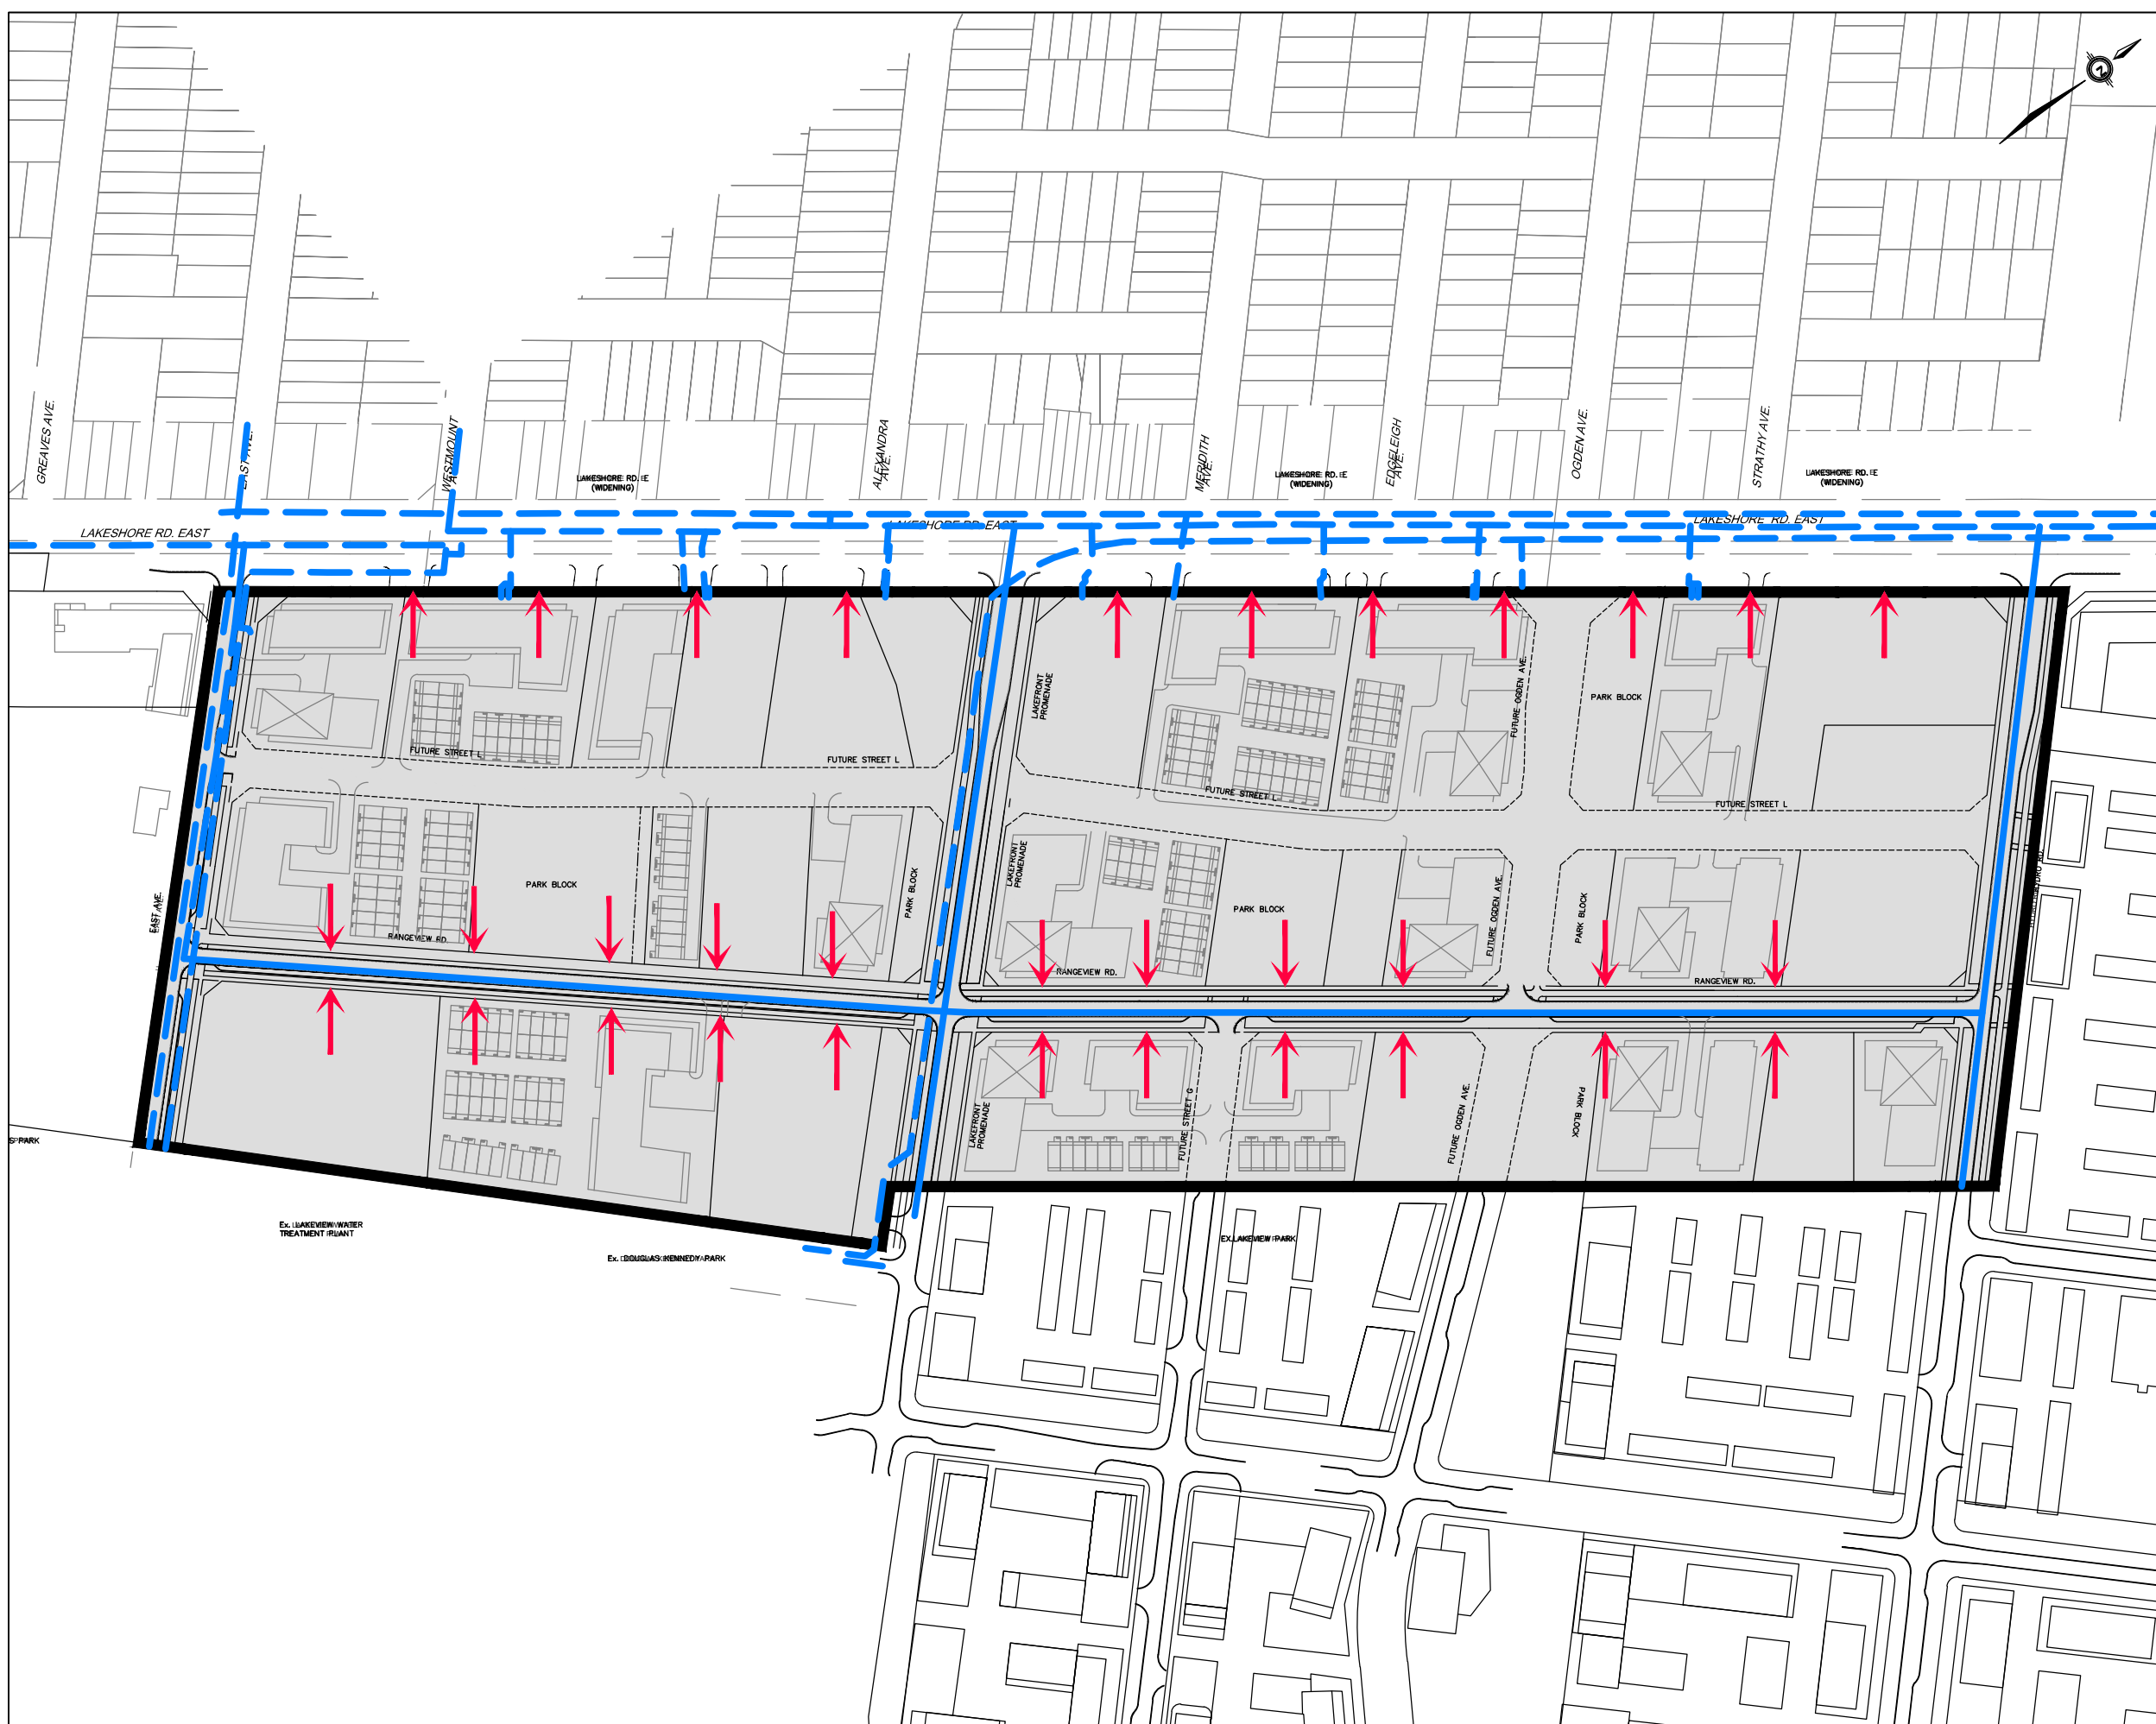

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION







**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)


FIGURE 2.2  
INTERIM - OPTION 1  
WATER SUPPLY SERVICES



RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  PROPOSED WATERMAIN
-  EXISTING WATERMAIN
-  DIRECTION OF SERVICE CONNECTION

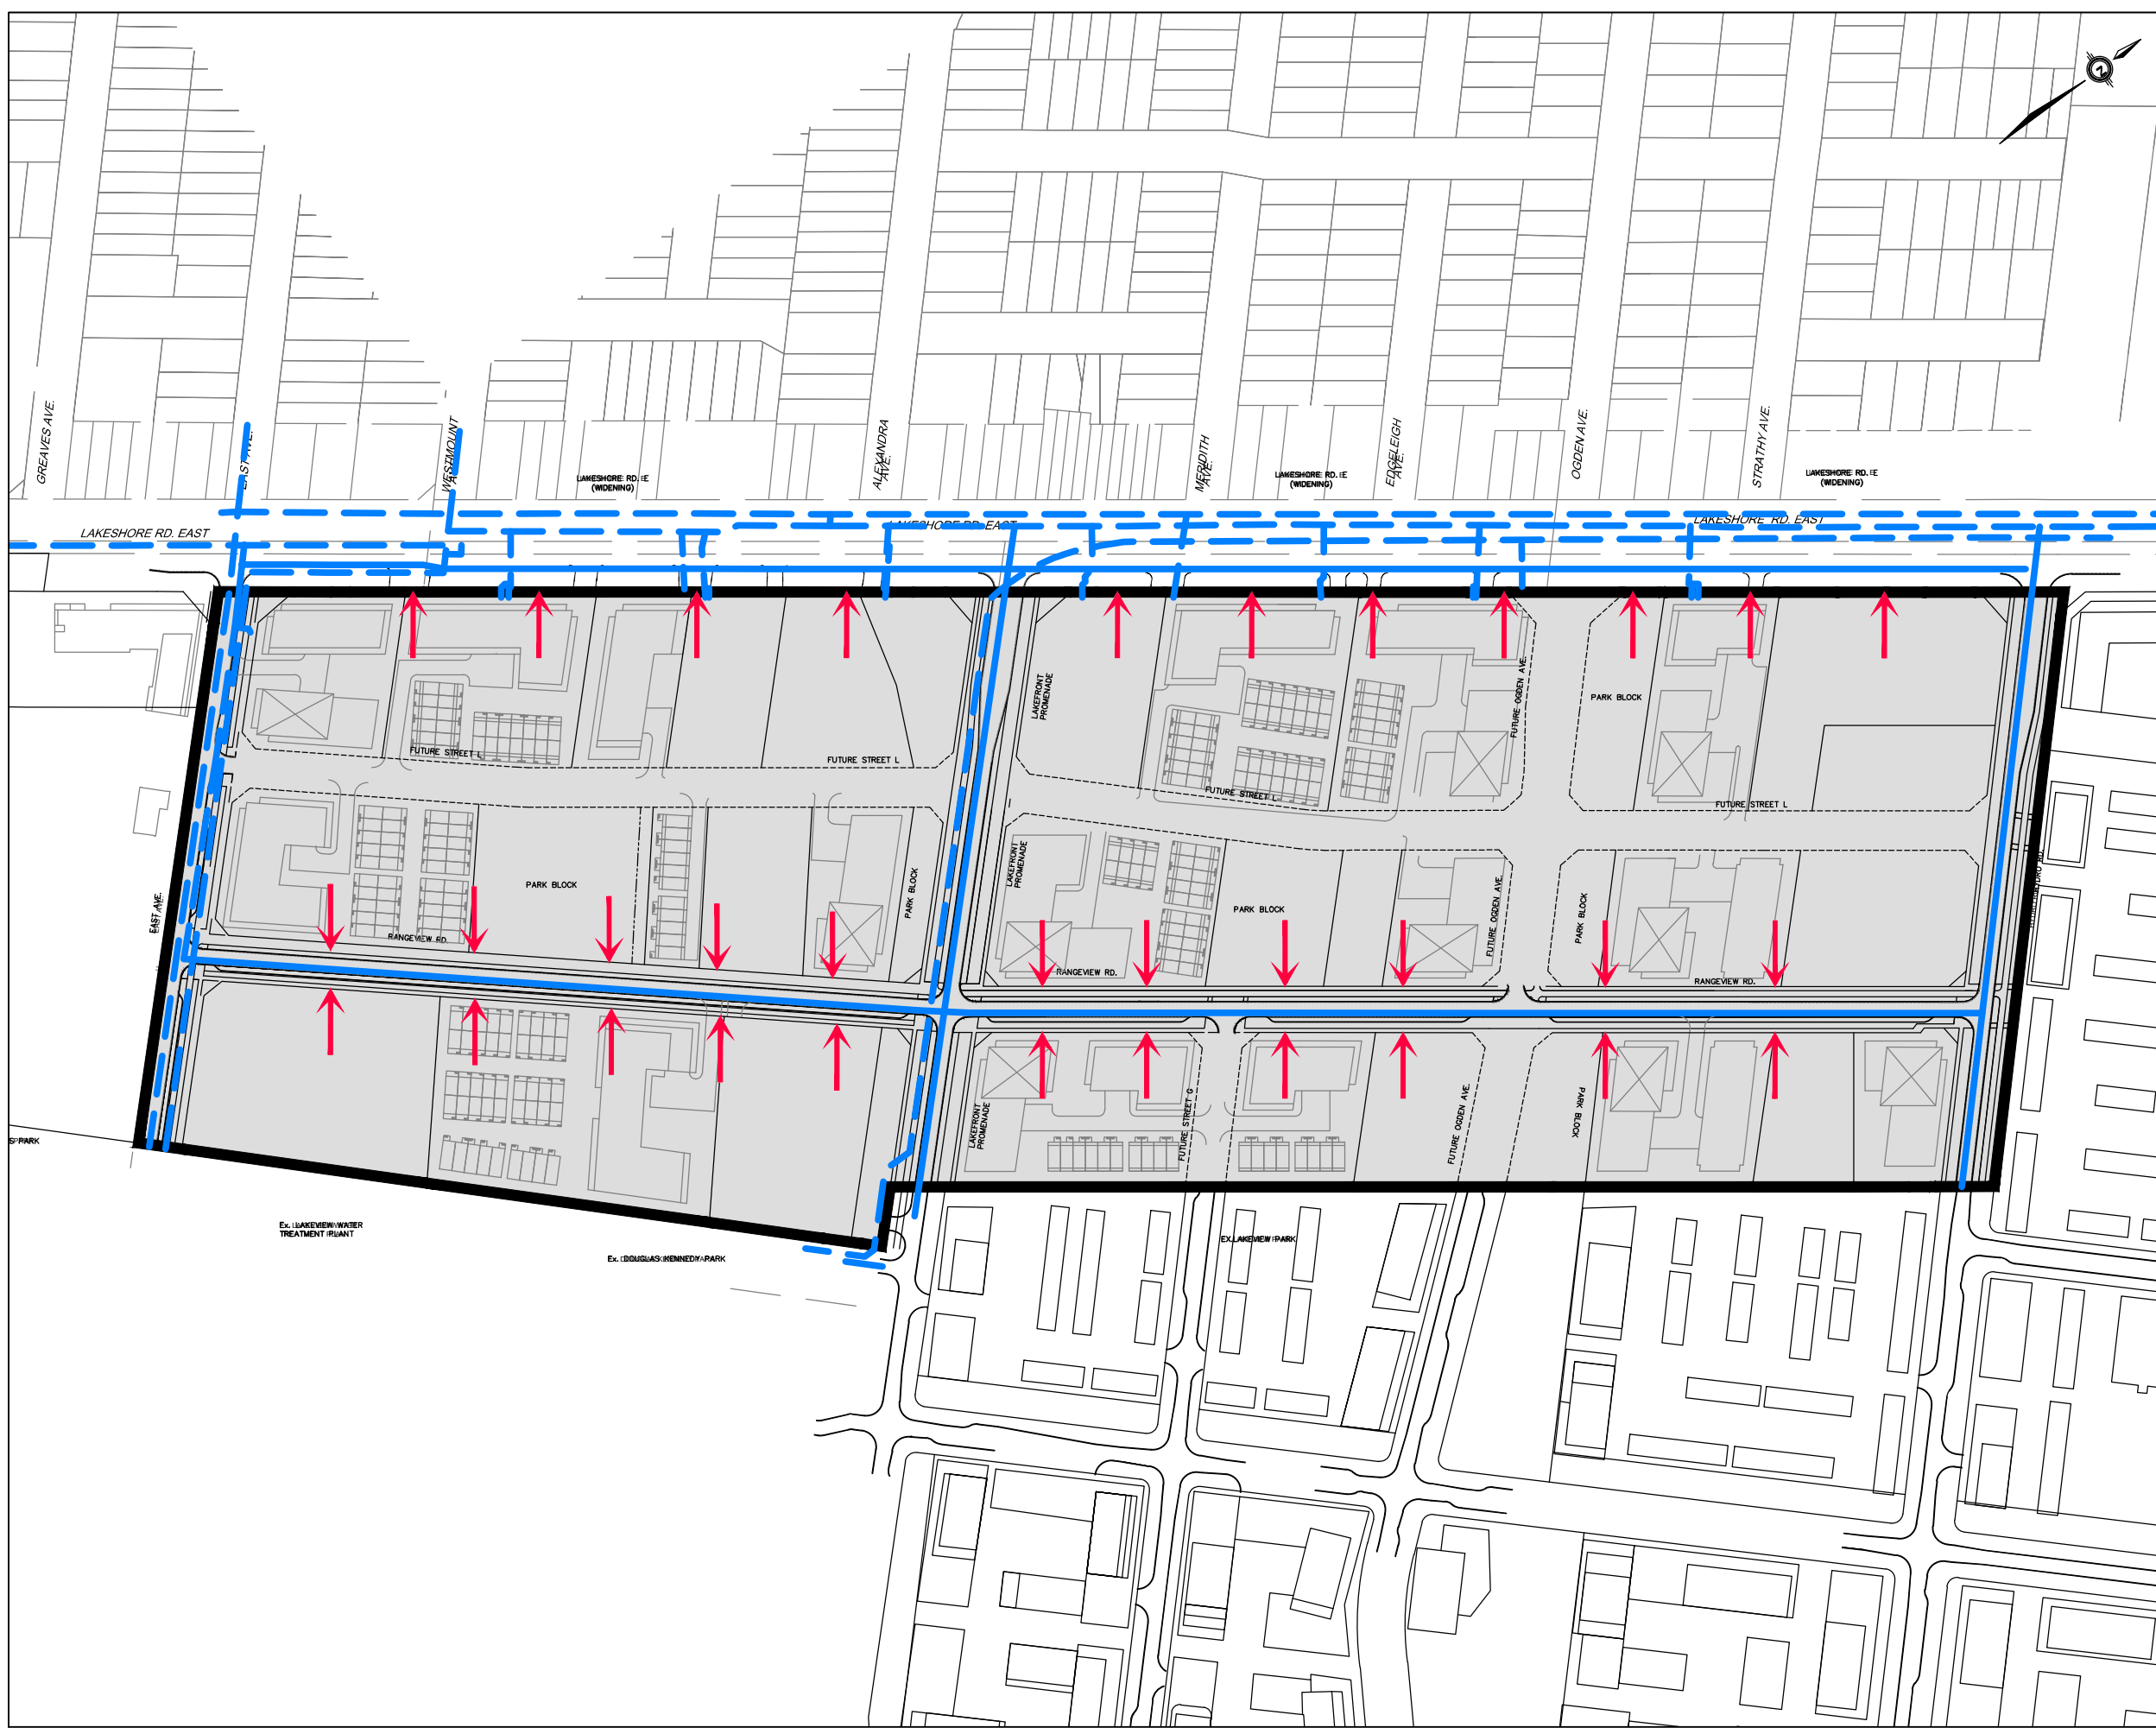

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION








**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 2.3  
INTERIM - OPTION 2  
WATER SUPPLY SERVICES

RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  PROPOSED WATERMAIN
-  EXISTING WATERMAIN
-  FUTURE WATERMAIN BY REGION
-  DIRECTION OF SERVICE CONNECTION



NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION



**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 2.3  
ULTIMATE  
WATER SUPPLY SERVICES

## 2.4 Water Demands

Water demands for the proposed development were calculated based on Rangeview site statistics provided by Bousfields Inc., dated July 17, 2023. Equivalent populations were calculated using 2 population density methods: population per hectare, per the Region’s Design, Specifications & Procedures Manual – Watermain Design Criteria (June 2010), and population per unit type, per correspondence with the Region on October 3, 2022. The equivalent population calculated using unit type yielded a higher value, thus, to be conservative this value was carried forward for water demand calculations.

Water demands for the Lakeview Community south of the subject site and external lands east of the subject site were calculated using population data from the Lakeview Community Technical Memorandum (TMIG, 2021). Per capita water demands and peaking factors were updated to reflect the latest Region design standards.

**Table 2-1** below summarizes the water demands for the Rangeview development. Refer to the detailed water demand calculations for the Rangeview development, Lakeview Community, and external lands in **Appendix B**.

**Table 2-1: Summary of Water Demands – Rangeview Development**

Land Use	Equivalent Population	Demand			Fire Flow
		Average Day	Max Day	Peak Hour	
		<i>L/s</i>	<i>L/s</i>	<i>L/s</i>	<i>L/s</i>
Residential	15,248	49.41	98.83	148.24	317

## 2.5 Hydraulic Modeling

An InfoWater model was prepared using elevation data from the Lakeview Community Technical Memorandum (TMIG, 2021) and the latest grading plan by SCE. Demands were assigned to the nearest junction within the proposed development.

The following boundary condition was assumed for the water supply analysis:

- The boundary condition utilized in the hydraulic model was sourced from a hydrant test

completed by EBAL Engineering Ltd. on April 23, 2021. The hydrant test, performed at 1000 Lakeshore Road East, Mississauga, yielded a static pressure of 82 psi. The boundary condition was modeled as a fixed-head reservoir with a head of 144.11 m, calculated as the sum of the ground elevation at the residual hydrant of 86.44 m (per the latest grading plan) and the measured static pressure of 82 psi (57.67 m head). Refer to **Appendix B** for the hydrant test results and analysis.

The InfoWater model was used to analyze the post-development system under the following demand scenarios: Average Day Demand, Maximum Day Demand, Peak Hour Demand, and Maximum Day plus Fire Flow Demand. The modeling results demonstrate the water supply system can provide sufficient pressure and flow to the proposed development under normal operational and fire flow scenarios in accordance with MECP and Region design guidelines.

**Table 2-2** below summarizes the pressures for each demand scenario. Detailed model outputs are provided in **Appendix B**.

**Table 2-2: Summary of Modelled System Pressures**

<b>Scenario</b>	<b>Minimum Pressure (psi)</b>	<b>Maximum Pressure (psi)</b>
Average Day	81.92	96.75
Maximum Day	81.77	96.33
Peak Hour	81.48	95.47

Fire flow (Max Day plus Fire Flow Demand) scenario modeling showed that a minimum residual pressure of 20 psi could be maintained for all nodes in the system proximate to the subject site.

**Table 2-3** below summarizes the pressure range under the Maximum Day plus Fire Flow scenario.

**Table 2-3: Pressure Range (MDD plus Fire Flow Scenario)**

	<b>Minimum Pressure</b> (psi)	<b>Maximum Pressure</b> (psi)
<b>Node ID</b> (Min/Max Location)	J230	J198
<b>Residual Pressure</b>	54.58	79.61

## 2.6 Water Age Analysis

A water age analysis was performed to ensure the proposed system is compliant with water age guidelines. Water turnover was calculated for the entirety of the modeled network as there are no proposed watermains that terminate at dead ends.

To be conservative, an occupancy rate of 20% and the minimum consumption rate (70% of the average day demand) were assumed for the purposes of calculating water age. Given these parameters, a water age of 0.59 days was determined for the entirety of the Rangeview and Lakeview Community water supply systems. Per “Effects of Water Age on Distribution System Water Quality” (AWWA, 2002), a maximum water turnover rate of 3 days is the criteria. With a water age of 0.59 days, the proposed system is less than the maximum allowed turnover rate and therefore meets water age requirements. Refer to the water age analysis in **Appendix B**.

### 3 SANITARY SERVICING

#### 3.1 Existing Sanitary Servicing

The majority of the site discharges sanitary flow westerly to the Beach Street Pumping Station (PS) via the existing 250mmØ sewers along Rangeview Road and the existing 250mmØ sewer on East Avenue. The remainder of the site, which includes the lots east of Lakeshore Road East and Lakefront Promenade, discharges easterly to the G.E. Booth Wastewater Treatment Facility (WWTF) via the existing 300mmØ sewers along Lakeshore Road East.

It is to be noted that there is another pumping station (Beechwood SPS), located north of Lakeshore Road East and east of Enola Avenue.

For further details, reference can be made to **Figure 3.1** for the existing sanitary services.

#### 3.2 Background Information

SCE previously completed a high-level downstream sanitary sewer analysis for the proposed lands, with an estimated population per parcel. The results of this analysis were presented in a meeting with the Region of Peel in April 2021. The Region recommended that all future flows from the proposed development lands were to be discharged to the Beechwood PS and none of the flows were to be discharged to the Beach Street PS or Lakeview PS. The Region informed SCE that the Beach Street PS would be decommissioned. Therefore, reliance on the Beach Street PS for ultimate servicing is not feasible. The Region further informed SCE that they would be commencing the design of a Capital Project to decommission the Beach Street PS and the Beach Street drainage area flow to be conveyed by a new gravity sewer along Lakeshore Road East to the Beechwood sewage pumping station.

The Region is currently detailed designing the sanitary trunk along Lakeshore Road East connecting the Rangeview Developments to the Beechwood pump station. Based on the collected information from the Region's plan and profile drawings, it was noted that the proposed servicing solution discussed described would be feasible. Reference can be made to **Appendix C** for the profile of this new sewer.

### 3.3 Sanitary Design Criteria

Reference has been made to the Region of Peel Public Works Design, Specifications & Procedures Manual (March 2017) and correspondence from the Region for the sanitary servicing portion of this report. Please note, the Region informed SCE that a density of 3.5 persons/unit and 2.7 persons/unit were to be considered for townhouses and apartments respectively. The relevant design criteria applicable to the development are summarized below:

- Average Residential Generation Rate  $q = 290$  L/person/day
- Average Non-residential Generation Rate  $q = 270$  L/person/day
- Infiltration Allowance  $i = 0.26$  L/s/ha
- Population (Townhouse)  $P = 3.5$  Persons/Unit
- Population (Apartment)  $P = 2.7$  Persons/Unit
- Population (Commercial)  $P = 50$  Persons/ha
- Population (Industrial)  $P = 70$  Persons/ha
- Harmon Peaking Factor  $M = [1+(14/(4+P(\text{total})^{1/2}))]$

### 3.4 Proposed Sanitary Servicing Plan

#### 3.4.1 Sanitary Spine Servicing

Under the interim scenario, infrastructure cannot be built along the entirety of Street ‘L’ due to the presence of non-participating landowners. The configuration of sanitary for the ultimate (full buildout) and the spine servicing is designed such that servicing from the proposed ROW of Street ‘L’ and Ogden Avenue is not required. It is proposed to incorporate future infrastructure in the ROW of Rangeview Road, East Avenue, Hydro Road, Lakefront Promenade and Lakeshore Road East to service all the blocks in the Rangeview Development. To provide flexibility for the development and for the Rangeview Development to be independent of requiring Street ‘L’ for servicing, it is proposed the lots fronting Lakeshore Road East be serviced from Lakeshore Road.

To avoid deep sanitary sewers along Lakeshore Road East, it was proposed that north blocks fronting Lakeshore Road East and east of the proposed Ogden Avenue to have sanitary flows collected and discharged the flows to the sanitary trunk going east of Lakeshore Road East. As

discussed in the existing conditions section, a portion of the site discharges to the existing sewers along Lakeshore Road East. Based on a memorandum entitled “*Downstream Sanitary Sewer Analysis, Rangeview Road Proposed Development Lands*” by SCE, dated September 2023, there was residual capacity for the sanitary trunk sewer going east along Lakeshore Road East (defined as SAN-3 as part of the memorandum). According to the Downstream Sanitary Sewer Analysis, the sanitary trunk sewer running east of Lakeshore Road East has a residual capacity to accommodate 2300 people (under 80% of flow ratio). The proposed population to discharge to the east trunk sewer is 1358 people. Therefore, the existing trunk sewer could safely accommodate the proposed development. Refer to the memorandum enclosed for further details.

For the blocks fronting Lakeshore Road East, west of the proposed Ogden Avenue, it is proposed to collect sanitary flows from the blocks and discharge to proposed sanitary sewers which would connect to the sanitary trunk going west of Lakeshore Road East. On Lakefront Promenade, there is a 2.4m diameter watermain that makes it challenging to have one continuous sanitary sewer along Lakeshore Road East. Therefore, to avoid a deep sanitary sewer network, it is proposed to run the sanitary sewer on Lakeshore Road East, west of the proposed Ogden Avenue, through the south of Lakefront Promenade, loop west of Rangeview Road, north of East Avenue and tie into the flow of the proposed sewers on Lakeshore Road East. Refer to **Figure 3.2** and **Figure 3.3** for a schematic representation of the proposed sanitary servicing.

Generally, connection to existing infrastructure was completed where feasible. The lots on the west side fronting Lakeshore Road East are proposed to be serviced from the existing infrastructure on Lakeshore Road East. On Rangeview Road, Lakeshore Road East (west of proposed Ogden Avenue), and East Avenue new sanitary sewers are proposed. Based on comments received from the Region, it was recommended to size the internal sanitary sewers at 60% capacity in case future applications exceed the proposed populations. In order to accommodate the 60% sizing capacity for the sanitary sewers, the existing 250mm sanitary sewer on Rangeview Road sewers is to be removed and new upsized sewers are proposed. New sanitary sewers are proposed on Lakefront Promenade and East Avenue to support the proposed servicing scheme. Refer to **Appendix C** for the design sheet analysis.



### 3.4.2 Ultimate Conditions

During ultimate conditions, the site is proposed to service 33 parcels of high-rise buildings, townhouses, and commercial properties. The full build-out of the site is expected to have a design population of approximately 15,248 people. As shown in the ultimate servicing plan in **Figure 3.3**, all future sanitary flows are proposed to follow the same sewer network as the interim conditions via the proposed spine servicing network. Please note that as shown in **Figure 3.3**, a section of the existing sanitary sewer on Lakeshore Road East will be decommissioned.

### 3.4.3 Sanitary Demand

The proposed sanitary demand for the subject site is presented in the table below.

**Table 3-1 Sanitary Demand**

Site Discharge	Population	Average Demand (L/S)	Harmon's Peaking Factor	Flow (L/s)	Infiltration (L/s)	Total Peak Flow (L/s)
Townhouse	1856	6.23	2.77	17.26	5.70	<b>17.26</b>
Apartment	12890	43.27		119.89		<b>119.89</b>
Commercial	52	0.16		0.48		<b>0.48</b>
Institutional	450	1.41		4.19		<b>4.19</b>
					Total Flow =	<b>147.53</b>

### 3.5 Downstream Capacity Analysis

A downstream sanitary sewer capacity analysis has been completed using theoretical design sheets to determine the pre-development and ultimate conditions. Reference has been made to the Region's design criteria to complete the downstream analysis. The purpose of the analysis is to analyze the capacity within the existing downstream sewers and determine if the existing infrastructure can support the flows from the proposed development. The outcome of this analysis will ensure that the sewers can safely convey the flow from the subject site to the outlet location.





Based on the ultimate servicing plan provided in **Figure 3.3**, the existing sewers along Rangeview Road will require upgrades to ensure that there is sufficient capacity to support the anticipated flows from future development. Approximately eight of the existing 250mmØ sewer legs, with a length of 642m, on Rangeview Road will require upgrades. It is to be noted that a sub-trunk sewer, approximately 200 m) is proposed to be constructed along East Avenue (from Rangeview Road to Lakeshore Avenue East). This sub-trunk sewer is proposed to connect to the new trunk sewer on Lakeshore Avenue East, which, as previously discussed, will be designed and constructed by the


Region. As per the design sheet analysis, the 205m sub-trunk sewer on East Avenue is required to be a minimum of 450-525mmØ.

Reference can be made to **Appendix C** for the design sheet analysis.

RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  EXISTING SANITARY SEWER
-  EXISTING FORCEMAIN
-  EXISTING WATERMAIN TO BE REMOVED

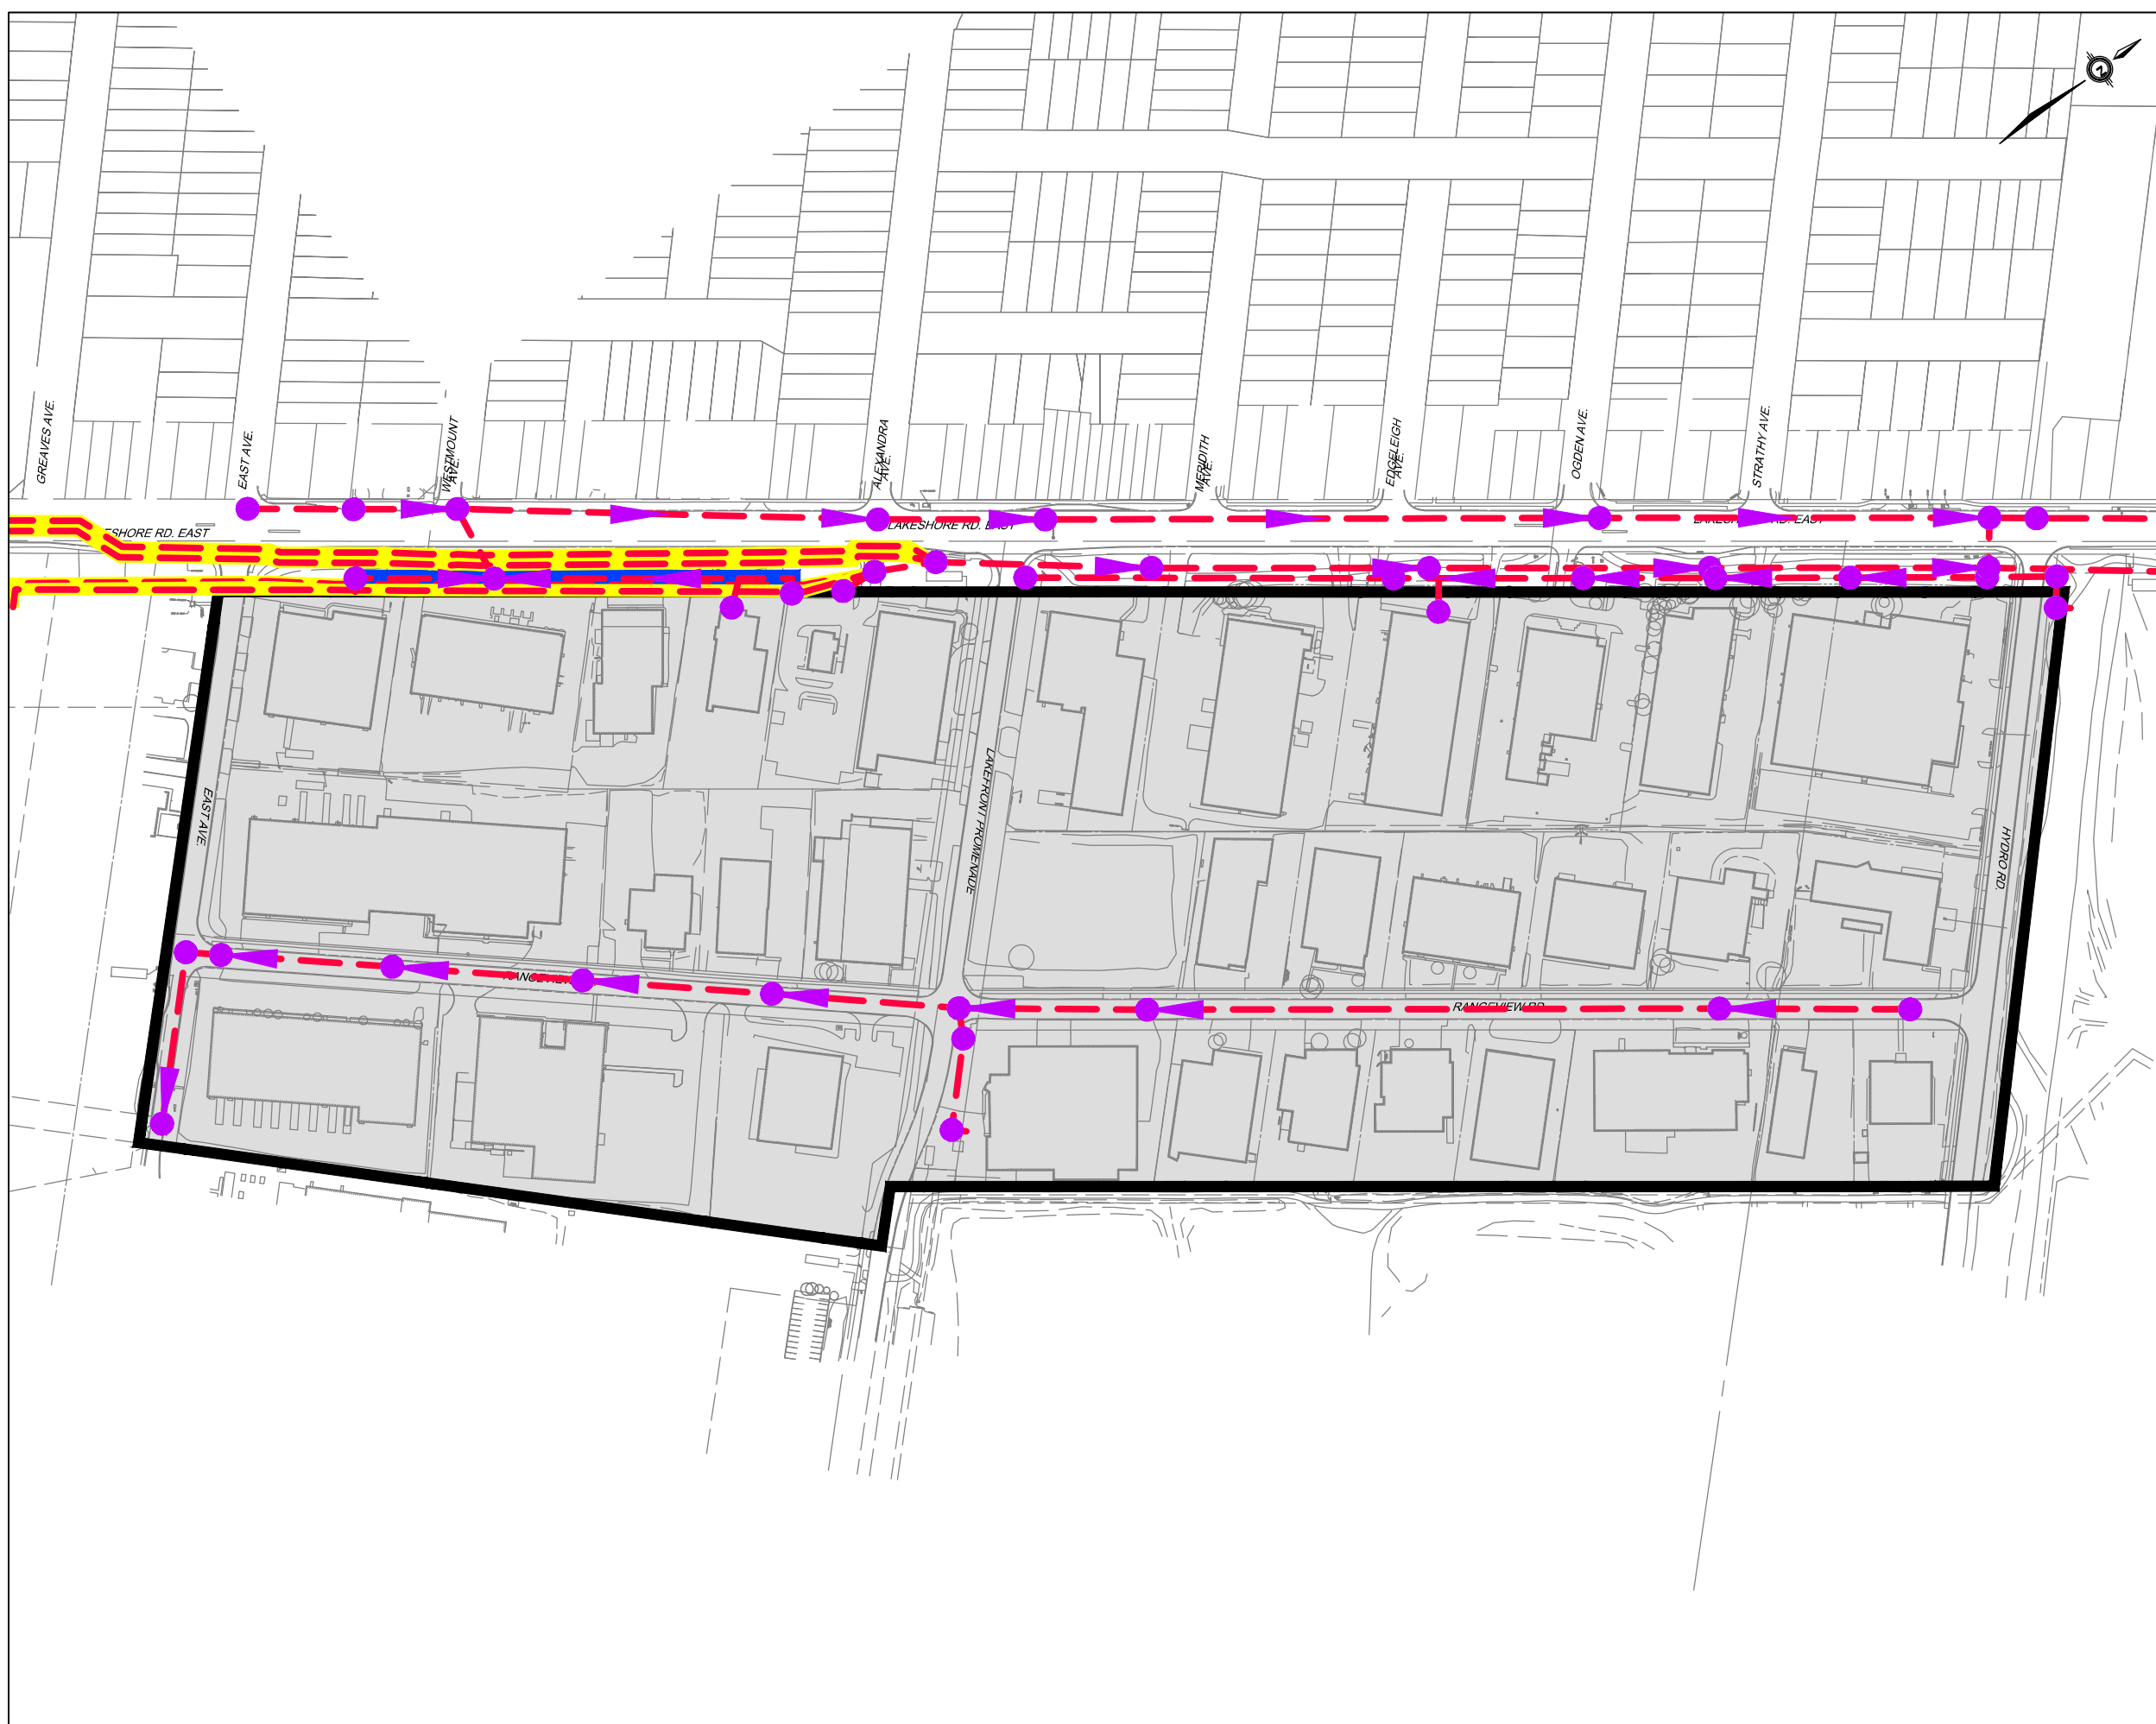

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION






**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 3.1  
EXISTING SANITARY SERVICES

RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND


-  SUBJECT AREA
-  PROPOSED SANITARY SEWER
-  EXISTING SANITARY SEWER



NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION




 **SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

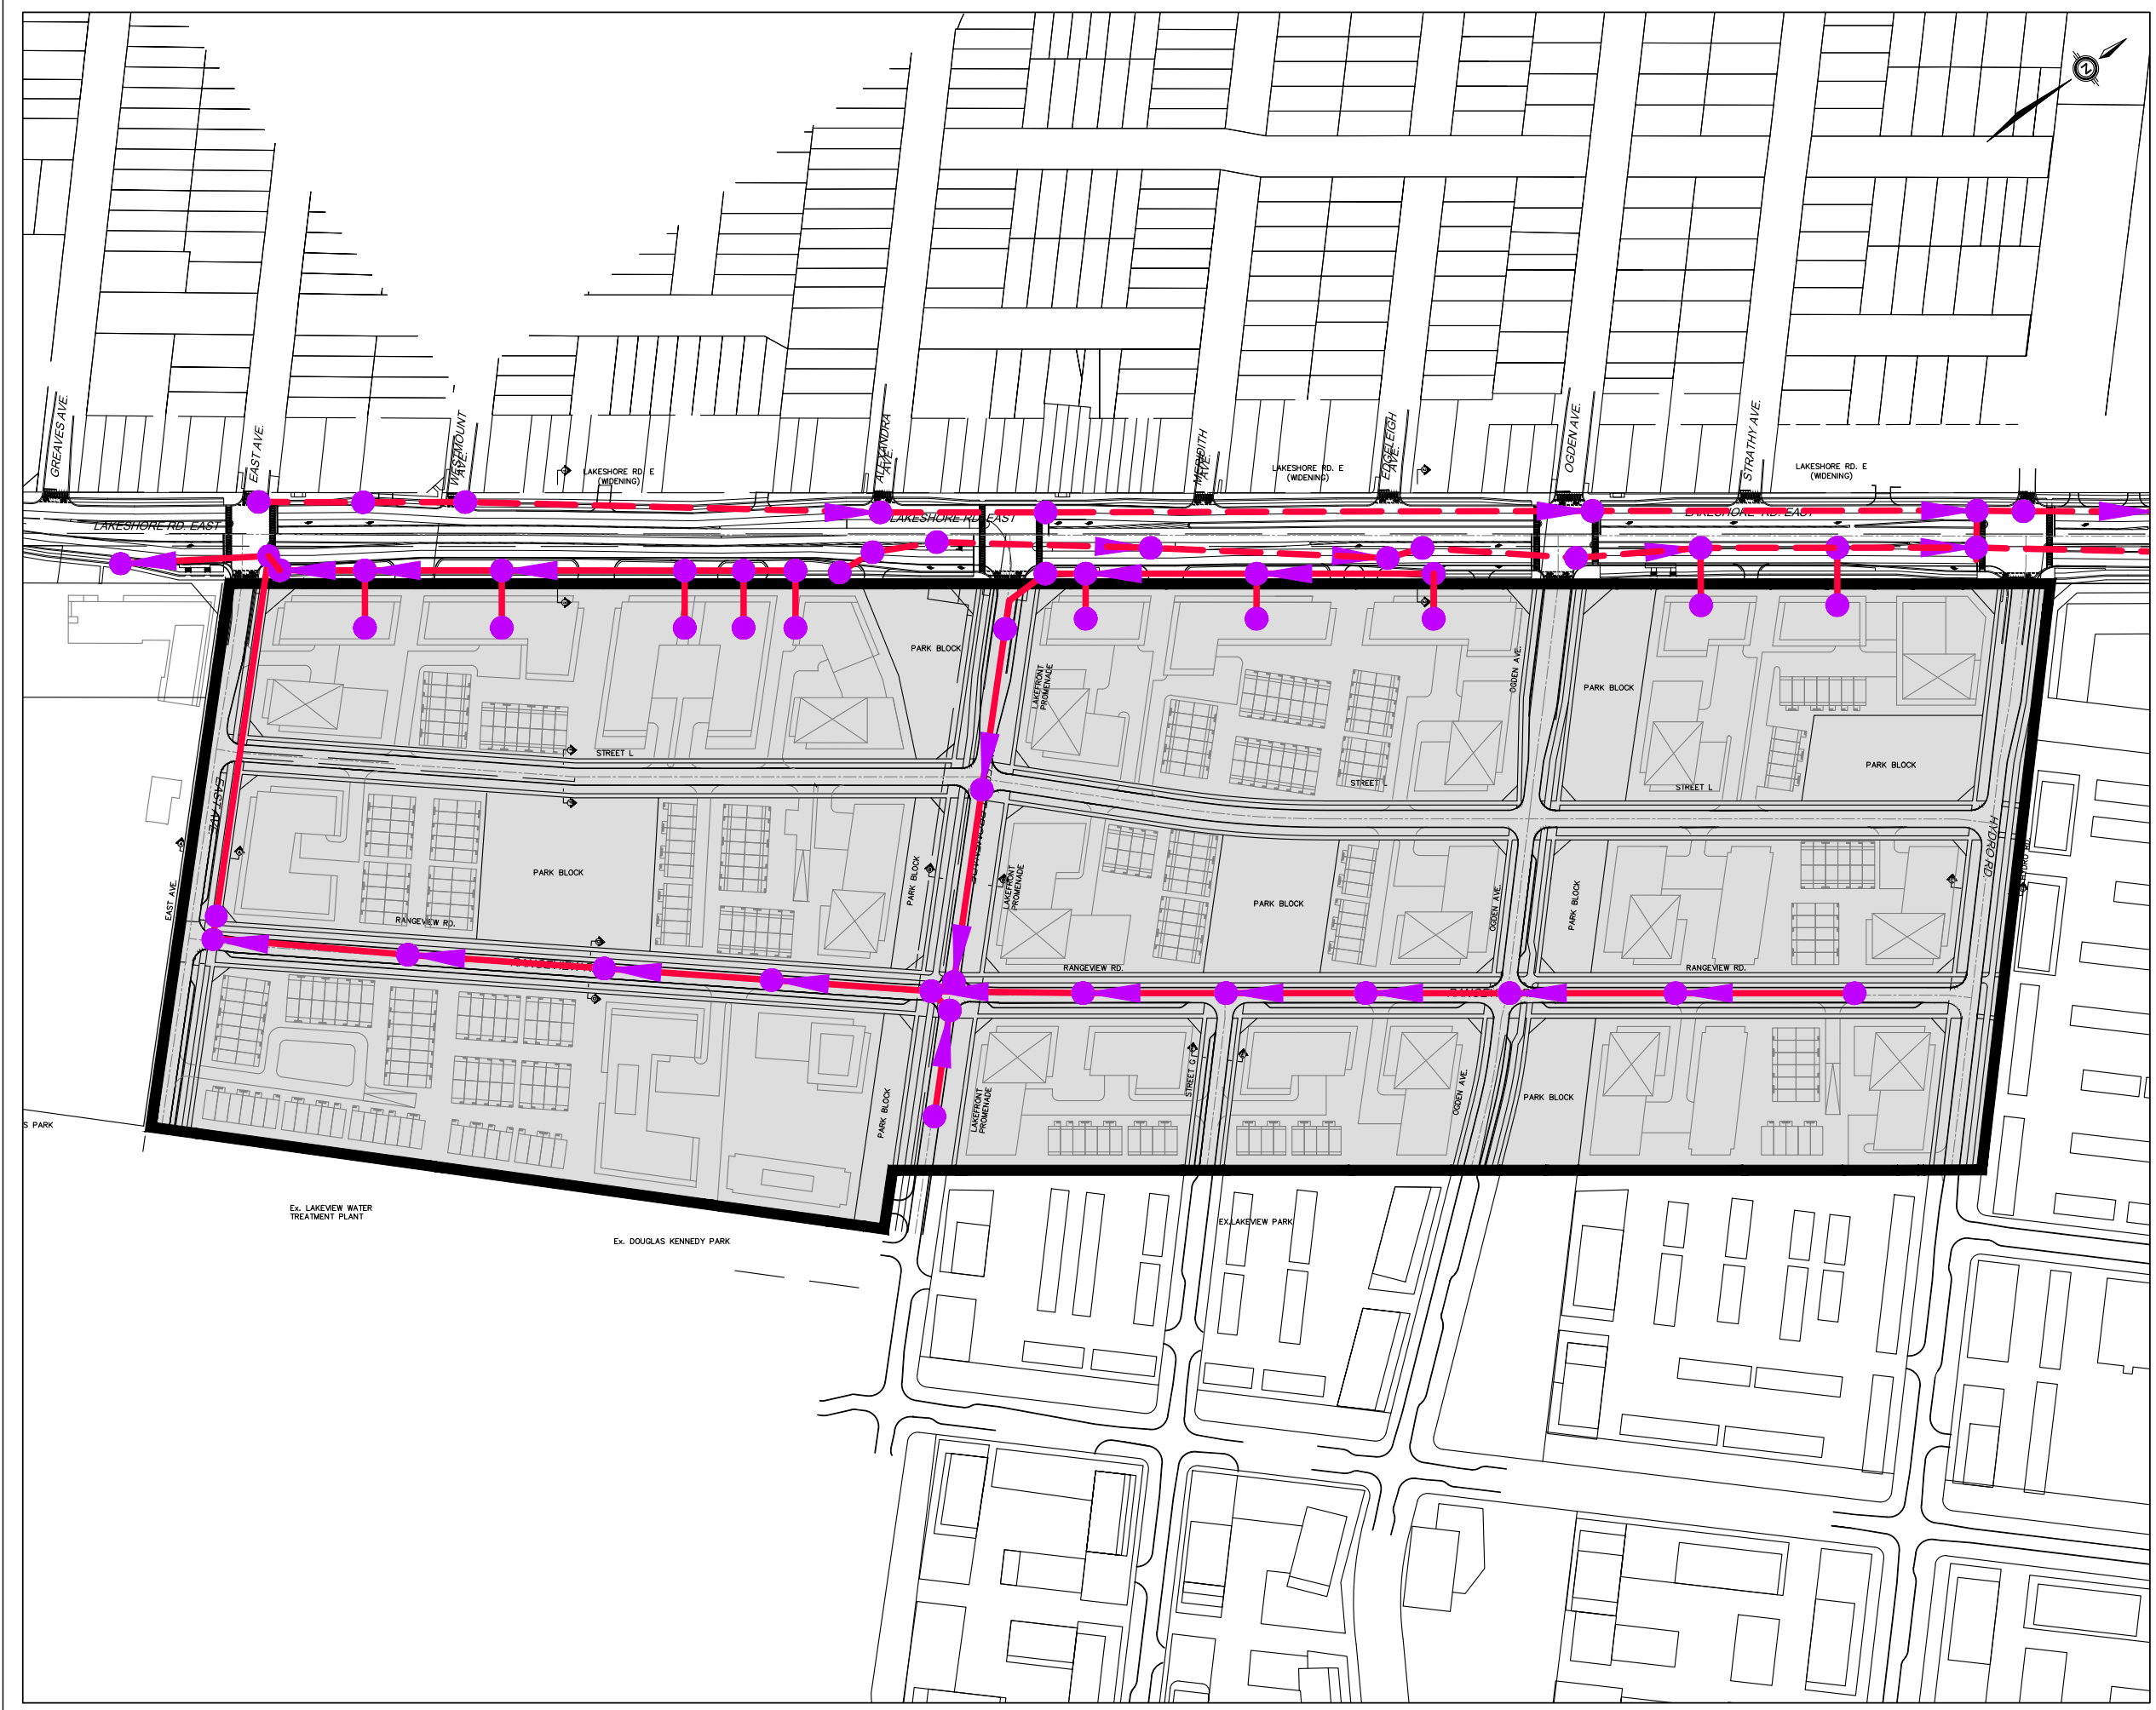FIGURE 3.2  
INTERIM  
SANITARY SERVICES



RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  PROPOSED SANITARY SEWER
-  EXISTING SANITARY SEWER

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION



**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 3.3  
ULTIMATE  
SANITARY SERVICES

## 4 STORMWATER MANAGEMENT


### 4.1 Existing Condition & Stormwater Infrastructure

The subject site is approximately 25.7 ha including municipal roadways, predominantly commercial and industrial area which is serviced by an existing major and minor system. Based on available topographic surveys and existing drainage, the current minor system consists of a storm sewer network, with primary servicing located within Lakeshore Rd. East, Lakefront Promenade, Rangeview Rd., and Hydro Road. Refer to **Figure 4.1** for the existing drainage and storm servicing. The existing municipal storm sewers around the site are as follows:

- 1) 300mmØ - 675mmØ and a 450mmØ-750 mmØ storm sewers in parallel at opposite ends of the road along Lakeshore Road East
- 2) 450mmØ-950mmØ along Hydro Road
- 3) 975mmØ-1200mmØ along Rangeview Road
- 4) 450mmØ-1800mmØ along Lakefront Promenade





Based on the topography and previous planning documents, it was determined that the majority of the subject site ultimately drains to Lake Ontario. Given the proposed developments' proximity to Lake Ontario, quantity control is not required as per City and CVC criteria. However, quantity control and the allowable release rates for the proposed site plans will be restricted based on the 10-year minor flows to storm sewers, as per the City of Mississauga Development Requirements Manual, dated 2020. As per background studies from the Lakeview Village development to the south, an external area of 10.67ha north of the subject site drains into the site area to Lakefront Promenade. The existing external drainage pattern is expected to be maintained in post-development conditions.

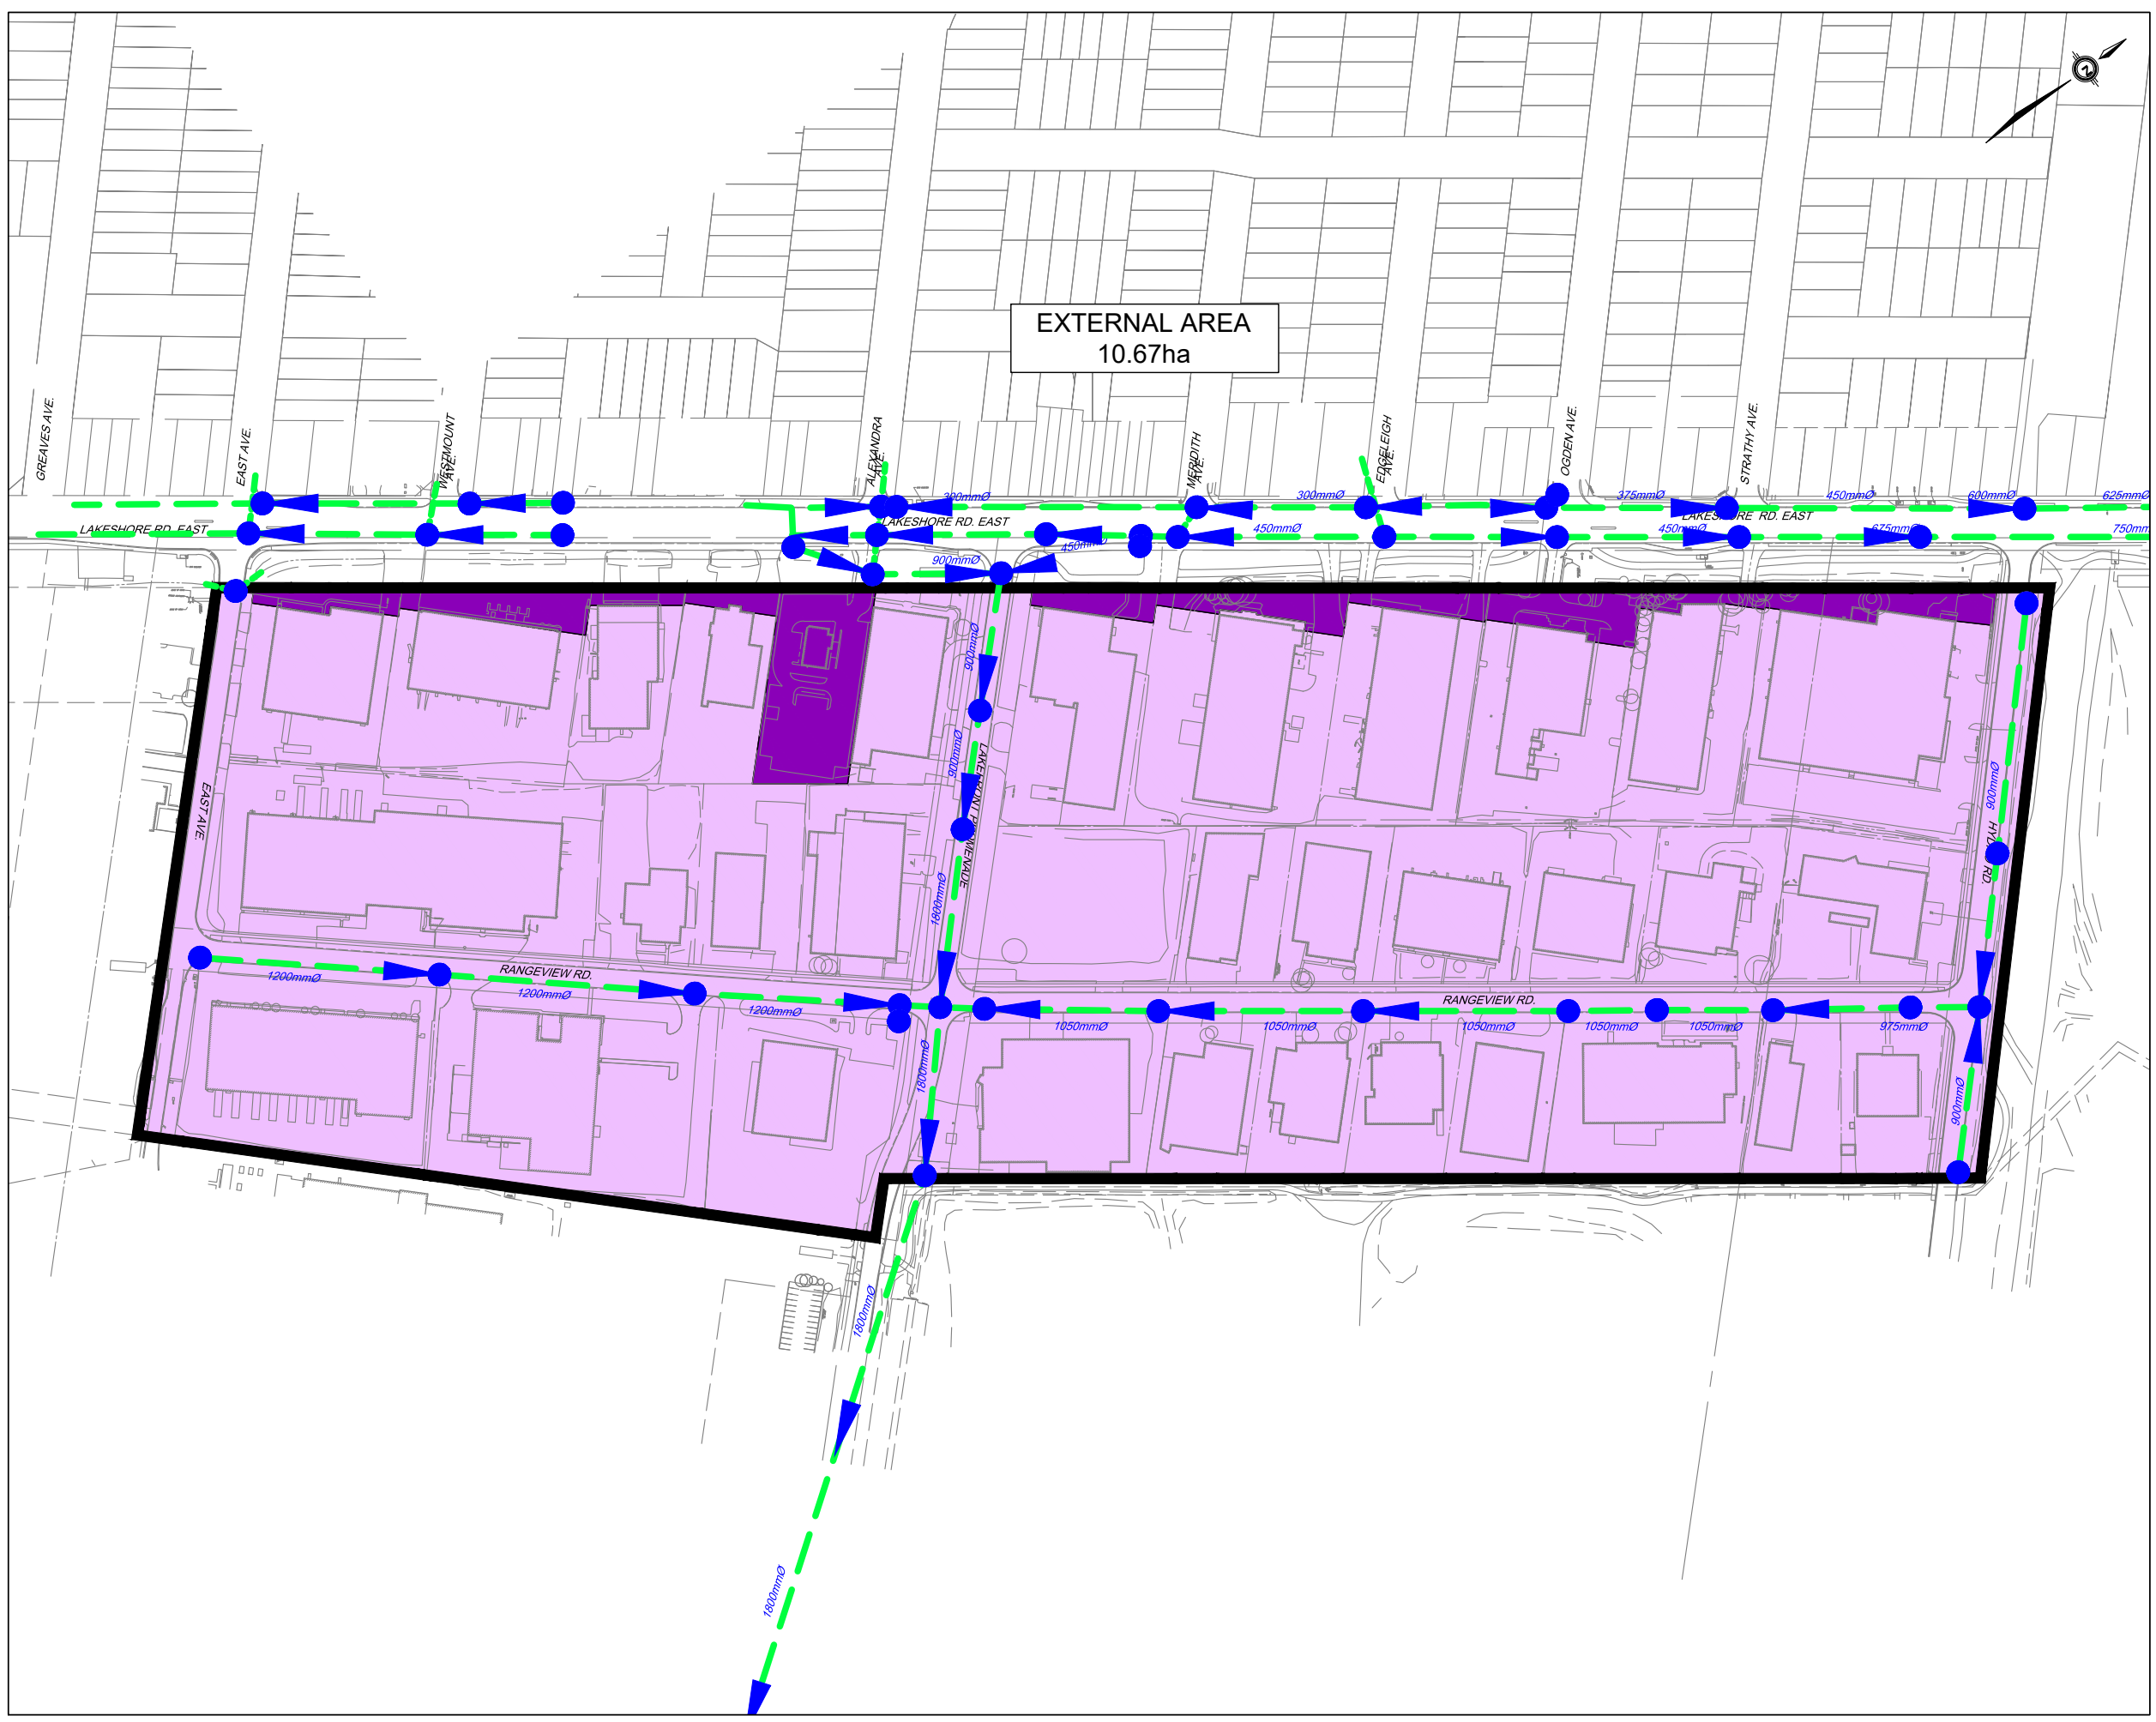It is to be noted a small portion of the development drains to ditches on Lakeshore Road East. These ditches span along the length of the proposed development on Lakeshore Road East.



RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  EXISTING STORM SEWER
-  EXISTING DRAINAGE AREA TO LAKE ONTARIO  
AREA = 24.4ha  
RUNOFF COEFFICIENT = 0.50
-  EXISTING DRAINAGE AREA TO LAKESHORE ROAD EAST  
AREA = 1.4ha  
RUNOFF COEFFICIENT = 0.50

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION



**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 4.1  
PRE-DEVELOPMENT DRAINAGE  
& EXISTING STORM SERVICING

## 4.2 Stormwater Management Criteria

Stormwater management criteria for the subject site are to be in accordance with the City of Mississauga, Peel Region, and the Credit Valley Conservation Authority (CVC) design criteria listed below.

### Based on the City of Mississauga design criteria:

- Storm sewers shall be designed to convey at least the 10-year return frequency storm without surcharging during any storm return frequency event;
- The minimum pipe diameter for storm sewers is 300mmØ;
- For estimating flows using the Rational Method from storms larger than the 10-year return, the runoff coefficients were increased to account for the increase in runoff due to saturation of the soil as per equations provided in the City of Mississauga design criteria.
- Storm sewers shall be designed using the Rational Method:  $Q = A \cdot I \cdot R / 360$ , where ‘Q’ is the flow rate in [m<sup>3</sup>/s], ‘R’ is the runoff coefficient (dimensionless), ‘A’ is the area in [ha], ‘I’ is rainfall intensity in mm/hr;

**Table 4-1 City of Mississauga IDF Curve**

Design Storm Event	A	B	C	I (mm/hr)
2-Year	610.0	4.6	0.78	59.9
5-Year	820.0	4.6	0.78	80.5
10-Year	1010.0	4.6	0.78	99.2
25-Year	1160.0	4.6	0.78	113.9
50-Year	1300.0	4.7	0.78	127.1
100-Year	1450.0	4.9	0.78	140.7

$I = A / (B + T_c)^C$ , where minimum time of concentration as per Mississauga Guidelines is  $T_c = 15$ mins

- **Water Quantity**–Site plans to be controlled to the post-development 10-year minor flows;
- **Water Quality**–Level 1 water quality (enhanced) protection (80% TSS removal) is required;
- **Water Balance**–The development is not located in the source protection plan's Q1, Q2 wellhead protection area. There is a lake within the vicinity of the proposed development.



Therefore, there is no requirement for a water balance analysis;

- **Volumetric Controls** – 5mm infiltration, filtration, or evapotranspiration is required.

The following sections describe how the subject site area will satisfy the above-mentioned stormwater management criteria.

### 4.3 Proposed Stormwater Management Plan

The following sections discuss in detail the proposed stormwater management solutions to be incorporated on-site to meet the applicable stormwater management criteria identified in **Section 4.2**.

The majority of the subject site is proposed to ultimately discharge in Lake Ontario as per existing conditions. The proposed SWM scheme considers the ultimate condition and complies with the Lakeview servicing proposed to the south of the subject site.

There was some concern from the municipality and Region on how the Master Plan would be developed due to the non-participating parcels, which disrupt the construction of Street 'L'. To address municipality concerns, the proposed storm servicing was revised such that the development spine remains within the existing right of way (ROW) and eliminates the need for blocks to be serviced from the new proposed municipal road (i.e.: Street 'L').

In order to provide flexibility for the proposed development, it is proposed to the blocks fronting Lakeshore Road East are proposed to be serviced via SWM infrastructure on Lakeshore Road East. Quantity control, quality control, and volumetric controls are proposed at the site plan level. As per the grading plans, a safe overland flow route is provided within the municipal roadways.

Quality control at the site plan level is proposed to be achieved via Jellyfish filters or equivalent measures. For the municipal right of way, quality control is proposed via a treatment train approach with tree pits in conjunction with OGS units to satisfy the required 80% TSS removal. Further details about quality control are presented in **Section 4.3.4**.

Considering the site's close proximity to the Lake, meeting the pre-development water balance is not a required criterion. However, 5mm retention via filtration or infiltration, or re-use is required for volumetric controls as per the City of Mississauga SWM criteria. Additional details about the 5mm retention on-site are presented in **Section 4.3.5**.

### 4.3.1 Allowable Release Rates

Allowable release rates were established based on the City of Mississauga's IDF parameters. The Rational method was used to calculate release rates as the total development discharges runoff to storm sewers. The allowable release rates for the blocks fronting Lakeshore Road East are to be based on the existing drainage to Lakeshore Road East. As shown in **Figure 4.1**, an area of 1.40ha currently drains to Lakeshore Road East from the existing lot frontage. It is anticipated the existing developments fronting Lakeshore Road East have roof connections draining into the roadway, however, this is unconfirmed due to the lack of available information. It is recommended to have further investigation to confirm the total existing drainage to Lakeshore Road East and as such, the release rates for blocks discharging to Lakeshore Road East (i.e.: post-development catchments 201-to-210, 300, and 301) will be refined at the detailed design stage. The release rates for the blocks fronting Lakeshore Road East were determined by prorating the existing drainage area of 1.40ha.

The allowable release rates for the site plan draining southerly to Lake Ontario were established based on the 10-year storm events using a pre-development runoff coefficient maximum of 0.50, summarized in **Table 4.2**. A minimum time of concentration of 15 minutes was considered as per the City of Mississauga guidelines.

As per background studies from the Lakeview Village development to the south, an external area of 10.67ha north of the subject site drains into the site to Lakefront Promenade. The existing external drainage pattern is expected to be maintained in post-development conditions.

Long-term foundation drainage can be discharged to the storm sewer system provided suitable pre-treatment is provided. The hydrogeological report estimated long-term dewatering rates based on the parcels, it was noted a block-wide detailed hydrogeological investigation is required to be completed to recommend the actual design dewatering requirements. The allowable release rates for the site plans were adjusted to consider an assumed groundwater pump rate of 2 L/s for each site plan (higher than the recommendation from the hydrogeological report). This groundwater pump rate is considered to be a conservative dewatering rate estimate, which can be revisited at the site plan approval stage throughout the SPA process. Therefore, the allowable discharge for

the site plans was calculated by reducing the 10-year minor flows by the assumed 2 L/s groundwater pumping rate. The release rate can be adjusted based on the final recommendations of the hydrogeological reports and mechanical engineer on an individual site plan basis throughout the SPA process.

**Table 4-2 Allowable Release Rate for Site Plans**

Catchment #*	Area (ha)	Pre-Development Runoff Coefficient	Post Development Runoff Coefficient	Allowable Discharge (10-year minor flows) (L/s)**	Groundwater Dewatering Rate (L/s)	Adjusted Allowable Release Rate (10-year flows – Groundwater pumping) (L/s)***
				A	B	C = A -B
201	0.52	0.25	0.90	7.24	2.00	5.24
202	0.76	0.25	0.90	10.59	2.00	8.59
203	0.39	0.25	0.90	5.43	2.00	3.43
204	0.39	0.25	0.90	5.43	2.00	3.43
205	0.48	0.25	0.90	6.69	2.00	4.69
206	0.54	0.25	0.90	7.52	2.00	5.52
207	0.93	0.25	0.90	11.96	2.00	9.96
208	0.92	0.25	0.90	11.82	2.00	9.82
209	0.58	0.25	0.90	8.08	2.00	6.08
210	0.84	0.25	0.90	11.70	2.00	9.70
211	0.86	0.50	0.90	118.45	2.00	116.45
212	0.20	0.50	0.90	27.55	2.00	25.55
213	0.40	0.50	0.90	55.09	2.00	53.09
214	0.34	0.50	0.90	46.83	2.00	44.83
215	0.82	0.50	0.90	112.94	2.00	110.94
216	0.19	0.50	0.90	26.17	2.00	24.17
217	0.36	0.50	0.90	49.58	2.00	47.58
218	0.58	0.50	0.90	79.88	2.00	77.88
219	0.57	0.50	0.90	78.51	2.00	76.51
220	1.00	0.50	0.90	137.73	2.00	135.73
221	1.30	0.50	0.90	179.05	2.00	177.05
222	0.74	0.50	0.90	101.92	2.00	99.92
223	0.82	0.50	0.90	112.94	2.00	110.94
224	0.46	0.50	0.90	63.36	2.00	61.36
225	0.38	0.50	0.90	52.34	2.00	50.34
226	0.61	0.50	0.90	84.02	2.00	82.02
227	0.32	0.50	0.90	44.07	2.00	42.07
228	0.35	0.50	0.90	48.21	2.00	46.21

\*Release rates for catchments 201-to 210, 300, and 301 to be refined at the detailed design stage

\*\*The allowable Discharge was calculated using a pre-development runoff coefficient of 0.50.

\*\*\*The adjusted allowable release rate = 10-year minor flows – Groundwater pumping rate

### 4.3.2 Quantity Control

In order to achieve the release rates, set up in **Section 4.3.1**, quantity control is proposed at the site plan level. Due to the close proximity of Lake Ontario, no quantity control is proposed for the park and municipal right of way. The established release rate for each site plan and the required storage are presented in **Table 4-3** below. The quantity control requirement on the site plan can be met via underground storage combined with an orifice control device.

As part of the City of Mississauga Road improvements, Lakeshore Road East is planned to be urbanized. In existing conditions, there is a ditch along Lakeshore Road East along the length of the proposed development. The ultimate cross-section drawings for Lakeshore Road East provided by the city, demonstrate the existing ditch is to be removed during ultimate conditions. It is anticipated the existing blocks frontages along Lakeshore Road East will be captured by catch basins and storm infrastructure, which are currently draining to the ditch. It is proposed for the lots fronting Lakeshore Road East to be serviced from the SWM infrastructure on Lakeshore Road as part of road improvements. If the site plans fronting Lakeshore Road East wish to proceed development before the City's Road improvement works, a local storm sewer can be proposed in coordination with the City and Region based on the ultimate Lakeshore Road East Road improvement plans.

The proposed SWM strategy comprises of a LID plan within the ROW and various servicing from different jurisdictions (ie: City and Region) along the ROW. Based on correspondence with the city, general servicing is required to be in typical ROW locations. Given the comprehensive servicing requirements and proposed ROW widening of Rangeview Road and East Avenue, many of the existing storm sewers require relocation or upsizing. Therefore, new storm sewers are proposed for East Avenue, Hydro Road, Lakefront Promenade and Rangeview Road to follow the City Criteria. The existing storm sewers along these ROWs are to be removed or relocated.

**Table 4-3 Storage Summary**

Catchment #*	Area (ha)	Post-Development Runoff Coefficient	Adjusted Allowable Discharge (L/s)	Required On-site storage (m <sup>3</sup> )
201	0.52	0.90	5.24	319.08
202	0.76	0.90	8.59	458.59
203	0.39	0.90	3.43	243.51
204	0.39	0.90	3.43	243.51
205	0.48	0.90	4.69	295.83
206	0.54	0.90	5.52	330.71
207	0.93	0.90	9.96	565.81
208	0.92	0.90	9.82	560.00
209	0.58	0.90	6.08	353.96
210	0.84	0.90	9.70	505.10
211	0.86	0.90	116.45	199.82
212	0.20	0.90	25.55	48.18
213	0.40	0.90	53.09	94.10
214	0.34	0.90	44.83	80.31
215	0.82	0.90	110.94	190.63
216	0.19	0.90	24.17	45.89
217	0.36	0.90	47.58	84.90
218	0.58	0.90	77.88	135.47
219	0.57	0.90	76.51	133.17
220	1.00	0.90	135.73	232.00
221	1.30	0.90	177.05	300.95
222	0.74	0.90	99.92	172.24
223	0.82	0.90	110.94	190.63
224	0.46	0.90	61.36	107.89
225	0.38	0.90	50.34	89.50
226	0.61	0.90	82.02	142.36
227	0.32	0.90	42.07	75.72
228	0.35	0.90	46.21	82.61

\*Release rates and storage for catchments 201-to 210, 300, and 301 to be refined at the detailed design stage

### 4.3.3 Quality Control

As per the quality control requirements of the City of Mississauga and CVC, the proposed developments require the provision of an enhanced level of quality treatment (i.e., 80% TSS removal) on-site.

In order to achieve an enhanced level of treatment for the site, different strategies have been

proposed based on each block's land use. The strategies for each land-use type are described in the following sections below.

#### **4.3.3.1 Private Site Plan Block Treatment**

Within the private site plan blocks, treatment can be provided through various options based on the proposed land use. Given the variety of options for treatment within private developments, it is proposed that all site plan blocks provide 80% TSS removal (enhanced level) at the site level.

1. Treatment Train Approach (i.e. Bioswale/Retention/Infiltration Unit + OGS Unit)
2. Centralized Filtration Units (ie: jellyfish or equivalent)

Note that the use of the above-mentioned options should be considered on a per-site plan basis and should be further explored during each block's specific design. Considerations for each site plan block option are further discussed in this section.

##### Option 1. Bioswale/Retention/Infiltration Unit + OGS Unit

In option 1, site plans where spatial factors are favourable, flows can be directed to surface-level bioretention facilities (such as bioswales or rain gardens) where an initial treatment layer can be provided. These facilities can be sized to provide a minimum of 60% TSS removal. Flows that have been treated by these facilities can then be directed to an on-site OGS for an additional layer of treatment (50% TSS removal). This approach would provide a treatment train to provide a minimum of 80% TSS prior to flows leaving the site.

##### Option 2. Centralized Filtration Units

In cases where infiltration-based treatment is not feasible, a centralized proprietary treatment unit can be provided within the private site and sized to provide an enhanced level of treatment (80% TSS removal) to site flows before discharging to the municipal sewers. Any proposed treatment units should be sized as per each block's specific site plan design.

##### Groundwater Treatment

It was determined from the hydrogeological report groundwater discharge to the storm sewers

requires treatment. Treatment options for groundwater discharge include but are not limited to the settlement of suspended solids and specialized filtration. Groundwater treatment for each site plan block can be finalized throughout the SPA process when detailed information from a mechanical engineer and treatment specialists becomes available.

#### **4.3.3.2 Public Park Block Treatment**

In general, public park blocks are considered to be made up of predominantly clean vegetated pervious areas. The proposed parks will enhance the area as it is increasing the green space from existing conditions. As a result, it is expected that limited to no treatment will be required to achieve 80% TSS removal. Should some level of treatment be required, LID measures such as vegetated filter strips or swales can be incorporated into the park's design in order to ensure an enhanced level of quality treatment is obtained.

#### **4.3.3.3 Public Right-of-Way Treatment**

Within the public right-of-way areas, quality treatment is generally more constrained as a result of paved roadway areas which occupy the majority of the ROW.

Since an enhanced level of quality treatment is required, various options were developed based on the detailed review of the feasible LID measures and groundwater levels on site. These options include:

1. Centralized OGS units and tree pits/tree trenches;
2. Perforated catchbasin lead and OGS;

The final selection of these options will be made based on discussions with the City. These options are discussed in further detail in the following sections.

#### Option 1 – Tree Pits/Tree Trenches within Boulevards + OGS

The inclusion of infiltration within the City's public right of way allows for both quality treatment and stormwater retention, which assists in reducing the erosion potential and impact on water balance as a result of development.

Based on the review of the preliminary hydrogeological report by DS Consultants Ltd on September 22, 2023, the groundwater levels varied between 1.57 m to 1.64 m under the existing



ground elevation and some dry readings; thus, it is anticipated an infiltration-based tree pit wouldn't be feasible; therefore, a filter-based tree pit is proposed.

A typical tree pit filter design will be incorporated within areas with ample boulevard room for planting space and placed along the roadway, upstream of proposed catch basins. In this scheme, flows will first be directed to a tree pit via a curb cut along the road. Once the flows are diverted to the tree pits, they can filter through the proposed engineered soil media (sized to provide a minimum 60% TSS removal based on volumes prescribed by MOE Table 3-2), from where the flows can be collected and diverted to the storm sewer system or be infiltrated.

Based on the MOE Table 3.2, the filter beds need to be sized for  $20\text{m}^3/\text{ha}$  to achieve 60% TSS removal. A downstream OGS unit will be provided to ensure that a minimum of 50% TSS removal is achieved, providing a total of 80% TSS removal when used in conjunction with tree pits ( $50\% + (1.0 - 0.5) \times 60\% = 80\%$ ). The sizing of the OGS units will be completed in the detailed design stage.

For ROW areas that are not treated by the OGS, the tree pits are to be sized to provide the entire 80% TSS removal as per MOE Table 3.2.

LIDs along Lakefront Promenade are proposed to satisfy the higher of the 5mm retention for volumetric controls or required TSS removal for quality. See **Appendix D** for details. Refer to the table below Summary of Retention Targets for the Municipal ROW.

#### Option 2 – Perforated CB lead + OGS

Flows captured by a typical roadside catch basin can be infiltrated via a perforated pipe system. to provide 60% TSS removal. The catch basin lead can be perforated and appropriately sized to enable infiltration with the excess draining directly to the sewer system. Alternatively, an exfiltration pipe can be proposed at the catch basin with excess flow overflowing to the storm sewer system via a CB lead placed strategically at a higher location.

Paired with the perforated CB lead and an OGS sized for 50% TSS removal to complete the

treatment train in achieving 80% TSS removal ( $50\% + (1.0 - 0.5) \times 60\% = 80\%$ ).

#### 4.3.4 Water Balance and Volumetric Controls

The Rangeview Development area was checked as per the Ontario Source Water Protection areas; the site was found to be outside of any source water well-head protection areas. Given the proximity of the site to Lake Ontario, there is no requirement for a water balance analysis. Furthermore, most of the subject site is developed under existing conditions and mainly consists of impervious commercial and industrial areas. Since it is proposed to provide nine park blocks and various landscaped areas within the subject site, it is expected that the development will provide a net reduction in impervious areas and an overall benefit to the water balance.

However, as stipulated in the City of Mississauga, on-site retention via infiltration, filtration, or water re-use of the first 5mm of rainfall should be retained on-site to mitigate water balance and volumetric impacts of development. The sections below discuss strategies to satisfy the volumetric requirements. The table below summarizes the required retention volumes for each portion of the proposed development.

**Table 4-4 Summary of Retention Targets**

Description	Catchment #	Area (ha)	Runoff Coefficient	Volumetric Requirement (m <sup>3</sup> )*
Site Plan	201	0.52	0.90	26.00
Site Plan	202	0.76	0.90	38.00
Site Plan	203	0.39	0.90	19.50
Site Plan	204	0.39	0.90	19.50
Site Plan	205	0.48	0.90	24.00
Site Plan	206	0.54	0.90	27.00
Site Plan	207	0.93	0.90	46.50
Site Plan	208	0.92	0.90	46.00
Site Plan	209	0.58	0.90	29.00
Site Plan	210	0.84	0.90	42.00
Site Plan	211	0.86	0.90	43.00
Site Plan	212	0.20	0.90	10.00
Site Plan	213	0.40	0.90	20.00

Description	Catchment #	Area (ha)	Runoff Coefficient	Volumetric Requirement (m <sup>3</sup> )*
Site Plan	214	0.34	0.90	17.00
Site Plan	215	0.82	0.90	41.00
Site Plan	216	0.19	0.90	9.50
Site Plan	217	0.36	0.90	18.00
Site Plan	218	0.58	0.90	29.00
Site Plan	219	0.57	0.90	28.50
Site Plan	220	1.00	0.90	50.00
Site Plan	221	1.30	0.90	65.00
Site Plan	222	0.74	0.90	37.00
Site Plan	223	0.82	0.90	41.00
Site Plan	224	0.46	0.90	23.00
Site Plan	225	0.38	0.90	19.00
Site Plan	226	0.61	0.90	30.50
Site Plan	227	0.32	0.90	16.00
Site Plan	228	0.35	0.90	17.50
Municipal ROW	401	0.20	0.90	10.00
Municipal ROW	402	0.19	0.90	9.50
Municipal ROW	403	0.18	0.90	9.00
Municipal ROW	404	0.71	0.90	35.50
Municipal ROW	405	0.82	0.90	41.00
Municipal ROW	406	0.23	0.90	11.50
Municipal ROW	407	0.27	0.90	13.50
Municipal ROW	408	0.29	0.90	14.50
Municipal ROW	409	0.52	0.90	26.00
Municipal ROW	410	0.61	0.90	30.50
Municipal ROW	411	0.18	0.90	9.00
Municipal ROW	412	0.16	0.90	8.00
Municipal ROW	413	0.32	0.90	16.00
Municipal ROW	414	0.44	0.90	22.00
Municipal ROW	415	0.50	0.90	25.00
Municipal ROW	416	0.21	0.90	10.50
Municipal ROW	417	0.21	0.90	10.50
Municipal ROW	418	0.34	0.90	17.00
Municipal ROW	419	0.15	0.90	7.50

\*Volumetric Requirement= TIMP x 5mm x Area x 10

#### 4.3.4.1 Private Site Plan Block Retention

Runoff can be infiltrated via infiltration-based LIDs or reused within private site plans via

rainwater harvesting tanks. Site reuse can include a combination of irrigation, greywater, mechanical cooling, or infiltration where possible. The specific site uses and retention designs should be confirmed per each private site plan block's specific servicing design. Infiltration-based LIDs should be supported by site-specific groundwater conditions.

#### **4.3.4.2 Public Park Block Retention**

Due to the nature of the park design, with the increased landscape and reduced level of imperviousness from existing conditions, it is not proposed to provide any retention on the park blocks.

#### **4.3.4.3 Public Right of Way Retention**




In order to achieve the required retention volume presented in **Table 4.4** the use of infiltration or filtration-based techniques within the public boulevard is required.

LIDs to be used along the public right of way can include tree pits (as described in Section 5.3.2) which can be sized to retain the greater of 5mm retention volumes or quality control. However, considering the site consists of high groundwater levels, the use of infiltration LIDs may be challenging. In scenarios where groundwater constraints present infiltration concerns, the tree pits can be designed for filtration.

#### **4.3.5 Interim Conditions**

Under the interim scenario, infrastructure cannot be built along the entirety of Street 'L' due to the presence of non-participating landowners. Thus, as shown in **Figure 4.3**, there are three (3) proposed cul-du sacs on Street L based on the current participating lands. The configuration of storm servicing for the ultimate (full buildout) scenario is designed such that servicing from Street 'L' is not necessitated. The proposed SWM scheme considers the interim phase and ensures no impediment to the drainage flow from the existing developments. The interim condition is subject to meeting the applicable stormwater management criteria identified in **Section 4.2**.


LEGEND

-  SUBJECT AREA
-  PROPOSED DRAINAGE BOUNDARY
-  201  
0.54ha  
C=0.90 CATCHMENT ID  
AREA IN HECTARES  
RUNOFF COEFFICIENT




**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 4.2  
PROPOSED STORM DRAINAGE PLAN

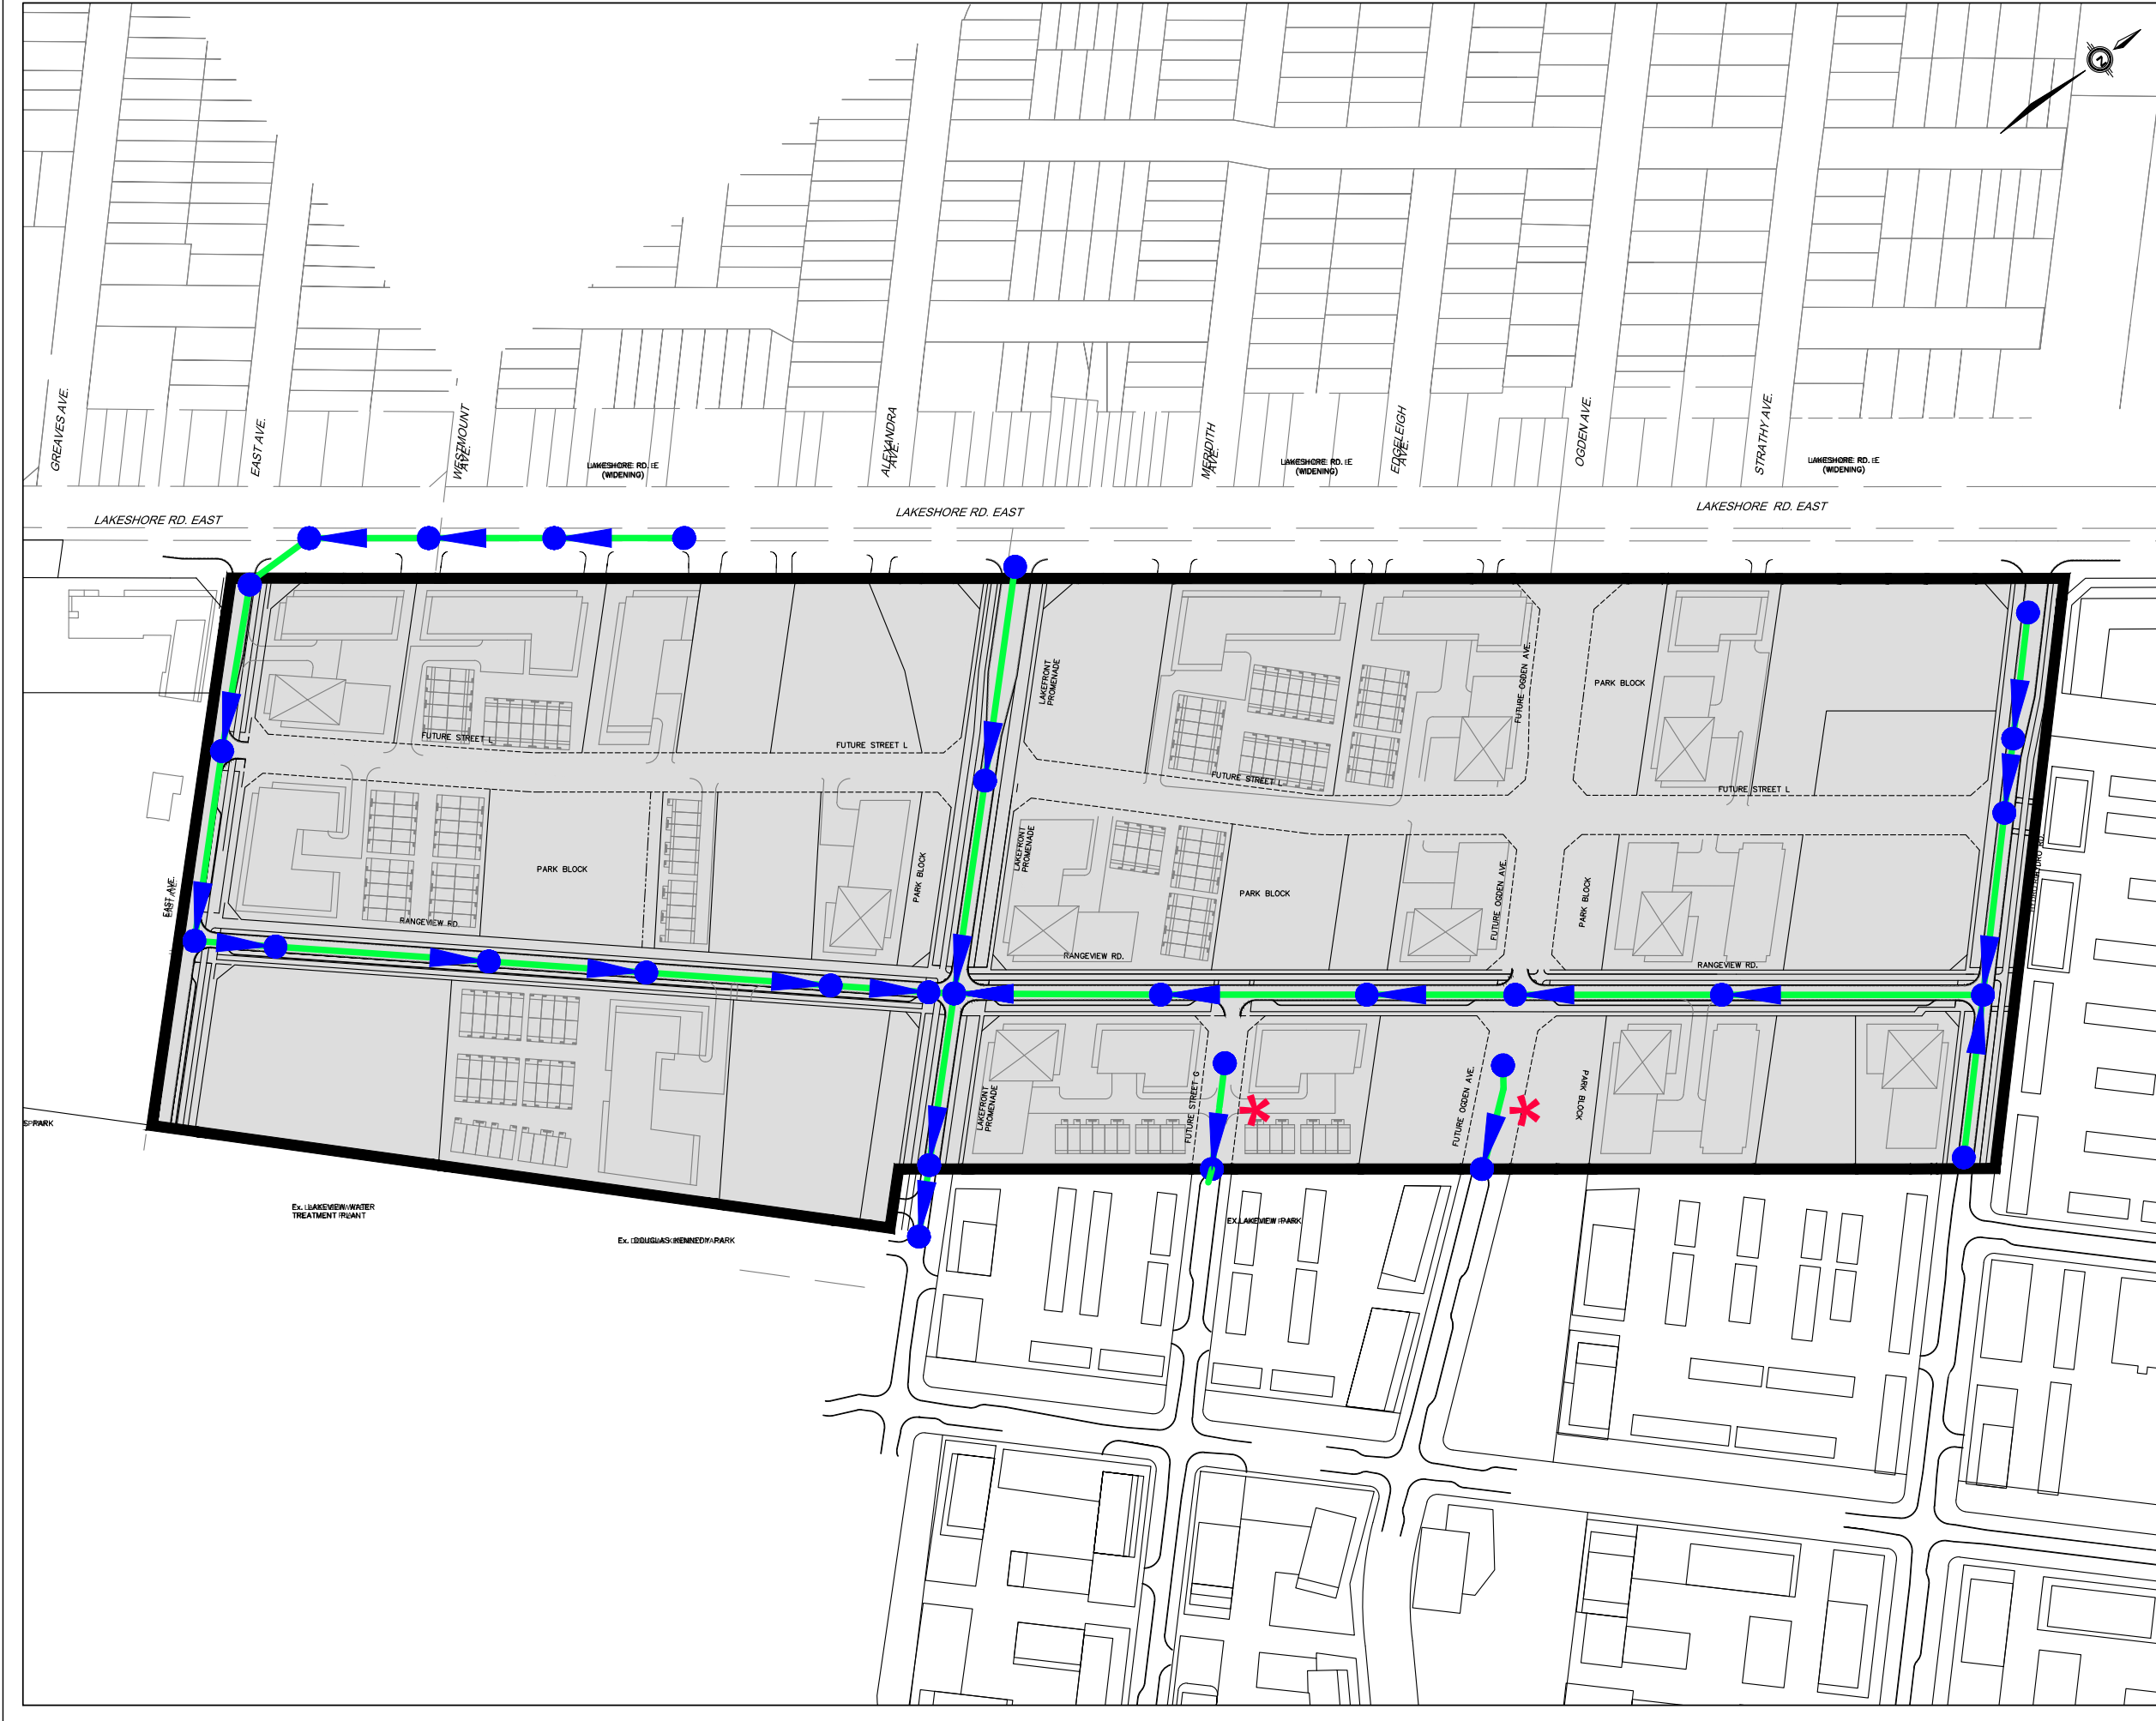

RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

SUBJECT AREA

PROPOSED STORM SEWER

PROPOSED OGS

STORM SEWER SHOWN ON  
OGDEN RD. AND STREET 'G',  
SOUTH OF RANGEVIEW ROAD,  
ARE ONLY REQUIRED TO  
SUPPORT POTENTIAL  
ROAD CONSTRUCTION.

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION





**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 4.3  
INTERIM  
STORM SERVICES



RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

-  SUBJECT AREA
-  PROPOSED STORM SEWER
-  PROPOSED OGS
-  STORM SEWER SHOWN ON OGDEN RD. AND STREET 'G', SOUTH OF RANGEVIEW ROAD, ARE ONLY REQUIRED TO SUPPORT POTENTIAL ROAD CONSTRUCTION.

NOTE:  
REFER TO ENGINEERING DRAWINGS  
FOR DETAILED INFORMATION



**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 4.4  
ULTIMATE  
STORM SERVICES

## 5 CLOSING REMARKS

This report illustrates the comprehensive servicing strategy for the Rangeview study area. The proposed municipal servicing strategy has been proposed to satisfy the City of Mississauga and CVC guidelines, and this strategy will be used by future developments for their respective detailed servicing designs. The proposed servicing strategy updated such that the development spine remains within the existing right of way (ROW) and eliminates the need for blocks to be serviced from the new proposed municipal road Street 'L' and Ogden Avenue.

The key servicing components are summarized below.

### Water Supply Servicing

- The developments within subject site are proposed to be serviced by connecting to the existing watermains along Lakeshore Road East, and to the proposed watermains along Rangeview Road.
- 600 mm diameter watermains along Lakefront Promenade and 400mm watermains along Hydro Road are expected as part of the Lakefront Community development;
- A watermain is proposed along Street 'L' to provide hydrant coverages;
- New watermains along Ogden Ave. and Street G are proposed to establish a looped system that integrates with the Lakeview Community development;
- The interim condition have been proposed depending on the agreements with the nonparticipating landowners.

### Sanitary Servicing

- The subject site will be serviced as per the details outlined in the Interim and Ultimate Servicing Plan.
- A downstream sanitary capacity analysis has been completed to analyze the sewers during the Ultimate Servicing Plan. As discussed in **Section 3.5**, upgrades will be required for the existing sewers along Rangeview Road and a pipe size has been provided for the new sub trunk sewer along East Avenue.



Storm Servicing

- Quantity control is proposed at a site plan level. Quantity controls for proposed site plan developments will include the capture and control of peak flows from storm events up to and including the 100-year storm to the 10-year sewer capacity.
- Quality controls will be provided within each site plan block to meet the enhanced level of treatment. For the public right of way, various options were reviewed to provide an enhanced level of treatment. Currently, it is proposed to implement a tree pit filtration/infiltration strategy with an end-of-pipe OGS to achieve an enhanced level of treatment.
- The retention of 5mm on-site can be achieved in each block through the use of infiltration or re-use systems within site plans, while the ROW can make use of infiltration/filtration via roadside tree pits.

We trust that you will find this material satisfactory, and we are looking forward to receiving your comments soon. Should you have any questions or comments, please do not hesitate to contact us.

Respectfully Submitted,

**SCHAEFFER & ASSOCIATES LTD.**



**Ishraque Chandan, EIT.**  
Water Resource Analyst



**Ming Gao, P.Eng.**  
Water Resource Engineer

---

---

Appendix A  
Background Information

---

---



# Rangerview Development Master Plan

**Concept Plan V7**

LOG Approved

**Rangerview Estates Precinct Area**

Mississauga ON

April 2024

# RANGEVIEW ESTATES PRECINCT

## Rangeview Development Master Plan

### Ownership Map



**Legend**  Rangeview Estates Precinct Area (Gross Area = ~25.67 ha) X Non-Participating Landowners  Existing Parcel Lines

# MASTER PLAN V7

## Rangeview Development Master Plan

### Concept Plan




**Legend**  Rangeview Estates Precinct Area  Existing Parcel Lines

# MASTER PLAN V7

## Rangeview Development Master Plan

### Built Form Typology

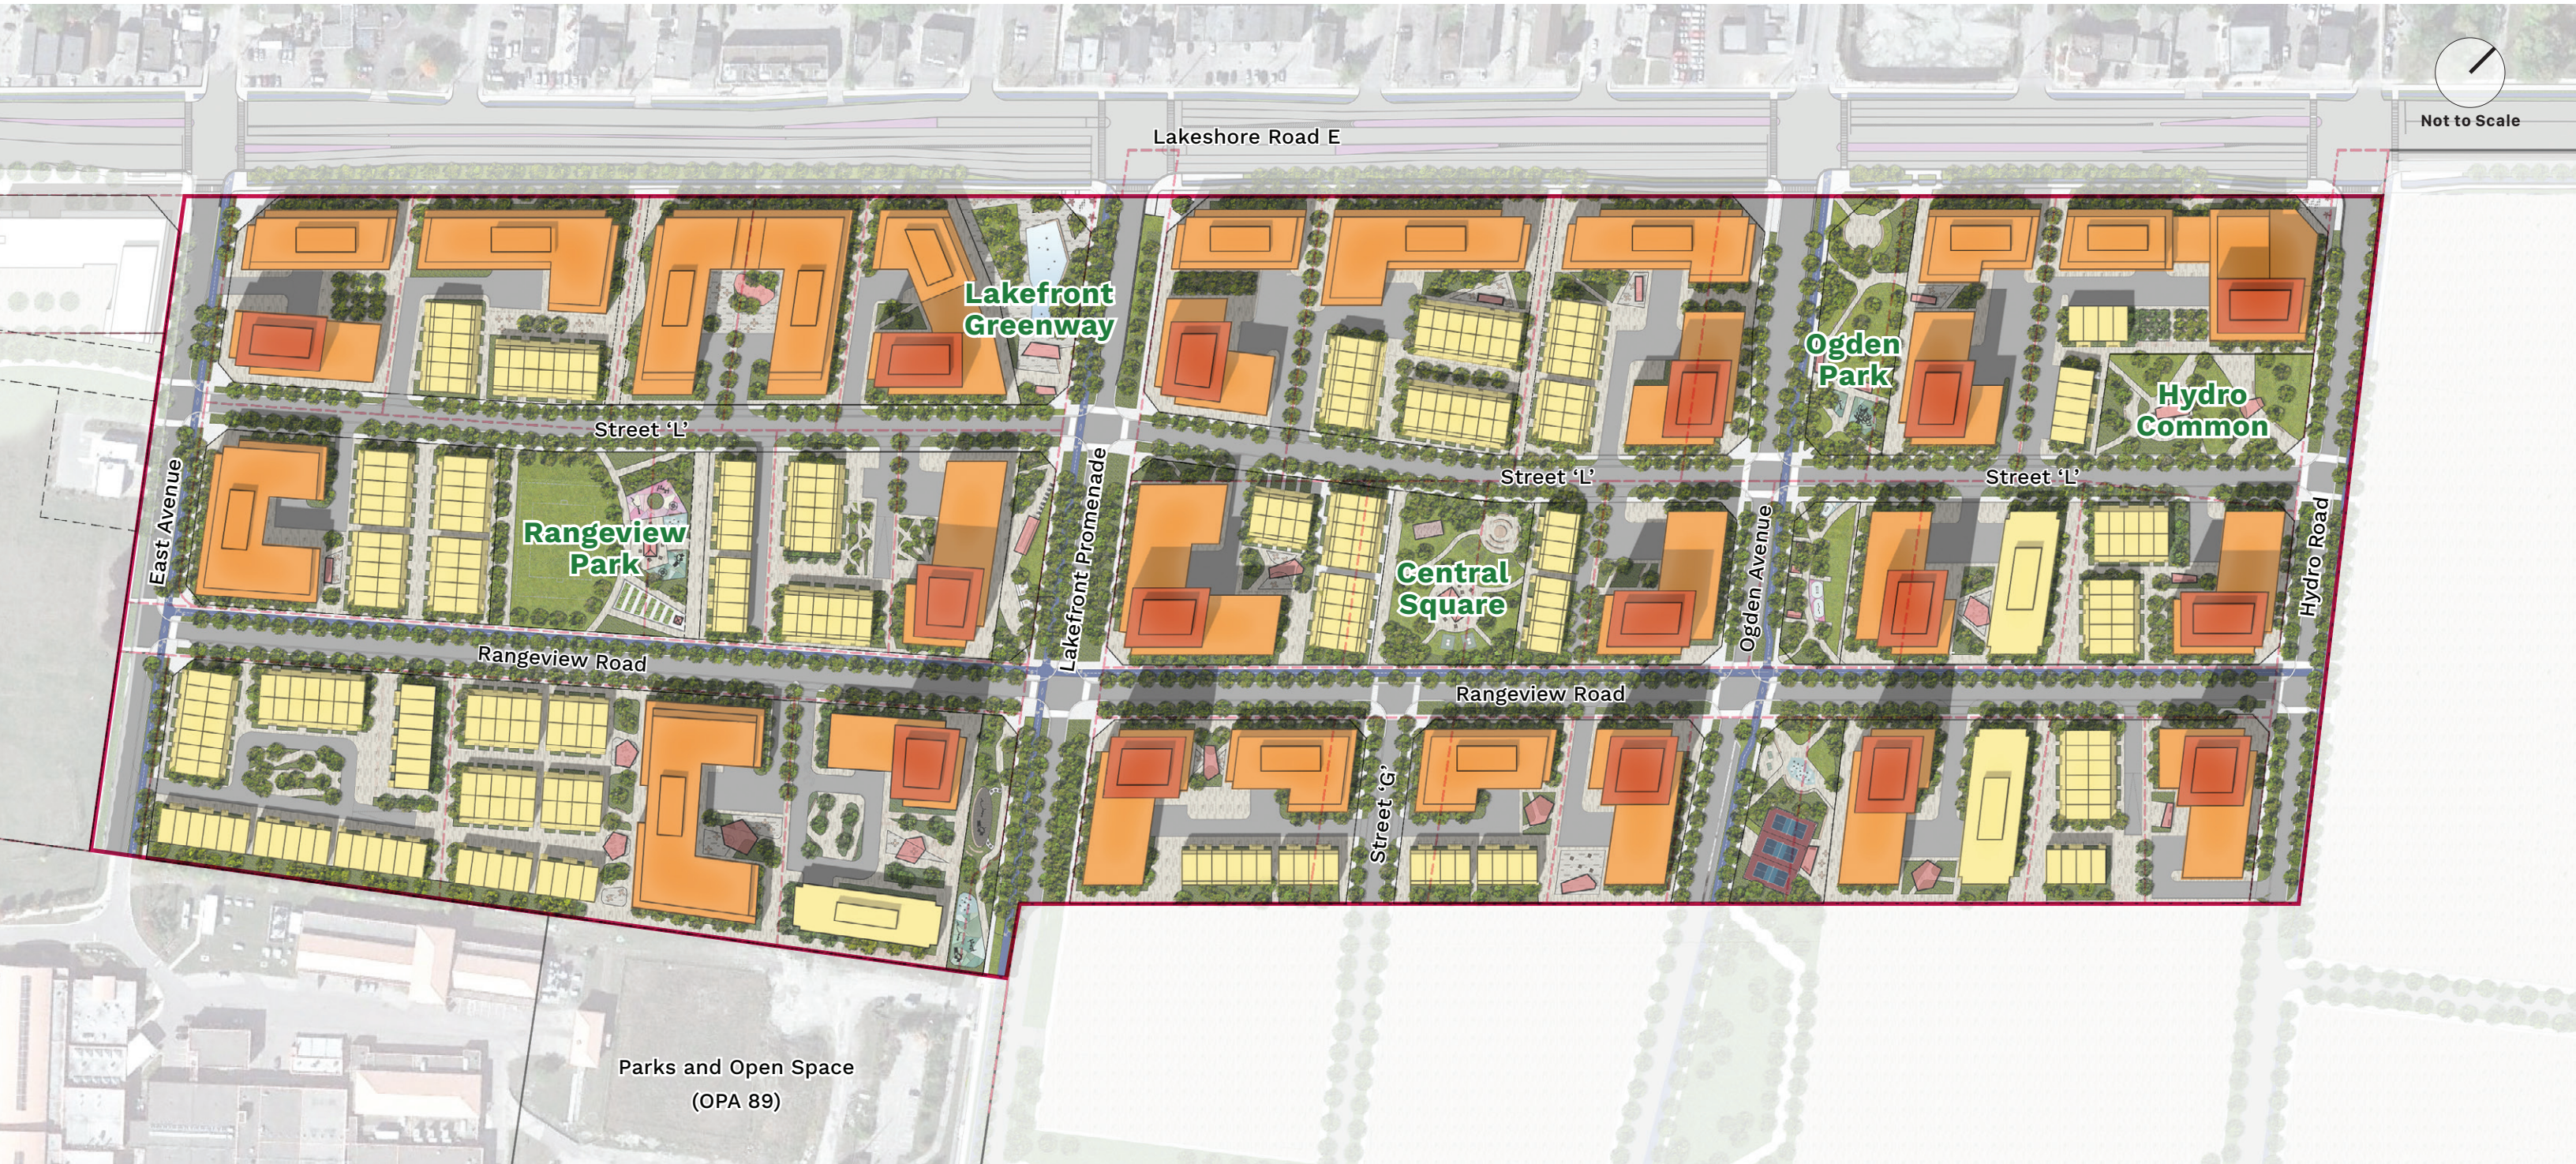


- Legend**
- Rangeview Estates Precinct Area
  - Existing Parcel Lines
  - Low-rise (Up to 4-Storeys)
  - Mid-rise / Podium (Tall Building) (5- to 8-Storeys)
  - Tower Element (Tall Building) (Up to 15-Storeys)

# MASTER PLAN V7

## Rangeview Development Master Plan

### Building Heights (Storeys) + Statistics

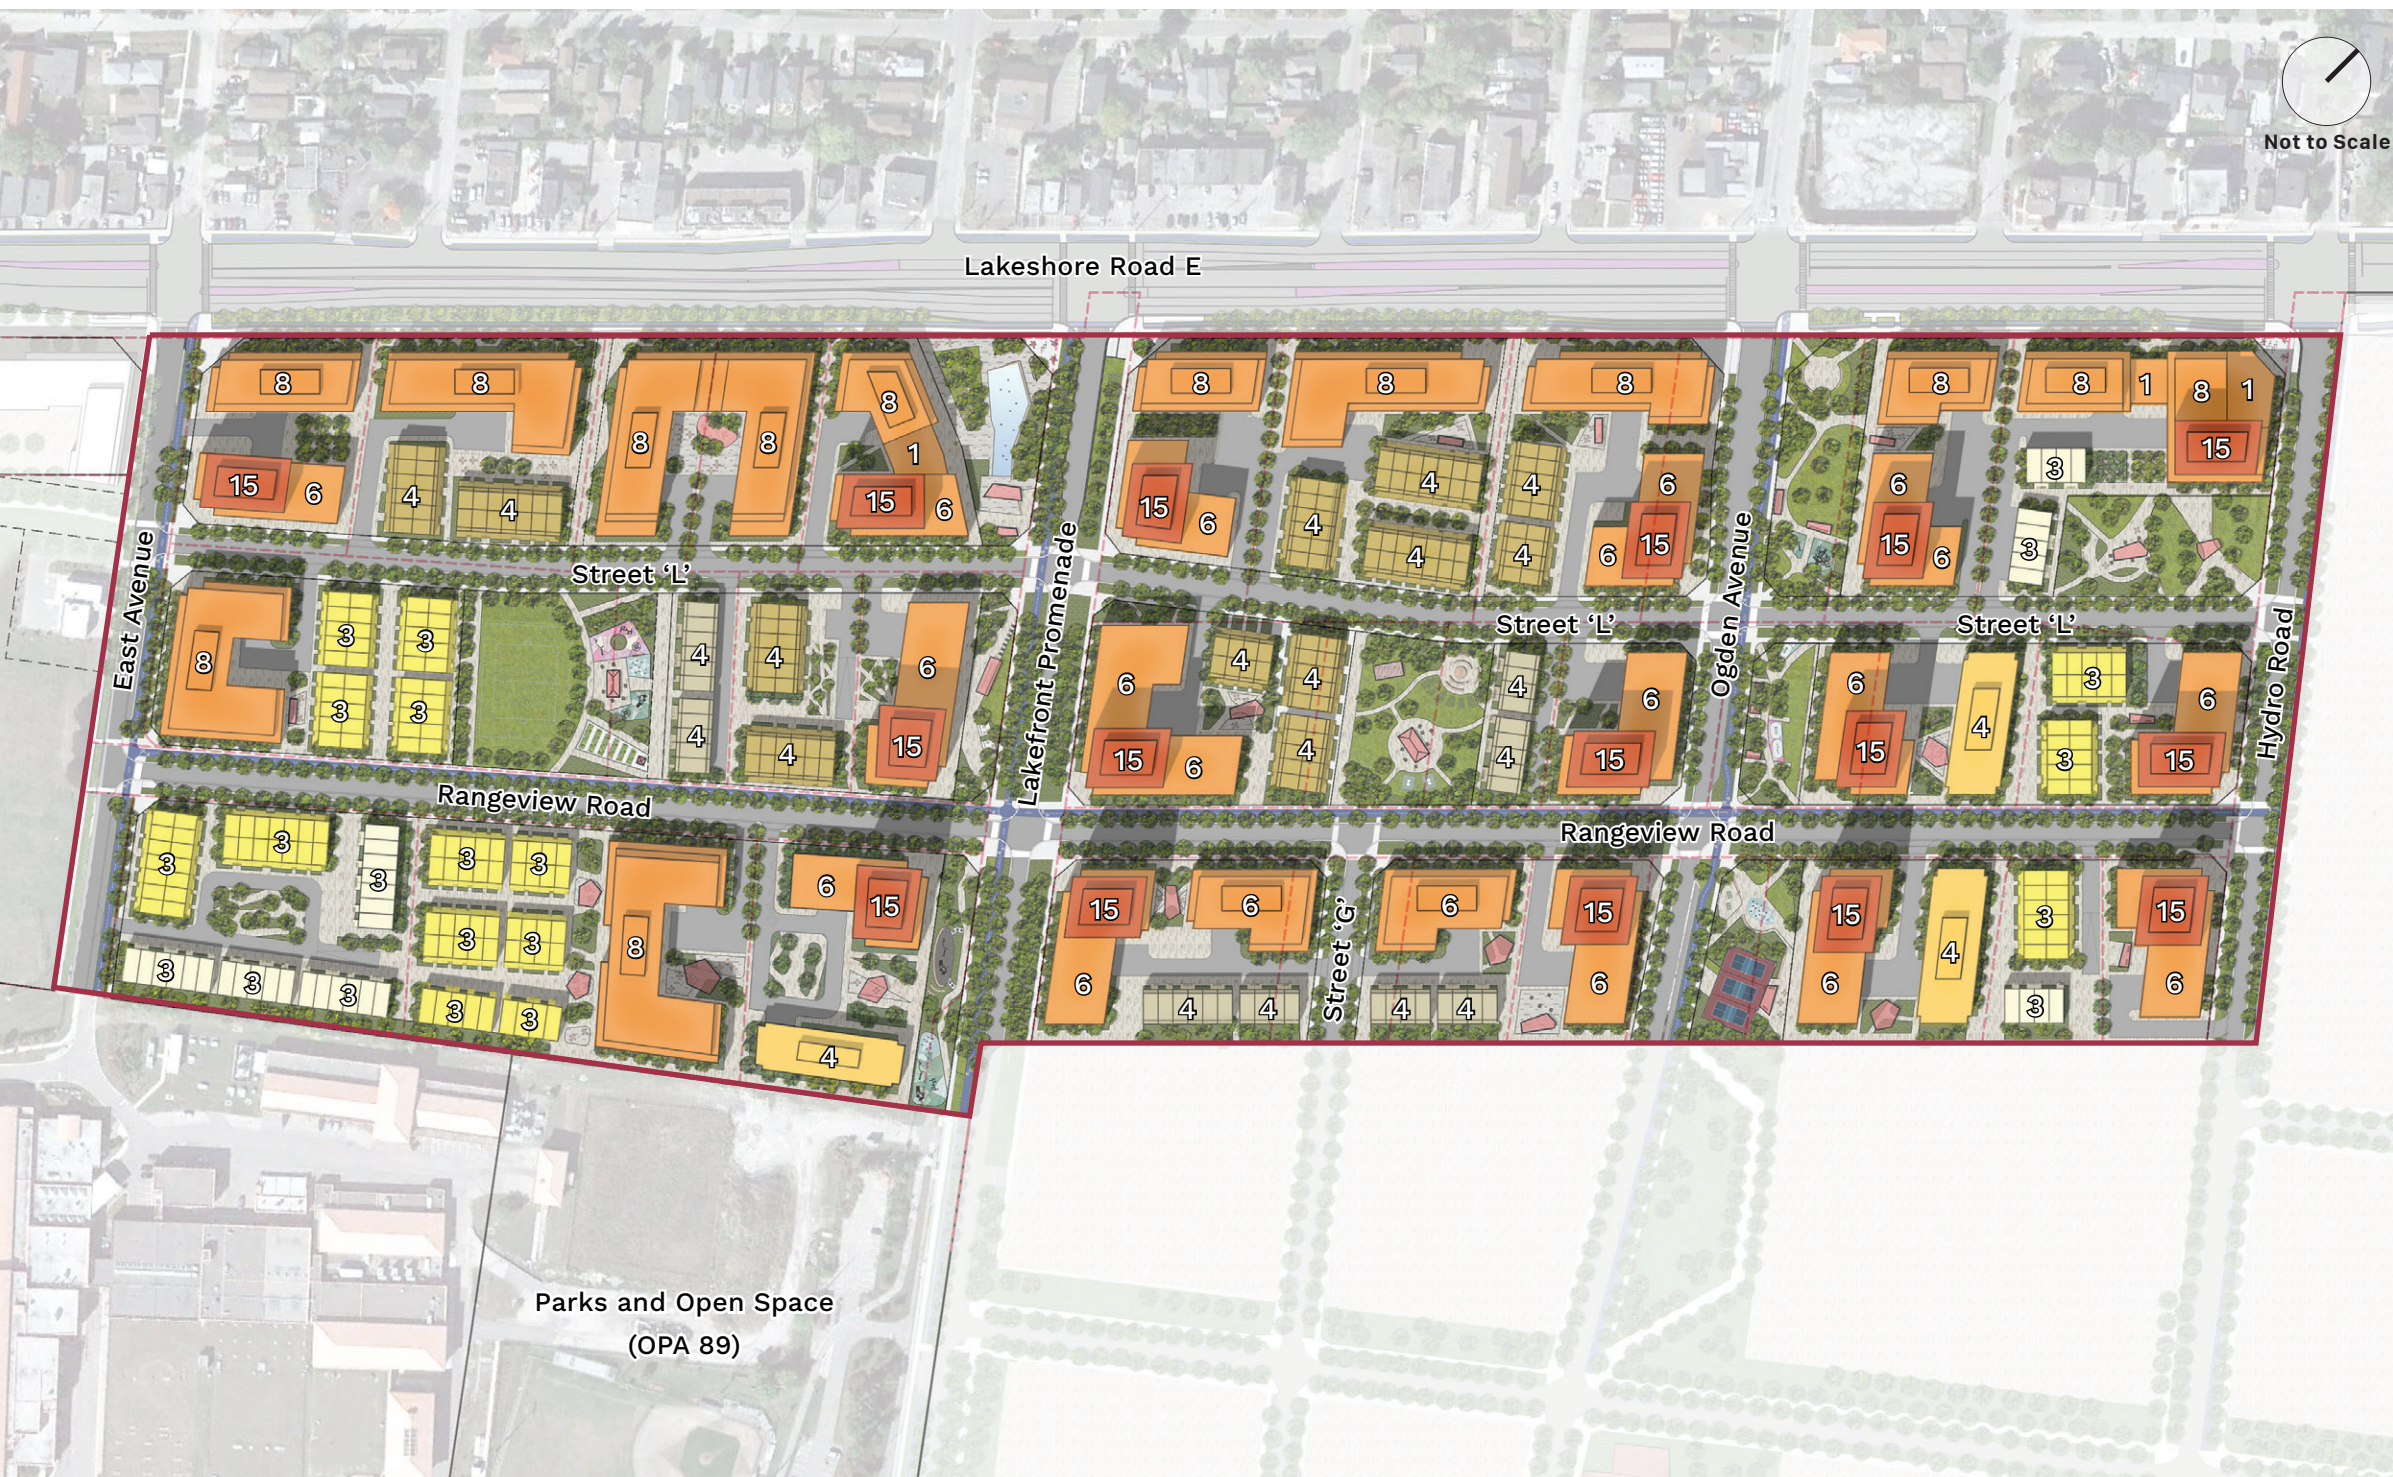

**Total Residential Units**  
± 5,300 units

**Low-rise (Up to 4-St)** **13%**  
± 689 units

Traditional Townhouse Blocks (3-ST) ± 46 units

Stacked Townhouse Blocks (4-ST) ± 76 units

Back-to-Back Townhouse Blocks (3-ST) ± 136 units

Stacked Back-to-Back Townhouse Blocks (4-ST) ± 272 units

Apartment (4-ST) ± 159 units

**Mid-rise Buildings (5- to 8-ST)** **31%**  
± 1,633 units

**Tall Buildings (9- to 15-ST)** **56%**  
± 2,978 units

#### Assumptions

- 1 Residential Gross Floor Area (GFA) for Apartments, Mid-rise and Tall Building based on 86% of the Gross Construction Area (GCA)
- 2 Approximate Unit Count for Apartments, Mid-rise and Tall Building based on an 81.29 sq.m. unit size
- 3 Individual Stacked Townhouse module = 2 units

**Legend**  Rangeview Estates Precinct Area  Existing Parcel Lines  Low-rise (Up to 4-Storeys)  Mid-rise / Podium (Tall Building) (5- to 8-Storeys)  Tower Element (Tall Building) (Up to 15-Storeys)  Building Height (Storeys)

**MASTER PLAN V7**

## Rangeview Development Master Plan

**Unit Count Statistics**

<b>Landowners</b>	<b>Total Parcel Area (Excluding Public Roads and Park)</b>	<i>Townhouse Unit Count</i>	<i>Apartment Unit Count</i>	<i>Mid-rise Building Unit Count</i>	<i>Tall Building Unit Count</i>	<b>Total Unit Count</b>
Dorsay (Lakeshore) Inc. Dorsay (Lakefront Promenade) Inc. Dorsay (Rangeview) Inc. (Dorsay Development Corp.)	<b>3.43 ha</b>	210	-	324	642	<b>1,176</b>
Elgroup Holdings Inc. Elias Bros. Construction Limited (Leonard Elia)	<b>2.66 ha</b>	76	-	466	346	<b>888</b>
Rangeview 1035 Holding Inc. Rangeview 1045 Holding Inc. 1207238 Ontario Limited Inc. (Bert Rebelo - Oasis Convention)	<b>0.79 ha</b>	-	54	-	354	<b>408</b>
2120412 Ontario Inc. (Jason Segato - Xtreme Tire)	<b>0.60 ha</b>	-	58	-	180	<b>238</b>
Whiterock 880 Rangeview Inc. (Dream Unlimited Corp.)	<b>1.29 ha</b>	52	-	233	-	<b>285</b>
447111 Ontario Limited (Norstar Group)	<b>0.71 ha</b>	36	-	136	-	<b>172</b>
1127792 Ontario Limited (Dino Collini)	<b>0.38 ha</b>	-	-	148	-	<b>148</b>
ILSCO of Canada Company (Thomas Quinn)	<b>0.59 ha</b>	-	-	85	170	<b>255</b>
Kotyck Investments Ltd. (Michael Kotyck)	<b>0.34 ha</b>	-	-	-	186	<b>186</b>
Non-Participating	<b>5.85 ha</b>	163	47	234	1,100	<b>1,544</b>
<b>TOTALS</b>	<b>16.64 ha</b>	<b>537</b>	<b>159</b>	<b>1,626</b>	<b>2,978</b>	<b>5,300</b>



**Preliminary Hydrogeological Investigation  
Proposed Residential and Commercial Buildings  
Rangeview Estates Precinct Development  
Mississauga, Ontario**

**PREPARED FOR:  
Rangeview Landowners Group Inc.**

**Project #:** 22-200-100  
**Date:** September 22, 2023



**DS CONSULTANTS LTD.**  
6221 Highway 7, Unit 16  
Vaughan, Ontario, L4H 0K8  
Telephone: (905) 264-9393  
[www.dsconsultants.ca](http://www.dsconsultants.ca)

---

22-200-100

September 22, 2023

**Rangeview Estates Precinct Development  
C/O Rangeview Landowners Group Inc.  
Rangeview Road  
Mississauga, ON**

**RE: Preliminary Hydrogeological Investigation-Rangeview Estates Precinct Development,  
Rangeview Road and Surrounding Area, Mississauga, ON**

DS Consultants Limited (DS) was retained by Rangeview Landowners Group Inc. to complete a preliminary hydrogeological investigation of the proposed development on Rangeview Road and the surrounding area in Mississauga, Ontario (Site). The site is located nearby about 3.5 kilometers east of Port Credit. The site is currently occupied by commercial and industrial buildings. Based on the conceptual plan, the site will be developed with low to mid-rise residential and commercial buildings with 1 to 3 levels of underground parking/basement. Also, it is DS's understanding installation of local site servicing will be part of the larger development. The report includes an overview of the existing geological and hydrogeological conditions at the Site and the surrounding area and provides a preliminary assessment of the hydrogeological constraints and impacts of the proposed development on the local groundwater.

Based on the results of our investigation, the following summary of conclusions and recommendations are presented:

1. Based on the MECP water wells records search, there are 244 water wells registered within 500 meters of the Site. One (1) water well is noted as a water supply for industrial use. All other well records as registered as test hole, monitoring well, not in use, dewatering well or unknown. DS conducted a door-to-door survey to confirm the water supply well. No wells were confirmed to have existed during the survey. The study area is fully serviced with municipal water and therefore, no groundwater users are expected in the area.
2. In total, 22 boreholes were drilled across the site by DS Consultants Ltd. (DS) as part of the preliminary hydrogeological investigation concurrently with the geotechnical investigation in August 2022. All boreholes were advanced to depths ranging from 2.5 to 8.2 meters below the ground surface (mbgs). A total of nine (9) drilled boreholes were converted into monitoring wells and screened in overburden and shale bedrock at depths ranging from 3.0 to 8.2 mbgs.
3. The study area (500 m radius) lies within the Iroquois Plain physiographic region of southern Ontario and is characterized by the Bevelled Till Plains physiographic landform. The surficial geology in the study area is dominated by clayey silt till deposits and coarse-textured glaciolacustrine deposits of sand, gravel, silt, and clay. The soils at the Site consist of asphalt and heterogeneous fill materials, followed by clayey silt till/ silty clay with interbedded sandy silt/silty sand seam and shale bedrock of the Georgian Bay Formation. Bedrock depth varies from about 2.2 m to 6.1 meters below the existing ground surface at the Site.

4. DS measured the groundwater levels in all wells on September 20, 2022. Groundwater levels in overburden monitoring wells were found between 1.57 mbgs and 1.64 mbgs and in bedrock wells at 2.29 mbgs. The groundwater levels at the Site can be subject to seasonal fluctuations. Groundwater flow direction is expected to be south towards Lake Ontario.
  
5. Single well response tests (SWRTs) were completed at three (3) monitoring wells with sufficient water to estimate hydraulic conductivity (k) for the representative geological units in which the wells are completed. The reported hydraulic conductivity values (k) for overburden range between  $5.3 \times 10^{-6}$  and  $1.1 \times 10^{-7}$  m/s and weathered shale/ shale bedrock is  $2.5 \times 10^{-6}$  m/s.
  
6. Construction Dewatering: Short-term and Long-term Discharge
  - DS understands that the proposed development concept will have up to three (3) levels of underground parking (P3). It is estimated that a conventional pile/lag shoring system will be used up to weathered shale bedrock and the excavation within the shale bedrock will be open cut (unsealed) for the proposed underground construction.
  
  - Based on the k-values of soils or rock for the site and surrounding areas, the dewatering flow rates within the assumed excavation area are expected to be low to medium. However, flow rates can be affected by any recharge from near Lake Ontario. Also, a secondary permeability of bedrock can contribute higher flow rate.
  
  - It is DS's understanding that a parcel/block-wise detailed hydrogeological investigation will be carried out in the future as per the actual design to estimate dewatering requirements. The preliminary estimated short-term and long-term discharge rates are presented in the table below.

Parcel	Area m <sup>2</sup>	UG Level	Short-term Discharge				Long-term Discharge	
			Flow Rate(Q) without a Safety factor L/day	Flow Rate with a Safety factor x 1.5 L/day	Stormwater (10 mm/24 hrs.) L/day	Total Flow Rate L/day	Flow Rate(Q) without a Safety factor L/day	Flow Rate with a Safety factor x 1.5 L/day
Parcel 1	5,200	3	30,000	45,000	52,000	97,000	23,000	34,500
Parcel 2	7,700	2	23,000	34,500	77,000	111,500	16,000	24,000
Parcel 3	3,800	3	27,000	40,500	38,000	78,500	20,000	30,000
Parcel 4	3,800	3	27,000	40,500	38,000	78,500	20,000	30,000
Parcel 5	4,700	3	29,000	43,500	47,000	90,500	22,000	33,000
Parcel 6	5,400	3	31,000	46,500	54,000	100,500	23,000	34,500
Parcel 7	9,300	2	25,000	37,500	93,000	130,500	17,000	25,500
Parcel 8-9	9,200	2	25,000	37,500	92,000	129,500	17,000	25,500

Parcel	Area m <sup>2</sup>	UG Level	Short-term Discharge				Long-term Discharge	
			Flow Rate(Q) without a Safety factor L/day	Flow Rate with a Safety factor x 1.5 L/day	Stormwater (10 mm/24 hrs.) L/day	Total Flow Rate L/day	Flow Rate(Q) without a Safety factor L/day	Flow Rate with a Safety factor x 1.5 L/day
Parcel 10	5,900	3	32,000	48,000	59,000	107,000	24,000	36,000
Parcel 11	8,300	2	24,000	36,000	83,000	119,000	16,000	24,000
Parcel 12	8,600	2	25,000	37,500	86,000	123,500	16,000	24,000
Parcel 13	2,000	-	-	-	-	-	-	-
Parcel 14	4,000	1	9,000	13,500	40,000	53,500	4,000	6,000
Parcel 15	3,800	3	27,000	40,500	38,000	78,500	20,000	30,000
Parcels 16-17	8,200	2	24,000	36,000	82,000	118,000	16,000	24,000
Parcel 18	1,800	-	-	-	-	-	-	-
Parcel 19	3,600	3	26,000	39,000	36,000	75,000	20,000	30,000
Parcels 20-21	5,800	2	21,000	31,500	58,000	89,500	14,000	21,000
Parcel 22	5,700	2	20,000	30,000	57,000	87,000	14,000	21,000
Parcel 23	10,000	1	13,000	19,500	100,000	119,500	6,000	9,000
Parcel 24	12,900	2	30,000	45,000	129,000	174,000	20,000	30,000
Parcel 25	7,400	3	35,000	52,500	74,000	126,500	27,000	40,500
Parcels 26-27	8,300	2	24,000	36,000	83,000	119,000	16,000	24,000
Parcels 27-28	4,600	2	19,000	28,500	46,000	74,500	12,000	18,000
Parcels 29-30	3,700	3	27,000	40,500	37,000	77,500	20,000	30,000
Parcel 31	6,000	2	21,000	31,500	60,000	91,500	14,000	21,000
Parcel 32	3,300	1	8,000	12,000	33,000	45,000	3,000	4,500
Parcel 33	3,400	3	26,000	39,000	34,000	73,000	19,000	28,500

#### 7. Construction Dewatering: Public ROW (Site Servicing):

- An assumed 100 m long and 2 m wide open cut section was considered for dewatering estimation during the installation of underground utilities such as water main, storm and sanitary sewer and utility access holes. Based on the site servicing drawings provided to DS, the proposed bottom of underground utilities varies between 5-6 mbsg. The highest shallow groundwater level for the site is 84 masl.
- The estimated dewatering rate (short-term) during the installation of underground utilities for the trench (30 m x 2 m) is 14,000 L/day without a safety factor and 21,000 L/day with a safety factor of x1.5. The additional flow rate that may be needed to be removed because of precipitation events (assuming 10 mm/24 hours) would be an additional 1,000 L/day.

---

The dewatering volume for the section can be change depending on the existing grade and the actual groundwater level encountered during the excavation of the section.

#### 8. Permits Requirements:

In the absence of drawings/site plans and construction sequencing details, DS anticipates that the construction of the proposed construction will be phased. Therefore, permit requirements can be determined once the final design, revised dewatering rates, and construction sequences are available. Below are the regulatory dewatering permit requirements regarding estimated daily discharge volume.

- An EASR or a PTTW is not required for water taking less than 50,000 L/day.
  - An Environmental Activity Sector Registration (EASR) is required to be submitted to the Ministry of the Environment, Conservation and Parks (MECP) if the taking of groundwater and stormwater for a temporary construction project is between 50,000 L/day and 400,000 L/ day. The EASR application is an online registry and should be submitted to the MECP before any construction dewatering.
  - A PTTW is required to be submitted to the MECP if the taking of groundwater and stormwater for a temporary construction project is more than 400,000 L/ day. The PTTW application is also an online registry and should be submitted to the MECP 90 days from the start of construction.
  - A discharge permit may be required from the City of Mississauga if groundwater is to be sent to the sewer system for short-term (during construction)
9. One (1) unfiltered groundwater sample was collected from the monitoring well BH 22-9 on September 22, 2022, and another water sample was collected from monitoring well BH 22-14 between April 17 and May 3, 2023. The groundwater samples were analyzed and compared against the parameters listed in the Region of Peel Wastewater Bylaw (53-2010) and the City of Mississauga Storm Sewer Use Bylaw.
10. Groundwater quality analysis indicates that TSS, various total metals and cis- 1,2-Dichloroethene exceeded the sanitary or storm criteria under the Region of Peel’s Wastewater Bylaw (53-2010) and the City’s Sewer Use Bylaw. Therefore, groundwater at the Site is not suitable for direct discharge to the Region’s or the City’s sewer system without pre-treatment. Treatment options include but are not limited to the settlement of suspended solids and specialized filtration to remove fines and associated metals.
11. The area is fully serviced by a municipal water supply. It is not expected to have any use of groundwater as a source of drinking water within a radius of 500 meters therefore, there will be no short-term impacts on private water wells occurring from dewatering activities.
12. Baseline groundwater quality has been assessed and established before construction. However, groundwater quality can change based on several factors (land-use change, spills, natural

variations, site remediation activities, etc.) and should be monitored during construction dewatering and after construction to ensure that water quality meets the guideline or regulations associated with any permits from the MECP and the City/Region.

13. In conformance with Regulation 903 of the Ontario Water Resources Act, the decommissioning of any dewatering system and monitoring wells should be conducted by a licensed contractor under the supervision of a licensed water well technician.

Should you have any questions regarding these findings, please contact the undersigned.

**DS Consultants Ltd.**

Prepared By:



**Pradeep Patel, M.Sc. P.Geol.**  
**Hydrogeologist**

Reviewed By:



**Martin Gedeon, M.Sc., P.Geol.**  
**Senior Hydrogeologist**



## Table of Contents

<b>1.0 INTRODUCTION</b> .....	<b>1</b>
1.1 Purpose.....	1
1.2 Scope of Work.....	1
<b>2.0 FIELD INVESTIGATION</b> .....	<b>2</b>
<b>3.0 PHYSICAL SETTING</b> .....	<b>2</b>
3.1 Physiography and Drainage .....	2
3.2 Geology.....	2
3.2.1 Quaternary Geology.....	2
3.2.2 Bedrock Geology.....	3
3.2.3 Site Geology/Subsurface Soils .....	3
3.3 Hydrogeology.....	3
3.3.1 Hydrostratigraphy.....	3
3.3.2 Local Groundwater Use .....	4
3.3.3 Groundwater Conditions .....	4
3.3.4 Hydraulic Conductivity.....	4
3.3.5 Groundwater Quality.....	5
<b>4.0 CONSTRUCTION DEWATERING</b> .....	<b>5</b>
4.1 Short-term Dewatering Requirements- Buildings .....	6
4.2 Short-term Dewatering Requirements- Public ROW (Site Servicing) .....	7
4.3 Long-term Dewatering Requirements- Buildings .....	8
4.4 Water-taking Permit Requirements.....	9
<b>5.0 POTENTIAL IMPACTS</b> .....	<b>10</b>
5.1 Current PTTW Search.....	10
5.2 Source Protection Area.....	10
5.3 Surface Water .....	10
5.4 Local Groundwater Use .....	10
5.5 Point of Discharge and Groundwater Quality.....	11
<b>7.0 LIMITATIONS</b> .....	<b>11</b>
<b>8.0 CONSULTANTS QUALIFICATIONS</b> .....	<b>13</b>
<b>9.0 REFERENCES</b> .....	<b>14</b>

## **FIGURES**

- FIGURE 1 Site Location and MECP Water Well Records
- FIGURE 2 Surficial Geology Map
- FIGURE 3 Borehole and Monitoring Well Locations
- Figure 4A Geological Cross Section (A-A')
- Figure 4B Geological Cross Section (B-B')

## **APPENDICES:**

- Appendix A Borehole Logs
- Appendix B MECP Water Wells Records
- Appendix C Hydraulic Conductivity Analysis
- Appendix D Groundwater Quality Certificate of Analysis
- Appendix E Conceptual Development Plan



## **1.0 INTRODUCTION**

DS Consultants Limited (DS) was retained by Rangeview Landowners Group Inc. to complete a preliminary hydrogeological investigation of the proposed development on Rangeview Road and the surrounding area in Mississauga, Ontario (Site). The site is located nearby about 3.5 kilometers east of Port Credit. The site is currently occupied by commercial and industrial buildings. Based on the conceptual plan, the site will be developed with low to mid-rise residential and commercial buildings with 1 to 3 levels of underground parking/basement. Also, it is DS's understanding that the installation of local site servicing will be part of the overall development.

The report includes an overview of the existing geological and hydrogeological conditions at the Site and the surrounding area and provides an assessment of the hydrogeological constraints and impacts of the proposed development on the local groundwater. The preliminary hydrogeological investigation is based on boreholes and monitoring wells drilled and installed by DS on the Site concurrently with the geotechnical investigations.

### **1.1 Purpose**

The purpose of this investigation was to review and determine the need for dewatering, estimate dewatering rates, assess groundwater quality, and determine the need for a Permit to Take Water (PTTW) or an Environmental Activity Sector Registry (EASR) from the Ministry of Environment and Climate Change (MECP) in addition to requirements to obtain discharge permits from the Region of the Peel Region/the City of Mississauga. Potential impacts related to construction dewatering and associated monitoring/mitigation measures were also to be investigated.

### **1.2 Scope of Work**

The scope of work for this investigation included:

- (i) Site visits;
- (ii) Collecting and interpreting available reports and data including the MECP Water Well Records (WWR), geotechnical, hydrogeological and environmental studies completed at the site and in the site's vicinity;
- (iii) In-situ hydraulic conductivity testing of newly installed monitoring wells;
- (iv) Assessing groundwater quantity and quality to evaluate discharge options;
- (v) Assessing potential impacts due to dewatering activities; and,
- (vi) Data analyses and report preparation.

## **2.0 FIELD INVESTIGATION**

- In total, 22 boreholes were drilled across the site by DS Consultants Ltd. (DS) as part of the preliminary hydrogeological investigation concurrently with the geotechnical investigation in August 2022. All boreholes were advanced to depths ranging from 2.5 to 8.2 meters below the ground surface (mbgs).
- A total of nine (9) drilled boreholes were converted into monitoring wells and screened in overburden and shale bedrock at depths ranging from 3.0 to 8.2 mbgs. All monitoring wells were developed before any use to allow for groundwater level monitoring, hydraulic conductivity testing, and to assess groundwater quality.
- A total of nine (9) single well response tests (SWRTs) were completed into wells by performing a rising head test to estimate hydraulic conductivity values of formations/soils at the Site.
- Two unfiltered groundwater samples were collected and analyzed for the parameters listed under the Region of Peel and City of Mississauga Sewer Use By-law to assess groundwater quality before any discharge to the City's sewers system.

## **3.0 PHYSICAL SETTING**

Available topographic maps and environmental, geotechnical, and hydrogeological reports were used to develop an understanding of the physical setting of the study area. The borehole logs from all investigations at the Site, as well as the Ministry of the Environment, Conservation and Parks Water Wells Records (MECP WWRs), were used to interpret the geological and hydrogeological conditions at the Site.

### **3.1 Physiography and Drainage**

The general topography at the study area and the Site has a gentle slope south towards Lake Ontario, with elevations decreasing from 85 m to 77 m. Drainage at the site is follow the local topography controlled by artificial channels and underground utilities such as sewers. The nearest surface water body Lake Ontario is located at the southern boundary of the Site.

### **3.2 Geology**

The following presents a brief description of regional and Site geological and hydrogeological conditions based on the review of available information and site-specific investigations.

#### **3.2.1 Quaternary Geology**

The study area (500 m radius) lies within the Iroquois Plain physiographic region of southern Ontario and is characterized by the Bevelled Till Plains physiographic landform. The surficial geology in the study area is

dominated by clayey to silt textured till (Halton till) and fined-textured glaciolacustrine deposits of silt, clay and minor sand and gravel. The surficial geology map is shown in **Figure 2**.

### **3.2.2 Bedrock Geology**

Available published mapping shows that bedrock in the area is predominantly shales and limestones of the Georgian Bay Formation (MNDM Map 2544 Bedrock Geology of Ontario). Based on the review of local boreholes and well record information, the depth to bedrock in the study area is estimated to be at an elevation of 70 to 80 masl.

### **3.2.3 Site Geology/Subsurface Soils**

Subsurface soils/Site geology on the site was interpreted from the existing boreholes/monitoring wells (BHs/MWs) drilled by DS. The locations of the BHs/MWs are shown in **Figure 3** and detailed subsurface conditions are presented on the borehole Logs in **Appendix A**. The subsurface conditions in the boreholes are summarized in the following paragraphs.

#### **Fill Materials:**

Fill material was found in all boreholes extending to depths ranging from 0.8 to 2.5 m below the ground surface. The fill material was heterogeneous and consisted of sandy silt and clayey silt to silty clay, with inclusions of topsoil/organics in varying proportions and trace limestone & shale fragments.

#### **Clayey Silt to Silty Clay Till/ Clayey Silt to Silty Clay:**

Below the fill materials, silty clay to clay silt till and interbedded clayey silt to silty clay deposits were encountered in all boreholes at varying depths and extended to the depth of 2.2- 8.2 mbgs.

#### **Shale Bedrock:**

Weathered shale/Shale bedrock belonging to Georgian Bay Formation was found at approximate depths varying from 2.2 to 6.1 m below the existing surface.

## **3.3 Hydrogeology**

The hydrogeology at the Site was evaluated using the on-Site monitoring wells installed by DS as part of geotechnical, environmental, and hydrogeological investigations, local domestic wells, and existing hydrogeological reports for the area.

### **3.3.1 Hydrostratigraphy**

The review of sub-surface soils indicates that there are three (3) major hydrostratigraphic units in the vicinity of the site: Glacial Till (Halton till), glaciolacustrine deposits and Shale bedrock of Georgian Bay Formation. These three (3) units are further described below.

- Glacial till is clayey to silty, textured till and known to be interbedded with minor sand deposits. This unit is considered as low permeable or an aquitard.
- The shale bedrock of the Georgian Bay Formation is not considered to be an aquifer and has limited groundwater movement. The upper weathered/fractured shale can have some local groundwater movement.

### 3.3.2 Local Groundwater Use

As part of the hydrogeological study, DS completed a search of the Ministry of the Environment, Conservation and Parks (MECP) Water Wells Records (WWRs) database. Based on the MECP water wells records search, there are 244 water wells registered within 500 meters of the Site (**Appendix B**). One (1) water well is noted as a water supply for industrial use. All other well records as registered as test hole, monitoring well, not in use, dewatering well or unknown. **Figure 1** shows the MECP water well location plan.

### 3.3.3 Groundwater Conditions

DS measured the groundwater level in all wells on September 15, 2022. Groundwater levels in overburden monitoring wells were found between 1.57 mbgs and 1.64 mbgs and in bedrock well at 2.29 mbgs. A summary of the measured groundwater levels in all monitoring wells is provided in **Table 3-1**.

**Table 3-1: Groundwater Levels in Monitoring Wells**

Well ID	Ground Elevation (masl)	Well Depth (mbgs)	Screened Interval (mbgs)	Screened Formation	Depth to Water (mbgs)	Groundwater Elevation (masl)
BH 22-3	81.80	3.1	1.5-3.1	Silty Clay to Clayey Silt till	Dry	-
BH 22-6	83.00	3.0	1.5-3.0	Silty Clay to Clayey Silt till	1.63	81.4
BH 22-9	85.80	6.0	3.0-6.0	Shale	2.29	83.5
BH 22-12	81.60	7.7	4.7-7.7	Silty Clay to Clayey Silt till	Dry	-
BH 22-13	85.40	3.7	2.5-3.7	Clay silty to Sandy Silt/Silty	1.57	83.8
BH 22-14	83.90	6.1	3.1-6.1	Silty Clay to Clayey Silt till	Dry	-
BH 22-17	85.50	3.0	1.5-3.0	Silty Clay to Clayey Silt till	1.64	83.9
BH 22-22	84.30	6.1	3.1-6.1	Silty Clay to Clayey Silt till	Dry	-

### 3.3.4 Hydraulic Conductivity

A single well response test (SWRT) was completed at three monitoring wells with sufficient water to estimate hydraulic conductivity (k) for the representative geological units in which the wells are completed. The reported hydraulic conductivity values (k) for overburden range between  $5.3 \times 10^{-6}$  and  $1.1 \times 10^{-7}$  m/s and weathered shale/ shale bedrock is  $2.5 \times 10^{-6}$  m/s. The test results are summarised in Table 3-2 and the hydraulic testing analysis is provided in **Appendix C**.

**Table 3-2: Hydraulic Conductivity (k) Test Results**

Well ID	Screen Interval	Screened Formation	K- Value(m/s)
BH 22-6	1.5-3.0	Silty Clay to Clayey Silt till	$5.3 \times 10^{-9}$
BH 22-9	9.2-12.2	Shale	$2.5 \times 10^{-6}$
BH 22-13	9.2-12.2	Clay silty to Sandy Silt/Silty Sand(Till)	$1.1 \times 10^{-7}$

### 3.3.5 Groundwater Quality

One unfiltered groundwater sample was collected from monitoring well BH 22-9 on September 22, 2022, and from monitoring well BH 22-14 between April 17 and May 3, 2023. The groundwater samples were analyzed and compared against the parameters listed in the Region of Peel Wastewater Bylaw (53-2010) and the City of Mississauga Storm Sewer Use Bylaw.

Groundwater quality analysis indicates that TSS, various total metals and cis- 1,2-Dichloroethene exceeded the sanitary or storm criteria under the Region of Peel’s Wastewater Bylaw (53-2010) and the City’s Sewer Use Bylaw. The selected certificates of analysis are provided in **Appendix D**.

**Table 3-4: Parameters in Groundwater Exceeding the Sewer Use By-law**

Parameter Exceeded	Unit	Peel Sanitary Sewer Use Criteria	Mississauga Storm Sewer Use Criteria	BH/MW 22-9 Concentration	BH/MW 22-14 Concentration
Total Suspended Solids	mg/L	350	15	<b>9560</b>	<b>42</b>
Aluminum	mg/L	50	1	<b>63.5</b>	0.1
Arsenic	mg/L	1	0.02	<b>0.038</b>	<0.01
Chromium	mg/L	5	0.08	<b>0.117</b>	<0.01
Copper	mg/L	3	0.04	<b>0.129</b>	<0.01
Manganese	mg/L	5	2	<b>5.44</b>	0.018
Nickel	mg/L	3	0.08	<b>0.135</b>	<0.005
Phosphorus	mg/L	10	0.4	<b>3.76</b>	<0.05
Zinc	mg/L	3	0.2	<b>0.37</b>	<0.005
cis-1,2-Dichloroethene	mg/L	4	-	<b>0.0115</b>	-

Note: **Bold** – Exceeded Peel Storm Sewer Use, \* Exceeded Mississauga Storm Sewer Use, Underline– Exceeded Peel Sanitary Sewer Use

## 4.0 CONSTRUCTION DEWATERING

DS understands that the proposed development concept (**Appendix E**) will have up to three (3) levels of underground parking (P3). It is estimated that a conventional pile/lag shoring system will be used up to weathered shale bedrock and the excavation within the shale bedrock will be open cut (unsealed) for the proposed underground construction. Based on the k-values of soils or rock for the site and

surrounding areas, the dewatering flow rates within the assumed excavation area are expected to be low to medium. However, flow rates can be affected by any recharge from near Lake Ontario. Also, a secondary permeability of bedrock can contribute higher flow rate. It is DS's understanding that a parcel/block-wise detailed hydrogeological investigation will be carried out as per the actual design to estimate dewatering requirements.

#### 4.1 Short-term Dewatering Requirements- Buildings

No detailed design drawings were available at the time of drafting this report. Following parameters are assumed for the preliminary dewatering assessment for the proposed buildings.

- a. Underground Structure: One (1) – Three (3) Levels
- b. Assumed Established Ground Elevation: 83.5 masl
- c. Assumed Lowest Finished Floor Level (P1-P3): 3-9 m below the established grade
- d. Considered Deepest Excavation (including foundation): 5- 11 m below the established grade
- e. Considered Average Groundwater Elevation: 82 masl
- f. Considered Geomean K- value:  $5 \times 10^{-7}$  m/s

The estimated dewatering volumes(Q) using steady-state equations are presented in **Table 4.1**.

$$Q = (\pi i * K (H^2 - h^2)) / \ln (R/r_e)$$

Where,

K – Hydraulic conductivity

H – Distance from static water level to the bottom of an aquifer

h – Depth of water in the well while pumping

$r_e$  – equivalent radius [m] =  $((a*b) / \pi)^{0.5}$  where a and b are excavation dimensions

R – Radius of the cone of depression =  $r_e + 3000 * (H - h) * K^{0.5}$

**Table: 4-1 Estimation of Flow Rate (Short-term Discharge)**

Parcel	Area m <sup>2</sup>	Under- ground level No.	H (m)	Flow Rate(Q) without a Safety factor L/day	Flow Rate with a Safety factor x 1.5 L/day	Stormwater (10 mm/24 hrs.) L/day	Total Flow Rate L/day
Parcel 1	5,200	3	9.5	30,000	45,000	52,000	97,000
Parcel 2	7,700	2	6.5	23,000	34,500	77,000	111,500
Parcel 3	3,800	3	9.5	27,000	40,500	38,000	78,500
Parcel 4	3,800	3	9.5	27,000	40,500	38,000	78,500
Parcel 5	4,700	3	9.5	29,000	43,500	47,000	90,500
Parcel 6	5,400	3	9.5	31,000	46,500	54,000	100,500

Parcel	Area m <sup>2</sup>	Under- ground level No.	H (m)	Flow Rate(Q) without a Safety factor L/day	Flow Rate with a Safety factor x 1.5 L/day	Stormwater (10 mm/24 hrs.) L/day	Total Flow Rate L/day
Parcel 7	9,300	2	6.5	25,000	37,500	93,000	130,500
Parcels 8-9	9,200	2	6.5	25,000	37,500	92,000	129,500
Parcel 10	5,900	3	9.5	32,000	48,000	59,000	107,000
Parcel 11	8,300	2	6.5	24,000	36,000	83,000	119,000
Parcel 12	8,600	2	6.5	25,000	37,500	86,000	123,500
Parcel 13	2,000	-	-	-	-	-	-
Parcel 14	4,000	1	3.5	9,000	13,500	40,000	53,500
Parcel 15	3,800	3	9.5	27,000	40,500	38,000	78,500
Parcels 16-17	8,200	2	6.5	24,000	36,000	82,000	118,000
Parcel 18	1,800	-	-	-	-	-	-
Parcel 19	3,600	3	9.5	26,000	39,000	36,000	75,000
Parcels 20-21	5,800	2	6.5	21,000	31,500	58,000	89,500
Parcel 22	5,700	2	6.5	20,000	30,000	57,000	87,000
Parcel 23	10,000	1	3.5	13,000	19,500	100,000	119,500
Parcel 24	12,900	2	6.5	30,000	45,000	129,000	174,000
Parcel 25	7,400	3	9.5	35,000	52,500	74,000	126,500
Parcels 26-27	8,300	2	6.5	24,000	36,000	83,000	119,000
Parcels 27-28	4,600	2	6.5	19,000	28,500	46,000	74,500
Parcels 29-30	3,700	3	9.5	27,000	40,500	37,000	77,500
Parcel 31	6,000	2	6.5	21,000	31,500	60,000	91,500
Parcel 32	3,300	1	3.5	8,000	12,000	33,000	45,000
Parcel 33	3,400	3	9.5	26,000	39,000	34,000	73,000

The estimated dewatering rate(short-term) for a parcel range between 8,000 L/day and 35,000 L/day without a safety factor and 12,000 L/day and 52,500 L/day with a safety factor of x1.5. Additional water that may be needed to be removed because of precipitation events (assuming 10 mm/24 hours) would be between 33,000 and 129,000 L/day. The dewatering volume for the section can be changed depending on the existing grade, hydraulic conductivity of soils or rock and the actual groundwater level encountered during the excavation of a parcel.

#### 4.2 Short-term Dewatering Requirements- Public ROW (Site Servicing)

No design drawings were available at the time of drafting this report. For the dewatering purpose, a theoretical 30 m long and 2 m wide and 5-6 m deep open cut trench was considered at any given time during the installation of underground utilities such as water main, storm and sanitary sewer and utility access holes as part of the Public ROW. Based on the existing ground levels at the site, the assumed

bottom of underground utilities is about 5-6 mbgs. The groundwater level for the site is between 1.57 and 2.29 mbgs. The requirements of dewatering for the sections will depend on the existing grade and the actual groundwater level encountered during the excavation of sections. The estimated dewatering volume for the assumed trench/section is as below.

$$Q = (\pi * K (H^2 - h^2)) / \ln (R/r_e) = 6,000 \text{ L/day without a safety factor}$$

Where,

K – Hydraulic conductivity=  $2.5 \times 10^{-6}$  m/s (highest k-value)

H – Distance from static water level to the bottom of an aquifer= 4.5

h – Depth of water in the well while pumping=0.0

$r_e$  – equivalent radius [m] =  $((a*b) / \pi)^{0.5}$  where a and b are excavation dimensions=

R – Radius of the cone of depression =  $r_e + 3000 * (H - h) * K^{0.5}$

The estimated dewatering rate(short-term) during the installation of underground utilities for the assumed trench (30 m x 2 m) is 14,000 L/day without a safety factor and 21,000 L/day with a safety factor of x1.5. The additional flow rate that may be needed to be removed because of precipitation events (assuming 10 mm/24 hours) would be 1,000 L/day. The dewatering volume for a parcel can be changed depending on the existing grade and the actual groundwater level encountered during the excavation of a parcel.

### 4.3 Long-term Dewatering Requirements- Buildings

Following the construction of the underground structure, long-term groundwater flow to the underfloor drainage system for the building will be a function of the upward flux and drainage along the foundation wall. The estimated long-term drainage flow rate for a parcel with P1-P3 levels using a steady-state flow equation is summarised in **Table 4-2**.

**Table 4-2: Estimation of Flow Rate (Long-term Discharge)**

Parcel	Area m <sup>2</sup>	Under-ground level- No.	H (m)	Flow Rate without a Safety Factor L/day	Flow Rate with a Safety factor x 1.5 L/day
Parcel 1	5,200	3	7.5	23,000	34,500
Parcel 2	7,700	2	4.5	16,000	24,000
Parcel 3	3,800	3	7.5	20,000	30,000
Parcel 4	3,800	3	7.5	20,000	30,000
Parcel 5	4,700	3	7.5	22,000	33,000
Parcel 6	5,400	3	7.5	23,000	34,500
Parcel 7	9,300	2	4.5	17,000	25,500
Parcel 8-9	9,200	2	4.5	17,000	25,500



Parcel	Area m <sup>2</sup>	Under- ground level- No.	H (m)	Flow Rate without a Safety Factor L/day	Flow Rate with a Safety factor x 1.5 L/day
Parcel 10	5,900	3	7.5	24,000	36,000
Parcel 11	8,300	2	4.5	16,000	24,000
Parcel 12	8,600	2	4.5	16,000	24,000
Parcel 13	2,000	-	-	-	-
Parcel 14	4,000	1	1.5	4,000	6,000
Parcel 15	3,800	3	7.5	20,000	30,000
Parcels 16-17	8,200	2	4.5	16,000	24,000
Parcel 18	1,800	-	-	-	-
Parcel 19	3,600	3	7.5	20,000	30,000
Parcels 20-21	5,800	2	4.5	14,000	21,000
Parcel 22	5,700	2	4.5	14,000	21,000
Parcel 23	10,000	1	1.5	6,000	9,000
Parcel 24	12,900	2	4.5	20,000	30,000
Parcel 25	7,400	3	7.5	27,000	40,500
Parcels 26-27	8,300	2	4.5	16,000	24,000
Parcels 27-28	4,600	2	4.5	12,000	18,000
Parcels 29-30	3,700	3	7.5	20,000	30,000
Parcel 31	6,000	2	4.5	14,000	21,000
Parcel 32	3,300	1	1.5	3,000	4,500
Parcel 33	3,400	3	7.5	19,000	28,500

The estimated long-term discharge for a parcel range between 3,000 L/day and 27,000 L/day without a safety factor and 4,500 L/day and 40,500 L/day with a safety factor of x1.5. The dewatering volume for a parcel can be changed depending on the existing grade, sub-drainage depth, hydraulic conductivity of soils or rock and the actual groundwater level encountered during the excavation of a parcel.

#### 4.4 Water-taking Permit Requirements

In the absence of drawings/site plans and construction sequences, DS anticipates that the construction of the proposed construction will be phased. Therefore, permit requirements can be determined once the final design, revised dewatering rates, and construction sequences are available. Below are the regulatory dewatering permit requirements concerning daily discharge volume.

- An EASR or a PTTW is not required for water taking less than 50,000 L/day.
- An Environmental Activity Sector Registration (EASR) is required to be submitted to the Ministry of the Environment, Conservation and Parks (MECP) if the taking of groundwater and

stormwater for a temporary construction project is between 50,000 L/day and 400,000 L/ day. The EASR application is an online registry and should be submitted to the MECP before any construction dewatering.

- A PTTW is required to be submitted to the MECP if the taking of groundwater and stormwater for a temporary construction project is more than 400,000 L/ day. The PTTW application is also an online registry and should be submitted to the MECP 90 days from the start of construction dewatering. Dewatering of up to 400,000 L/day is acceptable under an EASR registry.

## 5.0 POTENTIAL IMPACTS

The following are the predicted potential impacts because of construction dewatering:

### 5.1 Current PTTW Search

The MECP PTTW Open Data Catalogue was searched within a 1 km radius of the Site. The search indicated that there is one active PTTW within 1 km of the Site. The PTTW details are summarised below. The groundwater interferences from surrounding pumping activities are possible to occur depending on the radius of influence.

Permit Number	Permit Holder Name	Purpose	Specific Purpose	Max Litres per Day	Source Type	Distance (KM)
2216-BPJSE5	The Regional Municipality of Peel	Dewatering Construction	Construction	2590000	Ground Water	0.40

### 5.2 Source Protection Area

The site is located within the Credit Valley Source Protection Area (SPA). The Credit Valley Source Protection Plan contains policies aimed at protecting drinking water sources by reducing or eliminating significant threats to the source of municipal drinking water. The study area is serviced by municipal water. Therefore, no impacts are anticipated on the drinking water supply within the zone of influence.

### 5.3 Surface Water

Lake Ontario is not within the zone of influence during construction dewatering. Therefore, surface water impacts due to the short-term dewatering are not expected.

### 5.4 Local Groundwater Use

The area is fully serviced by a municipal water supply. It is not expected to have any use of groundwater as a source of drinking water within a radius of 500 meters and therefore, there will be no short-term or long-term predicted impacts on private water wells occurring from the proposed dewatering activities.

---

## 5.5 Point of Discharge and Groundwater Quality

Groundwater quality analysis indicates that TSS, various total metals and cis- 1,2-Dichloroethene exceeded the sanitary or storm criteria under the Region of Peel’s Wastewater Bylaw (53-2010) and the City’s Sewer Use Bylaw. Therefore, groundwater at the Site is not suitable for discharge to the Region’s or the City’s sewer system without treatment. Treatment options include but are not limited to the settlement of suspended solids and filtration to remove fines and associated metals. Discharge permits and agreements are required from the Region of the Peel/City of Mississauga to discharge groundwater into the sewer system.

## 6.0 MONITORING AND MITIGATION

Based on the finding of hydrogeological assessment and associated potential impacts due to development, the following monitoring and mitigation program is provided:

- Baseline groundwater quality has been assessed and established before construction. However, groundwater quality can change based on several factors (land-use change, spills, etc.) and should be monitored during construction dewatering and after construction to ensure that water quality meets the guideline or regulations associated with any permits from the MECP and the City of Mississauga.
- if a groundwater dewatering system is set up at the Site, daily and weekly monitoring should be implemented to assess the groundwater conditions such as water levels, measurement of discharge flow, discharge water quality and any adverse impacts because of dewatering.
- Following the completion of construction activities, all dewatering wells, well points, eductors and monitoring wells installed at various stages of this project must be decommissioned. The installation and eventual decommissioning of the wells and the dewatering system must be conducted by a licenced water well contractor in accordance with Regulation 903 of the Ontario Water Resources Act.

## 7.0 LIMITATIONS

This report was prepared for the sole use of the addressee to provide an assessment of the hydrogeological conditions on the property. The information presented in this report is based on information collected during the completion of the hydrogeological investigation by DS Consultants Ltd. DS Consultants Ltd. was required to use and rely upon various information sources produced by other parties. The information provided in this report reflects DS’s judgment considering the information available at the time of report preparation. This report may not be relied upon by any other person or entity without the written authorization of DS Consultants Ltd. The scope of services performed in the execution of this investigation may not be appropriate to satisfy the needs of other users, and any use or reuse of this document or findings, conclusions, and recommendations represented herein, is at the

sole risk of said users. The conclusions drawn from the Hydrogeological report were based on information at selected observation and sampling locations. Different conditions between and beyond these locations may become apparent during future investigations or on-Site work, which could not be detected or anticipated at the time of this investigation. DS Consultants Ltd. cannot be held responsible for hydrogeological conditions at the Site that was not apparent from the available information.

Should you have any questions regarding these findings, please contact the undersigned.

**DS Consultants Ltd.**

Prepared By:

Reviewed By:



**Pradeep Patel, M.Sc. P.Geo.  
Hydrogeologist**

**Martin Gedeon, M.Sc., P.Geo.  
Senior Hydrogeologist**



## 8.0 CONSULTANTS QUALIFICATIONS

**Martin Gedeon, M.Sc., P.Geo.** is a Professional Geoscientist (P.Geo.) with over 26 years of experience as an environmental/hydrogeological consultant in the areas of groundwater and soil monitoring, environmental site assessments, environmental due diligence, and remediation. Martin has significant experience in physical and contaminant hydrogeology across Canada and overseas and has provided hydrogeological/environmental technical support on various projects. Martin has prepared hundreds of hydrogeological reports in support of permit applications for a private sector development application, municipal dewatering operations and provincial infrastructure projects across the province.

**Pradeep Patel, M.Sc., P.Geo.** is a hydrogeologist at DS Consultants Ltd. and has more than 9 years of experience working in the environmental industry. He participates in numerous Hydrogeological and Geotechnical investigation projects. His experience includes the preparation of construction dewatering activities and hydrogeological investigations in support of Environmental Activity and Sector Registry (EASR) and Permit to Take Water (PTTW) applications.

## 9.0 REFERENCES

Appendix F-Hydrogeology Final Report- Lake Ontario Integrated Shoreline Strategy Background Review and Data Gap Analysis by Credit Valley Conservation, September 12, 2011

Chapman, L.J., and D.F. Putnam; The Physiography of Southern Ontario, Third Edition, Ontario Geological Survey Special Volume 2; 1984, & 2007.

Freeze, R.A., and J.A. Cherry. "Groundwater". Prentice-Hall, Inc. Englewood Cliffs, NJ. 1979.

<http://www.ebr.gov.on.ca/>

Ontario Regulation 153/04 made under the Environmental Protection Act, July 1, 2011.


Ontario Regulation 245/11- Environmental Activity and Sector Registry.

Powers, J. Patrick, P.E. (1992); Construction Dewatering: New Methods and Applications - Second Edition, New York: John Wiley & Sons.

Pat M. Cashman and Martin Preene; Groundwater Lowering in Construction- Second Edition, CRC Press.

The Region of Peel Wastewater Bylaw (53-2010).

# FIGURES

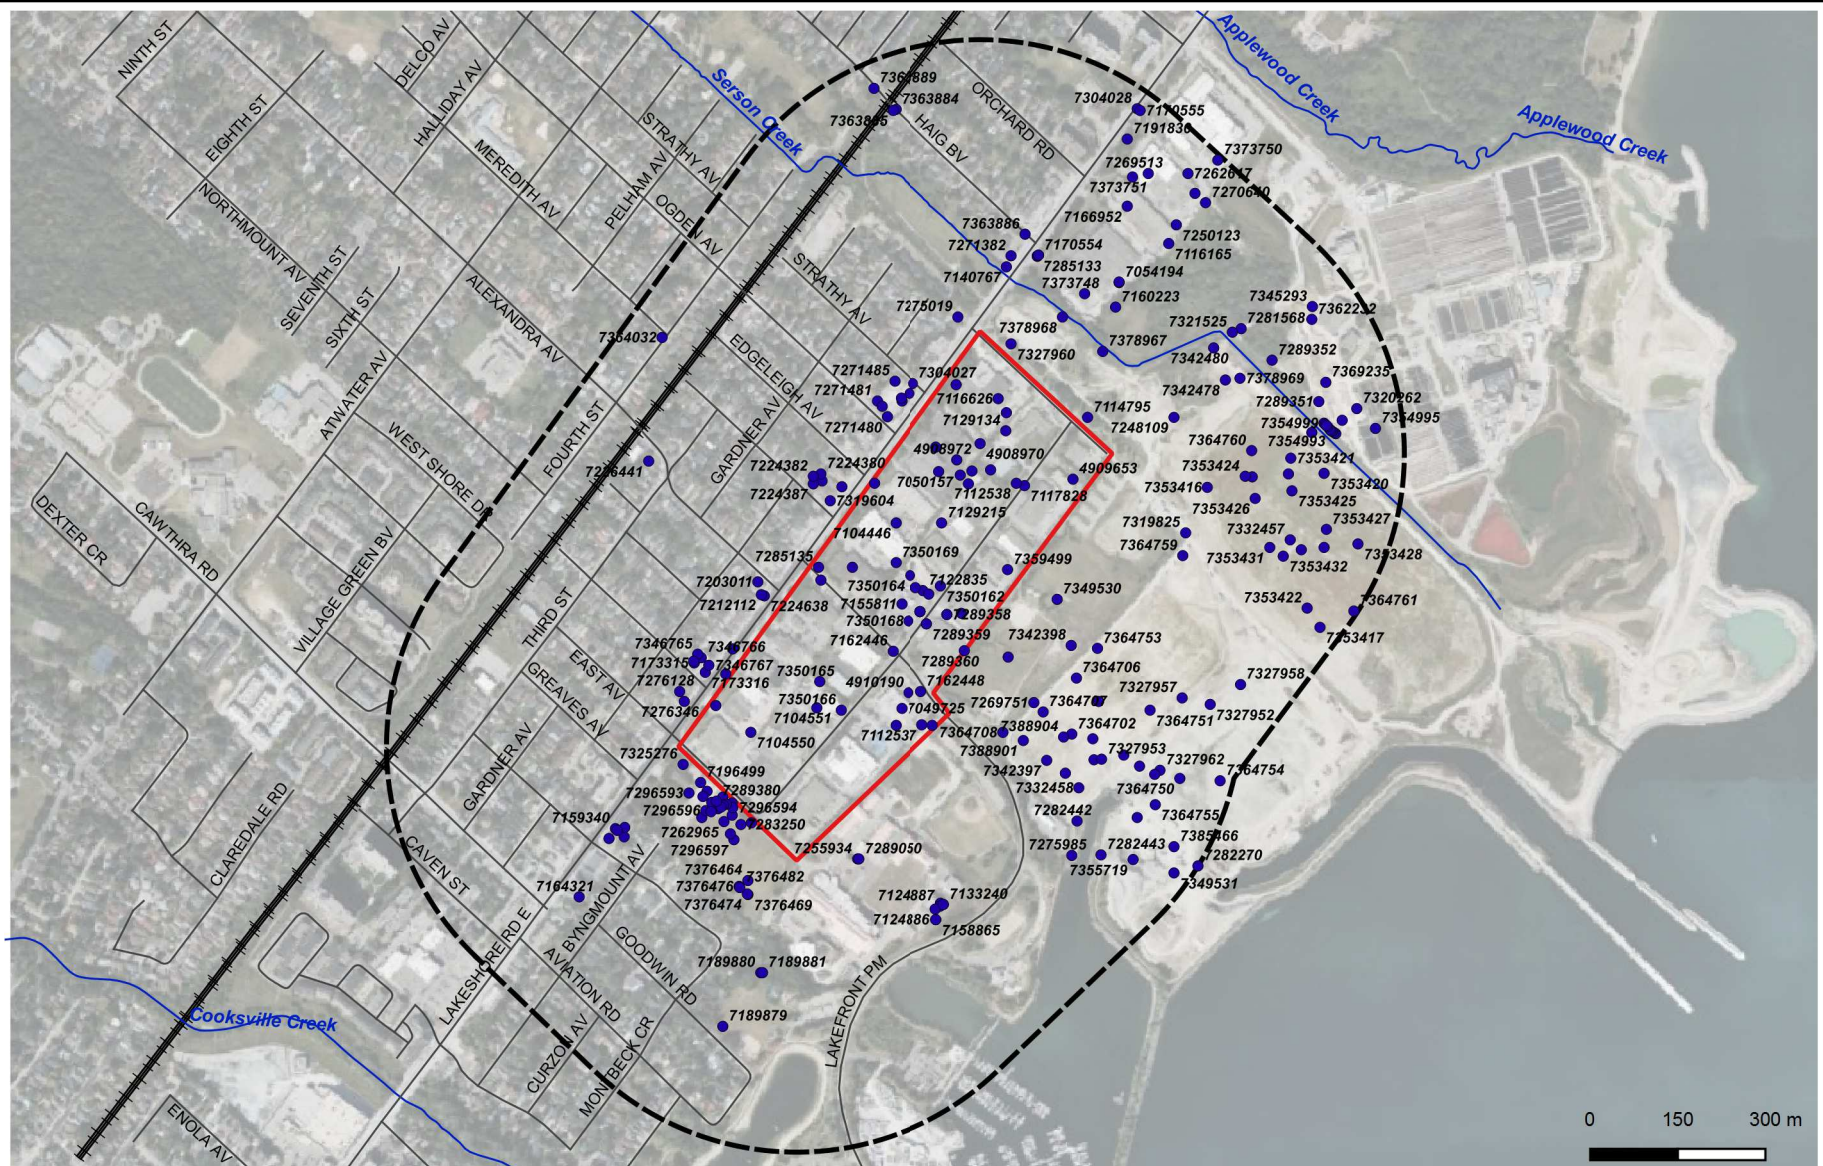

Legend

- Approx Property Boundary
- 500m Buffer
- Registered Water Well (MECP WWR)



**DS CONSULTANTS LTD.**

6221 Highway 7, UNIT 16  
 Vaughan, Ontario L4H 0K8  
 Telephone: (905) 264-9393  
 www.dsconsultants.ca

Client:  
**RANGEVIEW LANDOWNERS  
 GROUP INC.**


Project: **HYDROGEOLOGICAL INVESTIGATION**  
 Rangeview Estate Precinct Development, City of Mississauga, ON

Title: **SITE LOCATION AND MECP WELL RECORDS**



Size: 8.5 x 11	Approved By: P.P	Drawn By: S.Y	Date: October 2022
Rev: 0	Scale: As Shown	Project No.: 22-200-100	Figure No.: <b>1</b>
Image/Map Source: Bing Satellite Image			




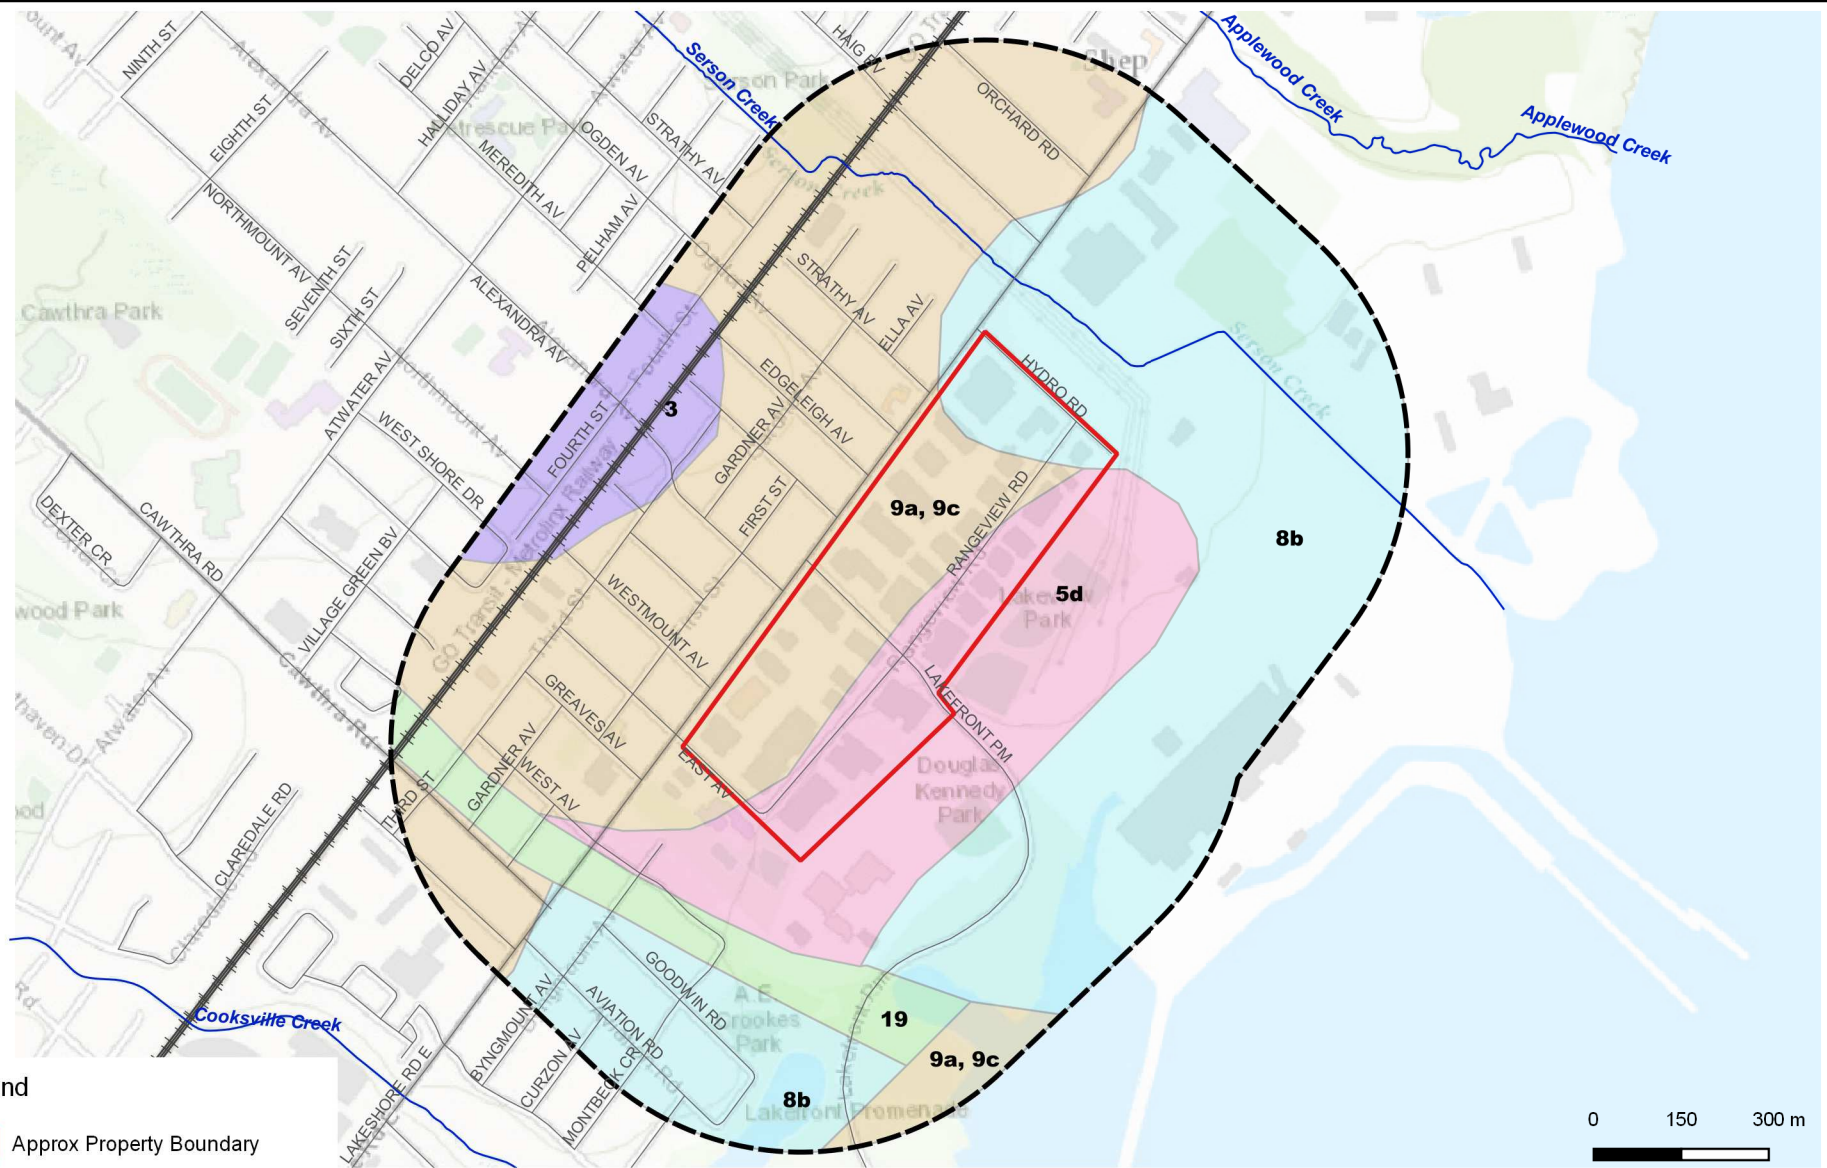


**Legend**

- Approx Property Boundary
- 500m Buffer
- 19 - Modern Alluvium
- 3 - Bedrock
- 5d - Till
- 8b - Glaciolacustrine Deposits
- 9a & 9c - Coarse-textured Glacial Lake Deposits

0 150 300 m



<p><b>DS CONSULTANTS LTD.</b> 6221 Highway 7, UNIT 16 Vaughan, Ontario L4H 0K8 Telephone: (905) 264-9393 www.dsconsultants.ca</p>	Project: HYDROGEOLOGICAL INVESTIGATION Rangeview Estate Precinct Development, City of Mississauga, ON			
	Title: <b>SURFICIAL GEOLOGY MAP</b>			
Client: <b>RANGEVIEW LANDOWNERS GROUP INC.</b>	Size: 8.5 x 11	Approved By: P.P	Drawn By: S.Y	Date: October 2022
	Rev: 0	Scale: As Shown	Project No.: 22-200-100	Figure No.: <b>2</b>
	Image/Map Source: Bing Satellite Image			

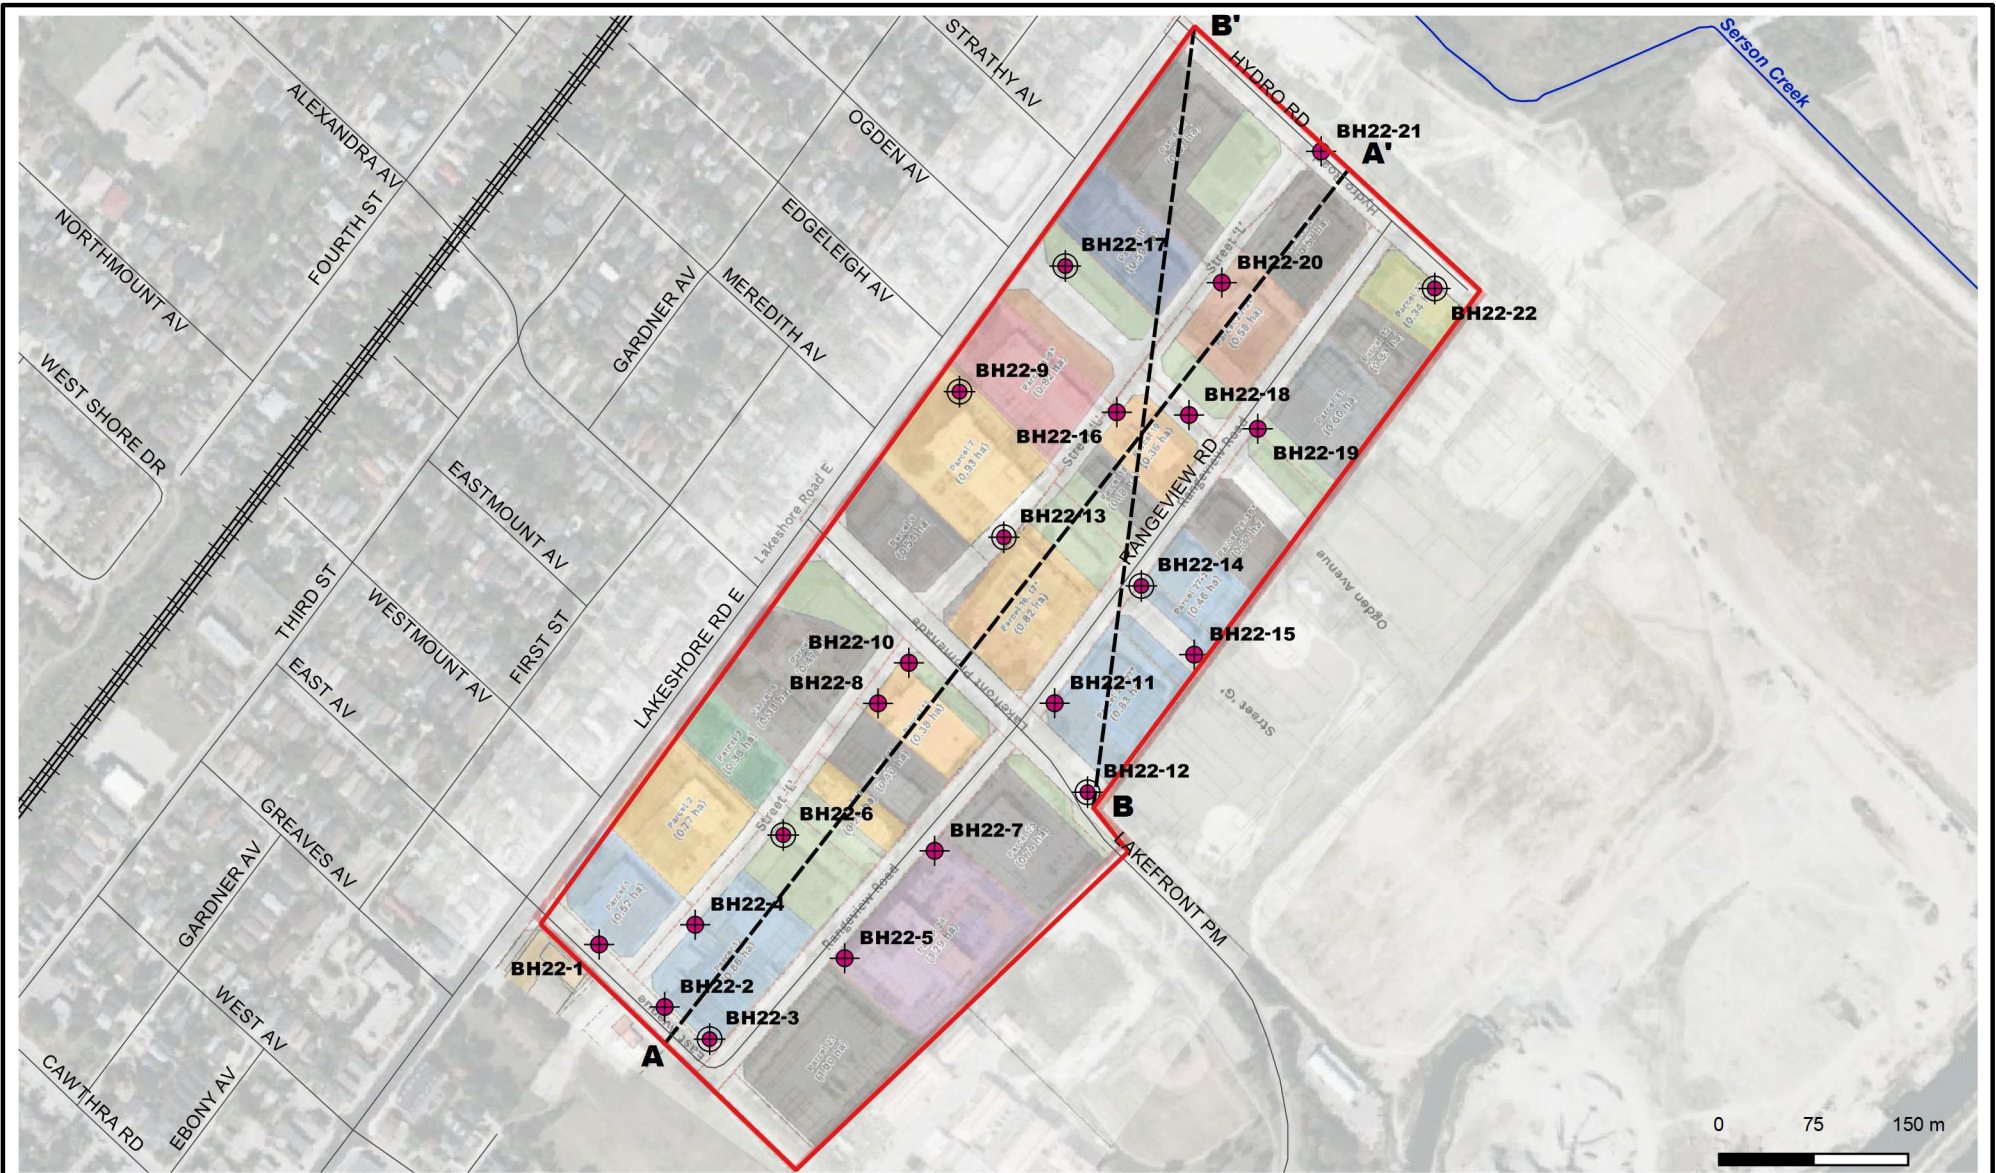

**Legend**

- Approx Property Boundary
- Borehole
- ⊗ Monitoring Well
- Cross Section



**DS CONSULTANTS LTD.**

6221 Highway 7, UNIT 16  
 Vaughan, Ontario L4H 0K8  
 Telephone: (905) 264-9393  
 www.dsconsultants.ca

Client:  
**RANGEVIEW LANDOWNERS  
 GROUP INC.**



Project: **HYDROGEOLOGICAL INVESTIGATION  
 Rangeview Estate Precinct Development, City of Mississauga, ON**


Title: **BOREHOLE AND MONITORING WELL LOCATIONS**





Size: 8.5 x 11	Approved By: P.P	Drawn By: S.Y	Date: May 2023
Rev: 0	Scale: As Shown	Project No.: 22-200-100	Figure No.: <b>3</b>
Image/Map Source: Bing Satellite Image			


Path:c:\0sharon\22-200-100 rangeview estate precinct development\7-misc\cad\geological cross section 22-200.dwg

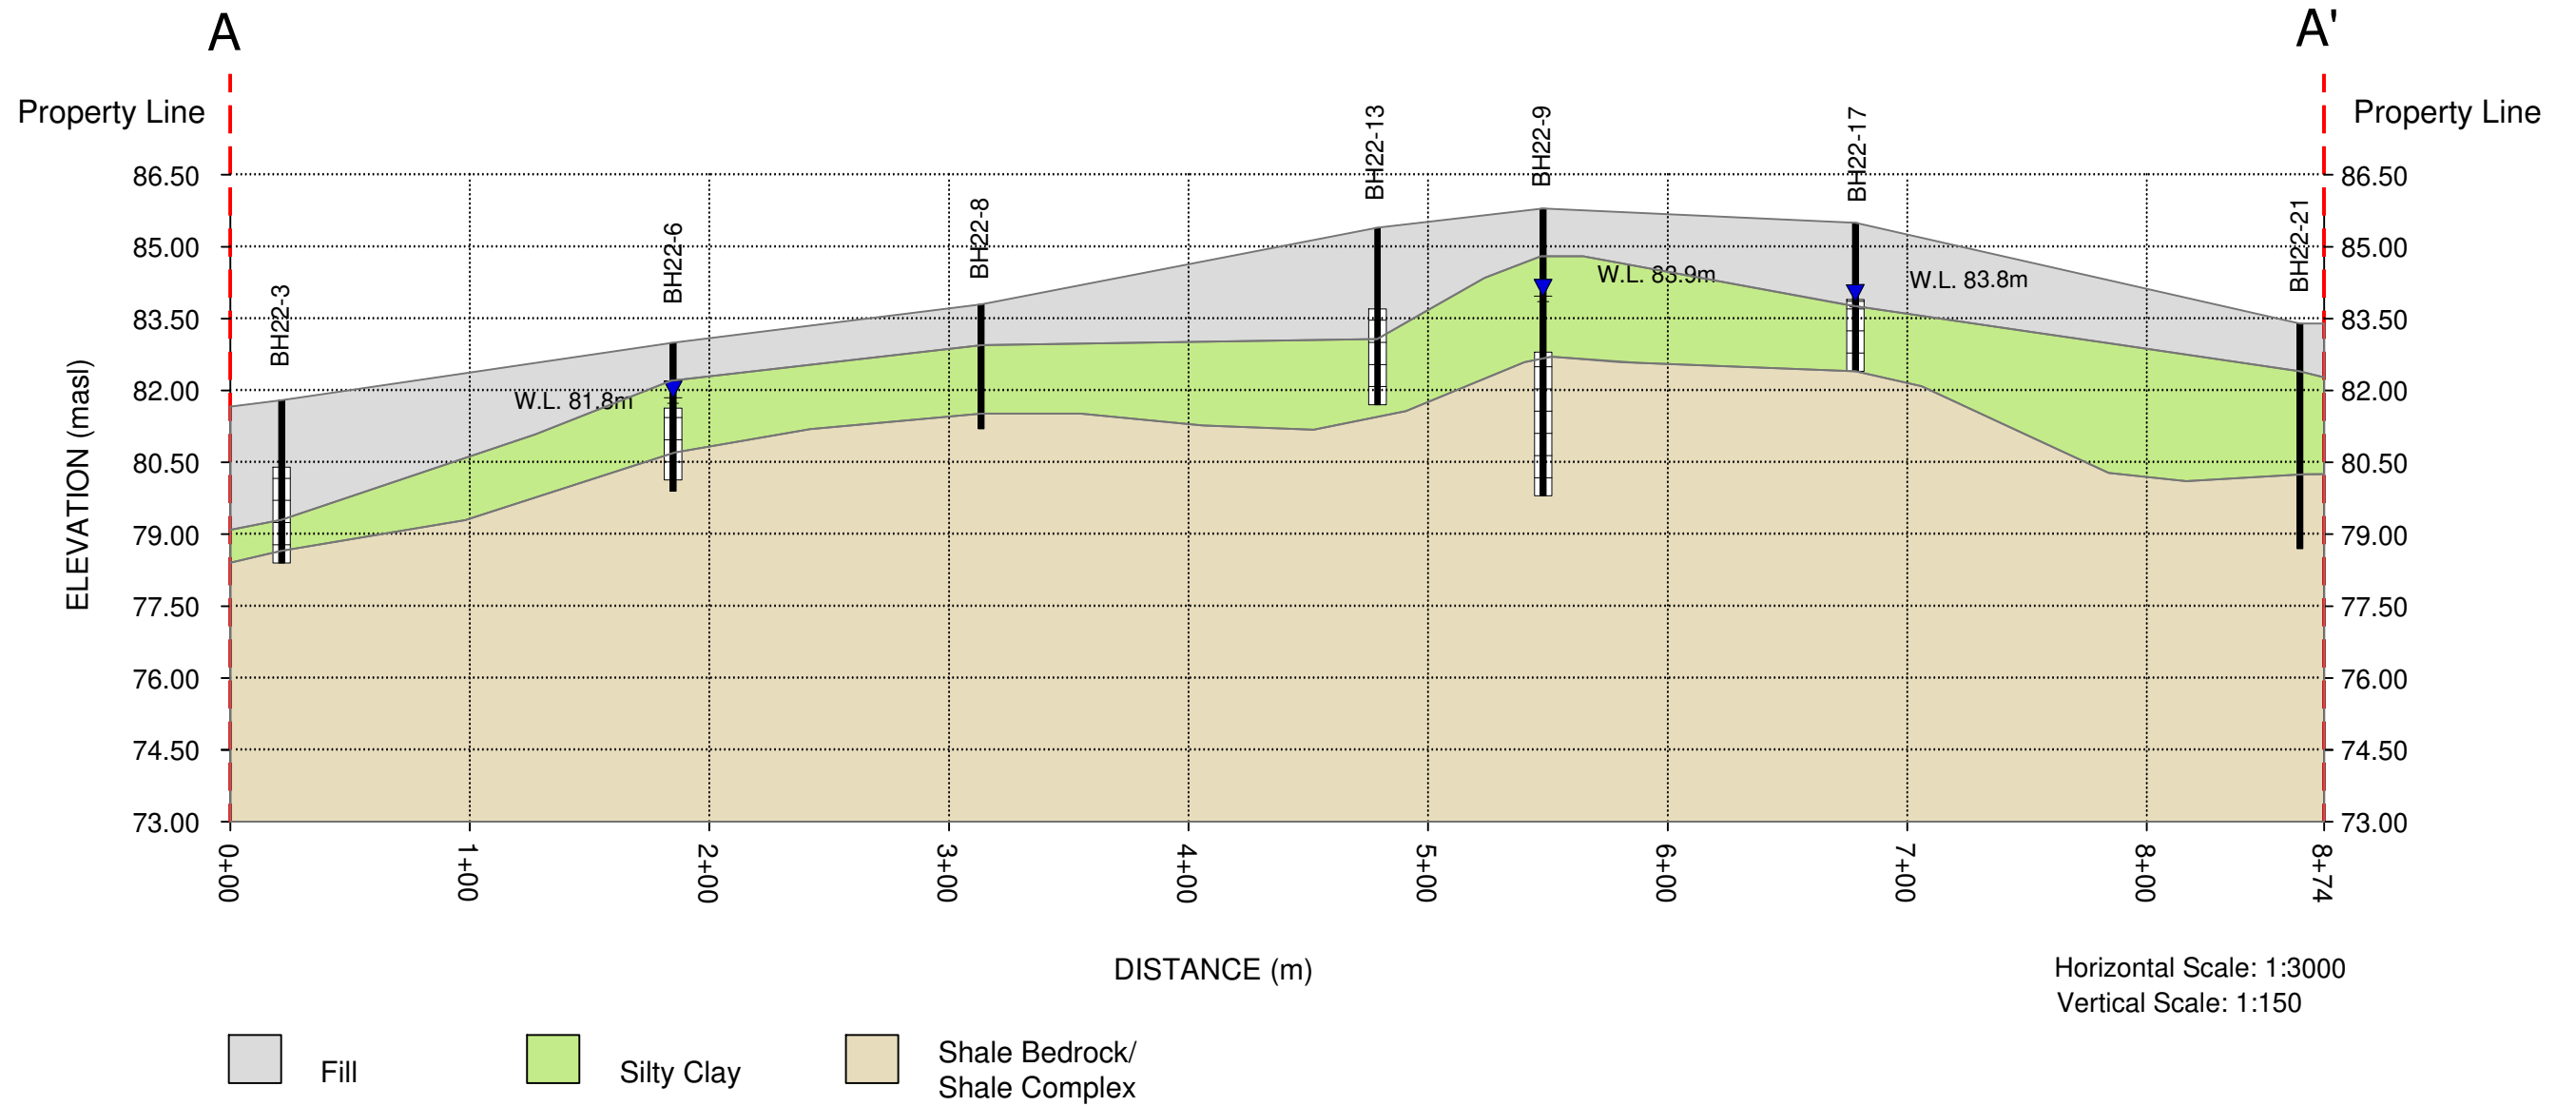

 <b>DS CONSULTANTS LTD.</b> 6221 Highway 7, UNIT 16 Vaughan, Ontario L4H 0K8 Telephone: (905) 264-9393 www.dsconsultants.ca	Project: HYDROGEOLOGICAL INVESTIGATION Rangeview Estate Precinct Development City of Mississauga, ON			
	Title: <b>GEOLOGICAL CROSS SECTION A-A'</b>			
Client: <b>RANGEVIEW LANDOWNERS GROUP INC.</b>	Size: 11 X 17	Approved By: P.P	Drawn By: S.Y	Date: October 2022
	Rev.	Scale: A Shown	Project No: 22-200-100	Figure No. <b>4A</b>

Path:c:\0sharon\22-200-100 rangeview estate precinct development\7-misc\cad\geological cross section 22-200.dwg

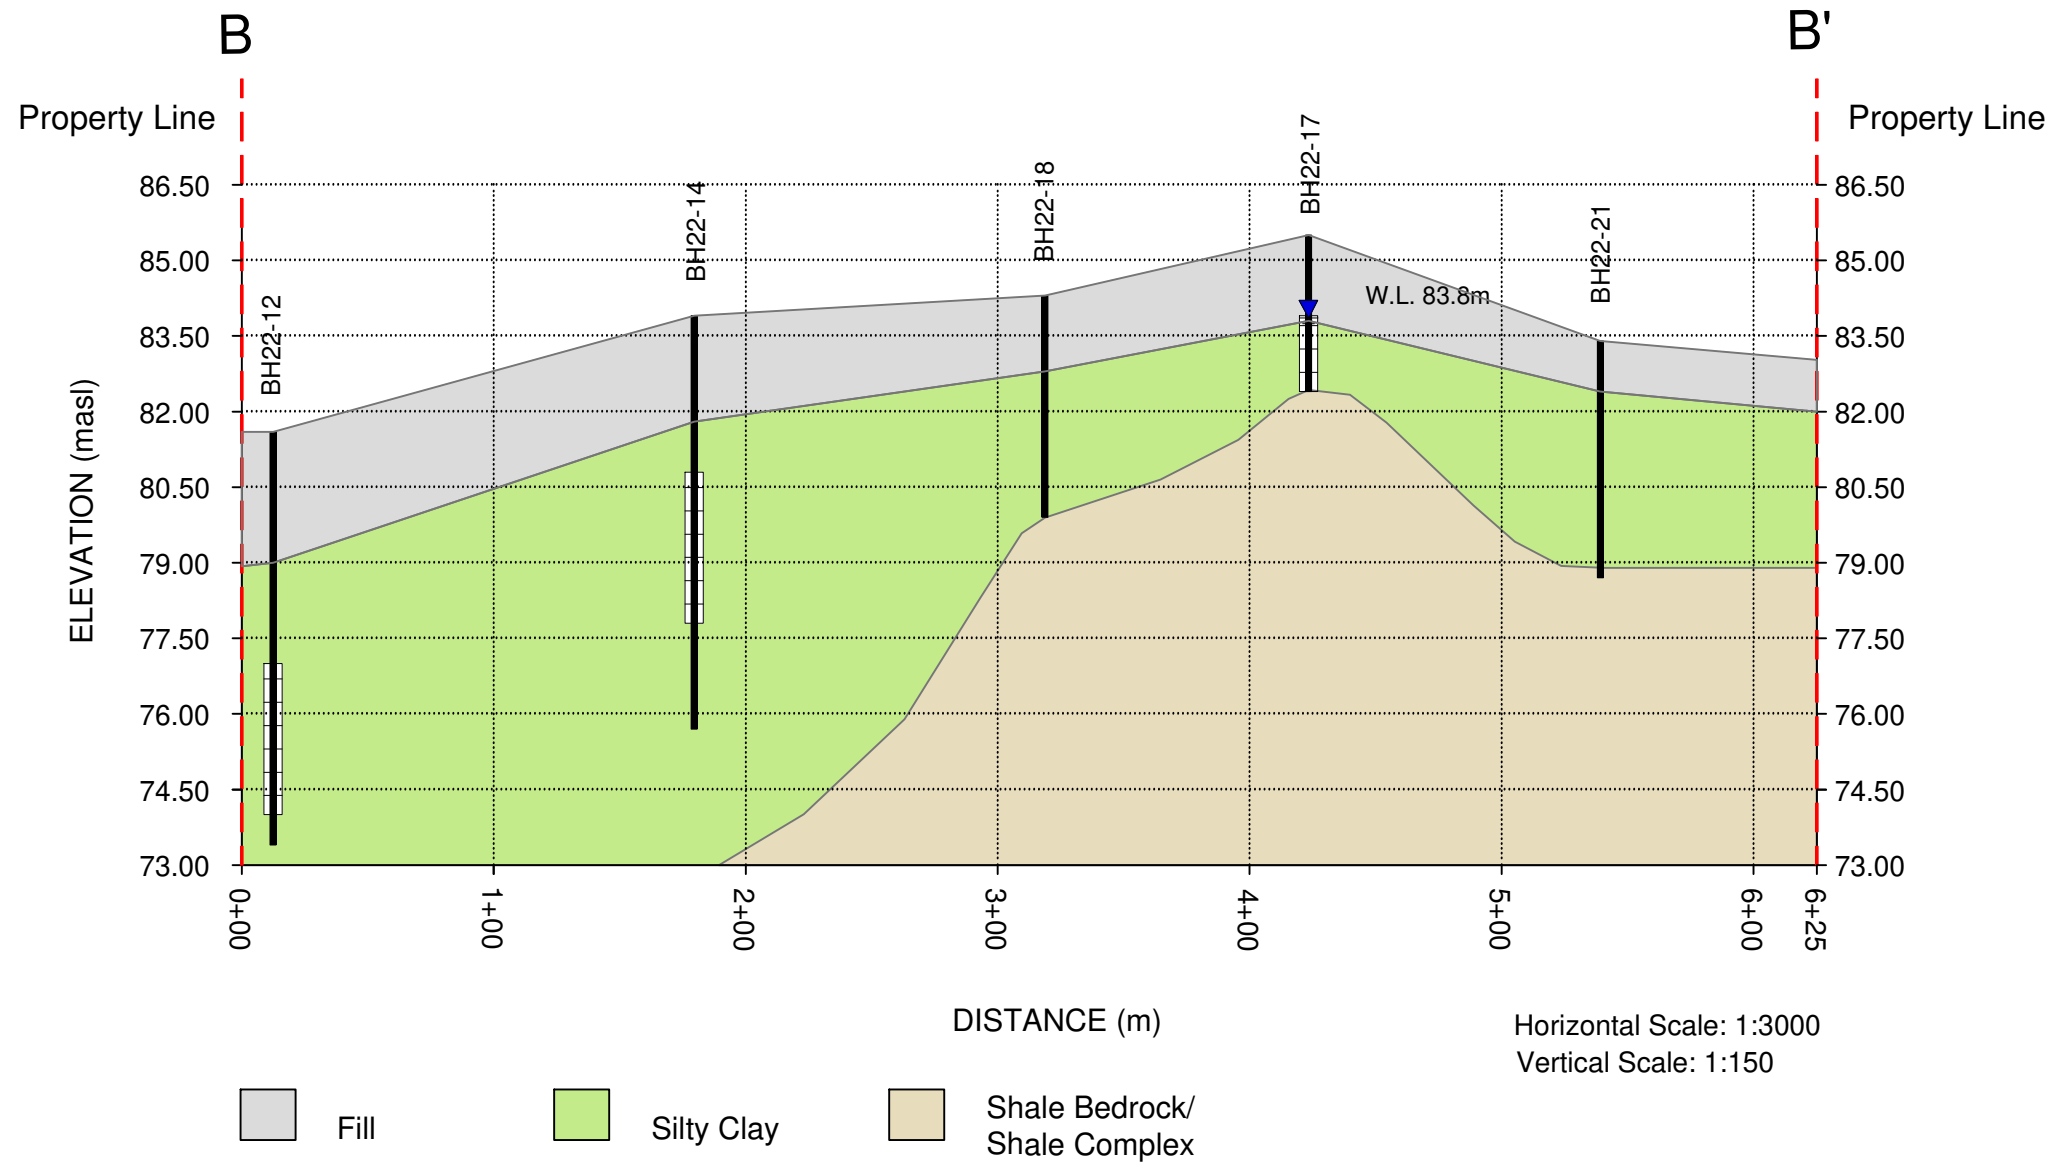

 <b>DS CONSULTANTS LTD.</b> 6221 Highway 7, UNIT 16 Vaughan, Ontario L4H 0K8 Telephone: (905) 264-9393 www.dsconsultants.ca	Project: HYDROGEOLOGICAL INVESTIGATION Rangeview Estate Precinct Development City of Mississauga, ON				
	<b>GEOLOGICAL CROSS SECTION B-B'</b>				
Client:	RANGEVIEW LANDOWNERS GROUP INC.	Size: 11 X 17	Approved By: P.P	Drawn By: S.Y	Date: October 2022
Rev.		Scale: A Shown	Project No: 22-200-100	Figure No. <b>4B</b>	

# **APPENDICES**

## **Appendix A: Borehole Logs**

PROJECT: Geotechnical Investigation  
 CLIENT: Landowners Group Inc.  
 PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON  
 DATUM: Geodetic  
 BH LOCATION: See Drawing 1 N 4825344.14 E 616049.35

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Aug-19-2022  
 REF. NO.: 22-200-100  
 ENCL NO.: 2

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)									
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60	80	100	20	40	60	80	100	10
82.6	ASPHALT: 150mm	[Solid black]																						
82.0	GRANULAR BASE: sand and gravel, 500mm	[Dotted]	1	SS	13																			
80.8	FILL: sand, trace brick pieces, some clay, trace organics, trace gravel, brown, moist, compact	[Cross-hatched]	2	SS	8																			
80.3	FILL: silty clay, trace sand, trace organics, trace gravel, brown, moist, stiff to very stiff	[Diagonal lines]	3	SS	17																			
79.5	SILTY CLAY: trace sand, trace gravel, greyish brown, moist, hard	[Horizontal lines]	4	SS	50/ 75mm																			
78.3	SHALE BEDROCK: grey, weathered	[Horizontal lines]	5	SS	50/ 100mm																			
78.3	END OF BOREHOLE: Notes: 1) Borehole dry upon completion.																							

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3, × 3: Numbers refer to Sensitivity ○ ● = 3% Strain at Failure

PROJECT: Geotechnical Investigation	<b>DRILLING DATA</b>
CLIENT: Landowners Group Inc.	Method: Solid Stem Auger
PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Aug-19-2022
BH LOCATION: See Drawing 1 N 4825294.58 E 616101.31	REF. NO.: 22-200-100
	ENCL NO.: 3

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cp) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
81.7	<b>ASPHALT:</b> 130mm													
80.9 0.1	<b>GRANULAR BASE:</b> sand and gravel, 460mm		1	SS	8									
81.1 0.6 80.9 0.8	<b>FILL:</b> sand and gravel, trace silt, trace clay, trace asphalt pieces, grey, moist, loose <b>FILL:</b> silty clay, some organics, trace gravel, grey, moist, firm to hard		2	SS	7									
80.0 1.7	<b>SILTY CLAY:</b> trace sand, trace gravel, occasional cobble, brown, moist, hard		3	SS	50/ 100mm									
78.5 3.2	<b>SHALE BEDROCK:</b> grey, weathered		4	SS	50/ 100mm									
78.1 3.6	<b>SHALE BEDROCK:</b> grey, weathered		5	SS	50/ 100mm									
3.6	<b>END OF BOREHOLE:</b> Notes: 1) Borehole dry upon completion.													

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure



<b>PROJECT:</b> Geotechnical Investigation <b>CLIENT:</b> Landowners Group Inc. <b>PROJECT LOCATION:</b> Rangeview Estates Precinct Area, Mississauga, ON <b>DATUM:</b> Geodetic <b>BH LOCATION:</b> See Drawing 1 N 4825269.07 E 616136.98	<b>DRILLING DATA</b> Method: Solid Stem Auger Diameter: 150mm Date: Aug-22-2022 REF. NO.: 22-200-100 ENCL NO.: 4
---	---

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (C <sub>u</sub> ) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
81.8	ASPHALT: 100mm													
81.3	GRANULAR BASE: sand and gravel, 450mm		1	SS	7									
81.3	FILL: silty clay, trace to some organics, trace concrete pieces, trace gravel, trace asphalt, grey, moist, firm to stiff		2	SS	5									
80.6			3	SS	11									
79.3			4	SS	57									8 18 48 26
78.7	SILTY CLAY TILL: some sand, trace gravel, occasional cobble, brown, moist, hard													
78.4	SHALE BEDROCK: grey, weathered		5	SS	50/ 130mm									
78.4	END OF BOREHOLE: Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water Level(mbg): Aug 25, 2022 dry													

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Geotechnical Investigation  
 CLIENT: Landowners Group Inc.  
 PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON  
 DATUM: Geodetic  
 BH LOCATION: See Drawing 1 N 4825359.79 E 616125.51

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Jul-15-2022  
 REF. NO.: 22-200-100  
 ENCL NO.: 5

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
82.3	ASPHALT: 180mm													
82.9	GRANULAR BASE/SUB BASE: sand and gravel, 460mm, crusher run limestone (160mm)		1	SS	4									
81.5	SILTY CLAY: trace sand, trace gravel, brown, moist, very stiff to hard		2	SS	17									2 8 62 28
80.0			3	SS	30									
79.9	SILTY CLAY TILL: sandy, trace gravel, brown, moist, hard		4	SS	50/25mm									
78.9	SHALE BEDROCK: Georgian Bay Formation, grey, weathered TCR=75%, SCR=14%, RQD=0		R1	RC	50/75mm									
77.4	TCR=96%, SCR=98%, RQD=28% Hard layer=18%, Maximum hard layer thickness=50mm		R2	RC										
75.9	TCR=93%, SCR=90%, RQD=63% Hard layer=5%, Maximum hard layer thickness=25mm		R3	RC										
74.5	TCR=100%, SCR=98%, RQD=70% Hard layer=9%, Maximum hard layer thickness=25mm		R4	RC										
74.5	END OF BOREHOLE:													

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY GPJ\_DS.GDT 22-9-12

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3, x 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

<p>PROJECT: Geotechnical Investigation          CLIENT: Landowners Group Inc.          PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON          DATUM: Geodetic          BH LOCATION: See Drawing 1 N 4825333.22 E 616244.07</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150mm          Date: Aug-19-2022</p> <p style="text-align: right;">REF. NO.: 22-200-100          ENCL NO.: 6</p>
---	---

(m) ELEV DEPTH	SOIL PROFILE DESCRIPTION	STRATA PLOT	SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
			NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)							PLASTIC LIMIT W <sub>p</sub>
81.7	<b>ASPHALT:</b> 76mm														
81.2	<b>GRANULAR BASE:</b> sand and gravel, 400mm		1	SS	4										
80.5	<b>FILL:</b> silty clay, trace asphalt pieces, sandy, trace concrete pieces, greyish brown, moist, firm to very stiff		2	SS	18		81								
80.3	<b>FILL:</b> sand and gravel, cobbles and boulders, grey, moist, very dense		3	SS	50/ 75mm		80								Auger grinding
79.4	<b>SILTY CLAY TILL:</b> trace sand, some gravel, greyish brown, moist, hard		4	SS	50/ 25mm		79								14 9 57 20
78.6	<b>SHALE BEDROCK:</b> grey, weathered		5	SS	50/ 50mm										
78.5	<b>END OF BOREHOLE:</b> Notes: 1) Borehole dry at bottom upon completion.														

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

<p>PROJECT: Geotechnical Investigation          CLIENT: Landowners Group Inc.          PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON          DATUM: Geodetic          BH LOCATION: See Drawing 1 N 4825430.9 E 616195.37</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150mm          Date: Jul-15-2022</p> <p style="text-align: right;">REF. NO.: 22-200-100          ENCL NO.: 7</p>
--	---

(m) ELEV DEPTH	SOIL PROFILE DESCRIPTION	STRATA PLOT	SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)		
			NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W				LIQUID LIMIT W <sub>L</sub>	GR
83.0	ASPHALT: 200mm															
82.8	GRANULAR BASE: sand and gravel, 380mm		1	SS	8											
82.4	FILL: silty clay, trace sand, trace gravel, some organics, brown, moist, stiff SILTY CLAY TILL: some sand, trace gravel, brown, moist, stiff to hard trace shale fragments below 1.5m		2	SS	11											
82.2			3	SS	50											
80.7			4	SS	50/ 50mm											
79.9	SHALE BEDROCK: grey, weathered															

3.1	<p><b>END OF BOREHOLE:</b>          Notes:          1) 50mm dia. monitoring well installed upon completion.          2) Water Level Readings:           Date: Water Level(mbgl):          Aug 25, 2022 1.15</p>												
-----	---	--	--	--	--	--	--	--	--	--	--	--	--

W. L. 81.8 m  
Aug 25, 2022

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

<p>PROJECT: Geotechnical Investigation          CLIENT: Landowners Group Inc.          PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON          DATUM: Geodetic          BH LOCATION: See Drawing 1 N 4825418.42 E 616315.42</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150mm          Date: Aug-19-2022</p> <p style="text-align: right;">REF. NO.: 22-200-100          ENCL NO.: 8</p>
---	---

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
82.0	<b>ASPHALT:</b> 130mm													
80.0	<b>GRANULAR BASE:</b> sand and gravel, 400mm		1	SS	7									
0.1														
81.6	<b>FILL:</b> silty clay, trace to some organics, trace concrete pieces, trace metal piece, cobbles, trace sand, grey, moist, firm to stiff		2	SS	8									Auger grinding @1.5m
0.4														
80.5	<b>SILT CLAY TILL:</b> some sand, some gravel, greyish brown, moist, hard		3	SS	73									19 17 43 21
1.5														
79.2	<b>SHALE BEDROCK:</b> grey, weathered		4	SS	43									
2.8														
78.8			5	SS	50/30mm									
3.2	<b>END OF BOREHOLE:</b> Notes: 1) Borehole is dry at bottom upon completion after drilling.													

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

<b>PROJECT:</b> Geotechnical Investigation <b>CLIENT:</b> Landowners Group Inc. <b>PROJECT LOCATION:</b> Rangeview Estates Precinct Area, Mississauga, ON <b>DATUM:</b> Geodetic <b>BH LOCATION:</b> See Drawing 1 N 4825535.37 E 616270.56	<b>DRILLING DATA</b> Method: Solid Stem Auger Diameter: 150mm Date: Jul-15-2022 REF. NO.: 22-200-100 ENCL NO.: 9
---	---

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
83.8	ASPHALT: 130mm													
83.0	GRANULAR BASE: sand and gravel, 330mm		1	SS	12									
83.0	FILL: silty clay, trace organics, trace gravel, brown, moist, stiff													
83.0	CLAYEY SILT TILL/SHALE COMPLEX: trace sand, trace gravel, brown to grey, moist, stiff to hard		2	SS	14									no recovery
81.5			3	SS	53									
81.2	SHALE BEDROCK: weathered, grey		4	SS	50/ 150mm									
2.6	END OF BOREHOLE: Notes: 1) Borehole is dry at bottom upon completion after drilling.													

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

PROJECT: Geotechnical Investigation  
 CLIENT: Landowners Group Inc.  
 PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON  
 DATUM: Geodetic  
 BH LOCATION: See Drawing 1 N 4825782.63 E 616335.18

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Aug-23-2022  
 REF. NO.: 22-200-100  
 ENCL NO.: 10

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)									
85.8	ASPHALT: 150mm																
85.3	GRANULAR BASE: sand and gravel, 330mm		1	SS	8												
84.8	FILL: silty clay, trace to some organics, trace gravel, grey, moist, stiff																
84.8	SILTY CLAY TILL: trace to some sand, trace gravel, brown, moist, very stiff to hard		2	SS	18												
84.8			3	SS	50/ 130mm												
84.8			4	SS	50/ 130mm												
84.8	trace shale fragments@2.3m																
82.8	SHALE BEDROCK: weathered, grey		5	SS R1	50/ 130mm RC												
82.8	TCR=100%, SCR=1%, RQD=0% Hard layer=0%, Maximum hard layer thickness=0mm																
82.8	TCR=100%, SCR=86%, RQD=56% Hard layer=25%, Maximum hard layer thickness=100mm																
81.0	TCR=96%, SCR=86%, RQD=72% Hard layer=20%, Maximum hard layer thickness=100mm																
81.0																	
79.8	END OF BOREHOLE:																
6.0	Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water Level(mbgl): Aug 25, 2022 1.83																

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

<p>PROJECT: Geotechnical Investigation          CLIENT: Landowners Group Inc.          PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON          DATUM: Geodetic          BH LOCATION: See Drawing 1 N 4825567.54 E 616294.99</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150mm          Date: Aug-19-2022</p> <p style="text-align: right;">REF. NO.: 22-200-100          ENCL NO.: 11</p>
---	--

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
83.9	ASPHALT: 100mm													
83.6	GRANULAR BASE: sand and gravel, 480mm		1	SS	8									
83.4	FILL: silty clay, trace organics, trace gravel, trace sand, grey, moist, stiff to very stiff													
82.9	SILTY CLAY TILL: sandy, trace gravel, grey, moist, very stiff to hard		2	SS	18									
82.2	CLAYEY SILT TILL/SHALE COMPLEX: trace sand, trace gravel, trace cobbles, grey, moist, hard		3	SS	40									
81.7			4	SS	50/75mm									
80.8	SHALE BEDROCK: grey, weathered		5	SS	50/50mm									Water at 2.4m
80.7	END OF BOREHOLE: Notes: 1) Borehole wet at the bottom upon completion after drilling.													

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12



<b>PROJECT:</b> Geotechnical Investigation	<b>DRILLING DATA</b>	
<b>CLIENT:</b> Landowners Group Inc.	Method: Solid Stem Auger	
<b>PROJECT LOCATION:</b> Rangeview Estates Precinct Area, Mississauga, ON	Diameter: 150mm	REF. NO.: 22-200-100
<b>DATUM:</b> Geodetic	Date: Aug-23-2022	ENCL NO.: 12
<b>BH LOCATION:</b> See Drawing 1 N 4825535.51 E 616410.91		

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT			PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)								
83.1	<b>TOPSOIL:</b> 250mm														
82.9	<b>FILL:</b> silty clay, trace organics, trace topsoil, trace rootlets, trace sand, brown, moist, firm to stiff	1	SS	9											
0.3		2	SS	7											
81.6	<b>SILTY CLAY TILL:</b> sandy, trace gravel, occasional cobble, brown, moist, very stiff to hard  grey below 2.3m	3	SS	50/ 75mm											
1.5		4	SS	30											
		5	SS	22											
		6	SS	17											
77.0	<b>SHALE BEDROCK:</b> grey, weathered	7	SS	50/ 25mm											

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

**END OF BOREHOLE:**  
Notes:  
1) Borehole is wet at bottom upon completion after drilling.

**GROUNDWATER ELEVATIONS**  
Measurement

1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

<b>PROJECT:</b> Geotechnical Investigation	<b>DRILLING DATA</b>
<b>CLIENT:</b> Landowners Group Inc.	Method: Solid Stem Auger
<b>PROJECT LOCATION:</b> Rangeview Estates Precinct Area, Mississauga, ON	Diameter: 150mm
<b>DATUM:</b> Geodetic	Date: Aug-22-2022
<b>BH LOCATION:</b> See Drawing 1 N 4825464.89 E 616436.99	REF. NO.: 22-200-100
	ENCL NO.: 13

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)							
81.6	ASPHALT: 130mm														
80.9	GRANULAR BASE: sand and gravel, 400mm		1	SS	10										
81.2	FILL: sand mixed with black organics, some silt, trace gravel, trace asphalt, black, moist, compact														
80.8			2	SS	5										
80.8			3	SS	6										
79.2	SILTY CLAY TILL: some sand to sandy, trace gravel, brown, moist, hard		4	SS	43										
79.2			5	SS	42										
78.2	grey below 3.1m		6	SS	35										
77.2			7	SS	47										
76.2			8	SS	39										
75.2			9	SS	45										
73.4	END OF BOREHOLE:														
8.2	Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water Level(mbg): Aug 25, 2022 dry														

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY GPJ\_DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, x 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

<b>PROJECT:</b> Geotechnical Investigation	<b>DRILLING DATA</b>
<b>CLIENT:</b> Landowners Group Inc.	Method: Solid Stem Auger
<b>PROJECT LOCATION:</b> Rangeview Estates Precinct Area, Mississauga, ON	Diameter: 150mm
<b>DATUM:</b> Geodetic	Date: Jul-19-2022
<b>BH LOCATION:</b> See Drawing 1 N 4825667.17 E 616370.55	REF. NO.: 22-200-100
	ENCL NO.: 14

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						WATER CONTENT (%)
85.4	ASPHALT: 180mm													
85.2	GRANULAR BASE/SUB BASE: sand and gravel, 380mm, crusher run limestone (200mm)	[Symbol]	1	SS	23									
84.6														
84.6	FILL: silty clay, some organics, some sand, trace gravel, grey, moist, stiff to very stiff	[Symbol]	2	SS	10									
83.1	SILTY CLAY TILL: some sand, some gravel, brown, moist, hard  trace shale fragments below 3.0m	[Symbol]	3	SS	22									
83.1			4	SS	50									13 18 47 22
81.7			5	SS	75									

**3.7 END OF BOREHOLE:**  
Notes:  
1) Auger refusal @3.7m on possible boulder or bedrock.  
2) 50mm dia. monitoring well installed upon completion.  
3) Water Level Readings:  
  
Date: Water Level(mbg):  
Aug 25, 2022 1.57

W. L. 83.8 m  
Aug 25, 2022

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

<b>PROJECT:</b> Geotechnical Investigation	<b>DRILLING DATA</b>
<b>CLIENT:</b> Landowners Group Inc.	Method: Solid Stem Auger
<b>PROJECT LOCATION:</b> Rangeview Estates Precinct Area, Mississauga, ON	Diameter: 150mm
<b>DATUM:</b> Geodetic	Date: Aug-23-2022
<b>BH LOCATION:</b> See Drawing 1 N 4825628.56 E 616479.7	REF. NO.: 22-200-100
	ENCL NO.: 15

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (MPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
83.9	<b>ASPHALT:</b> 150mm													
83.0	<b>GRANULAR BASE:</b> sand and gravel, 430mm	1	SS	13										
83.5	<b>FILL:</b> silty clay, some organics, trace gravel, trace sand, trace asphalt, grey, moist, firm to very stiff	2	SS	4										
0.4		3	SS	26										
81.8	<b>SILTY CLAY TILL:</b> sandy, trace gravel, occasional cobble, brown, moist, very stiff to hard	4	SS	42										
2.1		5	SS	66										
	grey below 3.9m	6	SS	46										
		7	SS	46										
		8	SS	36										
75.7	<b>END OF BOREHOLE:</b> Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water level(mbg): Aug 25, 2022 dry													

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY GPJ\_DS\_GDT\_22-9-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Geotechnical Investigation  
 CLIENT: Landowners Group Inc.  
 PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON  
 DATUM: Geodetic  
 BH LOCATION: See Drawing 1 N 4825574.05 E 616521.61

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Jul-15-2022  
 REF. NO.: 22-200-100  
 ENCL NO.: 16

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)							WATER CONTENT (%)
83.3															
0.0 83.0	<b>GRANULAR FILL:</b> sand and gravel, 280mm		1	SS	21										
0.3	<b>FILL:</b> sand & gravel, trace brick pieces, grey, moist, compact														
82.5	<b>FILL:</b> silty clay, trace to some organics, grey, moist, firm														
0.8			2	SS	5										
81.8	<b>SILTY CLAY:</b> trace sand, trace gravel, brown, moist, stiff														
1.5			3	SS	11										
81.0	<b>SILTY CLAY TILL:</b> sandy, trace gravel, occasional cobble, brown, moist, hard														
2.3			4	SS	44										
			5	SS	86										
			6	SS	47										
	grey below 6.1m														
			7	SS	50										
			8	SS	46										
75.1															
8.2	<b>END OF BOREHOLE:</b> Notes: 1) Borehole is wet at bottom upon completion after drilling.														

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY GPJ\_DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES**  
 + 3 , × 3 : Numbers refer to Sensitivity  
 ○ ● = 3% Strain at Failure

<p>PROJECT: Geotechnical Investigation          CLIENT: Landowners Group Inc.          PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON          DATUM: Geodetic          BH LOCATION: See Drawing 1 N 4825766.27 E 616460.23</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150mm          Date: Jul-18-2022</p> <p style="text-align: right;">REF. NO.: 22-200-100          ENCL NO.: 17</p>
---	--

(m) ELEV DEPTH	SOIL PROFILE DESCRIPTION	STRATA PLOT	SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)				
			NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)		PLASTIC LIMIT	NATURAL MOISTURE CONTENT				LIQUID LIMIT	W <sub>p</sub>	W	W <sub>L</sub>
84.6	<b>ASPHALT:</b> 150mm																	
84.0	<b>GRANULAR BASE:</b> sand and gravel, 250mm		1	SS	9													
84.2	<b>FILL:</b> silty clay, some organics, some sand, trace gravel, grey, moist, stiff																	
83.4	<b>CLAYEY SILT TO SILT:</b> trace sand, brown, moist, stiff to hard		2	SS	11													
82.3	<b>CLAYEY SILT:</b> , trace sand, trace gravel, brown, moist, hard		3	SS	30													0 7 76 17
81.5	<b>SHALE BEDROCK:</b> grey, weathered		5	SS	50/30mm													
81.4	<b>END OF BOREHOLE:</b> Notes: 1) Borehole is dry at bottom upon completion after drilling.																	

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

<b>PROJECT:</b> Geotechnical Investigation <b>CLIENT:</b> Landowners Group Inc. <b>PROJECT LOCATION:</b> Rangeview Estates Precinct Area, Mississauga, ON <b>DATUM:</b> Geodetic <b>BH LOCATION:</b> See Drawing 1 N 4825882.25 E 616419.37	<b>DRILLING DATA</b> Method: Solid Stem Auger Diameter: 150mm Date: Jul-18-2022 REF. NO.: 22-200-100 ENCL NO.: 18
---	--

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60
85.5	ASPHALT: 150mm															
86.0	GRANULAR BASE/SUB BASE: sand and gravel, 380mm, crusher run limestone (300mm)		1	SS	12											
84.7	FILL: clayey silt, trace organics, grey, moist, firm to very stiff		2	SS	7											
83.8	SILTY CLAY TILL: some sand, trace to some gravel, trace shale fragments, brown, moist, very stiff to hard		3	SS	29											
82.4	augar refusal at 3.1m on possible boulder or bedrock		4	SS	54											
3.1	<b>END OF BOREHOLE:</b> Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water Level(mbg): Aug 25, 2022 1.64															

W. L. 83.8 m  
Aug 25, 2022

10 10 56 24

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Geotechnical Investigation CLIENT: Landowners Group Inc. PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON DATUM: Geodetic BH LOCATION: See Drawing 1 N 4825764.09 E 616517.47	<b>DRILLING DATA</b> Method: Solid Stem Auger Diameter: 150mm Date: Jul-18-2022 REF. NO.: 22-200-100 ENCL NO.: 19
--	--

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
84.3	<b>ASPHALT:</b> 130mm													
84.0	<b>GRANULAR BASE:</b> sand and gravel, 380mm		1	SS	16									
83.8	<b>FILL:</b> silty clay, some organics, trace asphalt, grey, moist, firm to very stiff		2	SS	6									
82.8	<b>CLAYEY SILT TO SILT:</b> trace sand, trace gravel, brown to grey, moist, very stiff to hard		3	SS	15									
			4	SS	31									
			5	SS	29									
79.9			6	SS	50/25mm									

**END OF BOREHOLE:**  
 Notes:  
 1) No recovery@4.3m, auger refusal on possible boulder or bedrock at 4.4m.  
 2) Borehole was wet at bottom upon completion of drilling.

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12



PROJECT: Geotechnical Investigation  
 CLIENT: Landowners Group Inc.  
 PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON  
 DATUM: Geodetic  
 BH LOCATION: See Drawing 1 N 4825753.18 E 616572.03

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Aug-23-2022  
 REF. NO.: 22-200-100  
 ENCL NO.: 20

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
83.6															
83.6	ASPHALT: 150mm														
83.3	GRANULAR BASE: sand and gravel, 230mm		1	SS	23										
82.8	FILL: clayey silt, sandy, trace gravel, greyish brown, moist, very stiff														
82.8	SILTY CLAY TILL: sandy, trace gravel, occasional cobble, brown, moist, hard		2	SS	31										
			3	SS	50/ 100mm										
	grey below 2.3m		4	SS	56										
			5	SS	42										
			6	SS	34										
			7	SS	41										
			8	SS	45										
75.4	END OF BOREHOLE:														
8.2	Notes: 1) Borehole is wet at the bottom upon completion after drilling.														

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY GPJ DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Geotechnical Investigation CLIENT: Landowners Group Inc. PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON DATUM: Geodetic BH LOCATION: See Drawing 1 N 4825869.08 E 616543.51	<b>DRILLING DATA</b> Method: Solid Stem Auger Diameter: 150mm Date: Aug-23-2022 REF. NO.: 22-200-100 ENCL NO.: 21
--	--

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)									
83.7 83.6 0.1	<b>GRANULAR FILL:</b> sand and gravel, 130mm <b>FILL:</b> silty clay, trace sand, trace organics, greyish brown, moist, stiff to very stiff		1	SS	14												
82.7 1.0			<b>SILTY CLAY TILL:</b> sandy, trace gravel, occasional cobble, brown, moist, very stiff to hard	2	SS	19											
81.4 2.3 81.2 2.5	<b>SHALE BEDROCK:</b> grey, weathered <b>END OF BOREHOLE:</b> Notes: 1) Borehole is dry at bottom upon completion after drilling.			3	SS	50/ 50mm											
			4	SS	50/ 25mm												

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

PROJECT: Geotechnical Investigation  
 CLIENT: Landowners Group Inc.  
 PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON  
 DATUM: Geodetic  
 BH LOCATION: See Drawing 1 N 4825973.2 E 616622.29

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Jul-19-2022  
 REF. NO.: 22-200-100  
 ENCL NO.: 22

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)						
(m) ELEV. DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)							W <sub>p</sub>	W	W <sub>L</sub>	GR SA SI CL		
83.4	ASPHALT: 150mm																			
83.0	GRANULAR BASE: sand and gravel, 380mm		1	SS	13															
82.9																				
82.4	FILL: sand, some asphalt pieces, trace gravel, dark brown, moist, loose to compact																			
82.4	SILTY CLAY: trace sand, brown, moist, stiff to very stiff		2	SS	8															
82.0			3	SS	20												0	4	68	28
81.5			4	SS	25															
80.3																				
80.3	CLAYEY SILT TILL/SHALE COMPLEX: trace sand, trace gravel, grey, moist, hard		5	SS	69															
78.9																				
78.5	SHALE BEDROCK: grey, weathered		6	SS	50/50mm															
78.7	END OF BOREHOLE: Notes: 1) Borehole is dry at bottom upon completion after drilling.																			

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY.GPJ DS.GDT 22-9-12

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3, × 3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Geotechnical Investigation  
 CLIENT: Landowners Group Inc.  
 PROJECT LOCATION: Rangeview Estates Precinct Area, Mississauga, ON  
 DATUM: Geodetic  
 BH LOCATION: See Drawing 1 N 4825864.46 E 616712.36

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Aug-22-2022  
 REF. NO.: 22-200-100  
 ENCL NO.: 23

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100
83.1	ASPHALT: 130mm														
83.0	GRANULAR BASE: sand and gravel, 430mm		1	SS	4										
82.6	FILL: silty clay, trace to some organics, some sand, trace concrete piece, grey, moist, firm to stiff		2	SS	10										
81.7	SILTY CLAY TILL: some sand to sandy, trace gravel, occasional cobble, brown, moist, very stiff to hard		3	SS	40										
1.4	grey below 2.3m		4	SS	41										
			5	SS	32										
			6	SS	28										
			7	SS	40										
	silt seams @7.6m		8	SS	48										
74.9	END OF BOREHOLE: Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water Level(mbg): Aug 25, 2022 dry														

DS SOIL LOG-2021-FINAL 22-200-100 GEO COPY GPJ\_DS.GDT 22-9-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

## **Appendix B: MECP Water Wells Records**

Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

TOWNSHIP C	E	N	DATE CNTR	CASING	WATER	PUMP TEST	WELL USE	SCREEN	WELL	FORMATION
MISSISSAUGA CITY	616386	4825953	2016/08 3349	2					7271484	
MISSISSAUGA CITY	616374	4825987	2016/08 3349	2					7271485	
MISSISSAUGA CITY	616075	4825265	2016/09 7472	2			MO	0005 10	7272677	BRWN FILL 0005 BRWN SAND CLAY 0010 BRWN SAND 0015
MISSISSAUGA CITY	616484	4826097	2016/08 7075	2			MO	0010 10	7275019	BRWN SILT CLAY HARD 0008 GREY SILT CLAY HARD 0014 GREY SHLE HARD 0020
MISSISSAUGA CITY	616679	4825174	2016/08 7215	2	10		TH	0006 5	7275985	BRWN CLAY GRNT DRY 0005 GREY SHLE 0011
MISSISSAUGA CITY	616005	4825455	2016/08 7215						7276128	
MISSISSAUGA CITY	616013	4825438	2016/07 7215						7276346	
MISSISSAUGA CITY	616150	4825619	2014/05 6946						7224638	
MISSISSAUGA CITY	616895	4825156	2016/12 7464						7282270	
MISSISSAUGA CITY	616344	4825953	2016/08 3349	2					7271481	
MISSISSAUGA CITY	616688	4825233	2016/11 7215	2			TH	0020 5	7282442	FILL 0007 CLAY SILT 0018 SHLE WTHD 0025
MISSISSAUGA CITY	616729	4825175	2016/11 7215	2			TH	0005 15	7282443	FILL 0005 CLAY SILT TILL 0018 SHLE WTHD 0020
MISSISSAUGA CITY	616095	4825243	2017/02 7472						7283249	
MISSISSAUGA CITY	616110	4825227	2017/02 7472						7283250	
MISSISSAUGA CITY	616096	4825528	2017/02 7472						7283251	
MISSISSAUGA CITY	616079	4825274	2017/02 7472						7283252	
MISSISSAUGA CITY	616969	4826077	2016/06 6032	2			MO	0012 10	7281568	
MISSISSAUGA CITY	616095	4825264	2016/03 7360	2			MO	0010 5	7262964	BRWN FILL 0010 GREY DNSE HARD 0015
MISSISSAUGA CITY	616043	4825239	2014/10 7241	2			MT	0007 5	7231445	
MISSISSAUGA CITY	616854	4825925	2015/06 6032						7248109	
MISSISSAUGA CITY	616858	4826255	2015/01 7215						7250123	
MISSISSAUGA CITY	616310	4825168	2015/12 7403	2	UT 0025		MO	0020 10	7255934	BRWN SAND SHLE FILL 0002 GREY SHLE ROCK 0030
MISSISSAUGA CITY	616400	4825966	2016/08 3349	2					7271483	
MISSISSAUGA CITY	616128	4825230	2015/03 7360	2			MO	0010 5	7262963	BRWN FILL 0010 GREY DNSE HARD 0015
MISSISSAUGA CITY	616352	4825944	2016/08 3349	2					7271482	
MISSISSAUGA CITY	616081	4825232	2015/03 7360	2	UT 0005		MO	0015 5	7262965	BRWN FILL 0015 GREY DNSE HARD 0020
MISSISSAUGA CITY	616810	4826343	2015/12 7215						7269513	
MISSISSAUGA CITY	616614	4825436	2014/12 7215						7269751	
MISSISSAUGA CITY	616908	4826293	2015/09 7215						7270640	
MISSISSAUGA CITY	616575	4826202	2016/06 7215						7271382	
MISSISSAUGA CITY	616361	4825926	2016/07 3349	2					7271480	
MISSISSAUGA CITY	616620	4826201	2017/03 7148						7285134	
MISSISSAUGA CITY	616878	4826343	2015/03 6607						7262617	
MISSISSAUGA CITY	616791	4826454	2018/01 7610						7304028	

Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

MISSISSAUGA CITY	616096	4825256	2017/08 7241	2			OT	0010 10	7296594	
MISSISSAUGA CITY	616085	4825262	2017/08 7241	2			OT	0010 10	7296595	
MISSISSAUGA CITY	616050	4825251	2017/08 7241	2			OT	0010 10	7296596	
MISSISSAUGA CITY	616098	4825201	2017/08 7241	2			OT	0010 10	7296597	
MISSISSAUGA CITY	616071	4825254	2017/08 7241	2			OT	0010 10	7296598	
MISSISSAUGA CITY	616092	4825211	2017/08 7241	2			OT	0010 10	7296599	
MISSISSAUGA CITY	616406	4825983	2018/01 7610						7304027	
MISSISSAUGA CITY	616263	4825782	2018/05 7295	1.79			MO	0015 10	7319604	BLCK LOAM 0002 GREY FILL DRY 0005 LMSN DRY 0025
MISSISSAUGA CITY	616283	4825806	2018/05 7295	1.79			MO	0015 10	7319605	BLCK LOAM 0002 GREY FILL DRY 0005 ROCK LMSN 0025
MISSISSAUGA CITY	616249	4825816	2018/05 7295	1.79			MO	0015 10	7319606	BLCK LOAM ---- 0002 GREY FILL DRY 0005 ROCK LMSN DRY 0025
MISSISSAUGA CITY	616874	4825727	2018/07 7472	2			MO	0040 10	7319825	BRWN GRVL FILL SOFT 0005 BRWN TILL CLAY 0050
MISSISSAUGA CITY	616954	4826071	2018/01 7383	2			TH MO	0015 10	7321525	SILT SAND 0025
MISSISSAUGA CITY	616080	4825260	2017/08 7241	2			OT	0010 10	7296600	
MISSISSAUGA CITY	616430	4825571	2017/01 7383	2			TH MO	0010 10	7289359	SILT TILL 0020
MISSISSAUGA CITY	616234	4825811	2014/06 7241	2			MT	0008 10	7224387	BRWN SILT SAND 0007 GREY SHLE 0018
MISSISSAUGA CITY	616243	4825668	2017/03 7148						7285135	
MISSISSAUGA CITY	616052	4825284	2017/04 7383	2			TH	0012 5	7288973	SAND GRVL 0005 CLAY SLTY 0010 SHLE 0017
MISSISSAUGA CITY	616045	4825275	2017/04 7383	2			TH	0012 5	7288974	SAND GRVL 0005 CLAY SLTY 0010 SHLE 0017
MISSISSAUGA CITY	616063	4825257	2017/04 7383	2			TH	0012 5	7288975	SAND GRVL 0005 CLAY SLTY 0010 SHLE 0017
MISSISSAUGA CITY	616312	4825168	2017/05 6875				MO		7289050	
MISSISSAUGA CITY	617102	4825952	2016/10 7383	2			TH MO	0017 10	7289351	
MISSISSAUGA CITY	616021	4825281	2017/08 7241	2			OT	0010 10	7296593	
MISSISSAUGA CITY	616465	4825587	2017/01 7383	2			TH MO	0010 10	7289358	SILT TILL 0020
MISSISSAUGA CITY	616620	4826202	2017/03 7148						7285133	
MISSISSAUGA CITY	616495	4825525	2017/02 7383	2			TH	0035 10	7289360	SILT CLAY TILL 0045
MISSISSAUGA CITY	616465	4825587	2017/02 7383	2			TH	0037 10	7289361	SILT CLAY TILL 0047
MISSISSAUGA CITY	616430	4825571	2017/02 7383	2			TH	0027 10	7289362	SILT CLAY TILL 0037
MISSISSAUGA CITY	616060	4825265	2017/02 7383	2			TH	0009 5	7289377	
MISSISSAUGA CITY	616059	4825249	2017/02 7383	2			TH	0012 5	7289378	
MISSISSAUGA CITY	616076	4825257	2017/02 7383	2			TH	0012 5	7289379	
MISSISSAUGA CITY	616068	4825267	2017/02 7383	2			TH	0012 5	7289380	
MISSISSAUGA CITY	617022	4826023	2016/10 7383	2			TH MO	0013 10	7289352	
MISSISSAUGA CITY	616566	4825902	2008/01 6607	1.25			MO		7129134	BRWN SAND GRVL 0001 BRWN SILT SAND CLAY 0009 GREY SHLE LMSN FCRD 0025
MISSISSAUGA CITY	616598	4825808	2008/11 7215				TH	0013 10	7117828	BRWN CLAY 0008 GREY CLAY 0016 GREY CLAY WBRG 0023

**Table: MECP Water Wells Records (500 m Radius)****Location: Rangview Road, Mississauga**

MISSISSAUGA CITY	616424	4825628	2009/04 7241	1.25			MO		7122835	BRWN CLAY TILL 0008 RED SHLE WTHD 0014
MISSISSAUGA CITY	616454	4825092	2009/04 1663	2	UT	//4/1:0	MO	0013 5	7124885	GREY CLAY SAND GRVL 0013 GREY CLAY SAND SILT 0018
MISSISSAUGA CITY	615952	4825850	2014/07 6902	2	OT			0017 10	7226441	GREY CLAY SILT 0002 GREY SILT CLAY DNSE 0006 BRWN SILT SHLE 0012 GREY SHLE DRY 0025 GREY SHLE DRY 0028
MISSISSAUGA CITY	616453	4825087	2009/04 1663	6.11	UT	13/20/100/1:0	TH	0071 4 007	7124887	GREY CLAY SAND STNS 0027 GREY CLAY STNS SILT 0071 GREY CSND GRVL 0078
MISSISSAUGA CITY	616553	4825957	2008/11 7147	1.97			NU		7116626	GREY CMTD 0001 BRWN FILL 0002 BRWN TILL 0010 BRWN SHLE
MISSISSAUGA CITY	616456	4825744	2008/02 6607	1.25	FR 0028		MO		7129215	BRWN SAND GRVL FILL 0002 BRWN SILT CLAY SAND 0009 GREY SILT CLAY SAND 0013 GREY SHLE LMSN FCRD 0030
MISSISSAUGA CITY	615910	4825206	2009/07 7247	2			MO	0007 10	7130477	BRWN LOAM LOOS 0000 BRWN SAND CLAY SLTY 0004 BRWN CLAY TILL SLTY 0010 GREY SHLE DNSE 0017
MISSISSAUGA CITY	616446	4825064	2009/09 3413	8	FR 0072		DE	0079 5	7133239	GREY CLAY 0033 BRWN SAND 0038 GREY CLAY 0072 GRVL CGVL 0084
MISSISSAUGA CITY	616459	4825090	2009/09 3413	8	FR 0072		DE	0090 5 008	7133240	GREY CLAY 0033 BRWN SAND 0036 GREY CLAY 0072 GRVL CGVL 0095
MISSISSAUGA CITY	616567	4826183	2009/11 6809				MT		7140767	GREY TILL 0012 GREY SHLE ROCK 0015
MISSISSAUGA CITY	616453	4825087	2010/02 6875	5.9			TH	0071 7	7143015	
MISSISSAUGA CITY	616445	4825082	2009/04 1663	2		//10/1:0	NU	0064 10	7124886	GREY CLAY GRVL SAND 0018 GREY SAND CLAY 0023 GREY CLAY SAND GRVL 0027 GREY CLAY SILT STNS 0068 GREY CSND GRVL 0074 GREY CLAY 0074
MISSISSAUGA CITY	616240	4825427	2007/12 7241	1.22			MO		7104551	BRWN SAND 0001 BRWN SILT GRVL CLAY 0005 GREY SILT GRVL CLAY 0007 GREY SHLE ROCK 0025
MISSISSAUGA CITY	616451	4825832	2007/07 7230	2			NU	0008 3	7050157	BRWN GRVL DNSE 0001 BRWN CLAY HARD 0004 GREY CLAY DNSE 0010 GREY SHLE HARD 0011
MISSISSAUGA CITY	616084	4825485	2007/09 7238	2	8			0015 10	7051983	BRWN SAND GRVL 0003 BRWN SILT SAND CLAY 0005 GREY SILT CLAY 0008 GREY SHLE 0026
MISSISSAUGA CITY	616760	4826156	2007/11 6032	1.97			NU	0004 10	7054194	BRWN SAND GRVL BRWN SILT GREY ROCK
MISSISSAUGA CITY	616760	4826157	2007/11 6032				NU		7054195	



Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

MISSISSAUGA CITY	616681	4825819	2005/01 6607	2	25			0014 15	4909653	BRWN SAND GRVL 0002 BRWN SILT SNDY CLAY 0029
MISSISSAUGA CITY	616398	4825453	2006/05 7215	2				0005 5	4910190	
MISSISSAUGA CITY	616488	4825826	2006/09 6032	4.32 1.97			NU	0014 6	4910354	BRWN SAND GRVL CLAY 0004 GREY SHLE LMSN 0020
MISSISSAUGA CITY	616567	4825933	2008/11 7215				TH	0005 15	7116784	BRWN FILL DRY LOOS 0005 GREY SHLE DRY 0018 GREY SHLE WBRG 0020
MISSISSAUGA CITY	616301	4825668	2007/12 7241	1.25			MO		7104552	GREY SILT GRVL TILL 0007 GREY SHLE ROCK 0025
MISSISSAUGA CITY	616540	4825835	2008/07 7215				TH	0010 5	7116783	BRWN SAND SILT WBRG 0002 GREY SILT CLAY ROCK 0015
MISSISSAUGA CITY	616127	4825385	2007/12 7241	1.25			MO		7104550	BRWN GRVL SAND 0002 GREY SILT CLAY TILL 0008 GREY SHLE ROCK 0025
MISSISSAUGA CITY	616376	4825744	2007/12 7241	9.99	///:		MO		7104446	BRWN GRVL SAND FILL 0001 GREY SILT SAND GRVL 0007 GREY SHLE ROCK 0020
MISSISSAUGA CITY	616422	4825398	2008/08 6607	2	FR 0013 FR 0023		MO		7112537	BRWN SAND GRVL LOOS 0005 BRWN SILT GRVL DNSE 0013 RED SILT GRVL DNSE 0018 BRWN SILT GRVL HARD 0020 GREY CLAY SILT DNSE 0025 GREY SHLE LMSN LYRD 0027
MISSISSAUGA CITY	616584	4825812	2008/07 6607	2.31	FR 0013		OT		7112538	BRWN SILT STNS FILL 0007 GREY SHLE 0010 GREY LMSN 0022
MISSISSAUGA CITY	616706	4825925	2008/10 7241	1.59			MT	0008 10	7114795	BRWN SAND SOFT 0005 GREY SILT SHLE SOFT 0008 BLUE SHLE HARD 0018
MISSISSAUGA CITY	616481	4825981	2008/10 7241	1.17			MO		7114846	BRWN LOAM 0001 BRWN SILT CLAY GRVL 0009 GREY SHLE ROCK 0019
MISSISSAUGA CITY	616845	4826223	2008/05 7241	2.06			MT	0004 10	7116165	GREY TILL GRVL DNSE 0014
MISSISSAUGA CITY	616144	4824973	2012/09 7241	2.04			MT	0008 5	7189880	BRWN LOAM SAND LOOS 0002 BRWN SILT SAND HARD 0010 GREY SHLE WTHD 0013
MISSISSAUGA CITY	616622	4826203	2011/10 7238	2			TH	0020 10	7170553	BRWN FILL GRVL SOFT 0005 BRWN TILL CLAY HARD 0010 GREY SHLE CLAY HARD 0030
MISSISSAUGA CITY	616622	4826203	2011/10 7238	2			TH	0045 10	7170554	BRWN FILL GRVL HARD 0010 GREY SHLE CLAY HARD 0071
MISSISSAUGA CITY	616796	4826451	2011/09 7238	2			TH	0044 10	7170555	BRWN FILL GRVL HARD 0005 BRWN TILL CLAY HARD 0015 GREY SHLE HARD 0070

Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

MISSISSAUGA CITY	616037	4825516	2011/11 7241	2.04			MT	0003 9	7173314	WHIT HARD 0001 BRWN SAND GRVL LOOS 0003 GREY SILT FSND SOFT 0010 BRWN SHLE SLTY 0118
MISSISSAUGA CITY	616030	4825504	2011/11 7241	2.04			MT	0003 9	7173315	BLCK SOFT 0000 BRWN SAND SILT LOOS 0010 BRWN SILT SHLE HARD 0012
MISSISSAUGA CITY	616049	4825488	2011/11 7241	2.04			MT	0007 3	7173316	BLCK SOFT 0000 BLUE SILT SAND SOFT 0010 BRWN SILT SHLE HARD 0010
MISSISSAUGA CITY	616774	4826287	2011/04 7215	2			TH	0006 7	7166952	BRWN FILL 0004 BRWN CLAY SLTY 0009 GREY CLAY SILT SHLE 0013
MISSISSAUGA CITY	616079	4824881	2012/09 7241	2.04			MT	0008 5	7189879	BRWN LOAM LOOS 0002 BRWN SILT SAND HARD 0010 GREY SHLE WTHD 0013
MISSISSAUGA CITY	615833	4825103	2011/05 7215	2			TH	0016 5	7164321	BRWN FILL 0007 GREY SHLE WBRG 0016
MISSISSAUGA CITY	616147	4824973	2012/09 7241	2.04			MT	0007 5	7189881	BRWN LOAM LOOS DRY 0002 BRWN SILT SAND GRVL 0006 BRWN SAND 0010 WHIT SHLE WTHD 0012
MISSISSAUGA CITY	616774	4826402	2012/08 7215	2			TH	0012 5	7191830	BRWN SAND SILT CLAY 0012
MISSISSAUGA CITY	616041	4825299	2012/09 6032	2			MO	0025 10	7196499	BLCK STNS HARD 0001 BRWN SILT CLAY HARD 0009 GREY SHLE CLAY HARD 0025
MISSISSAUGA CITY	616139	4825643	2013/05 6946						7203011	
MISSISSAUGA CITY	616145	4825621	2013/07 6946						7212112	
MISSISSAUGA CITY	616247	4825828	2014/06 7241	2			MT	0008 10	7224380	BRWN SILT SAND 0007 GREY SHLE 0018
MISSISSAUGA CITY	616234	4825824	2014/06 7241	2			MT	0008 10	7224382	BRWN SILT SAND 0007 GREY SHLE 0018
MISSISSAUGA CITY	616385	4825958	2012/07 7230						7189019	
MISSISSAUGA CITY	616371	4825524	2011/04 7238	1			MO	0040 10	7162446	BRWN CLAY TILL 0010 GREY SHLE ROCK 0050
MISSISSAUGA CITY	617167	4825940	2018/09 7230						7320262	
MISSISSAUGA CITY	616339	4825812	2010/11 6032	1.97			MO	0010 10	7155337	BRWN SAND SILT SHLE 0020 BRWN SAND SILT SHLE 0020
MISSISSAUGA CITY	616386	4825605	2010/11 7241	0.79			MT		7155811	GREY SILT CLAY DRY 0007 BRWN TILL SILT 0026 BRWN SHLE WTHD 0072
MISSISSAUGA CITY	616446	4825064	2010/11 6875				DE		7158865	
MISSISSAUGA CITY	616459	4825090	2010/11 6875				DE		7158866	
MISSISSAUGA CITY	615895	4825220	2011/01 7241	2					7159340	
MISSISSAUGA CITY	616754	4826114	2010/12 6032				MO		7160223	GREY SAND SILT TILL 0020
MISSISSAUGA CITY	616502	4825811	2010/08 6607	2.00 2.00			MO		7152202	BRWN SAND GRVL FILL 0001 BRWN CLAY SILT DNSE 0005 GREY SHLE LMSN LYRD 0020

Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

MISSISSAUGA CITY	616440	4825397	2011/04 7238	1			MO	0040 10	7162447	BRWN CLAY SILT STNS 0015 GREY CLAY SILT STNS 0050
MISSISSAUGA CITY	616420	4825455	2011/04 7238	1			MO	0040 10	7162448	BRWN CLAY TILL 0010 GREY SHLE ROCK 0050
MISSISSAUGA CITY	616247	4825646	2011/04 7238	1			MO	0040 10	7162449	BRWN CLAY TILL 0010 GREY SHLE ROCK 0050
MISSISSAUGA CITY	616419	4825592	2011/05 7241	1.75			MT	0005 5	7164236	BLUE FILL SAND LOOS 0003 GREY SHLE TILL DNSE 0010
MISSISSAUGA CITY	616419	4825592	2011/05 7241	1.75			MT	0004 6	7164237	BRWN SAND LOOS 0003 GREY SHLE TILL DNSE 0010
MISSISSAUGA CITY	616419	4825592	2011/05 7241	1.75			MT	0004 5	7164238	BRWN SAND LOOS 0003 GREY SHLE TILL DNSE 0009
MISSISSAUGA CITY	616419	4825592	2011/05 7241	1.75			MT	0004 5	7164239	BRWN SAND FILL LOOS 0003 GREY SHLE TILL DNSE 0009
MISSISSAUGA CITY	616419	4825592	2011/05 7241	1.75			MO	0004 5	7164240	BRWN SAND FILL LOOS 0003 GREY SHLE TILL DNSE 0008
MISSISSAUGA CITY	615884	4825203	2011/01 7241	2			MT		7159341	
MISSISSAUGA CITY	616723	4825529	2020/03 7472						7364753	
MISSISSAUGA CITY	617114	4825985	2020/09 6875		8				7369235	
MISSISSAUGA CITY	616768	4825346	2020/03 7472						7364704	
MISSISSAUGA CITY	616795	4825327	2020/03 7472						7364705	
MISSISSAUGA CITY	616687	4825478	2020/03 7472						7364706	
MISSISSAUGA CITY	616630	4825420	2020/02 7472						7364707	
MISSISSAUGA CITY	616561	4825385	2020/02 7472						7364708	
MISSISSAUGA CITY	616864	4825306	2020/02 7472						7364750	
MISSISSAUGA CITY	616679	4825382	2020/03 7472						7364702	
MISSISSAUGA CITY	616715	4825374	2020/03 7472						7364752	
MISSISSAUGA CITY	616717	4825338	2020/02 7472						7364701	
MISSISSAUGA CITY	616933	4825302	2020/03 7472						7364754	
MISSISSAUGA CITY	616822	4825261	2020/02 7472						7364755	
MISSISSAUGA CITY	616988	4825823	2020/03 7472						7364756	
MISSISSAUGA CITY	616869	4825688	2020/03 7472						7364759	
MISSISSAUGA CITY	616987	4825868	2020/03 7472						7364760	
MISSISSAUGA CITY	617111	4825915	6875	5		///:	DE	0030 20	7354999	TILL CLAY GRVL 0020 GRVL BLDR WBRG 0025 GRVL SAND WBRG 0050
MISSISSAUGA CITY	616813	4825423	2020/03 7472						7364751	
MISSISSAUGA CITY	617142	4825920	6875	2		///:	DE	0045 5	7355003	TILL CLAY SAND 0010 GRVL BLDR 0024 TILL GRVL SAND 0040 SAND 0050
MISSISSAUGA CITY	616011	4825330	2018/11 7215						7325276	
MISSISSAUGA CITY	616791	4825239	2020/02 7238	2	UT 0003	///:	MO	0020 10	7355718	FILL 0005 SHLE ROCK 0030
MISSISSAUGA CITY	616725	4825438	2020/03 7472						7364703	
MISSISSAUGA CITY	616701	4826137	2020/10 7644						7373748	
MISSISSAUGA CITY	616569	4825664	2020/03 7464						7359499	
MISSISSAUGA CITY	617090	4826093	2020/06 7215						7362232	

Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

MISSISSAUGA CITY	616376	4826453	2020/05 7472	2		///:	MO	0016 10	7363884	BRWN SAND SILT LOOS 0009 GREY CLAY TILL PCKD 0013 GREY SHLE WTHD 0018 GREY SHLE 0026
MISSISSAUGA CITY	616371	4826451	2020/05 7472	2		///:	MO	0005 10	7363885	BRWN FILL LOOS 0005 GREY SILT PCKD 0010 GREY TILL SILT PCKD 0015
MISSISSAUGA CITY	616599	4826239	2020/05 7472	2		///:	MO	0008 10	7363886	BRWN FILL LOOS 0005 BRWN SAND SILT LOOS 0015 BRWN SAND PCKD 0018
MISSISSAUGA CITY	616338	4826489	2020/05 7472	2		///:	MO	0011 10	7363889	BLCK LOOS 0002 BRWN SAND SILT LOOS 0010 GREY CLAY SILT PCKD 0015 GREY SHLE 0021
MISSISSAUGA CITY	615975	4826062	2020/04 7472						7364032	
MISSISSAUGA CITY	616668	4825315	2020/02 7472						7364700	
MISSISSAUGA CITY	617162	4825593	2020/03 7472						7364761	
MISSISSAUGA CITY	616596	4825371	2021/03 1663						7388901	
MISSISSAUGA CITY	616665	4825377	2021/03 1663						7388904	
MISSISSAUGA CITY	616663	4826097	2020/12 7644						7378968	
MISSISSAUGA CITY	616890	4826309	2020/10 7644						7373749	
MISSISSAUGA CITY	616929	4826366	2020/10 7644						7373750	
MISSISSAUGA CITY	616783	4826337	2020/10 7644						7373751	
MISSISSAUGA CITY	616122	4825131	2020/12 6607	2	UT 0012	///:	MO	0020 5	7376464	BRWN LOAM SAND SOFT 0001 BRWN SAND SILT DNSE 0005 GREY SILT CLAY HARD 0009 GREY SHLE SHLE LYRD 0025
MISSISSAUGA CITY	616122	4825107	2020/12 6607	2	UT 0012	///:	MO	0015 10	7376469	BRWN LOAM SAND SOFT 0001 BRWN SAND SILT DNSE 0005 GREY SILT CLAY HARD 0009 GREY SHLE SHLE LYRD 0025
MISSISSAUGA CITY	616121	4825108	2020/12 6607	2	UT 0012	///:	MO	0009 4	7376474	BRWN LOAM SAND SOFT 0001 BRWN SAND SILT DNSE 0005 GREY SILT CLAY HARD 0008 GREY SILT SHLE DNSE 0013
MISSISSAUGA CITY	616107	4825121	2020/12 6607	2	UT 0012	///:	MO	0025 10	7376476	BRWN LOAM SAND SOFT 0001 BRWN SAND SILT DNSE 0005 GREY SILT CLAY HARD 0009 GREY SHLE SHLE LYRD 0035
MISSISSAUGA CITY	616732	4826038	2020/12 7644						7378967	
MISSISSAUGA CITY	617131	4825897	6875	5		///:	DE	0033 22	7355020	TILL ---- BLDR 0038 GRVL SAND WBRG 0053
MISSISSAUGA CITY	616967	4825992	2020/12 7644						7378969	
MISSISSAUGA CITY	616854	4825189	2021/03 7644						7385466	
MISSISSAUGA CITY	616108	4825119	2020/12 6607	2	UT 0012	///:	MO	0004 4	7376482	BRWN LOAM SAND SOFT 0001 BRWN SAND SILT DNSE 0005 GREY SILT CLAY HARD 0008
MISSISSAUGA CITY	616575	4826051	2017/11 7383	2			MT	0020 5	7327960	TILL ROCK 0025

Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

MISSISSAUGA CITY	616570	4825514	2017/11 7383	2			MT	0047 3	7327961	TILL ROCK 0050
MISSISSAUGA CITY	616830	4825320	2018/08 7644	2			MT	0020 10	7327962	SILT CLAY 0030
MISSISSAUGA CITY	617053	4825715	2018/08 7644	2			TH MO	0020 10	7332457	SILT CLAY 0030 LMSN
MISSISSAUGA CITY	616691	4825290	2018/07 7644	2			TH MO	0025 10	7332458	SILT CLAY 0035 LMSN
MISSISSAUGA CITY	616636	4825337	2019/07 7644	2		///:	MT	0010 10	7342397	GREY CLAY SLTY 0020
MISSISSAUGA CITY	616678	4825534	2019/07 7644	2	UT 0024	///:	MT	0015 10	7342398	GREY CLAY SLTY 0020
MISSISSAUGA CITY	616055	4825500	2019/10 7147	1.97		///:	MO	0005 5	7346767	BRWN SAND SILT 0010 BRWN SHLE
MISSISSAUGA CITY	616868	4825444	2017/11 7383	2			MT	0018 10	7327957	TILL ROCK 0028
MISSISSAUGA CITY	616942	4825989	2019/08 7644	2		///:	MT	0015 10	7342478	TILL CLAY 0025
MISSISSAUGA CITY	617090	4825899	2019/08 7644	2		///:	MO	0027 10	7342479	BRWN FILL 0010 BRWN TILL SNDY
MISSISSAUGA CITY	616784	4825167	2020/02 7238	2	UT 0005	///:	MO	0030 10	7355719	0025 GREY SILT SNDY 0037
MISSISSAUGA CITY	617091	4826115	6875	5		///:	DE MO	0025 20	7345293	FILL 0007 SHLE ROCK 0040
MISSISSAUGA CITY	617113	4825913	6875	5		///:	DE	0035 20	7354998	GREY TILL CLAY GRVL 0017 BRWN SAND WBRG 0033 GREY GRVL STNS WBRG 0045
MISSISSAUGA CITY	616042	4825513	2019/10 7147	1.97		///:	MO	0003 10	7346766	TILL CLAY GRVL 0008 GRVL ---- 0015 GRVL CLAY SAND 0032 GRVL SAND WBRG 0050 SAND WBRG 0055
MISSISSAUGA CITY	616968	4825467	2017/11 7383	2			MT	0004 10	7327958	BRWN SAND SILT 0010 BRWN SHLE 0013
MISSISSAUGA CITY	616821	4825313	2018/10 7644	2			MT	0005 10	7327951	TILL ROCK 0014
MISSISSAUGA CITY	616916	4825433	2018/10 7644	2			MT	0010 10	7327952	
MISSISSAUGA CITY	616730	4825339	2017/11 7683	2			MT	0018 10	7327953	TILL ROCK 0028
MISSISSAUGA CITY	616036	4825519	2019/10 7147	1.97		///:	MO	0003 10	7346765	BRWN SAND SILT 0010 BRWN SHLE 0013
MISSISSAUGA CITY	617018	4825702	2019/11 7644	2		///:	MT	0010 2	7353431	SILT 0012
MISSISSAUGA CITY	617082	4825598	2019/11 7644	2		///:	MT	0008 5	7353422	SILT 0013
MISSISSAUGA CITY	617050	4825828	2019/11 7644	2		///:	MT	0008 5	7353423	SILT 0013
MISSISSAUGA CITY	616029	4825507	2019/10 7147	1.97		///:	MO	0003 10	7346768	BRWN SAND SILT 0010 BRWN SHLE 0013
MISSISSAUGA CITY	617056	4825799	2019/11 7644	2		///:	MT	0010 5	7353425	SILT 0015
MISSISSAUGA CITY	616922	4826044	2019/08 7644	2		///:	MO	0030 10	7342480	BRWN FILL 0010 BRWN TILL SNDY 0025 GREY SILT SNDY 0040
MISSISSAUGA CITY	617115	4825733	2019/11 7644	2		///:	MT	0010 10	7353427	SILT SAND WBRG 0020
MISSISSAUGA CITY	617169	4825708	2019/11 7644	2		///:	MT	0010 28	7353428	SILT CLAY SAND 0038
MISSISSAUGA CITY	617054	4825855	2019/11 7644	2		///:	MT	0010 2	7353421	SILT 0012
MISSISSAUGA CITY	617072	4825698	2019/11 7644	2		///:	MT	0000 13	7353430	SILT 0013
MISSISSAUGA CITY	616976	4825824	2019/11 7644	2		///:	MT	0010 11	7353424	SILT CLAY 0021
MISSISSAUGA CITY	617041	4825687	2019/11 7644	2		///:	MT	0010 5	7353432	
MISSISSAUGA CITY	617128	4825899	6875	5		///:	DE	0030 20	7354991	TILL CLAY GRVL 0025 ---- SLTY 0035 GRVL SAND WBRG 0040 SAND GRVL WBRG 0050

Table: MECP Water Wells Records (500 m Radius)

Location: Rangview Road, Mississauga

MISSISSAUGA CITY	617125	4825901	6875	5	///:	DE	0030 20	7354992	TILL CLAY GRVL 0020 ---- GRVL WBRG 0030 SAND GRVL WBRG 0046 GRVL WBRG 0050	
MISSISSAUGA CITY	617123	4825902	6875	5	///:	DE	0035 20	7354993	TILL CLAY SAND 0018 GRVL CLAY SAND 0030 ---- SAND 0035 GRVL SAND ---- 0043 SAND GRVL 0050 GRVL 0055	
MISSISSAUGA CITY	617121	4825904	6875	5	///:	DE	0030 20	7354994	TILL CLAY GRVL 0035 GRVL WBRG 0042 SAND GRVL WBRG 0050	
MISSISSAUGA CITY	617199	4825906	6875	5	///:	DE	0030 20	7354995	TILL CLAY SAND 0035 GRVL WBRG 0042 SAND GRVL WBRG 0050	
MISSISSAUGA CITY	617117	4825909	6875	5	///:	DE	0033 20	7354996	TILL GRVL CLAY 0008 GRVL BLDR 0015 SAND GRVL WBRG 0033 GRVL SAND WBRG 0042 SAND WBRG 0053	
MISSISSAUGA CITY	617115	4825911	6875	5	///:	DE	0035 20	7354997	TILL CLAY GRVL 0008 GRVL BLDR 0015 GRVL SAND CLAY 0030 GRVL SAND WBRG 0050 SAND WBRG 0055	
MISSISSAUGA CITY	617111	4825702	2019/11 7644	2	///:	MT	0010 11	7353429	SILT CLAY SAND 0021	
MISSISSAUGA CITY	616401	4825654	2019/11 7641	2	///:	TH MO	0005 10	7350164		
MISSISSAUGA CITY	615911	4825222	2019/11 7241	2	///:	MT	0008 10	7348080	BRWN CLAY SILT 0009 GREY SHLE 0015 GREY SHLE 0018	
MISSISSAUGA CITY	615898	4825217	2012/11 7241	2	///:	MT	0012 10	7348081	BRWN CLAY SILT 0009 GREY SHLE 0020 GREY SHLE 0022	
MISSISSAUGA CITY	616654	4825613	2019/06 7644					7349530		
MISSISSAUGA CITY	616854	4825144	2018/06 7644					7349531		
MISSISSAUGA CITY	616993	4825786	7644	2	///:	MT	0010 2	7353426	SILT 0012	
MISSISSAUGA CITY	616434	4825622	2019/11 7644	2	///:	MT	0005 5	7350163	CLAY TILL 0008 ROCK 0015	
MISSISSAUGA CITY	617111	4825829	2019/11 7644	1.87	///:	MO	0010 5	7353420	SILT CLAY SAND 0015	
MISSISSAUGA CITY	616245	4825472	2019/11 7644	2	UT 0010	///:	MT	0005 10	7350165	BRWN FILL SAND GRVL 0001 GREY TILL SILT HARD 0010 GREY SHLE HARD 0015
MISSISSAUGA CITY	616282	4825423	2019/11 7644	2	UT 0010	///:	MT	0005 10	7350166	BRWN LOAM SOFT 0000 GREY SILT TILL HARD 0010 GREY SHLE HARD 0015
MISSISSAUGA CITY	616398	4825576	2019/11 7644	2	UT 0010	///:	MT	0005 10	7350168	BLCK ---- HARD 0000 GREY TILL SHLE HARD 0015
MISSISSAUGA CITY	616376	4825676	2019/11 7644	2	UT 0010	///:	MT	0005 10	7350169	BLCK ---- HARD 0000 GREY TILL SHLE HARD 0015
MISSISSAUGA CITY	616067	4825431	2019/11 7644	2	UT 0010	///:	MT	0005 10	7350170	BLCK ---- HARD 0000 GREY TILL HARD 0015
MISSISSAUGA CITY	616411	4825633	2019/11 7644	2	UT 0010	///:	MT	0005 10	7350167	BRWN FILL GRVL SAND 0005 GREY TILL SHLE HARD 0015
MISSISSAUGA CITY	616454	4825636	2019/11 7644	2	///:	MT	0010 10	7350162	CLAY TILL 0020	
MISSISSAUGA CITY	617104	4825565	2019/11 7644	2	///:	MT	0010 5	7353417	SILT 0015	

**Table: MECP Water Wells Records (500 m Radius)****Location: Rangview Road, Mississauga**


MISSISSAUGA CITY	616911	4825805	2019/11 7644	2		///:	MT	0010 3	7353416	SILT 0013
MISSISSAUGA CITY (PO	616376	4825397	2007/08 6607	1.99		///:	MO		7050861	BRWN SAND GRVL 0005 GREY SHLE SOFT 0010 GREY SHLE 0020
MISSISSAUGA CITY DS S 03	616508	4825833	2002/02 7147					0001 5	4908971	BRWN LOAM 0001 BRWN CLAY 0006 GREY SHLE ROCK 0006
MISSISSAUGA CITY DS S 03	616522	4825880	2002/02 7147					0001 5	4908970	BRWN LOAM 0001 BRWN CLAY 0006 GREY SHLE ROCK 0006
MISSISSAUGA CITY DS S 03	616482	4825852	2002/02 7147					0003 5	4908972	BRWN LOAM 0001 BRWN CLAY 0008 GREY SHLE ROCK 0008
MISSISSAUGA CITY DS S 03	616446	4825874	2002/02 7147					0001 5	4908969	BRWN LOAM 0001 BRWN CLAY 0006 GREY SHLE ROCK 0006
MISSISSAUGA CITY DS S 03 008	616490	4825589	1967/04 3512	8	FR 0070	30/35/135/:	IN	0072 10	4902286	BRWN CLAY MSND 0020 BLUE CLAY GRVL 0062 BLUE CLAY 0070 MSND GRVL 0082
TORONTO CITY	616386	4825426	2007/08 7241	1.5				0010 9	7049725	RED FILL SAND SOFT 0003 BRWN SILT CLAY DNSE 0017 BRWN SILT CLAY 0019

# **Appendix C: Hydraulic Conductivity Analysis**



		<b>Slug Test Analysis Report</b>	
		Project: Hydrogeology Investigation	
		Number: 22-200-100	
		Client: Rangeview Estates	

Location: Mississauga, ON	Slug Test: MW/BH 22-6	Test Well: MW/BH 22-6
Test Conducted by: AQ		Test Date: 10/18/2022
Analysis Performed by: PP	Hvorslev	Analysis Date: 10/18/2022
Aquifer Thickness: 1.31 m		

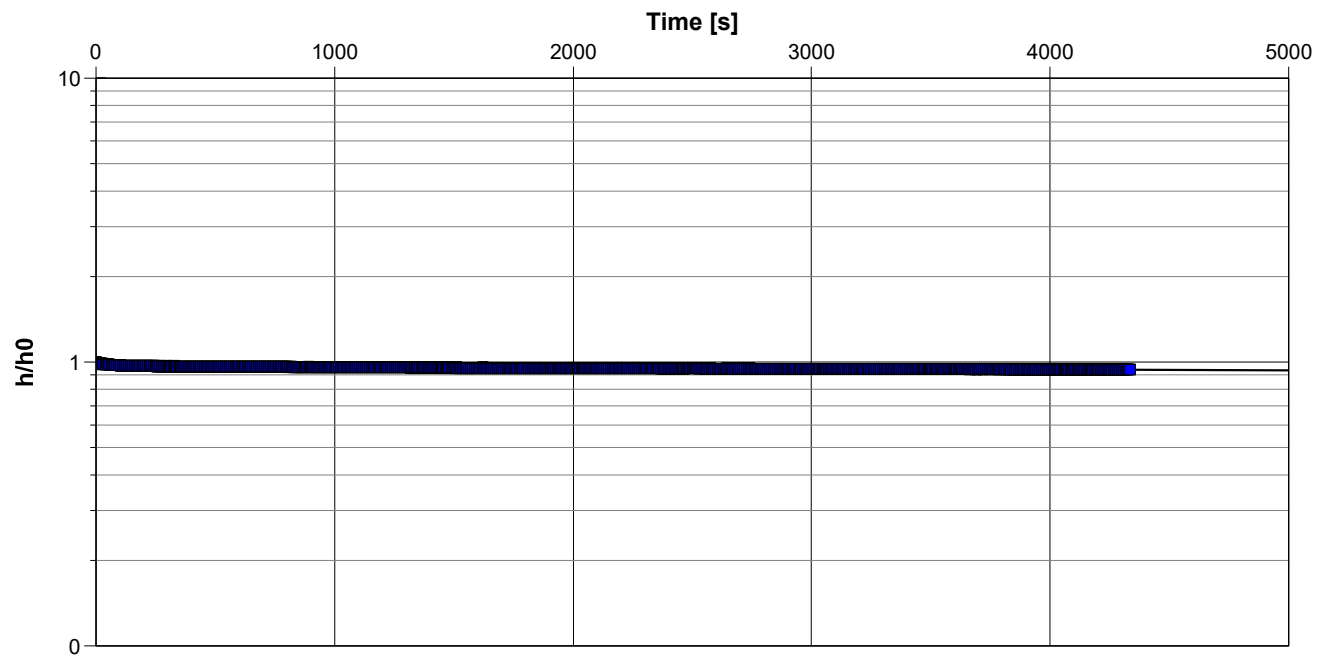

Calculation using Hvorslev		
Observation Well	Hydraulic Conductivity [m/s]	
MW/BH 22-6	$5.28 \times 10^{-9}$	

--	--	--

### Slug Test Analysis Report

Project: Hydrogeology Investigation

Number: 22-200-100

Client: Rangeview Estates

Location: Mississauga, ON

Slug Test: MW/BH 22-9

Test Well: MW/BH 22-9

Test Conducted by:


Test Date: 10/18/2022

Analysis Performed by: PP

Hvorslev

Analysis Date: 10/18/2022

Aquifer Thickness: 3.11 m

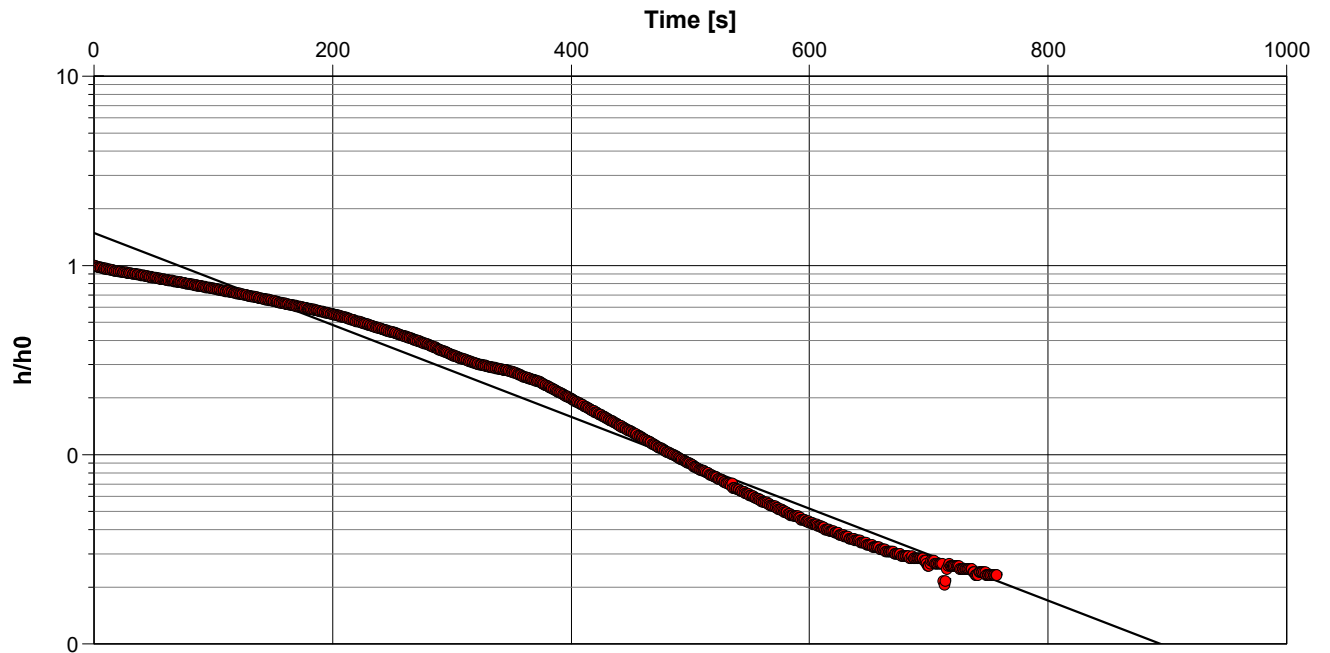

Calculation using Hvorslev

Observation Well	Hydraulic Conductivity [m/s]
MW/BH 22-9	$2.52 \times 10^{-6}$

**Slug Test Analysis Report**

Project: Hydrogeology Investigation

Number: 22-200-100

Client: Rangeview Estates

Location: Mississauga, ON

Slug Test: MW/BH 22-13

Test Well: MW/BH 22-13

Test Conducted by: PP


Test Date: 10/18/2022

Analysis Performed by: PP

Hvorslev

Analysis Date: 10/18/2022

Aquifer Thickness: 2.21 m

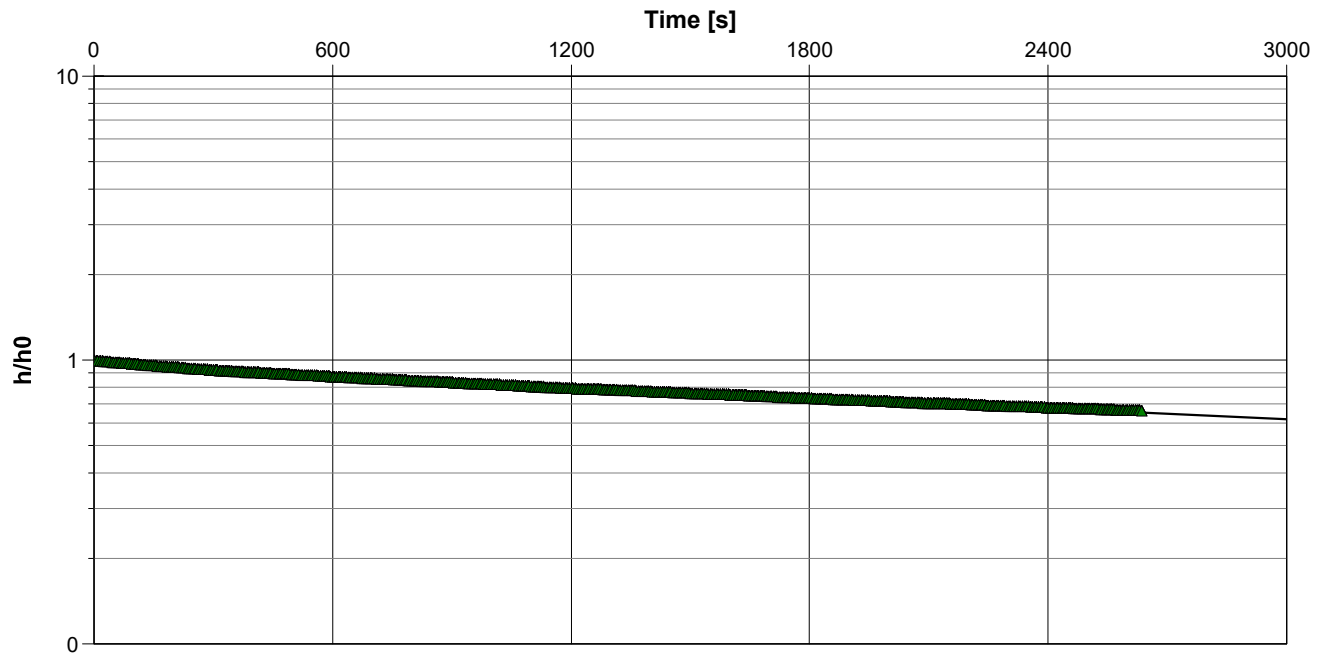

Calculation using Hvorslev

Observation Well	Hydraulic Conductivity [m/s]
------------------	------------------------------

MW/BH 22-13	$1.11 \times 10^{-7}$
-------------	-----------------------

**Appendix D: Groundwater Quality  
Certificate of Analysis**



## FINAL REPORT

CA14622-SEP22 R1

22-200-100, 974 Lakeshore Rd E, Mississauga

Prepared for

**DS Consultants**

## First Page

### CLIENT DETAILS

Client DS Consultants

Address 6221 Highway 7 Unit 6  
Vaughan, Ontario  
L4H 0K8, Canada

Contact Abdul Qadir

Telephone 204-951-8164

Facsimile 905-264-2685

Email [abdul.qadir@dsconsultants.ca](mailto:abdul.qadir@dsconsultants.ca); [don.hsu@dsconsultants.ca](mailto:don.hsu@dsconsultants.ca)

Project 22-200-100, 974 Lakeshore Rd E, Mississauga

Order Number

Samples Ground Water (2)

### LABORATORY DETAILS

Project Specialist Maarit Wolfe, Hon.B.Sc

Laboratory SGS Canada Inc.

Address 185 Concession St., Lakefield ON, K0L 2H0

Telephone 705-652-2000

Facsimile 705-652-6365

Email [Maarit.Wolfe@sgs.com](mailto:Maarit.Wolfe@sgs.com)

SGS Reference CA14622-SEP22

Received 09/23/2022

Approved 10/05/2022

Report Number CA14622-SEP22 R1

Date Reported 10/05/2022

### COMMENTS

RL - SGS Reporting Limit

Temperature of Sample upon Receipt: 8 degrees C

Cooling Agent Present: Yes

Custody Seal Present: Yes

Chain of Custody Number: 033384

Metals limits raised 10x due to sample matrix

### SIGNATORIES

Maarit Wolfe, Hon.B.Sc



TABLE OF CONTENTS

---

First Page.....	1
Index.....	2
Results.....	3-7
Exceedance Summary.....	8
QC Summary.....	9-19
Legend.....	20
Annexes.....	21-22



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9 03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Mississauga Sewer Use ByLaw - Storm Sewer - BL\_0046\_2022

Parameter	Units	RL	L1	Result	Result
<b>General Chemistry</b>					
Biochemical Oxygen Demand (BOD5)	mg/L	2	15	< 4 †	---
Total Suspended Solids	mg/L	2	15	9560	---
Total Kjeldahl Nitrogen	as N mg/L	0.5		< 0.5	---

### Metals and Inorganics

Total Chlorine	mg/L	0.02	1	< 0.02	---
Fluoride	mg/L	0.06		0.18	---
Cyanide (total)	mg/L	0.01	0.02	< 0.01	---
Sulphate	mg/L	2		98	---
Aluminum (0.2µm)	mg/L	0.001		0.211	---
Aluminum (total)	mg/L	0.01	1	63.5	---
Antimony (total)	mg/L	0.009		< 0.009	---
Arsenic (total)	mg/L	0.002	0.02	0.038	---
Cadmium (total)	mg/L	0.00003	0.008	0.00012	---
Chromium (total)	mg/L	0.0008	0.08	0.117	---
Copper (total)	mg/L	0.002	0.04	0.129	---
Cobalt (total)	mg/L	0.00004		0.0661	---
Lead (total)	mg/L	0.0009	0.12	0.0362	---
Manganese (total)	mg/L	0.0001	2	5.44	---
Molybdenum (total)	mg/L	0.0004		0.0033	---
Nickel (total)	mg/L	0.001	0.08	0.135	---
Phosphorus (total)	mg/L	0.03	0.4	3.76	---





# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9
		03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Mississauga Sewer Use ByLaw - Storm Sewer - BL\_0046\_2022

Parameter	Units	RL	L1	Result	Result
<b>Metals and Inorganics (continued)</b>					
Selenium (total)	mg/L	0.0004	0.02	0.0006	---
Silver (total)	mg/L	0.0005	0.12	< 0.0005	---
Tin (total)	mg/L	0.0006		0.0016	---
Titanium (total)	mg/L	0.0005		0.190	---
Zinc (total)	mg/L	0.02	0.2	0.37	---

## Microbiology

E. Coli	cfu/100mL	0	200	---	0
---------	-----------	---	-----	-----	---

## Nonylphenol and Ethoxylates

Nonylphenol	mg/L	0.001		< 0.001	---
Nonylphenol Ethoxylates	mg/L	0.01		< 0.01	---
Nonylphenol diethoxylate	mg/L	0.01		< 0.01	---
Nonylphenol monoethoxylate	mg/L	0.01		< 0.01	---

## Oil and Grease

Oil & Grease (total)	mg/L	2		< 2	---
Oil & Grease (animal/vegetable)	mg/L	4		< 4	---
Oil & Grease (mineral/synthetic)	mg/L	4		< 4	---



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9
		03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Mississauga Sewer Use ByLaw - Storm Sewer - BL\_0046\_2022

Parameter	Units	RL	L1	Result	Result
<b>Other (ORP)</b>					
pH	No unit	0.05	9	7.13	---
Chromium VI	mg/L	0.0002	0.04	< 0.0002	---
Mercury (total)	mg/L	0.00001	0.0004	0.00001	---
<b>PAHs</b>					
Benzo(b+j)fluoranthene	mg/L	0.0001		< 0.0001	---
<b>PCBs</b>					
Polychlorinated Biphenyls (PCBs) - Total	µg/L	0.04	0.4	< 0.04	---
<b>Phenols</b>					
4AAP-Phenolics	mg/L	0.002	0.008	< 0.002	---
<b>SVOCs</b>					
di-n-Butyl Phthalate	mg/L	0.002		< 0.002	---
Bis(2-ethylhexyl)phthalate	mg/L	0.002		< 0.002	---
PAHs (Total)	mg/L		0.002	< 0.001	---
Perylene	mg/L	0.0005		< 0.0005	---



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9
		03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Mississauga Sewer Use ByLaw - Storm Sewer - BL\_0046\_2022

Parameter	Units	RL	L1	Result	Result
<b>SVOCs - PAHs</b>					
7Hdibenzo(c,g)carbazole	mg/L	0.0001		< 0.0001	---
Anthracene	mg/L	0.0001		< 0.0001	---
Benzo(a)anthracene	mg/L	0.0001		< 0.0001	---
Benzo(a)pyrene	mg/L	0.0001		< 0.0001	---
Benzo(e)pyrene	mg/L	0.0001		< 0.0001	---
Benzo(ghi)perylene	mg/L	0.0002		< 0.0002	---
Benzo(k)fluoranthene	mg/L	0.0001		< 0.0001	---
Chrysene	mg/L	0.0001		< 0.0001	---
Dibenzo(a,h)anthracene	mg/L	0.0001		< 0.0001	---
Dibenzo(a,i)pyrene	mg/L	0.0001		< 0.0001	---
Dibenzo(a,j)acridine	mg/L	0.0001		< 0.0001	---
Fluoranthene	mg/L	0.0001		< 0.0001	---
Indeno(1,2,3-cd)pyrene	mg/L	0.0002		< 0.0002	---
Phenanthrene	mg/L	0.0001		< 0.0001	---
Pyrene	mg/L	0.0001		< 0.0001	---



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

Sample Number	8	9
Sample Name	BH22-9	BH22-9
		03-Oct-22
Sample Matrix	Ground Water	Ground Water
Sample Date	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Mississauga Sewer Use ByLaw - Storm Sewer - BL\_0046\_2022

Parameter	Units	RL	L1	Result	Result
<b>VOCs</b>					
Chloroform	mg/L	0.0005		< 0.0005	---
1,2-Dichlorobenzene	mg/L	0.0005	0.0056	< 0.0005	---
1,4-Dichlorobenzene	mg/L	0.0005	0.0068	< 0.0005	---
cis-1,2-Dichloroethene	mg/L	0.0005		0.0115	---
trans-1,3-Dichloropropene	mg/L	0.0005		< 0.0005	---
Methylene Chloride	mg/L	0.0005		< 0.0005	---
1,1,2,2-Tetrachloroethane	mg/L	0.0005	0.017	< 0.0005	---
1,1,1,2-Tetrachloroethane	mg/L	0.0005	0.017	< 0.0005	---
Methyl ethyl ketone	mg/L	0.02		< 0.02	---
Styrene	mg/L	0.0005		< 0.0005	---
Tetrachloroethylene (perchloroethylene)	mg/L	0.0005	0.0044	< 0.0005	---
Trichloroethylene	mg/L	0.0005	0.0076	0.0029	---

**VOCs - BTEX**

Benzene	mg/L	0.0005	0.002	< 0.0005	---
Ethylbenzene	mg/L	0.0005	0.002	< 0.0005	---
Toluene	mg/L	0.0005	0.002	< 0.0005	---
Xylene (total)	mg/L	0.0005	0.0044	< 0.0005	---
m-p-xylene	mg/L	0.0005		< 0.0005	---
o-xylene	mg/L	0.0005		< 0.0005	---

## EXCEEDANCE SUMMARY

Parameter	Method	Units	Result	L1
				SANSEW / WATER / - - Mississauga Sewer Use ByLaw - Storm Sewer - BL_0046_2022

### BH22-9

Total Suspended Solids	SM 2540D	mg/L	9560	15
Aluminum	SM 3030/EPA 200.8	mg/L	63.5	1
Arsenic	SM 3030/EPA 200.8	mg/L	0.038	0.02
Chromium	SM 3030/EPA 200.8	mg/L	0.117	0.08
Copper	SM 3030/EPA 200.8	mg/L	0.129	0.04
Manganese	SM 3030/EPA 200.8	mg/L	5.44	2
Nickel	SM 3030/EPA 200.8	mg/L	0.135	0.08
Phosphorus	SM 3030/EPA 200.8	mg/L	3.76	0.4
Zinc	SM 3030/EPA 200.8	mg/L	0.37	0.2



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Anions by discrete analyzer

Method: US EPA 375.4 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-026

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Sulphate	DIO5058-SEP22	mg/L	2	<2	9	20	111	80	120	91	75	125

### Biochemical Oxygen Demand

Method: SM 5210 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-007

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Biochemical Oxygen Demand (BOD5)	BOD0050-SEP22	mg/L	2	< 2	15	30	102	70	130	82	70	130

### Chlorine

Method: SM 4500 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-008

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Total Chlorine	EWL0494-SEP22	mg/L	0.02	< 0.02	ND	20	99	90	110	NA		



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Cyanide by SFA

Method: SM 4500 | Internal ref.: ME-CA-IENVISFA-LAK-AN-005

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Cyanide (total)	SKA0220-SEP22	mg/L	0.01	<0.01	ND	10	95	90	110	NV	75	125

### Fluoride by Specific Ion Electrode

Method: SM 4500 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-014

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Fluoride	EWL0495-SEP22	mg/L	0.06	<0.06	5	10	100	90	110	110	75	125

### Hexavalent Chromium by SFA

Method: EPA218.6/EPA3060A | Internal ref.: ME-CA-IENVISKA-LAK-AN-012

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Chromium VI	SKA0234-SEP22	mg/L	0.0002	<0.0002	ND	20	100	80	120	92	75	125



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

Mercury by CVAAS

Method: EPA 7471A/SM 3112B | Internal ref.: ME-CA-IENVISPE-LAK-AN-004

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Mercury (total)	EHG0052-SEP22	mg/L	0.00001	< 0.00001	11	20	118	80	120	102	70	130





# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

Metals in aqueous samples - ICP-MS

Method: SM 3030/EPA 200.8 | Internal ref.: ME-CA-IENVISPE-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Silver (total)	EMS0238-SEP22	mg/L	0.0005	<0.00005	ND	20	103	90	110	71	70	130
Aluminum (total)	EMS0238-SEP22	mg/L	0.01	<0.001	2	20	93	90	110	89	70	130
Arsenic (total)	EMS0238-SEP22	mg/L	0.002	<0.0002	6	20	106	90	110	103	70	130
Cadmium (total)	EMS0238-SEP22	mg/L	0.00003	<0.000003	20	20	103	90	110	91	70	130
Cobalt (total)	EMS0238-SEP22	mg/L	0.00004	<0.000004	7	20	104	90	110	102	70	130
Chromium (total)	EMS0238-SEP22	mg/L	0.0008	<0.00008	11	20	100	90	110	109	70	130
Copper (total)	EMS0238-SEP22	mg/L	0.002	<0.0002	14	20	100	90	110	91	70	130
Manganese (total)	EMS0238-SEP22	mg/L	0.0001	<0.00001	2	20	107	90	110	97	70	130
Molybdenum (total)	EMS0238-SEP22	mg/L	0.0004	<0.00004	7	20	94	90	110	100	70	130
Nickel (total)	EMS0238-SEP22	mg/L	0.001	<0.0001	0	20	100	90	110	92	70	130
Lead (total)	EMS0238-SEP22	mg/L	0.0009	<0.00001	14	20	94	90	110	89	70	130
Phosphorus (total)	EMS0238-SEP22	mg/L	0.03	<0.003	9	20	96	90	110	NV	70	130
Antimony (total)	EMS0238-SEP22	mg/L	0.009	<0.0009	ND	20	95	90	110	101	70	130
Selenium (total)	EMS0238-SEP22	mg/L	0.0004	<0.00004	7	20	101	90	110	95	70	130
Tin (total)	EMS0238-SEP22	mg/L	0.0006	<0.00006	ND	20	97	90	110	NV	70	130
Titanium (total)	EMS0238-SEP22	mg/L	0.0005	<0.00005	2	20	97	90	110	NV	70	130
Zinc (total)	EMS0238-SEP22	mg/L	0.02	<0.002	4	20	103	90	110	80	70	130
Aluminum (0.2µm)	EMS0242-SEP22	mg/L	0.001	<0.001	2	20	101	90	110	75	70	130



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Microbiology

Method: SM 9222D | Internal ref.: ME-CA-IENVIMIC-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
E. Coli	BAC9013-OCT22	cfu/100mL	-	ACCEPTED	ACCEPTED							

### Nonylphenol and Ethoxylates

Method: ASTM D7065-06 | Internal ref.: ME-CA-IENVIGC-LAK-AN-015

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Nonylphenol diethoxylate	GCM0393-SEP22	mg/L	0.01	<0.01			88	55	120			
Nonylphenol Ethoxylates	GCM0393-SEP22	mg/L	0.01	< 0.01								
Nonylphenol monoethoxylate	GCM0393-SEP22	mg/L	0.01	<0.01			90	55	120			
Nonylphenol	GCM0393-SEP22	mg/L	0.001	<0.001			91	55	120			

## QC SUMMARY

### Oil & Grease

Method: MOE E3401 | Internal ref.: ME-CA-IENVIGC-LAK-AN-019

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Oil & Grease (total)	GCM0482-SEP22	mg/L	2	<2	NSS	20	105	75	125			

### Oil & Grease-AV/MS

Method: MOE E3401/SM 5520F | Internal ref.: ME-CA-IENVIGC-LAK-AN-019

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Oil & Grease (animal/vegetable)	GCM0482-SEP22	mg/L	4	< 4	NSS	20	NA	70	130			
Oil & Grease (mineral/synthetic)	GCM0482-SEP22	mg/L	4	< 4	NSS	20	NA	70	130			

### pH

Method: SM 4500 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
pH	EWL0496-SEP22	No unit	0.05	NA	1		100			NA		



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Phenols by SFA

Method: SM 5530B-D | Internal ref.: ME-CA-IENVISFA-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
4AAP-Phenolics	SKA0228-SEP22	mg/L	0.002	<0.002	ND	10	105	80	120	102	75	125

### Polychlorinated Biphenyls

Method: MOE E3400/EPA 8082A | Internal ref.: ME-CA-IENVIGC-LAK-AN-001

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Polychlorinated Biphenyls (PCBs) - Total	GCM0452-SEP22	ug/L	0.04	< 0.04	NSS	30	100	60	140	NSS	60	140

## QC SUMMARY

### Semi-Volatile Organics

Method: EPA 3510C/8270D | Internal ref.: ME-CA-IENVIGC-LAK-AN-005

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
7Hdibenzo(c,g)carbazole	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	93	50	140	NSS	50	140
Anthracene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	104	50	140	NSS	50	140
Benzo(a)anthracene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	100	50	140	NSS	50	140
Benzo(a)pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	103	50	140	NSS	50	140
Benzo(b+j)fluoranthene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	99	50	140	NSS	50	140
Benzo(e)pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	98	50	140	NSS	50	140
Benzo(ghi)perylene	GCM0499-SEP22	mg/L	0.0002	< 0.0002	NSS	30	99	50	140	NSS	50	140
Benzo(k)fluoranthene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	102	50	140	NSS	50	140
Bis(2-ethylhexyl)phthalate	GCM0499-SEP22	mg/L	0.002	< 0.002	NSS	30	137	50	140	NSS	50	140
Chrysene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	105	50	140	NSS	50	140
di-n-Butyl Phthalate	GCM0499-SEP22	mg/L	0.002	< 0.002	NSS	30	132	50	140	NSS	50	140
Dibenzo(a,h)anthracene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	104	50	140	NSS	50	140
Dibenzo(a,i)pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	75	50	140	NSS	50	140
Dibenzo(a,j)acridine	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	88	50	140	NSS	50	140
Fluoranthene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	109	50	140	NSS	50	140
Indeno(1,2,3-cd)pyrene	GCM0499-SEP22	mg/L	0.0002	< 0.0002	NSS	30	109	50	140	NSS	50	140
Perylene	GCM0499-SEP22	mg/L	0.0005	< 0.0005	NSS	30	101	50	140	NSS	50	140
Phenanthrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	106	50	140	NSS	50	140
Pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	101	50	140	NSS	50	140



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Suspended Solids

Method: SM 2540D | Internal ref.: ME-CA-IENVIEWL-LAK-AN-004

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Total Suspended Solids	EWL0493-SEP22	mg/L	2	< 2	0	10	101	90	110	NA		

### Total Nitrogen

Method: SM 4500-N C/4500-NO3- F | Internal ref.: ME-CA-IENVISFA-LAK-AN-002

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Total Kjeldahl Nitrogen	SKA0230-SEP22	as N mg/L	0.5	<0.5	1	10	103	90	110	108	75	125

QC SUMMARY

Volatile Organics

Method: EPA 5030B/8260C | Internal ref.: ME-CA-ENVIGC-LAK-AN-004

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
1,1,1,2-Tetrachloroethane	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	95	60	130	99	50	140
1,1,2,2-Tetrachloroethane	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	95	60	130	97	50	140
1,2-Dichlorobenzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	99	50	140
1,4-Dichlorobenzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	97	50	140
Benzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	95	60	130	99	50	140
Chloroform	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	94	60	130	98	50	140
cis-1,2-Dichloroethene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	101	50	140
Ethylbenzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	101	50	140
m-p-xylene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	99	50	140
Methyl ethyl ketone	GCM0420-SEP22	mg/L	0.02	<0.02	ND	30	91	50	140	98	50	140
Methylene Chloride	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	99	50	140
o-xylene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	99	60	130	103	50	140
Styrene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	100	50	140
Tetrachloroethylene (perchloroethylene)	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	98	60	130	101	50	140
Toluene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	99	50	140
trans-1,3-Dichloropropene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	99	60	130	103	50	140
Trichloroethylene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	98	50	140

## QC SUMMARY

---

**Method Blank:** a blank matrix that is carried through the entire analytical procedure. Used to assess laboratory contamination.

**Duplicate:** Paired analysis of a separate portion of the same sample that is carried through the entire analytical procedure. Used to evaluate measurement precision.

**LCS/Spike Blank:** Laboratory control sample or spike blank refer to a blank matrix to which a known amount of analyte has been added. Used to evaluate analyte recovery and laboratory accuracy without sample matrix effects.

**Matrix Spike:** A sample to which a known amount of the analyte of interest has been added. Used to evaluate laboratory accuracy with sample matrix effects.

**Reference Material:** a material or substance matrix matched to the samples that contains a known amount of the analyte of interest. A reference material may be used in place of a matrix spike.

**RL:** Reporting limit

**RPD:** Relative percent difference

**AC:** Acceptance criteria

**Multielement Scan Qualifier:** as the number of analytes in a scan increases, so does the chance of a limit exceedance by random chance as opposed to a real method problem. Thus, in multielement scans, for the LCS and matrix spike, up to 10% of the analytes may exceed the quoted limits by up to 10% absolute and the spike is considered acceptable.

**Duplicate Qualifier:** for duplicates as the measured result approaches the RL, the uncertainty associated with the value increases dramatically, thus duplicate acceptance limits apply only where the average of the two duplicates is greater than five times the RL.

**Matrix Spike Qualifier:** for matrix spikes, as the concentration of the native analyte increases, the uncertainty of the matrix spike recovery increases. Thus, the matrix spike acceptance limits apply only when the concentration of the matrix spike is greater than or equal to the concentration of the native analyte.



## LEGEND

---

### FOOTNOTES

- NSS** Insufficient sample for analysis.
- RL** Reporting Limit.
  - ↑ Reporting limit raised.
  - ↓ Reporting limit lowered.
- NA** The sample was not analysed for this analyte
- ND** Non Detect

Results relate only to the sample tested.

Data reported represent the sample as submitted to SGS. Solid samples expressed on a dry weight basis.

"Temperature Upon Receipt" is representative of the whole shipment and may not reflect the temperature of individual samples.

Analysis conducted on samples submitted pursuant to or as part of Reg. 153/04, are in accordance to the "Protocol for Analytical Methods Used in the Assessment of Properties under Part XV.1 of the Environmental Protection Act and Excess Soil Quality" published by the Ministry and dated March 9, 2004 as amended.

SGS provides criteria information (such as regulatory or guideline limits and summary of limit exceedances) as a service. Every attempt is made to ensure the criteria information in this report is accurate and current, however, it is not guaranteed. Comparison to the most current criteria is the responsibility of the client and SGS assumes no responsibility for the accuracy of the criteria levels indicated.

SGS Canada Inc. statement of conformity decision rule does not consider uncertainty when analytical results are compared to a specified standard or regulation.

This document is issued, on the Client's behalf, by the Company under its General Conditions of Service available on request and accessible at [http://www.sgs.com/terms\\_and\\_conditions.htm](http://www.sgs.com/terms_and_conditions.htm).

The Client's attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any other holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. Reproduction of this analytical report in full or in part is prohibited.

This report supersedes all previous versions.

-- End of Analytical Report --

Received By: Soft v (mm/dd/yy)  
 Received Date: 09/23/2022  
 Received Time: 11:30 (hr : min)

Company: Accounting  
 Contact: Abdul Basim  
 Address: 6221 Hwy 7 Unit 16, Vaughan ON  
 Phone: 204-951-8164  
 Fax: abulbasim@abulbasim.com

Received By (signature): [Signature]  
 Cooling Agent Present: Yes  No   
 Custody Seal Intact: Yes  No   
 Temperature Upon Receipt (°C): 23

Project #: 22-200-100 P.O. #: 774 Lakeshore Rd E, Mississauga  
 Quotation #: 22-200-100 Site Location/ID: 774 Lakeshore Rd E, Mississauga  
 Turnaround Time (TAT) Required: Regular TAT (5-7days)

TAT's are quoted in business days (exclude statutory holidays & weekends)  
 Samples received after 6pm or on weekends: TAT begins next business day

RUSH TAT (Additional Charges May Apply):  1 Day  2 Days  3 Days  4 Days

PLEASE CONFIRM RUSH FEASIBILITY WITH SGS REPRESENTATIVE PRIOR TO SUBMISSION

Specify Due Date: \_\_\_\_\_

\*NOTE: DRINKING (POTABLE) WATER SAMPLES FOR HUMAN CONSUMPTION MUST BE SUBMITTED WITH SGS DRINKING WATER CHAIN OF CUSTODY

REPORT INFORMATION		INVOICE INFORMATION		REGULATIONS		RECORD OF SITE CONDITION (RSC)	
<input checked="" type="checkbox"/> (same as Report Information)	Company: <u>Accounting</u>	Other Regulations:	<input type="checkbox"/> Reg 347/558 (3 Day min TAT)	<input type="checkbox"/> O.Reg 153/04	<input type="checkbox"/> O.Reg 406/19	<input type="checkbox"/> Res/Park	Soil Texture:
Contact: _____	Address: _____	<input type="checkbox"/> PWOO	<input type="checkbox"/> MMER	<input type="checkbox"/> Table 1	<input type="checkbox"/> Table 2	<input type="checkbox"/> Ind/Com	<input type="checkbox"/> Coarse
Phone: _____	Address: _____	<input type="checkbox"/> CCME	<input type="checkbox"/> Other:	<input type="checkbox"/> Table 3	<input type="checkbox"/> Table 4	<input type="checkbox"/> Agr/Other	<input type="checkbox"/> Medium/Fine
Fax: _____	Address: _____	<input type="checkbox"/> MISA	<input type="checkbox"/> ODWS Not Reportable *See note	<input type="checkbox"/> Table 5	<input type="checkbox"/> Table 6	<input type="checkbox"/> Appx.	<input type="checkbox"/> >350m3
Sewer By-Law: <u>Mississauga</u>		Municipality: <u>Mississauga</u>		Soil Volume <input type="checkbox"/> <350m3 <input type="checkbox"/> >350m3		RECORD OF SITE CONDITION (RSC) <input type="checkbox"/> YES <input type="checkbox"/> NO	

SAMPLE IDENTIFICATION	DATE SAMPLED	TIME SAMPLED	# OF BOTTLES	MATRIX	Field Filtered (Y/N)	ANALYSIS REQUESTED												
						M & I	SVOC	PCB	PHC	VOC	Pest	Other (please specify)	SPLP	TCLP				
1 BH22-9	22/5/2022	PM	20	GW	N	Metals & Inorganics (Cd, Ni, Cu, Cr, Hg, Pb, Se, Zn, Ag, As, Ba, Be, B, Cd, Cr, Cu, Fe, Mn, Ni, Pb, Se, Zn, Ag, H, U, V, Zn)	PAHs only	SVOCs (All Ind PAHs, ABEs, CEs)	PCBs Total <input type="checkbox"/> Aroclor <input type="checkbox"/>	F1-F4 + BTEX no BTEX F1-F4 only	VOCs all incl BTEX BTEX only	Pesticides Organochlorine or specify other	Other (please specify) Water Characterization Pkg Sewer Use: <u>F&amp;L/Mississauga</u>	Specify tests <input type="checkbox"/> Metals <input type="checkbox"/> VOC <input type="checkbox"/> 1,4-Dioxins <input type="checkbox"/> OCP <input type="checkbox"/> ABN	Specify tests <input type="checkbox"/> Metals <input type="checkbox"/> VOC <input type="checkbox"/> PCB <input type="checkbox"/> B(b)P <input type="checkbox"/> ABN <input type="checkbox"/> Ignit.	COMMENTS: <u>Non-filtered</u>		
2																		
3																		
4																		
5																		
6																		
7																		
8																		
9																		
10																		
11																		
12																		

Observations/Comments/Special Instructions: \_\_\_\_\_

Sampled By (NAME): Abdul Basim Signature: [Signature] Date: 09/23/22 (mm/dd/yy)

Relinquished by (NAME): Abdul Basim Signature: [Signature] Date: 09/23/22 (mm/dd/yy)

Revision #: 1.5  
 Date of Issue: 02 May 2022

Note: Submission of samples to SGS is acknowledgement that you have been provided direction on sample collection, handling and transportation of samples. (2) Submission of samples to SGS is considered authorization for completion of work. Signatures may appear on this form or be retained on file in the contract, or in an alternative format (e.g. shipping documents). (3) Results may be sent by email to an unlimited number of addresses for no additional cost. Fax is available upon request. This document is issued by the Company under its General Conditions of Service accessible at [http://www.sgs.com/terms\\_and\\_conditions.htm](http://www.sgs.com/terms_and_conditions.htm). (Printed copies are available upon request.) Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein.

Pink Copy - Client  
 Yellow & White Copy - SGS

Industries & Environment - Lakefield: 185 Concession St., Lakefield, ON K0L 2H0 Phone: 705-652-2000 Fax: 705-652-6365 Web: www.sgs.com/environment  
- London: 657 Consortium Court, London, ON, N6E 2S8 Phone: 519-672-4500 Toll Free: 877-848-8060 Fax: 519-672-0361

Received By: Nicole Bergant  
Received Date: 10/03/22 (mm/dd/yy)  
Received Time: 11:30 (hr.: min)

Received By (signature): [Signature]  
Custody Seal Present: Yes  No   
Cooling Agent Present: Yes  No   
Custody Seal Intact: Yes  No   
Temperature Upon Receipt (°C): 9.9

LAB LIMS #: CA-14622-SEP22  
P.O. #: \_\_\_\_\_  
Site Location/ID: 774 Lakeshore Rd E, Mississauga

**REPORT INFORMATION**  
Company: DS Consultants  
Contact: Abdul Qadir  
Address: 6221 Hwy 7 Unit 16, Vaughan, ON  
Phone: 204-461-8164  
Fax: Abdul Qadir Edgars nhamk  
Email: .ca

**INVOICE INFORMATION**  
 (same as Report Information)  
Company: Accounting  
Contact: \_\_\_\_\_  
Address: \_\_\_\_\_  
Phone: \_\_\_\_\_  
Email: \_\_\_\_\_

**REGULATIONS**  
O.Reg 153/04  O.Reg 406/19   
Table 1  Res/Park  Soil Texture:  Coarse  Medium/Fine   
Table 2  Ind/Com   Other: \_\_\_\_\_  
Table 3  Agri/Other   Other: \_\_\_\_\_  
Table  Appx. \_\_\_\_\_  
Soil Volume  <350m3  >350m3

**ANALYSIS REQUESTED**

M & I	SVOC	PCB	PHC	VOC	Pest	Other (please specify)	SPLP TCLP
<input checked="" type="checkbox"/> Metals & Inorganics <input type="checkbox"/> Full Metals Suite <input type="checkbox"/> ICP Metals only <input type="checkbox"/> PAHs only <input type="checkbox"/> SVOCs <input type="checkbox"/> PCBS <input type="checkbox"/> F1-F4 + BTEX <input type="checkbox"/> F1-F4 only <input type="checkbox"/> VOCs <input type="checkbox"/> BTEX only <input type="checkbox"/> Pesticides <input type="checkbox"/> Organochlorine or specify other	<input type="checkbox"/> PAHs only <input type="checkbox"/> SVOCs <input type="checkbox"/> PCBS <input type="checkbox"/> F1-F4 + BTEX <input type="checkbox"/> F1-F4 only <input type="checkbox"/> VOCs <input type="checkbox"/> BTEX only <input type="checkbox"/> Pesticides <input type="checkbox"/> Organochlorine or specify other	<input type="checkbox"/> Total <input type="checkbox"/> Aroclor	<input type="checkbox"/> F1-F4 + BTEX <input type="checkbox"/> F1-F4 only	<input type="checkbox"/> VOCs <input type="checkbox"/> BTEX only	<input type="checkbox"/> Pesticides <input type="checkbox"/> Organochlorine or specify other	Sewer Use: <u>Rec Region / Mississauga</u> <input type="checkbox"/> General <input type="checkbox"/> Extended <input type="checkbox"/> Water Characterization Pkg	Specify tests <input type="checkbox"/> Metals <input type="checkbox"/> VOC <input type="checkbox"/> 1,4-dioxane <input type="checkbox"/> OCP <input type="checkbox"/> ABN <input type="checkbox"/> Light

**RECORD OF SITE CONDITION (RSC)** YES  NO

SAMPLE IDENTIFICATION	DATE SAMPLED	TIME SAMPLED	# OF BOTTLES	MATRIX
<u>BH22-9</u>	<u>03/oct/2022</u>	<u>Am</u>	<u>1</u>	<u>GW</u>

**COMMENTS:**  
CA14622  
Append

Observations/Comments/Special Instructions

Sampled By (NAME): Abdul Qadir Signature: [Signature] Date: 10/03/22 (mm/dd/yy)  
Relinquished by (NAME): Abdul Qadir Signature: [Signature] Date: 10/03/22 (mm/dd/yy)

Revision #: 1.6  
Date of Issue: 02 May 2022

Note: Submission of samples to SGS is acknowledgement that you have been provided direction on sample collection/handling and transportation of samples. (2) Submission of samples to SGS is considered authorization for completion of work. Signatures may appear on this form or be retained on file in the contract, or in an alternative format (e.g. shipping documents). (3) Results may be sent by email to an unlimited number of addresses for no additional cost. Fax is available upon request. This document is issued by the Company under its General Conditions of Service accessible at [http://www.sgs.com/terms\\_and\\_conditions.htm](http://www.sgs.com/terms_and_conditions.htm). (Printed copies are available upon request.) Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein.



## FINAL REPORT

CA14622-SEP22 R1

22-200-100, 974 Lakeshore Rd E, Mississauga

Prepared for

**DS Consultants**

## First Page

### CLIENT DETAILS

Client DS Consultants

Address 6221 Highway 7 Unit 6  
Vaughan, Ontario  
L4H 0K8, Canada

Contact Abdul Qadir

Telephone 204-951-8164

Facsimile 905-264-2685

Email [abdul.qadir@dsconsultants.ca](mailto:abdul.qadir@dsconsultants.ca); [don.hsu@dsconsultants.ca](mailto:don.hsu@dsconsultants.ca)

Project 22-200-100, 974 Lakeshore Rd E, Mississauga

Order Number

Samples Ground Water (2)

### LABORATORY DETAILS

Project Specialist Maarit Wolfe, Hon.B.Sc

Laboratory SGS Canada Inc.

Address 185 Concession St., Lakefield ON, K0L 2H0

Telephone 705-652-2000

Facsimile 705-652-6365

Email [Maarit.Wolfe@sgs.com](mailto:Maarit.Wolfe@sgs.com)

SGS Reference CA14622-SEP22

Received 09/23/2022

Approved 10/05/2022

Report Number CA14622-SEP22 R1

Date Reported 10/05/2022

### COMMENTS

RL - SGS Reporting Limit

Temperature of Sample upon Receipt: 8 degrees C

Cooling Agent Present: Yes

Custody Seal Present: Yes

Chain of Custody Number: 033384

Metals limits raised 10x due to sample matrix

### SIGNATORIES

Maarit Wolfe, Hon.B.Sc



TABLE OF CONTENTS

---

First Page.....	1
Index.....	2
Results.....	3-7
Exceedance Summary.....	8
QC Summary.....	9-19
Legend.....	20
Annexes.....	21-22



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9
		03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Peel Table 1 - Sanitary Sewer Discharge - BL\_53\_2010

L2 = SANSEW / WATER / - - Peel Table 2 - Storm Sewer Discharge - BL\_53\_2010

Parameter	Units	RL	L1	L2	Result	Result
<b>General Chemistry</b>						
Biochemical Oxygen Demand (BOD5)	mg/L	2	300	15	< 4 †	---
Total Suspended Solids	mg/L	2	350	15	9560	---
Total Kjeldahl Nitrogen	as N mg/L	0.5	100	1	< 0.5	---

### Metals and Inorganics

Total Chlorine	mg/L	0.02			< 0.02	---
Fluoride	mg/L	0.06	10		0.18	---
Cyanide (total)	mg/L	0.01	2	0.02	< 0.01	---
Sulphate	mg/L	2	1500		98	---
Aluminum (0.2µm)	mg/L	0.001			0.211	---
Aluminum (total)	mg/L	0.01	50		63.5	---
Antimony (total)	mg/L	0.009	5		< 0.009	---
Arsenic (total)	mg/L	0.002	1	0.02	0.038	---
Cadmium (total)	mg/L	0.00003	0.7	0.008	0.00012	---
Chromium (total)	mg/L	0.0008	5	0.08	0.117	---
Copper (total)	mg/L	0.002	3	0.05	0.129	---
Cobalt (total)	mg/L	0.00004	5		0.0661	---
Lead (total)	mg/L	0.0009	3	0.12	0.0362	---
Manganese (total)	mg/L	0.0001	5	0.05	5.44	---
Molybdenum (total)	mg/L	0.0004	5		0.0033	---
Nickel (total)	mg/L	0.001	3	0.08	0.135	---
Phosphorus (total)	mg/L	0.03	10	0.4	3.76	---



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9
		03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Peel Table 1 - Sanitary Sewer Discharge - BL\_53\_2010

L2 = SANSEW / WATER / - - Peel Table 2 - Storm Sewer Discharge - BL\_53\_2010

Parameter	Units	RL	L1	L2	Result	Result
<b>Metals and Inorganics (continued)</b>						
Selenium (total)	mg/L	0.0004	1	0.02	0.0006	---
Silver (total)	mg/L	0.0005	5	0.12	< 0.0005	---
Tin (total)	mg/L	0.0006	5		0.0016	---
Titanium (total)	mg/L	0.0005	5		0.190	---
Zinc (total)	mg/L	0.02	3	0.04	0.37	---

### Microbiology

E. Coli	cfu/100mL	0		200	---	0
---------	-----------	---	--	-----	-----	---

### Nonylphenol and Ethoxylates

Nonylphenol	mg/L	0.001	0.02		< 0.001	---
Nonylphenol Ethoxylates	mg/L	0.01	0.2		< 0.01	---
Nonylphenol diethoxylate	mg/L	0.01			< 0.01	---
Nonylphenol monoethoxylate	mg/L	0.01			< 0.01	---

### Oil and Grease

Oil & Grease (total)	mg/L	2			< 2	---
Oil & Grease (animal/vegetable)	mg/L	4	150		< 4	---
Oil & Grease (mineral/synthetic)	mg/L	4	15		< 4	---





# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9
		03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Peel Table 1 - Sanitary Sewer Discharge - BL\_53\_2010

L2 = SANSEW / WATER / - - Peel Table 2 - Storm Sewer Discharge - BL\_53\_2010

Parameter	Units	RL	L1	L2	Result	Result
<b>Other (ORP)</b>						
pH	No unit	0.05	10	9	7.13	---
Chromium VI	mg/L	0.0002			< 0.0002	---
Mercury (total)	mg/L	0.00001	0.01	0.0004	0.00001	---
<b>PAHs</b>						
Benzo(b+j)fluoranthene	mg/L	0.0001			< 0.0001	---
<b>PCBs</b>						
Polychlorinated Biphenyls (PCBs) - Total	µg/L	0.04	1	0.4	< 0.04	---
<b>Phenols</b>						
4AAP-Phenolics	mg/L	0.002	1	0.008	< 0.002	---
<b>SVOCs</b>						
di-n-Butyl Phthalate	mg/L	0.002	0.08	0.015	< 0.002	---
Bis(2-ethylhexyl)phthalate	mg/L	0.002	0.012	0.0088	< 0.002	---
PAHs (Total)	mg/L				< 0.001	---
Perylene	mg/L	0.0005			< 0.0005	---



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

<b>Sample Number</b>	8	9
<b>Sample Name</b>	BH22-9	BH22-9
		03-Oct-22
<b>Sample Matrix</b>	Ground Water	Ground Water
<b>Sample Date</b>	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Peel Table 1 - Sanitary Sewer Discharge - BL\_53\_2010

L2 = SANSEW / WATER / - - Peel Table 2 - Storm Sewer Discharge - BL\_53\_2010

Parameter	Units	RL	L1	L2	Result	Result
<b>SVOCs - PAHs</b>						
7Hdibenzo(c,g)carbazole	mg/L	0.0001			< 0.0001	---
Anthracene	mg/L	0.0001			< 0.0001	---
Benzo(a)anthracene	mg/L	0.0001			< 0.0001	---
Benzo(a)pyrene	mg/L	0.0001			< 0.0001	---
Benzo(e)pyrene	mg/L	0.0001			< 0.0001	---
Benzo(ghi)perylene	mg/L	0.0002			< 0.0002	---
Benzo(k)fluoranthene	mg/L	0.0001			< 0.0001	---
Chrysene	mg/L	0.0001			< 0.0001	---
Dibenzo(a,h)anthracene	mg/L	0.0001			< 0.0001	---
Dibenzo(a,i)pyrene	mg/L	0.0001			< 0.0001	---
Dibenzo(a,j)acridine	mg/L	0.0001			< 0.0001	---
Fluoranthene	mg/L	0.0001			< 0.0001	---
Indeno(1,2,3-cd)pyrene	mg/L	0.0002			< 0.0002	---
Phenanthrene	mg/L	0.0001			< 0.0001	---
Pyrene	mg/L	0.0001			< 0.0001	---



# FINAL REPORT

CA14622-SEP22 R1

**Client:** DS Consultants

**Project:** 22-200-100, 974 Lakeshore Rd E, Mississauga

**Project Manager:** Abdul Qadir

**Samplers:** Abdul Qadir

MATRIX: WATER

Sample Number	8	9
Sample Name	BH22-9	BH22-9
		03-Oct-22
Sample Matrix	Ground Water	Ground Water
Sample Date	22/09/2022	03/10/2022

L1 = SANSEW / WATER / - - Peel Table 1 - Sanitary Sewer Discharge - BL\_53\_2010

L2 = SANSEW / WATER / - - Peel Table 2 - Storm Sewer Discharge - BL\_53\_2010

Parameter	Units	RL	L1	L2	Result	Result
<b>VOCs</b>						
Chloroform	mg/L	0.0005	0.04	0.002	< 0.0005	---
1,2-Dichlorobenzene	mg/L	0.0005	0.05	0.0056	< 0.0005	---
1,4-Dichlorobenzene	mg/L	0.0005	0.08	0.0068	< 0.0005	---
cis-1,2-Dichloroethene	mg/L	0.0005	4	0.0056	0.0115	---
trans-1,3-Dichloropropene	mg/L	0.0005	0.14	0.0056	< 0.0005	---
Methylene Chloride	mg/L	0.0005	2	0.0052	< 0.0005	---
1,1,2,2-Tetrachloroethane	mg/L	0.0005	1.4	0.017	< 0.0005	---
1,1,1,2-Tetrachloroethane	mg/L	0.0005			< 0.0005	---
Methyl ethyl ketone	mg/L	0.02	8		< 0.02	---
Styrene	mg/L	0.0005	0.2		< 0.0005	---
Tetrachloroethylene (perchloroethylene)	mg/L	0.0005	1	0.0044	< 0.0005	---
Trichloroethylene	mg/L	0.0005	0.4	0.008	0.0029	---

**VOCs - BTEX**

Benzene	mg/L	0.0005	0.01	0.002	< 0.0005	---
Ethylbenzene	mg/L	0.0005	0.16	0.002	< 0.0005	---
Toluene	mg/L	0.0005	0.27	0.002	< 0.0005	---
Xylene (total)	mg/L	0.0005	1.4	0.0044	< 0.0005	---
m-p-xylene	mg/L	0.0005			< 0.0005	---
o-xylene	mg/L	0.0005			< 0.0005	---

## EXCEEDANCE SUMMARY

Parameter	Method	Units	Result	SANSEW / WATER	SANSEW / WATER
				/ - - Peel Table 1 - Sanitary Sewer Discharge - BL_53_2010 L1	/ - - Peel Table 2 - Storm Sewer Discharge - BL_53_2010 L2

### BH22-9

Parameter	Method	Units	Result	L1	L2
cis-1,2-Dichloroethene	EPA 5030B/8260C	mg/L	0.0115		0.0056
Total Suspended Solids	SM 2540D	mg/L	9560	350	15
Aluminum	SM 3030/EPA 200.8	mg/L	63.5	50	
Arsenic	SM 3030/EPA 200.8	mg/L	0.038		0.02
Chromium	SM 3030/EPA 200.8	mg/L	0.117		0.08
Copper	SM 3030/EPA 200.8	mg/L	0.129		0.05
Manganese	SM 3030/EPA 200.8	mg/L	5.44	5	0.05
Nickel	SM 3030/EPA 200.8	mg/L	0.135		0.08
Phosphorus	SM 3030/EPA 200.8	mg/L	3.76		0.4
Zinc	SM 3030/EPA 200.8	mg/L	0.37		0.04



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Anions by discrete analyzer

Method: US EPA 375.4 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-026

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Sulphate	DIO5058-SEP22	mg/L	2	<2	9	20	111	80	120	91	75	125

### Biochemical Oxygen Demand

Method: SM 5210 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-007

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Biochemical Oxygen Demand (BOD5)	BOD0050-SEP22	mg/L	2	< 2	15	30	102	70	130	82	70	130

### Chlorine

Method: SM 4500 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-008

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Total Chlorine	EWL0494-SEP22	mg/L	0.02	< 0.02	ND	20	99	90	110	NA		



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Cyanide by SFA

Method: SM 4500 | Internal ref.: ME-CA-IENVISFA-LAK-AN-005

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Cyanide (total)	SKA0220-SEP22	mg/L	0.01	<0.01	ND	10	95	90	110	NV	75	125

### Fluoride by Specific Ion Electrode

Method: SM 4500 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-014

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Fluoride	EWL0495-SEP22	mg/L	0.06	<0.06	5	10	100	90	110	110	75	125

### Hexavalent Chromium by SFA

Method: EPA218.6/EPA3060A | Internal ref.: ME-CA-IENVISKA-LAK-AN-012

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Chromium VI	SKA0234-SEP22	mg/L	0.0002	<0.0002	ND	20	100	80	120	92	75	125



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

Mercury by CVAAS

Method: EPA 7471A/SM 3112B | Internal ref.: ME-CA-IENVISPE-LAK-AN-004

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Mercury (total)	EHG0052-SEP22	mg/L	0.00001	< 0.00001	11	20	118	80	120	102	70	130



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

Metals in aqueous samples - ICP-MS

Method: SM 3030/EPA 200.8 | Internal ref.: ME-CA-IENVISPE-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Silver (total)	EMS0238-SEP22	mg/L	0.0005	<0.00005	ND	20	103	90	110	71	70	130
Aluminum (total)	EMS0238-SEP22	mg/L	0.01	<0.001	2	20	93	90	110	89	70	130
Arsenic (total)	EMS0238-SEP22	mg/L	0.002	<0.0002	6	20	106	90	110	103	70	130
Cadmium (total)	EMS0238-SEP22	mg/L	0.00003	<0.000003	20	20	103	90	110	91	70	130
Cobalt (total)	EMS0238-SEP22	mg/L	0.00004	<0.000004	7	20	104	90	110	102	70	130
Chromium (total)	EMS0238-SEP22	mg/L	0.0008	<0.00008	11	20	100	90	110	109	70	130
Copper (total)	EMS0238-SEP22	mg/L	0.002	<0.0002	14	20	100	90	110	91	70	130
Manganese (total)	EMS0238-SEP22	mg/L	0.0001	<0.00001	2	20	107	90	110	97	70	130
Molybdenum (total)	EMS0238-SEP22	mg/L	0.0004	<0.00004	7	20	94	90	110	100	70	130
Nickel (total)	EMS0238-SEP22	mg/L	0.001	<0.0001	0	20	100	90	110	92	70	130
Lead (total)	EMS0238-SEP22	mg/L	0.0009	<0.00001	14	20	94	90	110	89	70	130
Phosphorus (total)	EMS0238-SEP22	mg/L	0.03	<0.003	9	20	96	90	110	NV	70	130
Antimony (total)	EMS0238-SEP22	mg/L	0.009	<0.0009	ND	20	95	90	110	101	70	130
Selenium (total)	EMS0238-SEP22	mg/L	0.0004	<0.00004	7	20	101	90	110	95	70	130
Tin (total)	EMS0238-SEP22	mg/L	0.0006	<0.00006	ND	20	97	90	110	NV	70	130
Titanium (total)	EMS0238-SEP22	mg/L	0.0005	<0.00005	2	20	97	90	110	NV	70	130
Zinc (total)	EMS0238-SEP22	mg/L	0.02	<0.002	4	20	103	90	110	80	70	130
Aluminum (0.2µm)	EMS0242-SEP22	mg/L	0.001	<0.001	2	20	101	90	110	75	70	130





# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Microbiology

Method: SM 9222D | Internal ref.: ME-CA-IENVIMIC-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
E. Coli	BAC9013-OCT22	cfu/100mL	-	ACCEPTED	ACCEPTED							

### Nonylphenol and Ethoxylates

Method: ASTM D7065-06 | Internal ref.: ME-CA-IENVIGC-LAK-AN-015

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Nonylphenol diethoxylate	GCM0393-SEP22	mg/L	0.01	<0.01			88	55	120			
Nonylphenol Ethoxylates	GCM0393-SEP22	mg/L	0.01	< 0.01								
Nonylphenol monoethoxylate	GCM0393-SEP22	mg/L	0.01	<0.01			90	55	120			
Nonylphenol	GCM0393-SEP22	mg/L	0.001	<0.001			91	55	120			

## QC SUMMARY

### Oil & Grease

Method: MOE E3401 | Internal ref.: ME-CA-IENVIGC-LAK-AN-019

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Oil & Grease (total)	GCM0482-SEP22	mg/L	2	<2	NSS	20	105	75	125			

### Oil & Grease-AV/MS

Method: MOE E3401/SM 5520F | Internal ref.: ME-CA-IENVIGC-LAK-AN-019

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Oil & Grease (animal/vegetable)	GCM0482-SEP22	mg/L	4	< 4	NSS	20	NA	70	130			
Oil & Grease (mineral/synthetic)	GCM0482-SEP22	mg/L	4	< 4	NSS	20	NA	70	130			

### pH

Method: SM 4500 | Internal ref.: ME-CA-IENVIEWL-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
pH	EWL0496-SEP22	No unit	0.05	NA	1		100			NA		



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Phenols by SFA

Method: SM 5530B-D | Internal ref.: ME-CA-IENVISFA-LAK-AN-006

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
4AAP-Phenolics	SKA0228-SEP22	mg/L	0.002	<0.002	ND	10	105	80	120	102	75	125

### Polychlorinated Biphenyls

Method: MOE E3400/EPA 8082A | Internal ref.: ME-CA-IENVIGC-LAK-AN-001

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Polychlorinated Biphenyls (PCBs) - Total	GCM0452-SEP22	ug/L	0.04	< 0.04	NSS	30	100	60	140	NSS	60	140

## QC SUMMARY

### Semi-Volatile Organics

Method: EPA 3510C/8270D | Internal ref.: ME-CA-IENVIGC-LAK-AN-005

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
7Hdibenzo(c,g)carbazole	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	93	50	140	NSS	50	140
Anthracene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	104	50	140	NSS	50	140
Benzo(a)anthracene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	100	50	140	NSS	50	140
Benzo(a)pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	103	50	140	NSS	50	140
Benzo(b+j)fluoranthene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	99	50	140	NSS	50	140
Benzo(e)pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	98	50	140	NSS	50	140
Benzo(ghi)perylene	GCM0499-SEP22	mg/L	0.0002	< 0.0002	NSS	30	99	50	140	NSS	50	140
Benzo(k)fluoranthene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	102	50	140	NSS	50	140
Bis(2-ethylhexyl)phthalate	GCM0499-SEP22	mg/L	0.002	< 0.002	NSS	30	137	50	140	NSS	50	140
Chrysene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	105	50	140	NSS	50	140
di-n-Butyl Phthalate	GCM0499-SEP22	mg/L	0.002	< 0.002	NSS	30	132	50	140	NSS	50	140
Dibenzo(a,h)anthracene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	104	50	140	NSS	50	140
Dibenzo(a,i)pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	75	50	140	NSS	50	140
Dibenzo(a,j)acridine	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	88	50	140	NSS	50	140
Fluoranthene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	109	50	140	NSS	50	140
Indeno(1,2,3-cd)pyrene	GCM0499-SEP22	mg/L	0.0002	< 0.0002	NSS	30	109	50	140	NSS	50	140
Perylene	GCM0499-SEP22	mg/L	0.0005	< 0.0005	NSS	30	101	50	140	NSS	50	140
Phenanthrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	106	50	140	NSS	50	140
Pyrene	GCM0499-SEP22	mg/L	0.0001	< 0.0001	NSS	30	101	50	140	NSS	50	140



# FINAL REPORT

CA14622-SEP22 R1

## QC SUMMARY

### Suspended Solids

Method: SM 2540D | Internal ref.: ME-CA-IENVIEWL-LAK-AN-004

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Total Suspended Solids	EWL0493-SEP22	mg/L	2	< 2	0	10	101	90	110	NA		

### Total Nitrogen

Method: SM 4500-N C/4500-NO3- F | Internal ref.: ME-CA-IENVISFA-LAK-AN-002

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
Total Kjeldahl Nitrogen	SKA0230-SEP22	as N mg/L	0.5	<0.5	1	10	103	90	110	108	75	125

QC SUMMARY

Volatile Organics

Method: EPA 5030B/8260C | Internal ref.: ME-CA-ENVIGC-LAK-AN-004

Parameter	QC batch Reference	Units	RL	Method Blank	Duplicate		LCS/Spike Blank			Matrix Spike / Ref.		
					RPD	AC (%)	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
								Low	High		Low	High
1,1,1,2-Tetrachloroethane	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	95	60	130	99	50	140
1,1,2,2-Tetrachloroethane	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	95	60	130	97	50	140
1,2-Dichlorobenzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	99	50	140
1,4-Dichlorobenzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	97	50	140
Benzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	95	60	130	99	50	140
Chloroform	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	94	60	130	98	50	140
cis-1,2-Dichloroethene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	101	50	140
Ethylbenzene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	101	50	140
m-p-xylene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	99	50	140
Methyl ethyl ketone	GCM0420-SEP22	mg/L	0.02	<0.02	ND	30	91	50	140	98	50	140
Methylene Chloride	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	96	60	130	99	50	140
o-xylene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	99	60	130	103	50	140
Styrene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	100	50	140
Tetrachloroethylene (perchloroethylene)	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	98	60	130	101	50	140
Toluene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	99	50	140
trans-1,3-Dichloropropene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	99	60	130	103	50	140
Trichloroethylene	GCM0420-SEP22	mg/L	0.0005	<0.0005	ND	30	97	60	130	98	50	140

## QC SUMMARY

---

**Method Blank:** a blank matrix that is carried through the entire analytical procedure. Used to assess laboratory contamination.

**Duplicate:** Paired analysis of a separate portion of the same sample that is carried through the entire analytical procedure. Used to evaluate measurement precision.

**LCS/Spike Blank:** Laboratory control sample or spike blank refer to a blank matrix to which a known amount of analyte has been added. Used to evaluate analyte recovery and laboratory accuracy without sample matrix effects.

**Matrix Spike:** A sample to which a known amount of the analyte of interest has been added. Used to evaluate laboratory accuracy with sample matrix effects.

**Reference Material:** a material or substance matrix matched to the samples that contains a known amount of the analyte of interest. A reference material may be used in place of a matrix spike.

**RL:** Reporting limit

**RPD:** Relative percent difference

**AC:** Acceptance criteria

**Multielement Scan Qualifier:** as the number of analytes in a scan increases, so does the chance of a limit exceedance by random chance as opposed to a real method problem. Thus, in multielement scans, for the LCS and matrix spike, up to 10% of the analytes may exceed the quoted limits by up to 10% absolute and the spike is considered acceptable.

**Duplicate Qualifier:** for duplicates as the measured result approaches the RL, the uncertainty associated with the value increases dramatically, thus duplicate acceptance limits apply only where the average of the two duplicates is greater than five times the RL.

**Matrix Spike Qualifier:** for matrix spikes, as the concentration of the native analyte increases, the uncertainty of the matrix spike recovery increases. Thus, the matrix spike acceptance limits apply only when the concentration of the matrix spike is greater than or equal to the concentration of the native analyte.

## LEGEND

---

### FOOTNOTES

- NSS** Insufficient sample for analysis.
- RL** Reporting Limit.
  - ↑ Reporting limit raised.
  - ↓ Reporting limit lowered.
- NA** The sample was not analysed for this analyte
- ND** Non Detect

Results relate only to the sample tested.

Data reported represent the sample as submitted to SGS. Solid samples expressed on a dry weight basis.

"Temperature Upon Receipt" is representative of the whole shipment and may not reflect the temperature of individual samples.

Analysis conducted on samples submitted pursuant to or as part of Reg. 153/04, are in accordance to the "Protocol for Analytical Methods Used in the Assessment of Properties under Part XV.1 of the Environmental Protection Act and Excess Soil Quality" published by the Ministry and dated March 9, 2004 as amended.

SGS provides criteria information (such as regulatory or guideline limits and summary of limit exceedances) as a service. Every attempt is made to ensure the criteria information in this report is accurate and current, however, it is not guaranteed. Comparison to the most current criteria is the responsibility of the client and SGS assumes no responsibility for the accuracy of the criteria levels indicated.

SGS Canada Inc. statement of conformity decision rule does not consider uncertainty when analytical results are compared to a specified standard or regulation.

This document is issued, on the Client's behalf, by the Company under its General Conditions of Service available on request and accessible at [http://www.sgs.com/terms\\_and\\_conditions.htm](http://www.sgs.com/terms_and_conditions.htm).

The Client's attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any other holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. Reproduction of this analytical report in full or in part is prohibited.

This report supersedes all previous versions.

-- End of Analytical Report --





**Request for Laboratory Services and CHAIN OF CUSTODY**

No: 033384

Page 1 of 1

**Laboratory Information Section - Lab use only**

Received By: Soft  
 Received Date: 09/23/2022 (mm/dd/yy)  
 Received Time: 11:30 (hr : min)

Received By (signature): [Signature]  
 Custody Seal Present: Yes  No   
 Cooling Agent Present: Yes  No  Type: ICE  
 Custody Seal Intact: Yes  No   
 Temperature Upon Receipt (°C): 28.3

LAB LIMS #: CA14622-SEP22

**REPORT INFORMATION**  
 Company: Accounting  
 Contact: Abdul Qadin  
 Address: 6221 Hwy 7 Unit 16, Vaughan ON  
 Phone: 204-951-8164  
 Fax: [Blank]  
 Email: abdul.qadin@cdsconsultants.ca

**INVOICE INFORMATION**  
 (same as Report Information)  
 Company: Accounting  
 Contact: [Blank]  
 Address: [Blank]  
 Phone: [Blank]  
 Email: [Blank]

Quotation #: [Blank] P.O. #: [Blank]  
 Project #: 22-200-100 Site Location/ID: 974 Lakeshore Rd E, Mississauga  
**TURNAROUND TIME (TAT) REQUIRED**  
 Regular TAT (5-7days) TAT's are quoted in business days (exclude statutory holidays & weekends).  
 RUSH TAT (Additional Charges May Apply):  1 Day  2 Days  3 Days  4 Days  
 Samples received after 6pm or on weekends: TAT begins next business day  
**PLEASE CONFIRM RUSH FEASIBILITY WITH SGS REPRESENTATIVE PRIOR TO SUBMISSION**  
 Specify Due Date: [Blank] \*NOTE: DRINKING (POTABLE) WATER SAMPLES FOR HUMAN CONSUMPTION MUST BE SUBMITTED WITH SGS DRINKING WATER CHAIN OF CUSTODY

**REGULATIONS**  
 O.Reg 153/04  O.Reg 406/19  
 Table 1  Res/Park  Soil Texture:  Coarse  Medium/Fine  
 Table 2  Ind/Com  Agri/Other  Appx.  
 Table 3  Soil Volume  <350m3  >350m3  
 Other Regulations:  Reg 347/558 (3 Day min TAT)  PWQO  MMR  CCME  Other:  MISA  ODWS Not Reportable \*See note  
 Sewer By-Law:  Sanitary  Storm  
 Municipality: Peel / Mississauga

**ANALYSIS REQUESTED**

M & I	SVOC	PCB	PHC	VOC	Pest	Other (please specify)	SPLP	TCPLP
Field Filtered (Y/N)	PAHs only	Total <input type="checkbox"/> Arochlor <input type="checkbox"/>	F1-F4 + BTEX	VOCs all incl BTEX	Pesticides Organochlorine or specify other	Sewer Use: <u>Peel / Mississauga</u> Water Characterization Pkg General <input type="checkbox"/> Extended <input type="checkbox"/>	<input type="checkbox"/> Metals <input type="checkbox"/> VOC <input type="checkbox"/> 1,4-Dioxane <input type="checkbox"/> OCP <input type="checkbox"/> ABN	<input type="checkbox"/> M&I <input type="checkbox"/> VOC <input type="checkbox"/> PCB <input type="checkbox"/> B(p)P <input type="checkbox"/> ABN <input type="checkbox"/> Ignit.

**RECORD OF SITE CONDITION (RSC)**  YES  NO

SAMPLE IDENTIFICATION	DATE SAMPLED	TIME SAMPLED	# OF BOTTLES	MATRIX	Field Filtered (Y/N)	M & I	SVOC	PCB	PHC	VOC	Pest	Other	SPLP	TCPLP	COMMENTS:
1 BH22-9	22/Sep/2022	PM	20	GW	N										Non filtered
2															
3															
4															
5															
6															
7															
8															
9															
10															
11															
12															

Observations/Comments/Special Instructions: [Blank]

Sampled By (NAME): Abdul Qadin Signature: [Signature] Date: 09/23/22 (mm/dd/yy) Pink Copy - Client  
 Relinquished by (NAME): Abdul Qadin Signature: [Signature] Date: 09/23/22 (mm/dd/yy) Yellow & White Copy - SGS

Revision #: 1.5 Note: Submission of samples to SGS is acknowledgement that you have been provided direction on sample collection/handling and transportation of samples. (2) Submission of samples to SGS is considered authorization for completion of work. Signatures may appear on this form or be retained on file in the contract, or in an alternative format (e.g. shipping documents). (3) Results may be sent by email to an unlimited number of addresses for no additional cost. Fax is available upon request. This document is issued by the Company under its General Conditions of Service accessible at [http://www.sgs.com/terms\\_and\\_conditions.htm](http://www.sgs.com/terms_and_conditions.htm). (Printed copies are available upon request.) Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein.



**Request for Laboratory Services and CHAIN OF CUSTODY**

**Laboratory Information Section - Lab use only**

Received By: Nigole Brigant  
 Received Date: 10/03/22 (mm/dd/yy)  
 Received Time: 11:30 (hr:min)

Received By (signature): [Signature]  
 Custody Seal Present: Yes  No   
 Custody Seal Intact: Yes  No   
 Cooling Agent Present: Yes  No  Type: Ice packs  
 Temperature Upon Receipt (°C): 9.9.9

LAB LIMS #: CA-14622-SEP22

REPORT INFORMATION	INVOICE INFORMATION
Company: <u>DS Consultants</u>	<input checked="" type="checkbox"/> (same as Report Information)
Contact: <u>Abdul Qadir</u>	Company: <u>Accounting</u>
Address: <u>6221 Hwy 7, Unit 16, Vaughan, ON</u>	Contact: _____
Phone: <u>204-951-8164</u>	Address: _____
Fax: _____	Phone: _____
Email: <u>abdul.qadir@dsconsultants.ca</u>	Email: _____

Quotation #: \_\_\_\_\_ P.O. #: \_\_\_\_\_  
 Project #: 22-200-100 Site Location/ID: 774 Lakeshore Rd G, Mississauga

**TURNAROUND TIME (TAT) REQUIRED**  
 Regular TAT (5-7 days) TAT's are quoted in business days (exclude statutory holidays & weekends). Samples received after 6pm or on weekends: TAT begins next business day

RUSH TAT (Additional Charges May Apply):  1 Day  2 Days  3 Days  4 Days  
**PLEASE CONFIRM RUSH FEASIBILITY WITH SGS REPRESENTATIVE PRIOR TO SUBMISSION**

Specify Due Date: \_\_\_\_\_ \*NOTE: DRINKING (POTABLE) WATER SAMPLES FOR HUMAN CONSUMPTION MUST BE SUBMITTED WITH SGS DRINKING WATER CHAIN OF CUSTODY

**REGULATIONS**

O.Reg 153/04  O.Reg 406/19

Other Regulations:  
 Res/Park  Soil Texture:  
 Table 1  Ind/Com  Coarse  
 Table 2  Agri/Other  Medium/Fine  
 Table 3  Appx. \_\_\_\_\_  
 Soil Volume  <350m3  >350m3

Sewer By-Law:  
 Sanitary  
 Storm  
 Municipality: Peel Region/Mississauga

Reg 347/558 (3 Day min TAT)  
 PWQO  MMER  
 CCME  Other: \_\_\_\_\_  
 MISA  
 ODWS Not Reportable \*See note

**ANALYSIS REQUESTED**

M & I	SVOC	PCB	PHC	VOC	Pest	Other (please specify)	SPLP	TCLP
Field Filtered (Y/N)		Total <input type="checkbox"/> At/color <input type="checkbox"/>	F1-F4 + BTEX	F1-F4 only no BTEX	VOCs all incl BTEX	BTEX only	Pesticides Organochlorine or specify other	
Metals & Inorganics incl Cu, Ni, Cd, Hg, Pb, Cr, Mn, Zn, Fe, Al, Si, B, As, Ba, Be, Bi, Br, Ca, Co, Cr, Cu, Fe, Hg, Ni, Pb, Se, Sr, Tl, U, V, Zn								
Full Metals Suite ICP metals plus Bi (Pb, Sn) only Hg, Cu, Ni								
ICP Metals only Sb, As, Ba, Be, Bi, Br, Cd, Cr, Co, Cu, Pb, Mo, Ni, Se, Ag, Tl, U, V, Zn								
PAHs only								
SVOCs all incl PAHs, ABNs, CPs								
PCBs								
Field Use: <u>Peel Region</u> Specify pkg: <u>Mississauga</u>								
Water Characterization Pkg General <input type="checkbox"/> Extended <input type="checkbox"/>								
<input type="checkbox"/> Metals <input type="checkbox"/> M&I								
<input type="checkbox"/> VOC <input type="checkbox"/> VOC								
<input type="checkbox"/> 1,4-Dioxane <input type="checkbox"/> PCB								
<input type="checkbox"/> OCP <input type="checkbox"/> B(a)P								
<input type="checkbox"/> ABN <input type="checkbox"/> ABN								
<input type="checkbox"/> Ignit.								

RECORD OF SITE CONDITION (RSC)  YES  NO

SAMPLE IDENTIFICATION	DATE SAMPLED	TIME SAMPLED	# OF BOTTLES	MATRIX
1 BH22-9	03/oct/2022	Am	1	GW
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				

**COMMENTS:**

CA14622  
Append

Observations/Comments/Special Instructions

Sampled By (NAME): <u>Abdul Qadir</u>	Signature: <u>[Signature]</u>	Date: <u>10/03/22</u> (mm/dd/yy)	Pink Copy - Client
Relinquished by (NAME): <u>Abdul Qadir</u>	Signature: <u>[Signature]</u>	Date: <u>10/03/22</u> (mm/dd/yy)	Yellow & White Copy - SGS



Your Project #: 22-200-100  
 Site Location: RANGEVIEW RD, MISSISSAUGA  
 Your C.O.C. #: 930059-01-01

**Attention: PRADEEP PATEL**

DS Consultants Limited  
 6221 Highway 7, Unit 16  
 Vaughan, ON  
 CANADA L4H 0K8

**Report Date: 2023/05/01**  
 Report #: R7610413  
 Version: 1 - Final

**CERTIFICATE OF ANALYSIS**

**BUREAU VERITAS JOB #: C3A6391**

**Received: 2023/04/17, 13:05**

Sample Matrix: Water  
 # Samples Received: 1

Analyses	Quantity	Date	Date	Laboratory Method	Analytical Method
		Extracted	Analyzed		
ABN Compounds in Water by GC/MS	1	2023/04/20	2023/04/21	CAM SOP-00301	EPA 8270 m
Biochemical Oxygen Demand (BOD)	1	2023/04/21	2023/04/26	CAM SOP-00427	SM 23 5210B m
Carbonaceous BOD	1	2023/04/19	2023/04/24	CAM SOP-00427	SM 23 5210B m
Total Cyanide	1	2023/04/20	2023/04/20	CAM SOP-00457	OMOE E3015 5 m
Fluoride	1	2023/04/20	2023/04/20	CAM SOP-00449	SM 23 4500-F C m
Mercury in Water by CVAA	1	2023/04/20	2023/04/20	CAM SOP-00453	EPA 7470A m
Total Metals Analysis by Axial ICP	1	2023/04/20	2023/04/25	CAM SOP-00408	EPA 6010D m
E.coli, (CFU/100mL)	1	N/A	2023/04/19	CAM SOP-00552	MECP E3371
Total Nonylphenol in Liquids by HPLC	1	2023/04/21	2023/04/22	CAM SOP-00313	In-house Method
Nonylphenol Ethoxylates in Liquids: HPLC	1	2023/04/21	2023/04/22	CAM SOP-00313	Bureau Veritas
Animal and Vegetable Oil and Grease	1	N/A	2023/04/24	CAM SOP-00326	EPA1664B m,SM5520B m
Total Oil and Grease	1	2023/04/24	2023/04/24	CAM SOP-00326	EPA1664B m,SM5520B m
Polychlorinated Biphenyl in Water	1	2023/04/20	2023/04/21	CAM SOP-00309	EPA 8082A m
pH	1	2023/04/20	2023/04/20	CAM SOP-00413	SM 4500H+ B m
Phenols (4AAP)	1	N/A	2023/04/21	CAM SOP-00444	OMOE E3179 m
Sulphate by Automated Turbidimetry	1	N/A	2023/04/21	CAM SOP-00464	SM 23 4500-SO42- E m
Total Kjeldahl Nitrogen in Water	1	2023/04/20	2023/04/21	CAM SOP-00938	OMOE E3516 m
Total PAHs: Barrie/Mississauga Sewer Use (1)	1	N/A	2023/04/24	CAM SOP - 00301	
Mineral/Synthetic O & G (TPH Heavy Oil) (2)	1	2023/04/24	2023/04/24	CAM SOP-00326	EPA1664B m,SM5520F m
Total Suspended Solids	1	2023/04/20	2023/04/20	CAM SOP-00428	SM 23 2540D m
Volatile Organic Compounds in Water	1	N/A	2023/04/21	CAM SOP-00228	EPA 8260D

**Remarks:**

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, MELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.



Your Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your C.O.C. #: 930059-01-01

**Attention: PRADEEP PATEL**

DS Consultants Limited  
6221 Highway 7, Unit 16  
Vaughan, ON  
CANADA L4H 0K8

**Report Date: 2023/05/01**  
Report #: R7610413  
Version: 1 - Final

**CERTIFICATE OF ANALYSIS**

**BUREAU VERITAS JOB #: C3A6391**

**Received: 2023/04/17, 13:05**

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

\* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

(1) Total PAHs include only those PAHs specified in the sewer use by-by-law.

(2) Note: TPH (Heavy Oil) is equivalent to Mineral / Synthetic Oil & Grease

Encryption Key



Bureau Veritas  
01 May 2023 18:02:12

Please direct all questions regarding this Certificate of Analysis to:

Ashton Gibson, Project Manager  
Email: Ashton.Gibson@bureauveritas.com  
Phone# (905)817-5765

=====  
This report has been generated and distributed using a secure automated process.

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rodney Major, General Manager responsible for Ontario Environmental laboratory operations.



BUREAU  
VERITAS

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

### MISSISSAUGA STORM SEWER BYLAW (46-2022)

<b>Bureau Veritas ID</b>			VOI141		
<b>Sampling Date</b>			2023/04/17		
<b>COC Number</b>			930059-01-01		
	<b>UNITS</b>	<b>Criteria</b>	<b>BH22-14</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Inorganics</b>					
Total BOD	mg/L	15	<2	2	8620686
<b>Calculated Parameters</b>					
Total PAHs	ug/L	2	<3.4 (1)	3.4	8616586
No Fill	No Exceedance				
Grey	Exceeds 1 criteria policy/level				
Black	Exceeds both criteria/levels				
RDL = Reportable Detection Limit					
QC Batch = Quality Control Batch					
Criteria: City of Mississauga Storm Sewer Use By-Law 0046-2022					
(1) RDL exceeds criteria					



BUREAU  
VERITAS

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

### PEEL SANITARY & STORM SEWER (53-2010)

Bureau Veritas ID				VOI141			VOI141		
Sampling Date				2023/04/17			2023/04/17		
COC Number				930059-01-01			930059-01-01		
	UNITS	Criteria	Criteria-2	BH22-14	RDL	QC Batch	BH22-14 Lab-Dup	RDL	QC Batch
<b>Calculated Parameters</b>									
Total Animal/Vegetable Oil and Grease	mg/L	-	150	1.9	0.50	8611791			
<b>Inorganics</b>									
Total Carbonaceous BOD	mg/L	-	300	<2	2	8615705	<2	2	8615705
Fluoride (F-)	mg/L	-	10	0.22	0.10	8618800			
Total Kjeldahl Nitrogen (TKN)	mg/L	-	100	0.30	0.10	8618510			
pH	pH	6:9	5.5:10.0	7.28		8618816			
Phenols-4AAP	mg/L	0.008	1	<0.0010	0.0010	8621267			
Total Suspended Solids	mg/L	15	350	42	10	8616229			
Dissolved Sulphate (SO4)	mg/L	-	1500	300	1.0	8618856			
Total Cyanide (CN)	mg/L	0.02	2	<0.0050	0.0050	8619331	<0.0050	0.0050	8619331
<b>Petroleum Hydrocarbons</b>									
Total Oil & Grease	mg/L	-	-	1.9	0.50	8624415			
Total Oil & Grease Mineral/Synthetic	mg/L	-	15	<0.50	0.50	8624419			
<b>Miscellaneous Parameters</b>									
Nonylphenol Ethoxylate (Total)	mg/L	-	0.2	<0.025	0.025	8622178	<0.025	0.025	8622178
Nonylphenol (Total)	mg/L	-	0.02	<0.001	0.001	8621974			
<b>Metals</b>									
Total Aluminum (Al)	mg/L	1.0	50	0.1	0.1	8618519	0.1	0.1	8618519
Total Antimony (Sb)	mg/L	-	5	<0.02	0.02	8618519	<0.02	0.02	8618519
Total Arsenic (As)	mg/L	0.02	1	<0.01	0.01	8618519	<0.01	0.01	8618519
Total Cadmium (Cd)	mg/L	0.008	0.7	<0.002	0.002	8618519	<0.002	0.002	8618519
Total Chromium (Cr)	mg/L	0.08	5	<0.01	0.01	8618519	<0.01	0.01	8618519
Total Cobalt (Co)	mg/L	-	5	<0.002	0.002	8618519	<0.002	0.002	8618519
Total Copper (Cu)	mg/L	0.04	3	<0.01	0.01	8618519	<0.01	0.01	8618519
Total Lead (Pb)	mg/L	0.12	3	<0.01	0.01	8618519	<0.01	0.01	8618519
Total Manganese (Mn)	mg/L	2.0	5	0.018	0.001	8618519	0.017	0.001	8618519
Mercury (Hg)	mg/L	0.0004	0.01	<0.00010	0.00010	8618388			
Total Molybdenum (Mo)	mg/L	-	5	0.019	0.005	8618519	0.014	0.005	8618519
No Fill	No Exceedance								
Grey	Exceeds 1 criteria policy/level								
Black	Exceeds both criteria/levels								
RDL = Reportable Detection Limit									
QC Batch = Quality Control Batch									
Lab-Dup = Laboratory Initiated Duplicate									
Criteria: City of Mississauga Storm Sewer Use By-Law 0046-2022									
Criteria-2: The Regional Municipality of Peel Sanitary Sewer Discharge.									
By-Law Number 53-2010.									



BUREAU VERITAS

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

**PEEL SANITARY & STORM SEWER (53-2010)**

Bureau Veritas ID				VOI141			VOI141		
Sampling Date				2023/04/17			2023/04/17		
COC Number				930059-01-01			930059-01-01		
	UNITS	Criteria	Criteria-2	BH22-14	RDL	QC Batch	BH22-14 Lab-Dup	RDL	QC Batch
Total Nickel (Ni)	mg/L	0.08	3	<0.005	0.005	8618519	<0.005	0.005	8618519
Total Phosphorus (P)	mg/L	0.4	10	<0.05	0.05	8618519	<0.05	0.05	8618519
Total Selenium (Se)	mg/L	0.02	1	<0.02	0.02	8618519	<0.02	0.02	8618519
Total Silver (Ag)	mg/L	0.12	5	<0.01	0.01	8618519	<0.01	0.01	8618519
Total Tin (Sn)	mg/L	-	5	<0.02	0.02	8618519	<0.02	0.02	8618519
Total Titanium (Ti)	mg/L	-	5	<0.005	0.005	8618519	<0.005	0.005	8618519
Total Zinc (Zn)	mg/L	0.2	3	<0.005	0.005	8618519	<0.005	0.005	8618519
<b>Semivolatile Organics</b>									
Bis(2-ethylhexyl)phthalate	ug/L	-	12	<8.0	8.0	8619798			
Di-N-butyl phthalate	ug/L	-	80	<8.0	8.0	8619798			
<b>Volatile Organics</b>									
Benzene	ug/L	2	10	<0.40	0.40	8618617			
Chloroform	ug/L	-	40	<0.40	0.40	8618617			
1,2-Dichlorobenzene	ug/L	5.6	50	<0.80	0.80	8618617			
1,4-Dichlorobenzene	ug/L	6.8	80	<0.80	0.80	8618617			
cis-1,2-Dichloroethylene	ug/L	-	4000	<1.0	1.0	8618617			
trans-1,3-Dichloropropene	ug/L	-	140	<0.80	0.80	8618617			
Ethylbenzene	ug/L	2	160	<0.40	0.40	8618617			
Methylene Chloride(Dichloromethane)	ug/L	5.2	2000	<4.0	4.0	8618617			
Methyl Ethyl Ketone (2-Butanone)	ug/L	-	8000	<20	20	8618617			
Styrene	ug/L	-	200	<0.80	0.80	8618617			
1,1,2,2-Tetrachloroethane	ug/L	17	1400	<0.80	0.80	8618617			
Tetrachloroethylene	ug/L	4.4	1000	<0.40	0.40	8618617			
Toluene	ug/L	2	270	<0.40	0.40	8618617			
Trichloroethylene	ug/L	7.6	400	<0.40	0.40	8618617			
p+m-Xylene	ug/L	-	-	<0.40	0.40	8618617			
o-Xylene	ug/L	-	-	<0.40	0.40	8618617			
Total Xylenes	ug/L	4.4	1400	<0.40	0.40	8618617			

No Fill	No Exceedance
Grey	Exceeds 1 criteria policy/level
Black	Exceeds both criteria/levels
RDL = Reportable Detection Limit	
QC Batch = Quality Control Batch	
Lab-Dup = Laboratory Initiated Duplicate	
Criteria: City of Mississauga Storm Sewer Use By-Law 0046-2022	
Criteria-2: The Regional Municipality of Peel Sanitary Sewer Discharge.	
By-Law Number 53-2010.	



**BUREAU  
VERITAS**

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

**PEEL SANITARY & STORM SEWER (53-2010)**

Bureau Veritas ID				VOI141			VOI141		
Sampling Date				2023/04/17			2023/04/17		
COC Number				930059-01-01			930059-01-01		
	UNITS	Criteria	Criteria-2	BH22-14	RDL	QC Batch	BH22-14 Lab-Dup	RDL	QC Batch
<b>PCBs</b>									
Total PCB	ug/L	0.4	1	<0.05	0.05	8618461			
<b>Microbiological</b>									
Escherichia coli	CFU/100mL	200	-	0	N/A	8616957			
<b>Surrogate Recovery (%)</b>									
2,4,6-Tribromophenol	%	-	-	48		8619798			
2-Fluorobiphenyl	%	-	-	77		8619798			
2-Fluorophenol	%	-	-	28		8619798			
D14-Terphenyl	%	-	-	98		8619798			
D5-Nitrobenzene	%	-	-	87		8619798			
D5-Phenol	%	-	-	24		8619798			
Decachlorobiphenyl	%	-	-	94		8618461			
4-Bromofluorobenzene	%	-	-	99		8618617			
D4-1,2-Dichloroethane	%	-	-	115		8618617			
D8-Toluene	%	-	-	88		8618617			
No Fill	No Exceedance								
Grey	Exceeds 1 criteria policy/level								
Black	Exceeds both criteria/levels								
RDL = Reportable Detection Limit									
QC Batch = Quality Control Batch									
Lab-Dup = Laboratory Initiated Duplicate									
Criteria: City of Mississauga Storm Sewer Use By-Law 0046-2022									
Criteria-2: The Regional Municipality of Peel Sanitary Sewer Discharge.									
By-Law Number 53-2010.									
N/A = Not Applicable									





BUREAU  
VERITAS

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

### TEST SUMMARY

**Bureau Veritas ID:** VOI141  
**Sample ID:** BH22-14  
**Matrix:** Water

**Collected:** 2023/04/17  
**Shipped:**  
**Received:** 2023/04/17

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
ABN Compounds in Water by GC/MS	GC/MS	8619798	2023/04/20	2023/04/21	Kathy Horvat
Biochemical Oxygen Demand (BOD)	DO	8620686	2023/04/21	2023/04/26	Gurjot Kaur
Carbonaceous BOD	DO	8615705	2023/04/19	2023/04/24	Gurjot Kaur
Total Cyanide	SKAL/CN	8619331	2023/04/20	2023/04/20	Chloe Pollock
Fluoride	ISE	8618800	2023/04/20	2023/04/20	Kien Tran
Mercury in Water by CVAA	CV/AA	8618388	2023/04/20	2023/04/20	Gagandeep Rai
Total Metals Analysis by Axial ICP	ICPX	8618519	2023/04/20	2023/04/25	Medhat Nasr
E.coli, (CFU/100mL)	PL	8616957	N/A	2023/04/19	Sonja Elavinamannil
Total Nonylphenol in Liquids by HPLC	LC/FLU	8621974	2023/04/21	2023/04/22	Furneesh Kumar
Nonylphenol Ethoxylates in Liquids: HPLC	LC/FLU	8622178	2023/04/21	2023/04/22	Furneesh Kumar
Animal and Vegetable Oil and Grease	BAL	8611791	N/A	2023/04/24	Automated Statchk
Total Oil and Grease	BAL	8624415	2023/04/24	2023/04/24	Navneet Singh
Polychlorinated Biphenyl in Water	GC/ECD	8618461	2023/04/20	2023/04/21	Svitlana Shaula
pH	AT	8618816	2023/04/20	2023/04/20	Kien Tran
Phenols (4AAP)	TECH/PHEN	8621267	N/A	2023/04/21	Mandeep Kaur
Sulphate by Automated Turbidimetry	KONE	8618856	N/A	2023/04/21	Yogesh Patel
Total Kjeldahl Nitrogen in Water	SKAL	8618510	2023/04/20	2023/04/21	Jency Sara Johnson
Total PAHs: Barrie/Mississauga Sewer Use	CALC	8616586	N/A	2023/04/24	Automated Statchk
Mineral/Synthetic O & G (TPH Heavy Oil)	BAL	8624419	2023/04/24	2023/04/24	Navneet Singh
Total Suspended Solids	BAL	8616229	2023/04/20	2023/04/20	Shaneil Hall
Volatile Organic Compounds in Water	GC/MS	8618617	N/A	2023/04/21	Hai Son Tran

**Bureau Veritas ID:** VOI141 Dup  
**Sample ID:** BH22-14  
**Matrix:** Water

**Collected:** 2023/04/17  
**Shipped:**  
**Received:** 2023/04/17

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
Carbonaceous BOD	DO	8615705	2023/04/19	2023/04/24	Gurjot Kaur
Total Cyanide	SKAL/CN	8619331	2023/04/20	2023/04/20	Chloe Pollock
Total Metals Analysis by Axial ICP	ICPX	8618519	2023/04/20	2023/04/25	Medhat Nasr
Nonylphenol Ethoxylates in Liquids: HPLC	LC/FLU	8622178	2023/04/21	2023/04/22	Furneesh Kumar



### GENERAL COMMENTS

Each temperature is the average of up to three cooler temperatures taken at receipt

Package 1	2.0°C
-----------	-------

Sample VOI141 [BH22-14] : ABN Analysis: Due to the sample matrix, a smaller amount was used for analysis. Detection limits were adjusted accordingly.

Sample VOI141 [BH22-14] : VOC Analysis: Due to sample matrix, sample required dilution. Detection limits were adjusted accordingly.

**Results relate only to the items tested.**



**QUALITY ASSURANCE REPORT**

DS Consultants Limited  
 Client Project #: 22-200-100  
 Site Location: RANGEVIEW RD, MISSISSAUGA  
 Sampler Initials: HS

QC Batch	Parameter	Date	Matrix Spike		SPIKED BLANK		Method Blank		RPD		QC Standard	
			% Recovery	QC Limits	% Recovery	QC Limits	Value	UNITS	Value (%)	QC Limits	% Recovery	QC Limits
8618461	Decachlorobiphenyl	2023/04/21	101	60 - 130	96	60 - 130	97	%				
8618617	4-Bromofluorobenzene	2023/04/21	103	70 - 130	102	70 - 130	102	%				
8618617	D4-1,2-Dichloroethane	2023/04/21	105	70 - 130	101	70 - 130	110	%				
8618617	D8-Toluene	2023/04/21	103	70 - 130	106	70 - 130	89	%				
8619798	2,4,6-Tribromophenol	2023/04/21	87	10 - 130	93	10 - 130	62	%				
8619798	2-Fluorobiphenyl	2023/04/21	51	30 - 130	64	30 - 130	77	%				
8619798	2-Fluorophenol	2023/04/21	26	10 - 130	48	10 - 130	40	%				
8619798	D14-Terphenyl	2023/04/21	93	30 - 130	99	30 - 130	96	%				
8619798	D5-Nitrobenzene	2023/04/21	55	30 - 130	87	30 - 130	87	%				
8619798	D5-Phenol	2023/04/21	18	10 - 130	31	10 - 130	28	%				
8615705	Total Carbonaceous BOD	2023/04/24					<2	mg/L	NC	30	91	85 - 115
8616229	Total Suspended Solids	2023/04/20					<10	mg/L	4.8	20	96	85 - 115
8618388	Mercury (Hg)	2023/04/20	102	75 - 125	103	80 - 120	<0.00010	mg/L	NC	20		
8618461	Total PCB	2023/04/21	96	60 - 130	80	60 - 130	<0.05	ug/L	NC	40		
8618510	Total Kjeldahl Nitrogen (TKN)	2023/04/21	82	80 - 120	100	80 - 120	<0.10	mg/L	NC (1)	20	118	80 - 120
8618519	Total Aluminum (Al)	2023/04/25	127 (2)	80 - 120	94	80 - 120	<0.1	mg/L	10	20		
8618519	Total Antimony (Sb)	2023/04/25	107	80 - 120	103	80 - 120	<0.02	mg/L	NC	20		
8618519	Total Arsenic (As)	2023/04/25	109	80 - 120	103	80 - 120	<0.01	mg/L	NC	20		
8618519	Total Cadmium (Cd)	2023/04/25	106	80 - 120	103	80 - 120	<0.002	mg/L	NC	20		
8618519	Total Chromium (Cr)	2023/04/25	107	80 - 120	101	80 - 120	<0.01	mg/L	NC	20		
8618519	Total Cobalt (Co)	2023/04/25	96	80 - 120	100	80 - 120	<0.002	mg/L	NC	20		
8618519	Total Copper (Cu)	2023/04/25	99	80 - 120	101	80 - 120	<0.01	mg/L	NC	20		
8618519	Total Lead (Pb)	2023/04/25	95	80 - 120	100	80 - 120	<0.01	mg/L	NC	20		
8618519	Total Manganese (Mn)	2023/04/25	97	80 - 120	100	80 - 120	<0.001	mg/L	3.9	20		
8618519	Total Molybdenum (Mo)	2023/04/25	103	80 - 120	104	80 - 120	<0.005	mg/L	NC	20		
8618519	Total Nickel (Ni)	2023/04/25	98	80 - 120	103	80 - 120	<0.005	mg/L	NC	20		
8618519	Total Phosphorus (P)	2023/04/25	104	80 - 120	99	80 - 120	<0.05	mg/L	NC	20		
8618519	Total Selenium (Se)	2023/04/25	107	80 - 120	105	80 - 120	<0.02	mg/L	NC	20		
8618519	Total Silver (Ag)	2023/04/25	98	80 - 120	98	80 - 120	<0.01	mg/L	NC	20		
8618519	Total Tin (Sn)	2023/04/25	99	80 - 120	103	80 - 120	<0.02	mg/L	NC	20		
8618519	Total Titanium (Ti)	2023/04/25	102	80 - 120	101	80 - 120	<0.005	mg/L	NC	20		



**BUREAU VERITAS**

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

**QUALITY ASSURANCE REPORT(CONT'D)**

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

QC Batch	Parameter	Date	Matrix Spike		SPIKED BLANK		Method Blank		RPD		QC Standard	
			% Recovery	QC Limits	% Recovery	QC Limits	Value	UNITS	Value (%)	QC Limits	% Recovery	QC Limits
8618519	Total Zinc (Zn)	2023/04/25	99	80 - 120	101	80 - 120	<0.005	mg/L	NC	20		
8618617	1,1,2,2-Tetrachloroethane	2023/04/21	101	70 - 130	97	70 - 130	<0.40	ug/L	NC	30		
8618617	1,2-Dichlorobenzene	2023/04/21	95	70 - 130	95	70 - 130	<0.40	ug/L	NC	30		
8618617	1,4-Dichlorobenzene	2023/04/21	110	70 - 130	113	70 - 130	<0.40	ug/L	NC	30		
8618617	Benzene	2023/04/21	91	70 - 130	89	70 - 130	<0.20	ug/L	NC	30		
8618617	Chloroform	2023/04/21	98	70 - 130	95	70 - 130	<0.20	ug/L	NC	30		
8618617	cis-1,2-Dichloroethylene	2023/04/21	NC	70 - 130	99	70 - 130	<0.50	ug/L	4.5	30		
8618617	Ethylbenzene	2023/04/21	85	70 - 130	87	70 - 130	<0.20	ug/L	NC	30		
8618617	Methyl Ethyl Ketone (2-Butanone)	2023/04/21	104	60 - 140	97	60 - 140	<10	ug/L	NC	30		
8618617	Methylene Chloride(Dichloromethane)	2023/04/21	98	70 - 130	94	70 - 130	<2.0	ug/L	NC	30		
8618617	o-Xylene	2023/04/21	86	70 - 130	94	70 - 130	<0.20	ug/L	NC	30		
8618617	p+m-Xylene	2023/04/21	73	70 - 130	75	70 - 130	<0.20	ug/L	NC	30		
8618617	Styrene	2023/04/21	81	70 - 130	85	70 - 130	<0.40	ug/L	NC	30		
8618617	Tetrachloroethylene	2023/04/21	90	70 - 130	90	70 - 130	<0.20	ug/L	NC	30		
8618617	Toluene	2023/04/21	94	70 - 130	95	70 - 130	<0.20	ug/L	NC	30		
8618617	Total Xylenes	2023/04/21					<0.20	ug/L	NC	30		
8618617	trans-1,3-Dichloropropene	2023/04/21	113	70 - 130	101	70 - 130	<0.40	ug/L	NC	30		
8618617	Trichloroethylene	2023/04/21	101	70 - 130	100	70 - 130	<0.20	ug/L	NC	30		
8618800	Fluoride (F-)	2023/04/20	94	80 - 120	98	80 - 120	<0.10	mg/L	NC	20		
8618816	pH	2023/04/20			102	98 - 103			0.71	N/A		
8618856	Dissolved Sulphate (SO4)	2023/04/21	NC	75 - 125	97	80 - 120	<1.0	mg/L	3.6	20		
8619331	Total Cyanide (CN)	2023/04/20	103	80 - 120	103	80 - 120	<0.0050	mg/L	NC	20		
8619798	Bis(2-ethylhexyl)phthalate	2023/04/21	99	30 - 130	102	30 - 130	<2.0	ug/L	NC	40		
8619798	Di-N-butyl phthalate	2023/04/21	92	30 - 130	95	30 - 130	<2.0	ug/L	NC	40		
8620686	Total BOD	2023/04/26					<2	mg/L	NC	30	92	80 - 120
8621267	Phenols-4AAP	2023/04/21	106	80 - 120	100	80 - 120	<0.0010	mg/L	18	20		
8621974	Nonylphenol (Total)	2023/04/22	107	50 - 130	107	50 - 130	<0.001	mg/L	NC	40		
8622178	Nonylphenol Ethoxylate (Total)	2023/04/22	101	50 - 130	99	50 - 130	<0.025	mg/L	NC	40		
8624415	Total Oil & Grease	2023/04/24			99	85 - 115	<0.50	mg/L	0.25	25		



BUREAU  
VERITAS  
1875

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

## QUALITY ASSURANCE REPORT(CONT'D)

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

QC Batch	Parameter	Date	Matrix Spike		SPIKED BLANK		Method Blank		RPD		QC Standard	
			% Recovery	QC Limits	% Recovery	QC Limits	Value	UNITS	Value (%)	QC Limits	% Recovery	QC Limits
8624419	Total Oil & Grease Mineral/Synthetic	2023/04/24			96	85 - 115	<0.50	mg/L	0	25		

N/A = Not Applicable

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

QC Standard: A sample of known concentration prepared by an external agency under stringent conditions. Used as an independent check of method accuracy.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.

NC (Matrix Spike): The recovery in the matrix spike was not calculated. The relative difference between the concentration in the parent sample and the spike amount was too small to permit a reliable recovery calculation (matrix spike concentration was less than the native sample concentration)

NC (Duplicate RPD): The duplicate RPD was not calculated. The concentration in the sample and/or duplicate was too low to permit a reliable RPD calculation (absolute difference <= 2x RDL).

(1) Due to a high concentration of NOx, the sample required dilution. The detection limit was adjusted accordingly.

(2) Recovery or RPD for this parameter is outside control limits. The overall quality control for this analysis meets acceptability criteria.



### VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

Anastassia Hamanov, Scientific Specialist

Ewa Pranjić, M.Sc., C.Chem, Scientific Specialist

Sonja Elavinamannil, Master of Biochemistry, Team Lead

---

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by {0}, {1} responsible for {2} {3} laboratory operations.



BUREAU  
VERITAS

Bureau Veritas Job #: C3A6391  
Report Date: 2023/05/01

DS Consultants Limited  
Client Project #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Sampler Initials: HS

**Exceedance Summary Table – Mississauga Storm Sewer**  
**Result Exceedances**

Sample ID	Bureau Veritas ID	Parameter	Criteria	Result	DL	UNITS
BH22-14	VOI141-06	Total Suspended Solids	15	42	10	mg/L

**Detection Limit Exceedances**

Sample ID	Bureau Veritas ID	Parameter	Criteria	Result	DL	UNITS
BH22-14	VOI141-03	Total PAHs	2	<3.4	3.4	ug/L

The exceedance summary table is for information purposes only and should not be considered a comprehensive listing or statement of conformance to applicable regulatory guidelines.

**Exceedance Summary Table – Peel Region Sanitary 2010**  
**Result Exceedances**

Sample ID	Bureau Veritas ID	Parameter	Criteria	Result	DL	UNITS
No Exceedances						

The exceedance summary table is for information purposes only and should not be considered a comprehensive listing or statement of conformance to applicable regulatory guidelines.



Your P.O. #: 22-200-100  
 Site Location: RANGEVIEW RD, MISSISSAUGA  
 Your C.O.C. #: 930893-01-01

**Attention: PRADEEP PATEL**

DS Consultants Limited  
 6221 Highway 7, Unit 16  
 Vaughan, ON  
 CANADA L4H 0K8

**Report Date: 2023/05/10**  
 Report #: R7623181  
 Version: 1 - Final

**CERTIFICATE OF ANALYSIS**

**BUREAU VERITAS JOB #: C3C5477**

**Received: 2023/05/03, 16:42**

Sample Matrix: Ground Water  
 # Samples Received: 1

Analyses	Quantity	Date	Date	Laboratory Method	Analytical Method
		Extracted	Analyzed		
Total Chlorine	1	2023/05/04	2023/05/04	CAM SOP 00425	SM 23 4500-CL G m
Chromium (VI) in Water	1	N/A	2023/05/08	CAM SOP-00436	EPA 7199 m
PAH Compounds in Water by GC/MS (SIM)	1	2023/05/09	2023/05/09	CAM SOP-00318	EPA 8270E
Total PAHs: Barrie/Mississauga Sewer Use (1)	1	N/A	2023/05/10	CAM SOP - 00301	

**Remarks:**

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, MELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

\* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

(1) Total PAHs include only those PAHs specified in the sewer use by-by-law.





Your P.O. #: 22-200-100  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your C.O.C. #: 930893-01-01

**Attention: PRADEEP PATEL**

DS Consultants Limited  
6221 Highway 7, Unit 16  
Vaughan, ON  
CANADA L4H 0K8

**Report Date: 2023/05/10**  
Report #: R7623181  
Version: 1 - Final

**CERTIFICATE OF ANALYSIS**

**BUREAU VERITAS JOB #: C3C5477**

**Received: 2023/05/03, 16:42**

Encryption Key



**AUTHORIZED REPORT  
RAPPORT AUTORISÉ**

Bureau Veritas  
10 May 2023 15:30:38

Please direct all questions regarding this Certificate of Analysis to:  
Ashton Gibson, Project Manager  
Email: Ashton.Gibson@bureauveritas.com  
Phone# (905)817-5765

=====  
This report has been generated and distributed using a secure automated process.  
Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports.  
For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rodney Major, General Manager responsible for Ontario Environmental laboratory operations.



**BUREAU  
VERITAS**

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

### RESULTS OF ANALYSES OF GROUND WATER

<b>Bureau Veritas ID</b>		VSF740		
<b>Sampling Date</b>		2023/05/03		
<b>COC Number</b>		930893-01-01		
	<b>UNITS</b>	<b>BH 22-14</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Inorganics</b>				
Total Chlorine	mg/L	<0.1	0.1	8646949
RDL = Reportable Detection Limit				
QC Batch = Quality Control Batch				



**BUREAU  
VERITAS**

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

**ELEMENTS BY ATOMIC SPECTROSCOPY (GROUND WATER)**

<b>Bureau Veritas ID</b>		VSF740		
<b>Sampling Date</b>		2023/05/03		
<b>COC Number</b>		930893-01-01		
	<b>UNITS</b>	<b>BH 22-14</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Metals</b>				
Chromium (VI)	ug/L	<0.50	0.50	8648136
RDL = Reportable Detection Limit				
QC Batch = Quality Control Batch				



BUREAU  
VERITAS

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

**SEMI-VOLATILE ORGANICS BY GC-MS (GROUND WATER)**

<b>Bureau Veritas ID</b>		VSF740		
<b>Sampling Date</b>		2023/05/03		
<b>COC Number</b>		930893-01-01		
	<b>UNITS</b>	<b>BH 22-14</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Calculated Parameters</b>				
Total PAHs	ug/L	<0.20	0.20	8645642
<b>Polyaromatic Hydrocarbons</b>				
Biphenyl	ug/L	<0.050	0.050	8653288
Acenaphthene	ug/L	<0.050	0.050	8653288
Acenaphthylene	ug/L	<0.050	0.050	8653288
Anthracene	ug/L	<0.050	0.050	8653288
Benzo(a)anthracene	ug/L	<0.050	0.050	8653288
Benzo(a)pyrene	ug/L	<0.0090	0.0090	8653288
Benzo(b/j)fluoranthene	ug/L	<0.050	0.050	8653288
Benzo(g,h,i)perylene	ug/L	<0.050	0.050	8653288
Benzo(k)fluoranthene	ug/L	<0.050	0.050	8653288
Chrysene	ug/L	<0.050	0.050	8653288
Dibenzo(a,h)anthracene	ug/L	<0.050	0.050	8653288
Fluoranthene	ug/L	<0.050	0.050	8653288
Fluorene	ug/L	<0.050	0.050	8653288
Indeno(1,2,3-cd)pyrene	ug/L	<0.050	0.050	8653288
1-Methylnaphthalene	ug/L	<0.050	0.050	8653288
2-Methylnaphthalene	ug/L	<0.050	0.050	8653288
Naphthalene	ug/L	<0.050	0.050	8653288
Phenanthrene	ug/L	<0.030	0.030	8653288
Pyrene	ug/L	<0.050	0.050	8653288
<b>Surrogate Recovery (%)</b>				
D10-Anthracene	%	114		8653288
D14-Terphenyl (FS)	%	106		8653288
D8-Acenaphthylene	%	100		8653288
RDL = Reportable Detection Limit QC Batch = Quality Control Batch				



BUREAU  
VERITAS

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

### TEST SUMMARY

**Bureau Veritas ID:** VSF740  
**Sample ID:** BH 22-14  
**Matrix:** Ground Water

**Collected:** 2023/05/03  
**Shipped:**  
**Received:** 2023/05/03

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
Total Chlorine	SPEC	8646949	2023/05/04	2023/05/04	Leily Karimi
Chromium (VI) in Water	IC	8648136	N/A	2023/05/08	Theodora Luck
PAH Compounds in Water by GC/MS (SIM)	GC/MS	8653288	2023/05/09	2023/05/09	Jonghan Yoon
Total PAHs: Barrie/Mississauga Sewer Use	CALC	8645642	N/A	2023/05/10	Automated Statchk



### GENERAL COMMENTS

Each temperature is the average of up to three cooler temperatures taken at receipt

Package 1	4.3°C
-----------	-------

**Results relate only to the items tested.**



**BUREAU  
VERITAS**

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

## QUALITY ASSURANCE REPORT

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

QC Batch	Parameter	Date	Matrix Spike		SPIKED BLANK		Method Blank		RPD	
			% Recovery	QC Limits	% Recovery	QC Limits	Value	UNITS	Value (%)	QC Limits
8653288	D10-Anthracene	2023/05/09	104	50 - 130	101	50 - 130	113	%		
8653288	D14-Terphenyl (FS)	2023/05/09	102	50 - 130	104	50 - 130	105	%		
8653288	D8-Acenaphthylene	2023/05/09	98	50 - 130	100	50 - 130	100	%		
8646949	Total Chlorine	2023/05/04	70 (1)	85 - 115	99	85 - 115	<0.1	mg/L	NC	25
8648136	Chromium (VI)	2023/05/08	101	80 - 120	101	80 - 120	<0.50	ug/L	NC	20
8653288	1-Methylnaphthalene	2023/05/09	81	50 - 130	79	50 - 130	<0.050	ug/L	NC	30
8653288	2-Methylnaphthalene	2023/05/09	72	50 - 130	70	50 - 130	<0.050	ug/L	NC	30
8653288	Acenaphthene	2023/05/09	102	50 - 130	99	50 - 130	<0.050	ug/L	NC	30
8653288	Acenaphthylene	2023/05/09	100	50 - 130	95	50 - 130	<0.050	ug/L	NC	30
8653288	Anthracene	2023/05/09	106	50 - 130	102	50 - 130	<0.050	ug/L	NC	30
8653288	Benzo(a)anthracene	2023/05/09	106	50 - 130	103	50 - 130	<0.050	ug/L	NC	30
8653288	Benzo(a)pyrene	2023/05/09	109	50 - 130	106	50 - 130	<0.0090	ug/L	NC	30
8653288	Benzo(b,f)fluoranthene	2023/05/09	115	50 - 130	115	50 - 130	<0.050	ug/L	NC	30
8653288	Benzo(g,h,i)perylene	2023/05/09	129	50 - 130	126	50 - 130	<0.050	ug/L	NC	30
8653288	Benzo(k)fluoranthene	2023/05/09	123	50 - 130	115	50 - 130	<0.050	ug/L	NC	30
8653288	Biphenyl	2023/05/09	75	50 - 130	72	50 - 130	<0.050	ug/L		
8653288	Chrysene	2023/05/09	111	50 - 130	110	50 - 130	<0.050	ug/L	NC	30
8653288	Dibenzo(a,h)anthracene	2023/05/09	111	50 - 130	100	50 - 130	<0.050	ug/L	NC	30
8653288	Fluoranthene	2023/05/09	121	50 - 130	119	50 - 130	<0.050	ug/L	NC	30
8653288	Fluorene	2023/05/09	103	50 - 130	100	50 - 130	<0.050	ug/L	NC	30
8653288	Indeno(1,2,3-cd)pyrene	2023/05/09	120	50 - 130	117	50 - 130	<0.050	ug/L	NC	30
8653288	Naphthalene	2023/05/09	87	50 - 130	85	50 - 130	<0.050	ug/L	NC	30
8653288	Phenanthrene	2023/05/09	106	50 - 130	105	50 - 130	<0.030	ug/L	NC	30



BUREAU  
VERITAS  
1875

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

## QUALITY ASSURANCE REPORT(CONT'D)

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

QC Batch	Parameter	Date	Matrix Spike		SPIKED BLANK		Method Blank		RPD	
			% Recovery	QC Limits	% Recovery	QC Limits	Value	UNITS	Value (%)	QC Limits
8653288	Pyrene	2023/05/09	116	50 - 130	115	50 - 130	<0.050	ug/L	NC	30

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.

NC (Duplicate RPD): The duplicate RPD was not calculated. The concentration in the sample and/or duplicate was too low to permit a reliable RPD calculation (absolute difference <= 2x RDL).

(1) Recovery or RPD for this parameter is outside control limits. The overall quality control for this analysis meets acceptability criteria.





BUREAU  
VERITAS

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

### VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

A handwritten signature in cursive script that reads 'Cristina Carriere'.

---

Cristina Carriere, Senior Scientific Specialist

---

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by {0}, {1} responsible for {2} {3} laboratory operations.



**BUREAU  
VERITAS**

Bureau Veritas Job #: C3C5477  
Report Date: 2023/05/10

DS Consultants Limited  
Site Location: RANGEVIEW RD, MISSISSAUGA  
Your P.O. #: 22-200-100  
Sampler Initials: HS

**Exceedance Summary Table – Mississauga Storm Sewer  
Result Exceedances**

<b>Sample ID</b>	<b>Bureau Veritas ID</b>	<b>Parameter</b>	<b>Criteria</b>	<b>Result</b>	<b>DL</b>	<b>UNITS</b>
No Exceedances						
The exceedance summary table is for information purposes only and should not be considered a comprehensive listing or statement of conformance to applicable regulatory guidelines.						

## **Appendix E: Conceptual Development Plan**

# RANGEVIEW ESTATES

## Rangeview Development Master Plan


### Ownership Map



- Dorsay (Lakeshore) Inc.  
Dorsay (Lakefront Promenade) Inc.  
Dorsay (Rangeview) Inc.
- Elgroup Holdings Inc.  
Elias Bros. Construction Limited
- Rangeview 1035 Holding Inc.  
Rangeview 1045 Holding Inc.  
1207238 Ontario Limited Inc.
- 2120412 Ontario Inc.
- Whiterock 880 Rangeview Inc.
- 447111 Ontario Limited
- 1127792 Ontario Limited
- ILSCO of Canada Limited
- Kotyck Investments Ltd.

**Legend**  Rangeview Estates Precinct Area (Gross Area = ~25.67 ha) X Non-Participating Landowners  Existing Parcel Lines

**REPORT ON**  
Preliminary Geotechnical Investigation  
Proposed Residential & Commercial Development  
800 Hydro Road  
Mississauga, Ontario

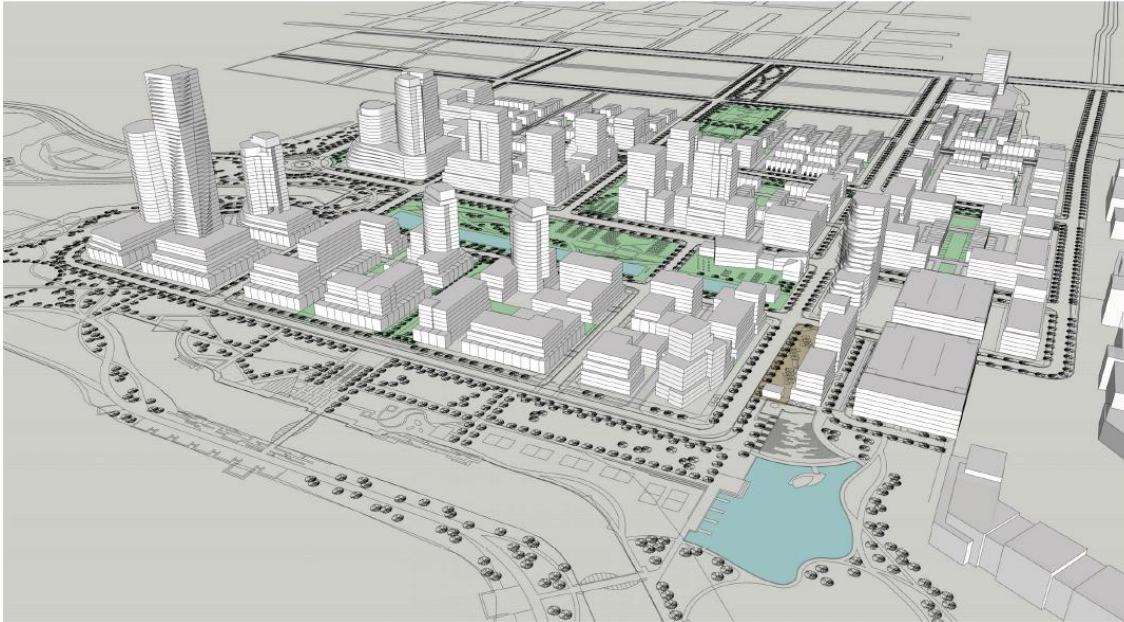

**PREPARED FOR:**  
Lakeview Community Partners Limited

**PREPARED BY:**  
DS Consultants Ltd.

**Project No:** 18-519-10 R2  
**Date:** June 9, 2020



**DS CONSULTANTS LTD.**  
6221 Highway 7, Unit 16  
Vaughan, Ontario, L4H 0K8  
Telephone: (905) 264-9393  
[www.dsconsultants.ca](http://www.dsconsultants.ca)

## Table of Contents

1. INTRODUCTION .....	1
2. FIELD WORK & LAB TESTING .....	2
3. SITE AND SUBSURFACE CONDITIONS.....	3
3.1 Soil Conditions in Area 'A' .....	3
3.2 Soil Conditions in Area 'B' .....	6
3.3 Soil Conditions in Area 'C' .....	8
3.4 Shale Bedrock (Georgian Bay Formation).....	9
3.5 Groundwater Conditions .....	11
4. FOUNDATIONS .....	11
4.1 Proposed Buildings in Area 'A' .....	12
4.2 Proposed Buildings in Area 'B' .....	12
4.3 Proposed Buildings in Area 'C' .....	14
4.4 Other Comments on Foundations .....	15
5. FROST PROTECTION .....	15
6. FLOOR SLAB AND PERMANENT DRAINAGE.....	16
7. ELEVATOR AND SUMP PITS .....	16
8. EARTH, ROCK AND WATER PRESSURES.....	16
9. EXCAVATIONS AND GROUNDWATER CONTROL.....	17
10. EARTHQUAKE CONSIDERATIONS .....	18
11. ROADS .....	18
11.1 Pavement Thickness.....	18
11.2 Stripping, Sub-excavation and Grading.....	19
11.3 Construction.....	20
11.4 Drainage .....	20
12. UNDERGROUND UTILITIES .....	20
13. GENERAL COMMENTS AND LIMITATIONS OF REPORT.....	21

### DRAWINGS

BOREHOLE LOCATION PLAN	1-1A
NOTES ON SAMPLE DESCRIPTION	1B
BOREHOLE LOGS	2 – 46
GENERALIZED SUB-SURFACE PROFILES IN AREA 'A', 'B' & 'C'	47-57
GRAIN SIZE ANALYSES RESULTS	58-59
DRAINAGE AND BACKFILL RECOMMENDATIONS	60-62

### APPENDIX A: PHOTOGRAPHS OF ROCK CORES

GENERAL COMMENTS ON SHALE BEDROCK IN GREATER TORONTO AREA

**APPENDIX B:** LOGS AND LOCATION PLAN OF EXP BOREHOLES

**APPENDIX C:** GEOPHYSICAL SURVEY REPORT BY GEOPHYSICS GPR INTERNATIONAL INC.

---

## 1. INTRODUCTION

DS Consultants Ltd. (DS) was retained by the ARGO Development Corporation on behalf of Lakeview Community Partners Limited to carry out preliminary geotechnical and hydrogeological investigations for the proposed Lakeview Village on the lands of the former Lakeview Power Generation Station located at 800 Hydro Road in Mississauga, Ontario.

It is understood that the proposed 71.6-hectare Lakeview Village will include 5,000 to 7,000 new homes in a variety of housing options, including townhouses, mid-rise and high-rise buildings. There will be more than 600,000 square feet of employment and institutional use and another 200,000 square feet of cultural space. Lakeview Village will include a Serson Square, a year-round central gathering space with retail offices and homes that can be used as an arts and cultural hub.

The proposed high-rise structures will entail up to 3-levels of basement. The finished basement floor elevations are not available to us at the time of writing this report.

exp Services Inc (exp.) conducted a preliminary geotechnical investigation at the subject site in December 2017 and drilled nine (9) boreholes as a part of their field work. The logs and location plan of exp. boreholes (BH1 to BH9) are attached in **Appendix B** of this report.

The purpose of this geotechnical investigation was to determine the subsurface conditions at the borehole locations and make preliminary engineering recommendations for the following:

1. Foundations
2. Floor slabs and permanent drainage
3. Earth pressures
4. Excavations and backfill
5. Earthquake considerations
6. Pavements
7. Underground utilities

This report deals with geotechnical issues only. Preliminary hydrogeological findings by DS will be presented in a separate report. Environmental testing was not part of our scope of work.

This report is provided on the basis of the assumption that the design will be in accordance with the applicable codes and standards. If there are any changes in the design features relevant to the geotechnical analyses, or if any questions arise concerning the geotechnical aspects of the codes and standards, this office should be contacted to review the design. It may then be necessary to carry out additional borings and reporting before the recommendations of this office can be relied upon.



The site investigation and recommendations follow generally accepted practice for geotechnical consultants in Ontario, Canada. The format and contents are guided by client specific needs and economics and conform to generalized standards for services. Laboratory testing for most part follows ASTM or CSA Standards or modifications of these standards that have become standard practice.

The foundation recommendations made in this report are based on the subsoil conditions found during the field investigation. The comments made in this report on potential construction problems and possible construction options intended only for guidance of the designer.

This report has been prepared for Lakeview Community Partners Limited and its architects and designers. Third party use of this report without DS Consultants Ltd. consent is prohibited.

## **2. FIELD WORK & LAB TESTING**

Forty-five (45) boreholes (BH18-1 to BH18-49, except BH18-22 to BH18-24 and BH18-26, see Drawing 1 and 1A for location plan) were drilled at the site to depths varying from 1.7 m to 48.3m below the existing grade.

Four boreholes (BH18-22 to BH18-24 and BH18-26) were not be drilled due to the on-going construction work related to removal of buried concrete slabs associated with the former powerhouse.

Boreholes were drilled with solid stem and hollow stem continuous flight auger equipment by a drilling sub-contractor under the direction and supervision of DS Consultants Ltd personnel. Mud rotary was used in the drilling of some deep boreholes. Samples were retrieved at regular intervals with a 50 mm O.D. split-barrel sampler driven with a hammer weighing 624 N and dropping 760 mm in accordance with the Standard Penetration Test (SPT) method. The samples were logged in the field and returned to the DS Consultants Ltd laboratory for detailed examination by the project engineer and for laboratory testing.

Shale bedrock was cored at five (5) borehole locations (BH18-19, BH18-29, BH18-32, BH18-37 and BH18-45), with HQ double tube wireline equipment providing 63.5mm diameter rock core samples. The coring was carried out under the full-time supervision of a representative from DS who identified and described the rock samples, noting and recording the percentages of total and solid rock core recovery, RQD values, fracture index and the percentage and thicknesses of hard layers.

As well as visual examination in the laboratory, majority of the soil samples were tested for moisture contents. Selected fourteen (14) soil samples were subjected to grain size analyses and gradation curves are presented on Drawings 58 & 59. Atterberg's Limits tests were conducted on selected five (5) soil samples and results are presented on the respective borehole logs.

Water level observations were made during drilling and in the open boreholes at the completion of the drilling operations. Monitoring wells were installed in overburden and bedrock at seven (7) borehole locations for the longer-term groundwater level monitoring.

Methane gas measurements were taken in boreholes during drilling and upon completion of drilling, using a portable multi-gas detector RKI Eagle 2 instrument.

The ground surface elevations at the borehole locations was undertaken by DS personnel, using the differential GPS unit, leased from Sokkia Inc.

Geophysical survey was carried out at the subject site by the sub-contractor, Geophysics GPR International Inc. and their report is attached in **Appendix C** of this report.

### **3. SITE AND SUBSURFACE CONDITIONS**

The subject site is located at 800 Hydro Road in Mississauga, approximately three kilometers east of Port Credit, on Mississauga's waterfront. The subject property primarily consists of former OPG Lakeview Coal plant that was decommissioned between 2006 & 2008 and the City own lands that is currently being used as playing fields and parking lot. The topography of the site has gentle slope towards south towards Lake Ontario, with elevations decreasing from 84m to 77m. At the time of our field work, the existing concrete slabs associated with the former OPG powerhouse were being removed by the contractor.

The borehole location plan is shown on Drawings 1 and 1A. Notes on samples description are provided on Drawing 1B. The subsurface conditions in the boreholes are presented in the individual borehole log on Drawings 2 to 46. Generalized sub-surface profiles are provided on Drawing 47 to 57.

Based on the borehole information, there is a significant variation in the bedrock depths at site along the north-south and east-west directions. There is a bedrock valley within the site, with the bedrock surface depths varying from 1.5m to at or below 48.3m. To delineate the bedrock valley and for the ease of describing the geotechnical conditions, the site is sub-divided into three areas (Area A, Area B & Area C, see Drawing 1 for areas & respective borehole locations). The subsurface conditions in the boreholes, area wise, are summarized in the following paragraphs.

#### **3.1 Soil Conditions in Area 'A'**

Seventeen boreholes (BH18-14, BH18-19, BH18-21, BH18-25, BH27 to BH18-38 and BH18-49) were drilled within Area 'A'. All boreholes were drilled to shale bedrock.

**Topsoil, Pavement Structure & Fill Materials:** A surficial topsoil layer, ranging in thickness from 125 to 350mm, was encountered at BH18-21, BH18-33 to BH18-38 & BH18-49. Two boreholes (BH18-28 & BH18-30) drilled on the paved areas encountered 70mm of asphalt at the surface, overlying granular base/subbase. Fill materials were found in all boreholes, extending to depths varying from 0.8 to 4.2m below the existing grade. Fill material was heterogeneous and consisted of sand & gravel, crusher run limestone, silty sand, sandy silt and clayey silt to silty clay, with inclusions of organics/topsoil, wood,

concrete, asphalt and shale fragments. The SPT 'N' values recorded in fill materials ranged from 5 to over 50 blows per 300mm of spoon penetration, indicating loose to very dense state of relative density.

**Clayey Silt to Silty Clay Till:** Below the fill materials, clayey silt to silty clay till deposits were encountered in BH18-14, BH18-19, BH18-29, and BH18-34 to BH18-38 (except BH18-35), overlying shale bedrock or silty clay. Clayey silt till was present in a stiff to hard consistency, with measured SPT 'N' values ranging from 8 to over 50 blows per 300mm of spoon penetration. Occasional cobble/boulders and sand seams were encountered within this deposit.

Grain size analysis of one soil sample (BH18-33/SS3) was conducted. The results are shown on Drawing 59, with the following fractions:

Clay: 29%  
Silt: 46%  
Sand: 23%  
Gravel: 2%

Atterberg limits testing of one soil sample (BH18-33/SS3) was conducted. The results are shown on the borehole log and are summarized as follows:

Liquid limit ( $W_L$ ): 34%  
Plastic limit ( $W_P$ ): 21%  
Plasticity index (PI): 13

**Silty Clay:** A silty clay deposit was encountered in BH18-25, BH18-27, BH18-30 and BH18-36, below the fill material, or cohesionless soils or clayey silt till, and overlying shale bedrock. Silty clay was present in a firm to hard, generally hard consistency, with measured SPT 'N' values ranging from 6 to more than 50 blows for 300 mm penetration.

Grain size analysis of one soil sample (BH18-36/SS4) was conducted. The results are shown on Drawing 59 with the following fractions:

Clay: 32%  
Silt: 57%  
Sand: 11%

Atterberg limits testing of same soil sample (BH18-36/SS7) was conducted. The results are shown on the borehole log and are summarized as follows:

Liquid limit ( $W_L$ ): 37%  
Plastic limit ( $W_P$ ): 23%  
Plasticity index (PI): 14

**Cohesionless Soils (Sand & Gravel, Sand):** Cohesionless soils consisting of sand and gravel and sand were encountered in boreholes BH18-25, to BH18-28, BH18-32 below the fill material. These

cohesionless soils were water bearing and present in a very loose to very dense state, as indicated by the measured SPT 'N' values of nil to over 50 blows per 300mm of spoon penetration.

**Sandy Silt Till:** A sandy silt till deposit was encountered in BH18-49 below the fill material, extending to a depth of 4.5m, overlying shale bedrock. Sandy silt till was present in a compact to dense state, as indicated by the measured SPT 'N' values of 29 to 31 blows per 300mm of spoon penetration. Occasional cobble/boulders and sand seams were encountered within this deposit.

**Shale Bedrock:**

In Area 'A', shale bedrock of Georgian Bay Formation was found at all borehole locations, at depths ranging from 1.5 to 6.3m below the existing grade, corresponding to elevations ranging from 71.2 to 80.1m. The approximate depth and elevation of the shale bedrock surface at the borehole locations are listed on Table 3.1 below.

**Table 3.1: Approximate Depth and Elevation of Shale Bedrock Surface in Area 'A'**

<b>Borehole No.</b>	<b>Depth of Shale Bedrock Surface below Existing Ground (m)</b>	<b>Approximate Elevation of Shale Bedrock Surface (m)</b>	<b>Notes</b>
BH18-14	2.3	78.1	Augered
BH18-19	4.5	76.2	CORED
BH18-21	1.5	78.2	Augered
BH18-25	4.2	73.3	Augered
BH18-27 (30a)	3.8	73.5	Augered
BH18-28	3.3	79.5	Auger refusal
BH18-29A	6.3	71.2	cored
BH18-30	1.5	75.7	Augered
BH18-31	3.8	73.5	Augered
BH18-32	4.3	72.9	CORED
BH18-33	3.8	75.7	Augered
BH18-34	3.1	77.0	Augered
BH18-35	4.2	73.7	Augered
BH18-36	4.6	75.7	Augered
BH18-37	3.1	78.2	CORED
BH18-38	4.6	75.7	Augered
BH18-49	4.5	76.3	Augered
<b>BH3*</b>	<b>3.2</b>	<b>74.1</b>	<b>CORED</b>
<b>BH5*</b>	<b>3.5</b>	<b>76.8</b>	<b>Augered</b>
<b>BH6*</b>	<b>1.3</b>	<b>75.8</b>	<b>Augered</b>
<b>BH9*</b>	<b>4.4</b>	<b>74.6</b>	<b>CORED</b>

\*exp. boreholes

Detailed description of shale bedrock is provided in Section 3.4.

### 3.2 Soil Conditions in Area 'B'

Twenty-two (22) boreholes (BH18-1 to BH18-13, BH18-15 to BH18-18, BH18-20, BH18-39, BH18-40, BH18-46 & BH18-48) were drilled within Area 'B', to depths ranging from 11.1 to 48.3m.

**Topsoil, Pavement Structure & Fill Materials:** A surficial topsoil layer, ranging in thickness from 100 to 350mm, was encountered at BH18-1, BH18-3 to BH18-6, BH18-10 to BH18-12, BH18-16, BH18-39, BH18-40 and BH18-48). Three boreholes (BH18-2, BH18-17 and BH18-20) drilled on the paved areas encountered 70 to 100mm of asphalt at the surface, overlying granular base/subbase. Fill materials were found in all boreholes, extending to depths varying from 0.8 to 3.1m below the existing grade. Fill material was heterogeneous and consisted of clayey silt, silty clay, silty sand, sandy silt, silt and sand and gravel, with inclusions of organics/topsoil in varying proportions and trace asphalt & shale fragments. The SPT 'N' values recorded in fill materials ranged from 4 to 50 blows per 300mm of spoon penetration, indicating loose to very dense state of relative density.

**Clayey Silt to Silty Clay Till:** Clayey silt to silty clay till deposits of varying thicknesses were encountered in boreholes at varying depths. Clayey silt to silty clay till was present in a stiff to hard consistency, with measured SPT 'N' values ranging from 14 to over 50 blows per 300mm of spoon penetration. Occasional cobble/boulders and sand seams were encountered within this deposit.

Grain size analysis of four soil samples from clayey silt to silty clay till (BH18-1/SS5, BH18-2/SS6, BH18-7/SS12 & BH18-15/SS3) were conducted. The results are shown on Drawings 58 & 59, with the following fractions:

Clay: 16 to 37%  
Silt: 33 to 48%  
Sand: 15 to 49%  
Gravel: 1 to 9%

Atterberg limits testing of two soil samples (BH18-2/SS6 & BH18-3/SS15) were conducted. The results are shown on the borehole logs and are summarized as follows:

Liquid limit ( $W_L$ ): 19 to 20%  
Plastic limit ( $W_P$ ): 11 to 12%  
Plasticity index (PI): 8

**Clayey Silt to Silty Clay:** Clayey silt to silty clay deposit of varying thicknesses were encountered in boreholes at varying depths of the boreholes. Clayey silt o silty clay was present in a firm to hard, generally in very stiff consistency, with measured SPT 'N' values ranging from 6 to more than 50 blows for 300 mm penetration.

Grain size analysis of one soil sample (BH18-6/SS12) was conducted. The results are shown on Drawings 58 with the following fractions:

Clay: 68%  
Silt: 26%  
Sand: 6%

Atterberg limits testing of same soil sample (BH18-6/SS12) was conducted. The results are shown on the borehole log and are summarized as follows:

Liquid limit ( $W_L$ ): 48%  
Plastic limit ( $W_P$ ): 23%  
Plasticity index (PI): 25

**Sandy Silt to Silty Sand Till:** Sandy silt to silty sand till deposits of varying thicknesses were encountered in boreholes at varying depths. Sandy silt to silty sand till was generally water bearing and present in a very dense state, with measured SPT 'N' values of over 50 blows per 300mm of spoon penetration. Occasional to frequent cobble/boulders should be expected within this deposit.

**Cohesionless Soils (Sand & Gravel, Sand, Silty Sand, Sandy Silt, Silt):** Cohesionless soils consisting of sand & gravel, sand, silty sand, sandy silt, silt were encountered in majority of boreholes, embedded within the glacial till, at varying depths. These cohesionless soils were water bearing and present in a compact to very dense state, as indicated by the measured SPT 'N' values of 22 to over 50 blows per 300mm of spoon penetration.

Grain size analyses of seven (7) soil sample (BH18-2/SS3, BH18-3/SS10, BH18-8/SS7, BH18-8/SS8, BH18-8/SS12, BH18-9/SS5 and BH18-40/SS7) were conducted. The results are shown on Drawings 58 and 59, with the following fractions: 2

Clay: 2 to 10%  
Silt: 3 to 62%  
Sand: 23 to 95%  
Gravel: up to 4%

**Shale Bedrock:**

In Area 'B', shale bedrock Georgian Bay Formation was found at five (5) borehole locations (BH18-6, BH18-9, BH18-15, BH18-18 & BH18-20), at depths ranging from 9.1 to 48.1 below the existing grade, corresponding to elevations ranging from 34.7 to 71.3m. There is a bedrock valley in this area which was further confirmed by the geophysics testing. The approximate depth and elevation of the shale bedrock surface at the borehole locations are listed on Table 3.2 below.

**Table 3.2: Approximate Depth and Elevation of Shale Bedrock Surface in Area 'B'**

<b>Borehole No.</b>	<b>Depth of Shale Bedrock Surface below Existing Ground (m)</b>	<b>Approximate Elevation of Shale Bedrock Surface (m)</b>	<b>Notes</b>
BH18-6	48.1	34.7	Augered
BH18-7	>30.7		Not encountered at 30.7m
BH18-9	15.2	65.0	Augered
BH18-15	9.1	71.3	Augered
BH18-18	13.7	67.4	Augered
BH18-20	10.7	69.6	Augered
<b>BH2*</b>	<b>12.0</b>	<b>68.3</b>	<b>Augered</b>

\*exp. boreholes

Detailed description of shale bedrock is provided in Section 3.4.

### 3.3 Soil Conditions in Area 'C'

Six boreholes (BH18-41 to BH18-45 and BH18-47) were drilled within Area 'C'. All boreholes were drilled to shale bedrock.

**Topsoil & Fill Materials:** A surficial topsoil layer, ranging in thickness from 150 to 400mm, was encountered at borehole locations. Fill materials were found in all boreholes, extending to depths varying from 0.8 to 3.4m below the existing grade. Fill material was heterogeneous and consisted of clayey silt, silty clay, sandy silt, and sand & gravel with trace inclusions of organics/topsoil, brick, concrete, asphalt and shale fragments. The SPT 'N' values recorded in fill materials ranged from 4 to 17 blows per 300mm of spoon penetration, indicating loose to compact/firm to stiff state of compactness.

**Clayey Silt to Silty Clay Till:** Below the fill materials or silt/sandy silt, clayey silt to silty clay till deposits were encountered in boreholes, overlying shale bedrock or silt/sandy silt. Clayey silt till was present in a stiff to hard consistency, with measured SPT 'N' values ranging from 13 to over 50 blows per 300mm of spoon penetration.

**Cohesionless Soils (Silt, Sandy Silt to Silty Sand):** Cohesionless soils consisting of silt and sandy silt to silty sand were encountered in all boreholes, except in BH18-43 and BH18-44 below the fill material or clayey silt till. These cohesionless soils were generally water bearing and present in a very loose to dense state, as indicated by the measured SPT 'N' values of 5 to 32 blows per 300mm of spoon penetration.

**Shale Bedrock:** In Area 'C', shale bedrock of Georgian Bay Formation was found at all borehole locations, at depths ranging from 3.1 to 7.6m below the existing grade, corresponding to elevations ranging from 75.7 to 80.4m. The approximate depth and elevation of the shale bedrock surface at the borehole locations are listed on Table 3.3 below.

**Table 3.3: Approximate Depth and Elevation of Shale Bedrock Surface in Area 'C'**

Borehole No.	Depth of Shale Bedrock Surface below Existing Ground (m)	Approximate Elevation of Shale Bedrock Surface (m)	Notes
BH18-41	7.6	75.7	Augered
BH18-42	6.1	79.6	Augered
BH18-43	3.1	80.4	Augered
BH18-44	3.8	80.1	Augered
BH18-45	3.8	79.2	CORED
BH18-47	6.1	76.3	Augered
BH7*	3.6	79.8	CORED

\*exp. boreholes

Detailed description of shale bedrock is provided in Section 3.4.

### 3.4 Shale Bedrock (Georgian Bay Formation)

Shale bedrock belonging to Georgian Bay Formation was encountered at this site. Because of the method of drilling and sampling, the surface elevations of the bedrock can be different than indicated on the borehole logs (Drawings 2 to 46). Commonly the till overlying the shale contains slabs of limestone which would give a false indication of the bedrock level. Similarly, the depth of weathering cannot be determined accurately due to the presence of limestone layers.

Shale bedrock was cored at five (5) borehole locations (BH18-19, BH18-29, BH18-32, BH18-37 and BH18-45) to confirm the depth and quality of bedrock.

Photographs of the bedrock cores are also presented in **Appendix A** of the report. The descriptive terms used on the record of rock cores and throughout this report are explained on the "Explanation of Terms Used in the Bedrock Core Log" sheet in Appendix A. **Appendix A** also presents more details and general comments about the shale bedrock in Toronto area.

#### **Total Core Recovery (TCR):**

The total core recovery indicates the total length of rock core recovered, expressed as a percentage of the actual length of the core run. The total core recovery for the cored runs ranged from 67 to 100%. Generally, less core recovery was experienced only near the surface of the rock, where the formation is highly to moderately weathered and was almost full as depth increased.

#### **Solid Core Recovery (SCR):**

The solid core recovery is the total length of solid, full diameter rock core that was recovered, expressed as a percentage of the length of the core run. Solid core recovery ranged from 28 to 98%, and also



appears to generally improve with depth. The SCR index was generally influenced by the orientations of the fractures. SCR was low when fractures oblique to the borehole axis were intercepted.

#### **Rock Quality Designation (RQD):**

The rock quality designation index is obtained by measuring the total length of recovered rock core pieces which are longer than 100mm and expressing their sum total length as a percentage of the length of the core run. RQD is a function of the frequency of joints, bedding plane partings and fractures in the rock cores. While the use of double tube core barrels provided reasonably good protection of the core during drilling and core retrieval, the fissile nature of the shale greatly influences the RQD values of the rock cores. Consequently, it is believed that the RQD values recorded underestimate the rock quality classification of the laminated fissile shale. On the basis of the recorded RQD values which range from nil to 97%, the rock quality is estimated to be “very poor” to “excellent”, and the average value of more than 50% suggests a rock of generally “fair” quality.

#### **Hard Layers:**

Based on the visual examination of the rock cores, an attempt was made to identify and record the thickness and percentages of the relatively harder siltstone and limestone layers. The percentage of the “hard layers” per core run ranges between nil and 32%. The thickness of these layers varied but was generally varied from 50 to 380mm, but thicker layers have been observed to be as much as 750 to 900 mm at other sites. The layers are actually lenses and they can vary significantly in thickness over short distance. Encountering such thick layers should be anticipated. It is also common to encounter closely spaced groupings of thin strong limestone/siltstone layers which individually may only be 25 to 50mm thick but collectively can be 1m in thickness.

#### **Fracture Index:**

When logging the rock cores, the fracture Index (i.e. the number of fractures for each 0.3m length of core) was also recorded. The recorded values range between nil and greater than 25. Occasional fragmented and broken zones were encountered within the solid core. Bedrock was fragmented up to a depth of about 4.9m m in BH18-37, as indicated by nil solid core recovery in this zone. It was observed that the planes of weaknesses along which the cores tended to break, included planes of fissility and bedding, the contact surfaces between shale and siltstone or limestone bands and some oblique and subvertical joints.

#### **Weathering:**

In general, moderately weathered zone in the bedrock was limited to about 1.5 m from the bedrock surface. Below this, the degree of weathering ranged from slightly weathered to fresh. The siltstone and limestone layers were generally fresh with only slight surficial weathering on joint surfaces in the zone close to bedrock surface.

### Methane Gas:

Methane gas under pressure was encountered in BH18-13 below a depth of about 11m, which is possibly just above the bedrock surface. The borehole was terminated at this depth and properly sealed. Although, during the rock coring there were no physical indications of the presence of gas in the coreholes, the Georgian Bay Formation is known to contain pockets of combustible gas. Therefore, appropriate care and monitoring are essential in all confined excavation work, particularly caissons and tunnels.

## 3.5 Groundwater Conditions

During drilling, short-term (un-stabilized) groundwater levels were found at depths ranging from 1.5 to 18.3m below the existing grade. Long-term (stabilized) groundwater levels in the monitoring wells were found at depths ranging from 2.0 to 8.0m below the existing grade, corresponding to Elevations of 74.9 to 80.2m. The results of the water level readings taken on Sept. 26, 2018 in the monitoring wells are summarized on Table 3.5.

**Table 3.5: Groundwater Levels Observed in DS Monitoring Wells**

Borehole	Surface Elevation (m)	Date of Observation	Water Level Depth (mbgs)	Water Level Elev. (m)	Notes
BH18-8	81.6	Sept. 26, 2018	2.8	78.8	Screened in overburden
BH18-12	83.2	Sept. 26, 2018	8.0	75.2	Screened in overburden
BH18-16	82.9	Sept. 26, 2018	2.7	80.2	Screened in overburden
BH18-19	80.7	Sept. 26, 2018	4.7	76.0	Screened in bedrock
BH18-29A*	77.5	Sept. 26, 2018	-	-	Screened in bedrock (Well not accessible)
BH18-32	77.2	Sept. 26, 2018	2.3	74.9	Screened in bedrock
BH18-37	81.3	Sept. 26, 2018	2.0	79.3	Screened in bedrock

It should be noted that the groundwater levels can vary and are subject to seasonal fluctuations in response to major weather events.

## 4. FOUNDATIONS

It is understood that the 71.6-hectare Lakeview Village will include 5,000 to 7,000 new homes in a variety of housing options, including townhouses, mid-rise and high-rise buildings. The proposed structures will entail up to 3-levels of basement. The finished basement floor elevations are not available to us at the time of writing this report. It is assumed that P1, P2 and P3 basement levels will approximately be at 3m, 6m and 9m depths respectively below the existing grade. Footings will be 1m to 2m below the lowest basement slab.

Based on the encountered bedrock depths, the subject site is sub-divided into three areas (Area A, Area B and Area C), as summarized in Sections 3.1 to 3.3. The foundation recommendations for these three areas are provided below:

#### **4.1 Proposed Buildings in Area 'A'**

Boreholes drilled within Area 'A' (BH18-14, BH18-19, BH18-21, BH18-25, BH27 to BH18-38 and BH18-49) reported shale bedrock at depths ranging from 1.5 to 6.3m below the existing grade, corresponding to elevations ranging from 71.2 to 80.1m. Due to the shallow bedrock depths, this area is considered more suitable for high-rise development with one or more basement levels.

Depending upon the finished lowest basement floor elevation, the proposed buildings can be supported by conventional spread and strip footings / mat foundations or short drilled piers founded on shale bedrock, at minimum 0.3 m below the shale bedrock surface, for a bearing pressure values of 2.5 MPa at the Serviceability Limit States (SLS), and for a factored geotechnical resistance of 3.75 MPa at the Ultimate Limit States (ULS).

The footings/piers founded on sound shale, at minimum 1.5 m below the shale surface can be designed for a bearing pressure of 5.0 MPa at SLS, and a factored geotechnical resistance of 7.5 MPa at ULS.

The depths and elevations of shale bedrock at the borehole locations in Area 'A' are provided in Table 3.1 of this report.

#### **4.2 Proposed Buildings in Area 'B'**

Twenty-two (22) boreholes (BH18-1 to BH18-13, BH18-15 to BH18-18, BH18-20, BH18-39, BH18-40, BH18-46 & BH18-48) were drilled within Area 'B', to depths ranging from 11.1 to 48.3m.

There is a bedrock valley within Area 'B', with bedrock depths ranging from 9.1 to 48.1m below the existing grade, corresponding to elevations ranging from 34.7 to 71.3m. Therefore, this area is more suitable for low-rise to mid-rise development to be supported by shallow foundations (footings/raft) founded on undisturbed native soil.

Depending upon the location of the building and number of basement levels, it may be possible to support the proposed development in this area on footings or deep foundations such as caissons founded on bedrock.

Additional boreholes will be required to further delineate and confirm the bedrock depths if foundations are to be supported on bedrock.

Footings and/or raft founded on undisturbed native soils can be designed for a bearing capacity values of 300 to 500 kPa at SLS (serviceability limit states) and for a factored geotechnical resistance of 450 to

750 kPa at ULS (ultimate limit states). The bearing values and the corresponding founding elevations at the borehole locations are summarized on Table 4.2.

**Table 4.2: Bearing Values and Founding Levels of Spread Footings**

BH No.	Material	Bearing Capacity at SLS (kPa)	Factored Geotechnical Resistance at ULS (kPa)	Minimum Depth below Existing Ground (m)	Founding Level At or Below Elevation (m)	Notes/WL Elevation (m)
BH18-1	Silty clay Till/ Sandy Silt Till	500	750	3.4	79.4	during drilling WL at 76.7m
BH18-2	Clayey Silt Till	500	750	2.6	81.2	
BH18-3	Clayey Silt Till/ sandy silt to silty sand	500	750	1.0	80.4	during drilling WL at 76.8m
BH18-4	Sandy silt to silty sand	400	600	2.1	79.0	during drilling WL at 75.1m
BH18-5	Clayey Silt Till	500	750	2.6	81.4	
BH18-6	Clayey Silt Till	500	750	1.8	81.0	
BH18-7	Clayey Silt Till	500	750	1.5	80.6	
BH18-8	Clayey Silt/sandy silt	400	600	1.1	80.5	WL at 78.8m on Sept. 26/18
BH18-9	Clayey Silt/sandy silt	300 500	450 750	2.3 6.1	77.9 74.1	during drilling WL at 77.1m
BH18-10	Clayey Silt Till/clayey silt/sandy silt till	500	750	1.8	80.5	during drilling WL at 76.5m
BH18-11	Clayey Silt Till Silty Clay	500 300	750 450	3.4 13.0	81.7 72.1	
BH18-12	Clayey Silt Till Clayey Silt	500 300	750 450	3.0 8.0	80.2 75.2	WL at 75.2m on Sept. 26/18
BH18-13	Clayey Silt Till/Clayey Silt/Sandy silt to silty sand till	300 500	450 750	1.8 4.6	78.4 75.6	during drilling WL at 75.6m; methane gas encountered at 11m
BH18-15	Silt/silty sand/silty clay	500	750	3.1	77.3	
BH18-16	Clayey silt till	500	750	2.6	80.3	WL at 80.2m on Sept. 26/18
BH18-17	Clayey Silt Till/Clayey Silt	500	750	1.8	78.5	
BH18-18	Clayey silt till Silty clay/silt	300	450	2.1	79.0	
BH18-20	Clayey silt till/silty clay/silt to clayey silt	500	750	1.0	79.3	during drilling WL at 77.2m
BH18-39	Sandy silt till/silty clay till	500	750	3.4	78.4	
BH18-40	Sandy Silt to silty sand/silty clay till	500	750	2.5	79.3	during drilling WL at 79.5m
BH18-46	Silty clay till	500	750	1.1	80.3	

BH18-48	Clayey silt till/sandy silt till	500	750	1.8	79.3	during drilling WL at 78.0m
---------	----------------------------------	-----	-----	-----	------	-----------------------------

### 4.3 Proposed Buildings in Area 'C'

Boreholes drilled in Area 'C' (BH18-41 to BH18-45 and BH18-47) reported shale bedrock depths ranging from 3.1 to 7.6m below the existing grade, corresponding to elevations ranging from 75.7 to 80.4m. Due to the shallow bedrock depths, this area is also suitable for high-rise development with one or more basement levels.

Depending upon the finished lowest basement floor elevation, the proposed buildings can be supported by conventional spread and strip footings / mat foundations or short drilled piers founded on shale bedrock, at minimum 0.3 m below the shale bedrock surface, for a bearing pressure values of 2.5 MPa at the Serviceability Limit States (SLS), and for a factored geotechnical resistance of 3.75 MPa at the Ultimate Limit States (ULS).

The footings/piers founded on sound shale, at minimum 1.5 m below the shale surface can be designed for a bearing pressure of 5.0 MPa at SLS, and a factored geotechnical resistance of 7.5 MPa at ULS.

The depths and elevations of shale bedrock at the borehole locations are provided in Table 3.3 of this report.

Footings and/or raft founded on undisturbed native soils can be designed for a bearing capacity values of 300 to 500 kPa at SLS (serviceability limit states) and for a factored geotechnical resistance of 450 to 750 kPa at ULS (ultimate limit states). The bearing values and the corresponding founding elevations at the borehole locations are summarized on Table 4.3.

**Table 4.3: Bearing Values and Founding Levels of Spread Footings**

BH No.	Material	Bearing Capacity at SLS (kPa)	Factored Geotechnical Resistance at ULS (kPa)	Minimum Depth below Existing Ground (m)	Founding Level At or Below Elevation (m)	Notes/WL Elevation (m)
BH18-41	Silty clay Till/ silt	500	750	2.6	80.7	during drilling WL at 78.7m
BH18-42	Clayey Silt Till	500	750	4.6	81.1	
BH18-43	Clayey Silt Till	500	750	1.1	82.4	
BH18-44	Clayey Silt Till	300	450	1.5	82.4	
BH18-45	Silty Clay Till	400	600	2.6	80.7	
BH18-47	Clayey Silt Till / Silt/sandy silt to silty sand	300	450	1.0	81.4	during drilling WL at 77.8m

#### **4.4 Other Comments on Foundations**

Foundations designed to the specified bearing capacity at the serviceability limit states (SLS) are expected to settle less than 25 mm total and 19 mm differential.

Where it is necessary to place footings at different levels in soil, the upper footing must be founded below an imaginary 10 horizontal to 7 vertical line drawn up from the base of the lower footing. Where it is necessary to place footings at different levels on bedrock, the upper footing must be founded below an imaginary 1 horizontal to 1 vertical line (1H:1V in bedrock) drawn up from the base of the lower footing. The lower footing must be installed first to help minimize the risk of undermining the upper footing.

All foundation bases must be inspected by this office prior to pouring concrete.

The shale bedrock weathers rapidly between wetting and drying cycles. In view of this, it is suggested that a lean concrete mat slab be placed immediately after the excavation is complete to keep the shale intact, unless the footings are cast immediately after excavating.

The inspected and approved footing base should be covered with 50 mm thick mud slab immediately in order to avoid disturbance of the founding soil due to construction activity and weathering /drying.

It should be noted that the recommended bearing capacities have been calculated by DS Consultants Limited from the borehole information for the preliminary design stage only. Additional boreholes may be required when the final building plans are available. The investigation and comments are necessarily on-going as new information of the underground conditions becomes available. For example, more specific information is available with respect to conditions between boreholes when foundation construction is underway. The interpretation between boreholes and the recommendations of this report must therefore be checked through field inspections provided by DS Consultants Limited to validate the information for use during the construction stage.

#### **5. FROST PROTECTION**

All foundations exposed to seasonal freezing conditions must have at least 1.2m of soil cover for frost protection.

There is no official rule governing the required founding depth for footings below unheated basement floors. Certainly, it will not be greater than the 1.2 m required in Southern Ontario for exterior footings. Un-monitored experience indicates that a shallower depth ranging from 0.82 to 0.9 m for interior column footings and 0.4 m for wall footings has been successful where 2 or more basement levels apply. The 0.82 m depth is believed to be close to the minimum structural requirement for interior column footings. Adjacent to air shafts and entrance and exit doors, a footing depth of 1.2 m below floor level is required or, alternatively, insulation protection must be provided.

It is also emphasized that underfloor drainage and/or an adequate free draining gravel base is required to minimize the risk of floor dampness. Floor dampness could lead to temporary icing and the risk of accidents.

## 6. FLOOR SLAB AND PERMANENT DRAINAGE

The floor slab can be supported on grade provided all existing fill material and disturbed soils are removed and the base thoroughly proof rolled. The fill required to raise the grade can consist of inorganic soil, placed in shallow lifts and compacted to 98 percent of Standard Proctor Maximum Dry Density (SPMDD). A moisture barrier consisting of at least 200 mm of 19 mm clear crushed stone should be installed under the floor slab.

In the area where shale bedrock is encountered at floor slab level, the floor slab can be cast as slab-on-grade, provided a 200 mm layer of clear crushed stone (19 mm maximum size) is placed between the underside of the floor slab and the exposed bedrock surface.

A perimeter and underfloor drainage system will be required for buildings with basements. Typical drainage and backfill recommendations are illustrated on Drawings 60 to 62 for the open cut and shored excavation system.

## 7. ELEVATOR AND SUMP PITS

If elevator/sump pits are to be installed in cohesionless soils (sandy silt, sand, silt) below the water table, drainage systems at the base level of the pits are not recommended, due to the concern of loss of fines. In this case, the pits can be designed as water-tight structures, and water pressure on the pit walls and the pit base slab should be considered.

## 8. EARTH, ROCK AND WATER PRESSURES

The design of basement walls can incorporate the conventional design in the overburden using the earth pressure coefficient  $K_1=0.40$ . In the rock, the earth pressure coefficient  $K$  can be reduced to  $K_2=0.20$ .

The lateral earth/rock pressure acting at any depth on basement walls can be calculated as follows:

$$\text{In soil: } p = K_1 (\gamma_1 h_1 + q) + p_w$$

$$\text{In rock: } p = K_2 (\gamma_1 H_1 + q + \gamma_2 h_2) + p_w$$

where  $p$  = lateral earth and water pressure in kPa acting at depth  $h_1$  or  $h_2$

$K_1, K_2$  = earth pressure coefficients,  $K_1=0.40$  for overburden soil;  $K_2=0.20$  for rock

$\gamma_1$  = unit weight of overburden soil, assuming  $20.5 \text{ kN/m}^3$  above the water table and  $11 \text{ kN/m}^3$  below the water table

$\gamma_2$	=	unit weight of rock below water, assuming 15 kN/m <sup>3</sup>
$h_1$	=	Depth in overburden soil, below ground surface
$H_1$	=	thickness of soil above rock
$h_2$	=	Depth in rock, below rock surface
$q$	=	value of surcharge in kPa
$\rho_w$	=	hydrostatic water pressure

When the foundation wall is poured against the caisson wall, the foundation wall as well as the caisson wall should be designed for hydrostatic pressure, even though a drainage board is provided between the basement wall and the caisson wall.

## **9. EXCAVATIONS AND GROUNDWATER CONTROL**

Excavations can be carried out with heavy hydraulic backhoe. Long-term (stabilized) groundwater levels in the monitoring wells were found at depths ranging from 2.0 to 8.0m below the existing grade, corresponding to Elevations of 74.9 to 80.2m. Positive dewatering will be required prior to any excavation in water bearing cohesionless soils below the groundwater table, otherwise it will result in an unstable base and flowing sides. A contractor specializing in dewatering should be retained to design the dewatering systems for excavations below the groundwater table.

Further comments on groundwater control during construction and permanent drainage are provided in our preliminary hydrogeology report.

It should be noted that the glacial till soils may contain boulders. Large obstructions in the fill material are anticipated. Provisions must be made in the excavation contract for the removal of boulders in the till and large obstructions in the fill material.

Excavation of the shale can be carried out using heaviest available single tooth ripper equipment. The limestone beds are present and may overly the shale bedrock surface at some locations. It may be necessary at some locations to utilize jackhammer type equipment to “open” the limestone layers for the ripper.

All excavations must be carried out in accordance with the most recent Occupational Health and Safety Act (OHSA). In accordance with OHSA, the fill material can be classified as Type 3 soil above the groundwater table. The very stiff to hard clayey soils can be classified as Type 2 Soil above the groundwater table and as Type 3 below the groundwater table. The cohesionless soils of sand and silty sand can be classified as Type 3 Soil above the groundwater table and Type 4 soil below the groundwater table.



The native soils free from topsoil and organics can be used as general construction backfill, provided its moisture content is within 2 percent of the optimum moisture content. Loose lifts of soil, which are to be compacted, should not exceed 200 mm. Depending on the time of construction and weather, some excavated material may be too wet to compact and will require aeration prior to its use.

Imported granular fill, which can be compacted with hand held equipment, should be used in confined areas. The excavated soils are not considered to be free draining. Where free draining backfill is required, imported granular fill such as OPSS Granular B should be used.

It should be noted that the excavated soils are subject to moisture content increase during wet weather which would make these materials too wet for adequate compaction. Stockpiles should be compacted at the surface or be covered with tarpaulins to minimize moisture uptake.

## **10. EARTHQUAKE CONSIDERATIONS**

Based on the existing borehole information and according to Table 4.1.8.4.A of OBC 2012, the subject site for the proposed development can be classified as “Class C” for seismic site response.

In Area ‘A’ and Area ‘B’, for the proposed buildings with one or more levels of basement, founded on sound shale bedrock, it may be possible to classify the site as “Class B” for seismic site response. This should be further confirmed during the detail design stage.

## **11. ROADS**

The proposed development will be serviced by a network of roads.

### **11.1 Pavement Thickness**

The investigation has shown that the predominant subgrade soil, after stripping the topsoil and any other organic and otherwise unsuitable subsoil, will generally consist of clayey silt till, clayey silt, clayey silt till shale complex and shale bedrock.

Based on the above and assuming that traffic usage will be residential/commercial for local and collector road, the following minimum pavement thicknesses are recommended for roads to be constructed within the development.

#### **Collector Road**

40 mm HL3 Asphaltic Concrete

85 mm HL8 Asphaltic Concrete

200 mm Granular ‘A’

325 mm Granular ‘B’

### **Local/Minor Local Road**

40 mm HL3 Asphaltic Concrete

85 mm HL8 Asphaltic Concrete

200 mm Granular 'A'

175 mm Granular 'B'

These values may need to be adjusted according to the City of Mississauga Standards. The site subgrade and weather conditions (i.e. if wet) at the time of construction may necessitate the placement of thicker granular sub-base layer in order to facilitate the construction. Furthermore, heavy construction equipment may have to be kept off the newly constructed roads before the placement of asphalt and/or immediately thereafter, to avoid damaging the weak subgrade by heavy truck traffic.

### **11.2 Stripping, Sub-excavation and Grading**

The site should be stripped of all topsoil and any organic, weathered or otherwise unsuitable soils to the full depth of the roads, both in cut and fill areas. Following stripping, the site should be graded to the subgrade level and approved. The subgrade should then be proof-rolled, in the presence of the Geotechnical Engineer, by at least several passes of a heavy compactor having a rated capacity of at least 8 tonnes. Any soft spots thus exposed should be removed and replaced by select fill material, similar to the existing subgrade soil and approved by the Geotechnical Engineer. The subgrade should then be re-compacted from the surface to at least 98% of its Standard Proctor Maximum Dry Density (SPMDD). The final subgrade should be cambered or otherwise shaped properly to facilitate rapid drainage and to prevent the formation of local depressions in which water could accumulate.

Owing to the clayey (i.e. impervious) nature of some subsoils at the site, proper cambering and allowing the water to escape towards the sides (where it can be removed by means of subdrains) is considered to be beneficial for this project. Otherwise, any water collected in the granular sub-base materials could be trapped thus causing problems due to softened subgrade, differential frost heave, etc. For the same reason damaging the subgrade during and after placement of the granular materials by heavy construction traffic should be avoided. If the moisture content of the local material cannot be maintained at  $\pm 2\%$  of the optimum moisture content, imported granular material may need to be used.

Any fill required for re-grading the site or backfill should be select, clean material, free of topsoil, organic or other foreign and unsuitable matter. The fill should be placed in thin layers and compacted to at least 95% of its SPMDD. The degree of compaction should be increased to 98% within the top 1.0 m of the subgrade, or as per City Standards. The compaction of the new fill should be checked by frequent field density tests.

### **11.3 Construction**

Once the subgrade has been inspected and approved, the granular base and sub-base course materials should be placed in layers not exceeding 200 mm (uncompacted thickness) and should be compacted to at least 100% of their respective SPMDD. The grading of the material should conform to current OPS Specifications.

The placing, spreading and rolling of the asphalt should be in accordance with OPS Specifications or, as required by the local authorities.

Frequent field density tests should be carried out on both the asphalt and granular base and sub-base materials to ensure that the required degree of compaction is achieved.

### **11.4 Drainage**

The City of Mississauga may require the installation of full-length subdrains on all roads. The subdrains should be properly filtered to prevent the loss of (and clogging by) soil fines.

All paved surfaces should be sloped to provide satisfactory drainage towards catch-basins. As discussed in Section 11.2, by means of good planning any water trapped in the granular sub-base materials should be drained rapidly towards subdrains or other interceptors.

## **12. UNDERGROUND UTILITIES**

It is understood that underground services (watermains, storm and sanitary sewer) will be installed at the site to service the proposed development. Based on the preliminary servicing plans prepared by Urbantech, invert levels of the proposed utilities will be about 2 to 6m below the existing grade, with sanitary sewer at the deepest point at about 6m below the existing grade.

Trenches will be dug through fill materials followed by native soils of cohesive and cohesionless nature. Long-term (stabilized) groundwater levels in the monitoring wells were found at depths ranging from 2.0 to 8.0m below the existing grade, corresponding to Elevations of 74.9 to 80.2m. Positive dewatering will be required prior to any excavation in water bearing cohesionless soils below the groundwater table, otherwise it will result in an unstable base and flowing sides. Water table must be lowered to at least 1m below the lowest excavation level.

Detailed comments on excavation and groundwater control are provided in Section 9.

The undisturbed native soils encountered in the boreholes will provide adequate support for the service pipes and allow the use of Class B type bedding. The recommended minimum thickness of granular bedding below the invert of the pipes is 150 mm. The thickness of the bedding may, however, have to be increased depending on the pipe diameter or in accordance with local standards or if wet or weak

subgrade conditions are encountered, especially when the soil at the trench base level consists of wet, dilatant silt.

The bedding material should conform to City of Mississauga bedding stone gradation requirements. Where the bedding falls below the anticipated water table, the bedding stone must be surrounded with a geotextile filter cloth.

For deep trenches, i.e. more than 2.0 m below the shale surface, a minimum 50 mm thick polystyrene etc. layer will be required at both sides of the pipe to avoid rock squeezing. The polystyrene layer should extend vertically to at least 0.3 m above the pipe. The rock trench should be wide enough so that at each side, the horizontal distance between the pipe side and the cut rock surface is at least 0.3 m.

The select inorganic fill materials or native soils free from topsoil / organics can be used as general construction backfill, provided their moisture contents at the time of construction are within 2% of their optimum moisture content.

In any case the degree of compaction of the trench backfill should be at least 95% of the material's Standard Proctor Maximum Dry Density (SPMDD). This value should be increased to at least 98% within 2 m of the road surface. The granular pavement sub-base and base materials should be compacted to at least 100% of their respective SPMDD.

### **13. GENERAL COMMENTS AND LIMITATIONS OF REPORT**

This geotechnical report is preliminary, prepared based on the conceptual design plans. Additional boreholes will be required, once the detailed development plans are available to confirm the findings and recommendations provided in this report.

This report is intended solely for the client named. The material in it reflects our best judgment in light of the information available to DS Consultants Ltd at the time of preparation. Unless otherwise agreed in writing by DS Consultants Ltd, it shall not be used to express or imply warranty as to the fitness of the property for a particular purpose. No portion of this report may be used as a separate entity, it is written to be read in its entirety.

The conclusions and recommendations given in this report are based on information determined at the borehole locations. The information contained herein in no way reflects on the environment aspects of the project, unless otherwise stated. Subsurface and groundwater conditions between and beyond the boreholes may differ from those encountered at the borehole locations, and conditions may become apparent during construction, which could not be detected or anticipated at the time of the site investigation. The benchmark and elevations used in this report are primarily to establish relative elevation differences between the borehole locations and should not be used for other purposes, such as grading, excavating, planning, development, etc.


DS Consultants Ltd should be retained for a general review of the final design and specifications to verify that this report has been properly interpreted and implemented. If not accorded the privilege of making this review, DS Consultants Ltd will assume no responsibility for interpretation of the recommendations in the report.

Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. DS Consultants Ltd accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this report.


We accept no responsibility for any decisions made or actions taken as a result of this report unless we are specifically advised of and participate in such action, in which case our responsibility will be as agreed to at that time.

We trust that the information contained in this report is satisfactory. Should you have any questions, please do not hesitate to contact this office.

**DS CONSULTANTS LTD**


  
Alka Sangar, M.Eng., P.Eng.



  
Fanyu Zhu, Ph.D., P.Eng.



# Drawings

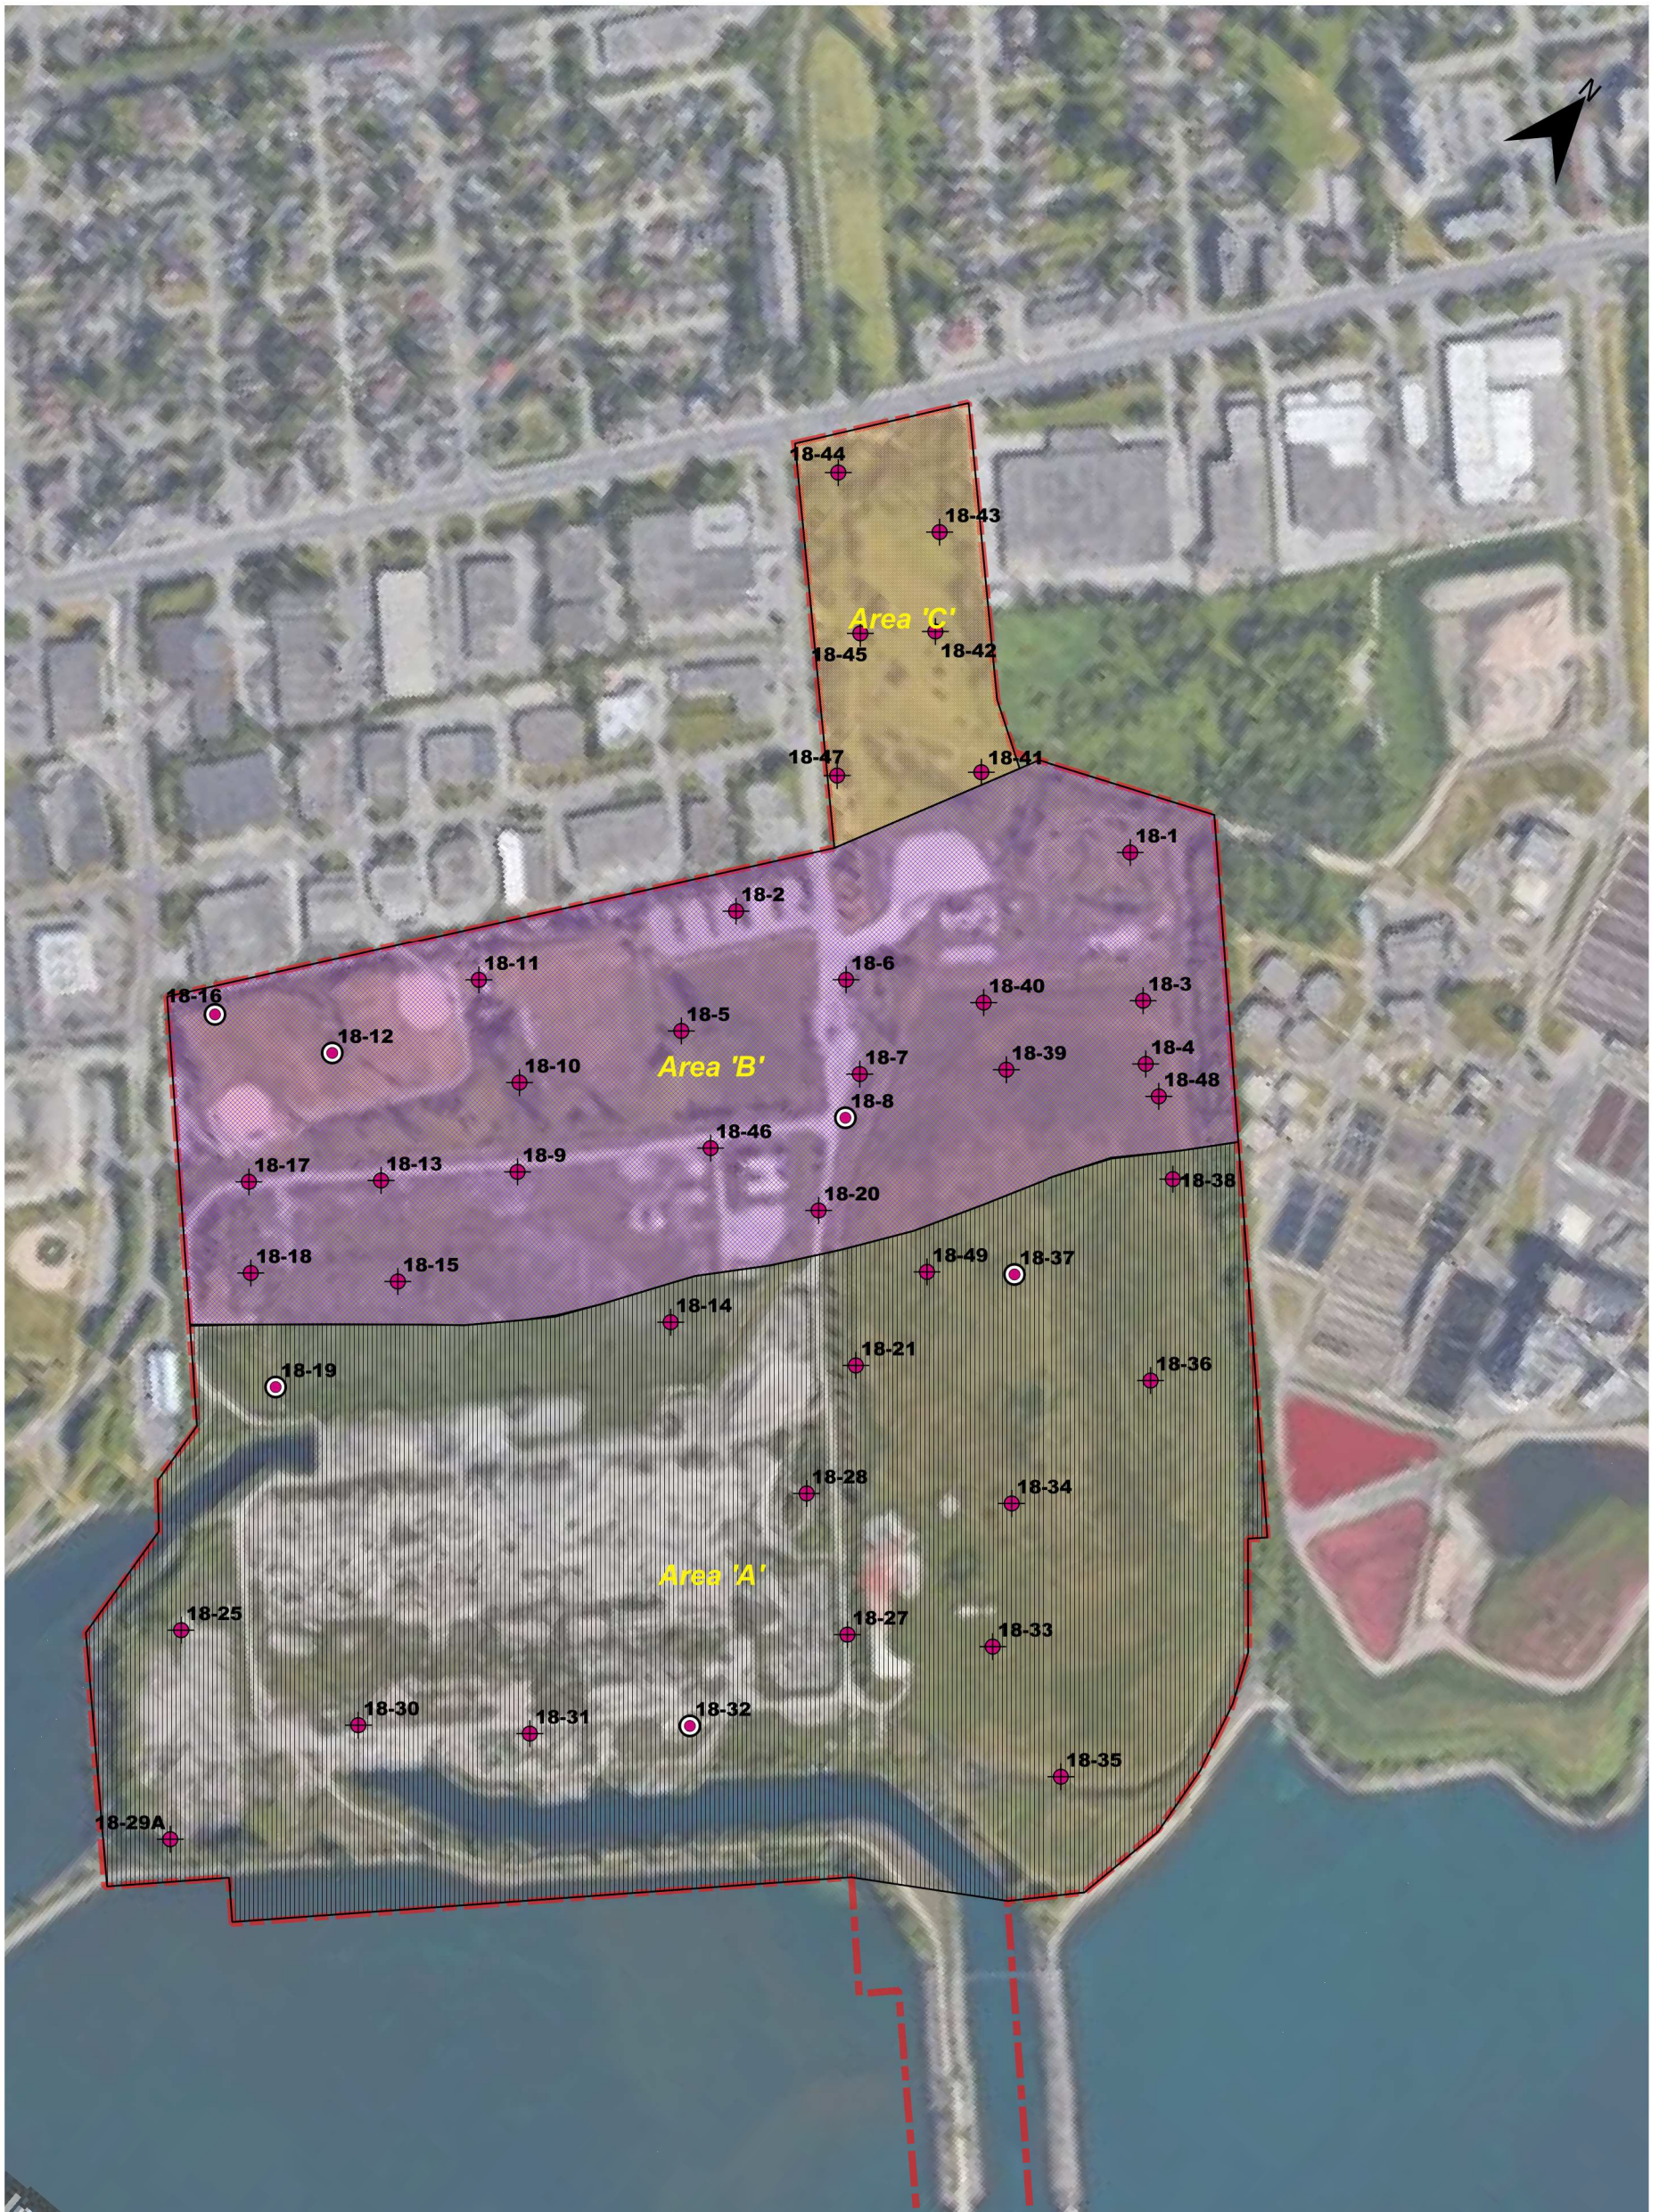


100 0 100 200 m

Image Source: Imagery @2018 Google

**Legend:**

- Boreholes**
- Monitoring Well
  - Borehole
  - Area 'A'  
Bedrock depth 1.5 to 4.6m
  - Area 'B'  
Bedrock depth 9.1 to 48.1m
  - Area 'C'  
Bedrock depth 3.1 to 76m

 <p><b>DS CONSULTANTS LTD.</b> 6221 Highway 7, Unit 16 Vaughan, Ontario, L4H 0K8 Telephone: (905) 264-9393 <a href="http://www.dsconsultants.ca">www.dsconsultants.ca</a></p>	Project: GEOTECHNICAL INVESTIGATION		
	<b>BOREHOLE LOCATION PLAN</b>		
Client: LAKEVIEW COMMUNITY PARTNERS LIMITED	Approved By: N.W	Drawn By: S.Y	Date: October 2018
	Scale: As Shown	Project No.: 18-519-10	Figure No.: 1



- Legend**
- Approx\_Site\_bnd
  - Monitoring Well (2018)
  - Borehole (2018)

**DS CONSULTANTS LTD.**  
 6221 Highway 7, UNIT 16  
 Vaughan, Ontario L4H 0K8  
 Telephone: (905) 264-9393  
 www.dsconsultants.ca

Client:  
**ARGO DEVELOPMENT CORPORATION**

Project: **PROPOSED GEOTECHNICAL INVESTIGATION - PHASE 1 AREA**  
 Lakeview Development, 800 Hydro Road, Toronto, ON

Title: **BOREHOLE LOCATION PLAN**

Size: 11 x 17  
 Approved By: N.W  
 Drawn By: S.Y  
 Date: June 2020

Rev: 0  
 Scale: As Shown  
 Project No.: 18-519-10  
 Drawing No.: **1A**


Image/Map Source: CAD Drawing





## Drawing 1B: Notes On Sample Descriptions

1. All sample descriptions included in this report generally follow the Unified Soil Classification. Laboratory grain size analyses provided by DSCL also follow the same system. Different classification systems may be used by others, such as the system by the International Society for Soil Mechanics and Foundation Engineering (ISSMFE). Please note that, with the exception of those samples where a grain size analysis and/or Atterberg Limits testing have been made, all samples are classified visually. Visual classification is not sufficiently accurate to provide exact grain sizing or precise differentiation between size classification systems.

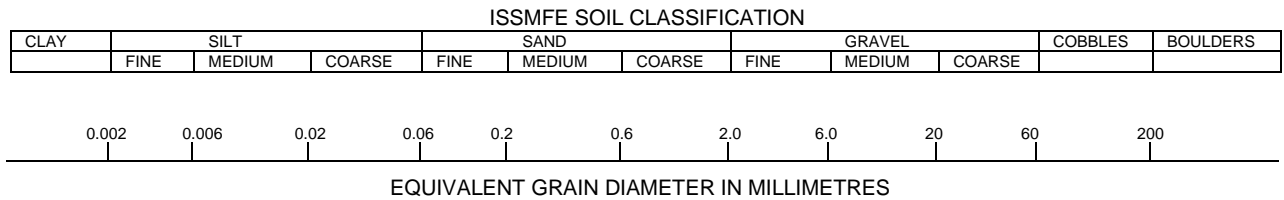

CLAY (PLASTIC) TO	FINE	MEDIUM	CRS.	FINE	COARSE
SILT (NONPLASTIC)	SAND			GRAVEL	

**UNIFIED SOIL CLASSIFICATION**

2. **Fill:** Where fill is designated on the borehole log it is defined as indicated by the sample recovered during the boring process. The reader is cautioned that fills are heterogeneous in nature and variable in density or degree of compaction. The borehole description may therefore not be applicable as a general description of site fill materials. All fills should be expected to contain obstruction such as wood, large concrete pieces or subsurface basements, floors, tanks, etc., none of these may have been encountered in the boreholes. Since boreholes cannot accurately define the contents of the fill, test pits are recommended to provide supplementary information. Despite the use of test pits, the heterogeneous nature of fill will leave some ambiguity as to the exact composition of the fill. Most fills contain pockets, seams, or layers of organically contaminated soil. This organic material can result in the generation of methane gas and/or significant ongoing and future settlements. Fill at this site may have been monitored for the presence of methane gas and, if so, the results are given on the borehole logs. The monitoring process does not indicate the volume of gas that can be potentially generated nor does it pinpoint the source of the gas. These readings are to advise of the presence of gas only, and a detailed study is recommended for sites where any explosive gas/methane is detected. Some fill material may be contaminated by toxic/hazardous waste that renders it unacceptable for deposition in any but designated land fill sites; unless specifically stated the fill on this site has not been tested for contaminants that may be considered toxic or hazardous. This testing and a potential hazard study can be undertaken if requested. In most residential/commercial areas undergoing reconstruction, buried oil tanks are common and are generally not detected in a conventional preliminary geotechnical site investigation.
3. **Till:** The term till on the borehole logs indicates that the material originates from a geological process associated with glaciation. Because of this geological process the till must be considered heterogeneous in composition and as such may contain pockets and/or seams of material such as sand, gravel, silt or clay. Till often contains cobbles (60 to 200 mm) or boulders (over 200 mm). Contractors may therefore encounter cobbles and boulders during excavation, even if they are not indicated by the borings. It should be appreciated that normal sampling equipment cannot differentiate the size or type of any obstruction. Because of the horizontal and vertical variability of till, the sample description may be applicable to a very limited zone; caution is therefore essential when dealing with sensitive excavations or dewatering programs in till materials.

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-18-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 2

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)				
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>
82.8																		
0.0	<b>TOPSOIL:</b> 350mm		1	SS	14							○						
82.4	<b>FILL:</b> clayey silt, some organics, trace gravel, grey, moist, stiff		2	SS	8							○						
82.0			3	SS	10							○						
80.5			4	SS	8							○						
2.3	<b>FILL:</b> sandy silt, some organics, grey, moist, loose		5	SS	17							○						
79.7	<b>SILTY CLAY TILL:</b> some sand, trace gravel, brown, moist, very stiff		6	SS	50							○						
3.1			7	SS	45							○						
78.2	<b>SANDY SILT TILL:</b> trace to some clay, trace gravel, grey, moist, very dense		8	SS	50							○						
4.6	<b>SAND:</b> trace silt, brown, wet, dense		9	SS	78							○						
76.7			10	SS	45							○						
6.1	<b>SAND AND GRAVEL:</b> trace silt, brown, wet, very dense		11	SS	50							○						
75.2			12	SS	50							○						
7.6	<b>SILTY SAND TILL:</b> some gravel to gravelly, occasional cobble/boulders, trace clay, grey, moist to wet, very dense		13	SS	50							○						
73.7			14	SS	78							○						
9.1																		

W. L. 76.7 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+3, ×3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
DATUM: Geodetic	Date: Jul-18-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 2

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)					
						20 40 60 80 100 ○ UNCONFINED    + FIELD VANE ● QUICK TRIAXIAL    × LAB VANE	20 40 60 80 100 ○ UNCONFINED    + FIELD VANE ● QUICK TRIAXIAL    × LAB VANE	W <sub>p</sub> w    W <sub>L</sub> PLASTIC LIMIT    NATURAL MOISTURE CONTENT    LIQUID LIMIT	10 20 30 WATER CONTENT (%)				GR SA SI CL
72	<b>SILTY SAND TILL:</b> some gravel to gravelly, occasional cobble/boulders, trace clay, grey, moist to wet, very dense(Continued)		10	SS	50								
71													
70.0	wet below 12.2 m		11	SS	76								
12.8	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 6.1 mbgl during drilling												

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement    1st    2nd    3rd    4th

**GRAPH NOTES**    +<sup>3</sup> , ×<sup>3</sup>: Numbers refer to Sensitivity    ○ ●=3% Strain at Failure




<p><b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development  <b>CLIENT:</b> Lakeview Community Partners Ltd.  <b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON  <b>DATUM:</b> Geodetic  <b>BOREHOLE LOCATION:</b> See Drawing 1</p>	<p><b>DRILLING DATA</b>  <b>Method:</b> Hollow Stem Auger  <b>Diameter:</b> 200 mm  <b>Date:</b> Jul-19-2018</p> <p style="text-align: right;">REF. NO.: 18-519-10 ENCL NO.: 3</p>
---	--

ELEV DEPTH (m)	SOIL PROFILE			STRATA PLOT	SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT Wp	NATURAL MOISTURE CONTENT		LIQUID LIMIT Wl	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
					NUMBER	TYPE	"N" BLOWS 0.3 m			20	40		60	80				
83.8	ASPHALT: 100 mm								83.8									
83.4	SAND AND GARVEL: 250 mm				1	AS			83.4									
83.0	FILL: silty sand, trace gravel, grey, wet								83.0									
82.3	CLAYEY SILT TILL: some sand, trace gravel, brown, moist, very stiff				2	SS	22		82.3									
81.5	SILTY SAND: trace clay, brown, wet, dense				3	SS	40		81.5									
81.5	CLAYEY SILT TILL: sandy, trace gravel, occasional cobble/boulder, grey, moist, very stiff to hard				4	SS	46		81.5						225			
					5	SS	40							225				
					6	SS	28		79.0					225		1	49 33 17	
					7	SS	41		77.0					225				
					8	SS	70		76.0					225				
					9	SS	44		75.0					225				
									74.0	wet spoon				225			July 19, 2018	
																	July 20, 2018	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page



**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-19-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 3

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80							100	
70.1	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, occasional cobble/boulder, grey, moist, very stiff to hard(Continued)		10	SS	21														
73																			
72																			
71																			
70																			
13.7	<b>CLAYEY SILT:</b> trace sand, grey, moist, very stiff		12	SS	21														
69																			
68																			
67																			
66																			
65	stiff at 18.3 m		15	SS	19														
64																			

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	DRILLING DATA
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
DATUM: Geodetic	Date: Jul-19-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 3

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80						
63.4	<b>CLAYEY SILT:</b> trace sand, grey, moist, very stiff(Continued)		16	SS	18											225	
20.4	<b>END OF BOREHOLE</b> Notes: 1 ) Borehole dry upon completion																

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement

**GRAPH NOTES** + 3 , × 3 : Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development CLIENT: Lakeview Community Partners Ltd. PROJECT LOCATION: 800 Hydro Road, Mississauga, ON DATUM: Geodetic BOREHOLE LOCATION: See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 150mm Date: Jun-25-2018  REF. NO.: 18-519-10 ENCL NO.: 4
---	---

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC	NATURAL	LIQUID	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)				
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80			100	W <sub>p</sub>	W	W <sub>L</sub>	GR
81.4																		
0.0	<b>TOPSOIL:</b> 350mm	[Symbol]	1	SS	13													
81.0																		
0.4	<b>POSSIBLE FILL:</b> clayey silt, brown, moist, stiff	[Symbol]																
80.6																		
0.8	<b>CLAYEY SILT:</b> some sand, occasional sand seams, brown, moist, very stiff to hard	[Symbol]	2	SS	22													
80.6																		
79.7																		
1.7	<b>CLAYEY SILT TILL :</b> some sand, trace gravel, occasional sand seams, brown, moist, very stiff	[Symbol]	3	SS	33													
80.6																		
79.7																		
4.0																		
3.1	<b>SANDY SILT TO SILTY SAND</b> trace clay, trace gravel, brown, moist to wet , very dense	[Symbol]	5	SS	50/ 100mm													
81.0																		
3.1																		
78.3																		
4.6	grey, wet below 4.6 m																	
78.3																		
3.1																		
78.3																		
7.6	<b>SILTY SAND TO SAND:</b> trace clay, grey, wet, dense	[Symbol]	8	SS	46													
81.0																		
73.8																		
7.6																		
73.8																		
9.1	<b>SILTY SAND TILL:</b> trace to some clay, trace gravel, occasional cobble/boulder, grey, wet, very dense	[Symbol]	9	SS	50/ 150mm													
81.0																		
72.3																		
9.1																		
72.3																		

DS SOIL LOG - 18-519-10 800 HYDRO ROAD GP J D.S.GDT. 18-10-12

W. L. 76.8 m during drilling

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+3, X3: Numbers refer to Sensitivity

○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-25-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 4

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20 40 60 80 100	20 40 60 80 100						
70.7	<b>SILTY SAND TILL:</b> trace to some clay, trace gravel, occasional cobble/boulder, grey, wet, very dense(Continued)						71								
10.7	<b>SAND:</b> trace silt, grey, wet, dense to very dense		10	SS	42									0	95 (5)
							70								
							69								
							68								
67.7	<b>SANDY SILT TO SILTY SAND:</b> trace to some clay, some gravel, grey, wet, very dense		12	SS	80										
							67								
							66								
							65								
							64								
63.1	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, occasional cobble/boulders, grey, moist, hard		15	SS	50/ 150mm										
18.3							63								
							62								

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS

Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity

○ = 3% Strain at Failure





PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jun-25-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 4

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80							100
61.2			16	SS	92													
20.2	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 4.6 mbgl during drilling																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** +<sup>3</sup>, ×<sup>3</sup>: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-22-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 5

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
81.1															
81.0	<b>TOPSOIL:</b> 150mm														
80.9	<b>FILL:</b> silty sand and gravel, brown, moist, compact		1	SS	10										
80.3	<b>FILL:</b> silt to clayey silt, trace organics, trace gravel, grey, moist, compact		2	SS	12										
79.3	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, trace cobble, brown, moist, very stiff		3	SS	14										
78.8	<b>SANDY SILT TO SILTY SAND:</b> trace clay, trace to some gravel, brown, moist to wet, very dense to compact		4	SS	29										
78.3			5	SS	50/ 150mm										
77.8			6	SS	50/ 50mm										
77.3															
76.8															
76.3															
75.8															
75.3															
74.8															
74.3															
73.8															
73.5	<b>SILTY SAND TILL:</b> trace clay, some gravel, occasional cobble/boulders, grey, wet, very dense		8	SS	78										
73.0															
72.5															
72.0			9	SS	64										
71.5															
71.0															
70.5															
70.0															
69.5															
69.0															
68.5															
68.0															
67.5															
67.0															
66.5															
66.0															
65.5															
65.0															
64.5															
64.0															
63.5															
63.0															
62.5															
62.0															
61.5															
61.0															
60.5															
60.0															

W. L. 75.1 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** +3, x3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-22-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 5

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)					
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	GR
71	<b>SILTY SAND TILL:</b> trace clay, some gravel, occasional cobble/boulders, grey, wet, very dense(Continued)		10	SS	hammer bounced														
70																			
69																			
68																			
67.4																			
13.7	<b>SAND:</b> trace silt, grey, wet, very dense  interbed of silt at 15.5 m		12	SS	62														
66																			
65																			
64																			
62.9	<b>SILTY CLAY TILL:</b> some sand, trace gravel, grey, moist, hard		14	SS	80														
63																			
18.2																			
62			15	SS	56														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-22-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 5

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80						
60.7	<b>SILTY CLAY TILL:</b> some sand, trace gravel, grey, moist, hard(Continued)		16	SS	42												
20.4	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 6.0 mbgl during drilling																

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3 , × 3 : Numbers refer to Sensitivity      ○ ● =3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-26-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 6

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
84.0	<b>TOPSOIL:</b> 127mm														
84.0 0.1	<b>FILL:</b> clayey silt, trace rootlet, trace organic, brown, moist, stiff to hard		1	SS	22										
1			2	SS	11										
2			3	SS	50										
81.7	<b>CLAYEY SILT TILL:</b> some sand, trace gravel, occasional cobble/boulder, brown to grey, moist, hard		4	SS	45										
2.3			5	SS	69										
3			6	SS	93										
4			7	SS	58										
5	grey below 4.9 m		8	SS	60										
6			9	SS	39										
7															
8															
9															
10															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+3, ×3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-26-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 6

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60
71.8	<b>CLAYEY SILT TILL:</b> some sand, trace gravel, occasional cobble/boulder, brown to grey, moist, hard(Continued)		10	SS	51											
72																
12.2	<b>SILTY CLAY:</b> trace sand, grey, moist, hard to very stiff		11	SS	32											
71																
68.8	<b>CLAYEY SILT:</b> trace sand, grey, moist, very stiff		12	SS	19											
70																
15.2	<b>CLAYEY SILT:</b> trace sand, grey, moist, very stiff		13	SS	21											
69																
65.7	<b>SILT:</b> trace clay, trace sand, grey, wet, compact		14	SS	19											
67																
18.3	<b>SILT:</b> trace clay, trace sand, grey, wet, compact		15	SS	26											
66																
64.5	<b>SANDY SILT TO SILTY SAND TILL :</b> interbed of wet sand, grey, wet, very dense															
65																

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS

Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity

○ = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Solid Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 150 mm
DATUM: Geodetic	Date: Jul-26-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 6

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80							100	W <sub>p</sub>
63.6			16	SS	66														
20.4	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 18.3 mbgl upon completion.																		

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement

**GRAPH NOTES** +<sup>3</sup>, ×<sup>3</sup>: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure





PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-18-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 7

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60
69.1	<b>CLAYEY SILT TILL:</b> some sand to sandy trace gravel, brown, moist, hard(Continued)		10	SS	54											
71			11	SS	64											
69.1			12	SS	16									48	125	0 6 26 68
13.7	<b>SILTY CLAY:</b> trace sand, occasional sand seams, grey, moist, very stiff		13	SS	26											
66.0			14	SS	23									200		
16.8	<b>CLAYEY SILT TO SILT :</b> some clay, trace sand, grey, moist, compact		15	SS	26											
66.0			14	SS	23									200		
64			15	SS	26										>225	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity  
 ○ ● = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-18-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 7

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)					
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	GR
62	<b>CLAYEY SILT TO SILT</b> : some clay, trace sand, grey, moist, compact(Continued)		16	SS	23														
61			17	SS	28														
60	<b>SILT</b> :some clay, grey, very moist to wet, dense		18	SS	32														
59			19	SS	81														
58	<b>SAND</b> :trace silt, some gravel to gravelly, grey, wet, very dense		20	SS	87														
57			21	SS	58														
56	<b>SANDY SILT TO SILTY SAND</b> :trace clay, grey, wet, very dense		22	SS	81														
55			21	SS	58														
54	<b>SILTY CLAY</b> :trace sand, trace gravel, grey, moist, hard		22	SS	81														
53			22	SS	81														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3 , × 3 : Numbers refer to Sensitivity  
 ○ ● =3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-18-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 7

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
30.0	<b>SILT:</b> some clay, trace sand, grey, wet, dense														
51.8			23	SS	45										
31.0	<b>SAND:</b> trace silt, grey, wet, dense														
50.8															
32.0	<b>SAND AND GRAVEL:</b> trace silt, occasional cobble/boulders, grey, wet, very dense		24	SS	80										
			25	SS	87										
			26	SS	50/ 125mm										
			27	SS	76										
			28	SS	50/ 150mm										
			29	SS	80										

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-18-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 7

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)							
41	SAND AND GRAVEL: trace silt, occasional cobble/boulders, grey, wet, very dense (Continued)		30	SS	50/100mm										
42															
43			31	SS	50/125mm										
44															
45			32	SS	50/100mm										
46															
47			33	SS	50/100mm										
48															
34.7	SHALE: Georgian Bay Formation, weathered, grey		35	SS	100/50mm										
48.1	END OF BOREHOLE:														
48.3	Notes: 1) Water level at 16.8m during drilling.														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

<b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
<b>CLIENT:</b> Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
<b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON	Diameter: 150mm
<b>DATUM:</b> Geodetic	Date: Jun-20-2018
<b>BOREHOLE LOCATION:</b> See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 8

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m³)	METHANE AND GRAIN SIZE DISTRIBUTION (%)		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60				80	100
82.1	<b>GRANULAR BASE:</b> 300mm		1	AS											
0.0 81.8	<b>FILL:</b> sand, some gravel, grey, moist, compact														
0.3			2	SS	16										
81.0 1.1	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, occasional cobble/boulder, brown to grey, moist, very stiff to hard  grey below 3.1 m		3	SS	33										
			4	SS	79										
			5	SS	59										
			6	SS	58										
			7	SS	51										
74.5 7.6	<b>SANDY SILT TILL:</b> some clay, some gravel, occasional cobble/boulder, grey, very moist to wet, very dense		8	SS	87										
73.0 9.1	<b>SILT:</b> trace sand, grey, moist to very moist, compact		9	SS	29										

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

W. L. 74.5 m during drilling

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** +3, ×3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-20-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 8

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100
72	SILT: trace sand, grey, moist to very moist, compact(Continued)														
71.4	SANDY SILT TO SILTY SAND: trace gravel, grey, wet, very dense		10	SS	77										
10.7															
71															
70.0	SILTY CLAY TILL: sandy, trace gravel, occasional cobble/boulder, grey, moist, hard		11	SS	59										
12.1															
69															
68															
68			12	SS	59										2 27 48 23
67															
66.9	SANDY SILT TO SILTY SAND: trace clay, grey, wet, very dense		13	SS	79										
15.2															
66															
65.3	CLAYEY SILT TILL: some sand to sandy, trace gravel, occasional cobble/boulder, grey, moist, hard		14	SS	72										
16.8															
65															
64															
63			15	SS	40										
62.3															
19.8															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-20-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 8

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)						
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	GR	SA
62	<b>SILTY CLAY:</b> trace sand, grey, moist, hard(Continued)		16	SS	39									200						
61			17	SS	34										175					
60																				
59			18	SS	56											>225				
58																				
57			19	SS	52											>225				
56			20	SS	57											>225				
55																				
54																				
53			<b>SANDY SILT TILL:</b> trace to some clay, trace gravel, occasional cobble/boulder, grey, wet, very dense		21	SS	50/ 25mm									>225				

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS

Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity

○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-20-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 8

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)					
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)							WATER CONTENT (%)				
						20 40 60 80 100 ○ UNCONFINED + FIELD VANE & Sensitivity ● QUICK TRIAXIAL × LAB VANE					W <sub>p</sub>	w	W <sub>L</sub>	GR SA SI CL					
51.4	SANDY SILT TILL: trace to some clay, trace gravel, occasional cobble/boulder, grey, wet, very dense(Continued)		22	SS	50/100mm	52													
30.7	END OF BOREHOLE Notes: 1) Water level at 7.6m during drilling.																		

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



<b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
<b>CLIENT:</b> Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
<b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON	Diameter: 150mm
<b>DATUM:</b> Geodetic	Date: Jun-28-2018
<b>BOREHOLE LOCATION:</b> See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 9

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
81.6 0.0	<b>FILL:</b> sand and gravel, brown, wet, compact		1	SS	17									
80.8 0.8	<b>CLAYEY SILT:</b> trace sand, brown to grey, moist, very stiff to hard		2	SS	16									
			3	SS	20									
	grey below 2.3 m		4	SS	28									
			5	SS	32									
			6	SS	24									
76.7 4.9	<b>SAND &amp; SILT:</b> trace to some clay, grey, wet, compact to dense		7	SS	46									0 43 47 10
			8	SS	66									0 31 62 7
74.0 7.6	<b>SANDY SILT:</b> trace clay, grey, wet, very dense		9	SS	71									
72.5 9.1	<b>CLAYEY SILT TILL:</b> some sand to sandy, trace gravel, occasional cobble/boulder, grey, moist, hard													

DS SOIL LOG - 18-519-10 800 HYDRO ROAD GP J D.S.GDT. 18-10-12

W. L. 78.8 m  
Sep 26, 2018

Bentonite

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-28-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 9

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20 40 60 80 100	20 40 60 80 100						
70.9	<b>CLAYEY SILT TILL:</b> some sand to sandy, trace gravel, occasional cobble/boulder, grey, moist, hard(Continued)						71								
10.7	<b>SILT TO CLAYEY SILT:</b> trace sand, grey, moist to very moist, dense		10	SS	34		70					175			
69.4							69.4								
12.2	<b>SILTY SAND TILL:</b> trace clay, some gravel, grey, wet, very dense		11	SS	50/ 150mm		69								
68.1							68.1								
13.5	<b>SAND:</b> trace silt, trace gravel, grey, wet, very dense		12	SS	74		68							8	88 (4)
66.4							66.4								
15.2	<b>SANDY SILT TO SILTY SAND:</b> trace clay, grey, wet, very dense		13	SS	82		66								
64.5							65								
17.1	<b>SILTY CLAY:</b> trace sand, grey, moist, hard		14	SS	71		64								
							63								
							62								
							63						>225		

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure



<p>PROJECT: Preliminary Geotechnical Investigation- Proposed Development          CLIENT: Lakeview Community Partners Ltd.          PROJECT LOCATION: 800 Hydro Road, Mississauga, ON          DATUM: Geodetic          BOREHOLE LOCATION: See Drawing 1</p>	<p><b>DRILLING DATA</b>          Method: Hollow Stem Auger          Diameter: 150mm          Date: Jun-28-2018</p> <p style="text-align: right;">REF. NO.: 18-519-10          ENCL NO.: 9</p>
--	---

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT NATURAL MOISTURE CONTENT LIQUID LIMIT			POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80	100	W <sub>p</sub>	w				W <sub>L</sub>	WATER CONTENT (%)
61.2	<b>SILTY CLAY:</b> trace sand, grey, moist, hard(Continued)	[Hatched Box]	16	SS	35								o						
20.4	<b>END OF BOREHOLE</b> Notes: 1) Water level at 4.9 mbgl during drilling 2) Water level in the monitoring well recorded at 2.8m on Sept. 26, 2018.																		

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-04-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 19

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC NATURAL LIQUID			POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m³)	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m)	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80	100			
80.2															
0.0	<b>FILL:</b> sandy silt, trace gravel, grey, moist		1	AS											
79.4															
0.8	<b>FILL:</b> silty clay, trace organics, grey, moist, loose		2	SS	4										
78.7															
1.5	<b>CLAYEY SILT:</b> trace sand, grey, moist, firm to very stiff		3	SS	6										
			4	SS	20									>225	
77.1															
3.1	<b>SANDY SILT:</b> trace to some clay, grey, wet, compact		5	SS	22										
			6	SS	30										
74.1															
6.1	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, grey, moist, hard		7	SS	75										>225
72.6															
7.6	<b>SILT TO SANDY SILT:</b> trace clay, grey, wet, very dense		8	SS	81										
			9	SS	50/125mm										

W. L. 77.1 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ, D.S.GDT, 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**  
 + 3, x 3: Numbers refer to Sensitivity  
 ○ s=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-04-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 19

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100
69.5	<b>SILT TO SANDY SILT:</b> trace clay, grey, wet, very dense(Continued)														
10.7	<b>SILTY CLAY:</b> trace sand, trace gravel, grey, moist, hard		10	SS	32										
			11	SS	53										
13.7	<b>SILT:</b> trace to some clay, trace sand, grey, wet, dense		12	SS	34										
65.0															
64.9	<b>SHALE-</b> Georgian Bay Formation, weathered, grey		13	SS	50/100mm										
15.3	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 3.1 mbgl during drilling.														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, x 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-25-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 11

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
82.3															
0.0	<b>TOPSOIL:</b> 300 mm														
82.0															
0.3	<b>FILL:</b> silty clay, trace topsoil, trace gravel, brown, wet, stiff		1	SS	14										
81.5															
0.8	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, brown, moist, very stiff to hard		2	SS	19								200		
1															
1.2															
1.4															
1.6															
1.8															
2.0															
2.2															
2.4															
2.6															
2.8															
3.0															
3.2															
3.4															
3.6															
3.8															
4.0															
4.2															
4.4															
4.6	<b>CLAYEY SILT:</b> trace sand, grey, moist, very stiff		6	SS	20								225		
4.8															
5.0															
5.2															
5.4															
5.6															
5.8															
6.0															
6.2															
6.1	<b>SILT:</b> trace clay, trace to some sand, grey, wet, compact		7	SS	23										
6.3															
6.4															
6.5															
6.6															
6.7															
6.8															
6.9															
7.0															
7.1															
7.2															
7.3															
7.4															
7.5															
7.6	<b>SANDY SILT TILL:</b> some clay, frequent seams of wet sand, trace gravel, occasional cobble/boulders, grey, moist, very dense		8	SS	54										
7.8															
8.0															
8.2															
8.4															
8.6															
8.8															
9.0															
9.2															
9.4															
9.6															
9.8															
10.0															

W. L. 76.5 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES +3, ×3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-25-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 11

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)							
72	SANDY SILT TILL: some clay, frequent seams of wet sand, trace gravel, occasional cobbe/boulders, grey, moist, very dense(Continued)		10	SS	50										
71															
70.1															
12.2	SILTY CLAY: trace sand, grey, moist, very stiff		11	SS	27										
69															
68															
67															
66															
64.0	SAND AND GRAVEL: trace silt, grey, saturated, very dense		13	SS	30										
64															
63															
62.3			15	SS	76										
			16	SS	50/										

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	DRILLING DATA
CLIENT: Lakeview Community Partners Ltd.	Method: Solid Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 150 mm
DATUM: Geodetic	Date: Jul-25-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 11

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)				
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80	100				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	WATER CONTENT (%)
20.0	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 5.8 mbgl during drilling			50mp														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** +<sup>3</sup>, ×<sup>3</sup>: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-20-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 12

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)				
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>
85.1																		
84.9	<b>TOPSOIL:</b> 250 mm																	
0.2	<b>FILL:</b> clayey silt, mixed with topsoil, trace gravel, grey, moist, compact		1	SS	18							○						
84.3																		
0.8	<b>FILL:</b> silty clay, trace to some organics, trace gravel, grey, moist, loose to compact		2	SS	20							○						
			3	SS	9							○						
			4	SS	7							○						
82.0																		
3.1	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, greyish brown, moist, very stiff to hard		5	SS	22							○						>225
			6	SS	58							○						>225
			7	SS	34							○						>225
			8	SS	35							○						>225
			9	SS	39							○						

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity

○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-20-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 12

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL			
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60	80	100
75	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, greyish brown, moist, very stiff to hard(Continued)  wet sand seams below 10.7 m		10	SS	50													
74																		
73																		
72					11	SS	41											
71.4																		
13.7	<b>SILT CLAY:</b> trace sand/silt seams, grey, moist, stiff to very stiff		12	SS	14													
71																		
70																		
69					13	SS	21											
68					14	SS	19											
67																		
66			15	SS	23													

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-20-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 12

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)					
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)							WATER CONTENT (%)	GR SA SI CL			
64.7	<b>SILT CLAY:</b> trace sand/silt seams, grey, moist, stiff to very stiff (Continued)		16	SS	16		65						150						
20.4	<b>END OF BOREHOLE</b> Notes: 1 ) Borehole dry upon completion																		

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-24-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 13

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
83.2														
83.0	<b>TOPSOIL:</b> 150 mm													
82.8	<b>FILL:</b> silty clay, mixed with topsoil/organics, trace gravel, brown to grey, moist, loose to compact	1	SS	23										
82.6		2	SS	28										
82.4		3	SS	6										
82.2														
82.0														
81.8														
81.6														
81.4														
81.2														
81.0														
80.8														
80.6														
80.5	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, occasional cobble/boulders, brown, moist, very stiff to hard	4	SS	7										
80.3														
80.1														
79.9														
79.7														
79.5														
79.3														
79.1														
78.9														
78.7														
78.5														
78.3														
78.1														
77.9														
77.7														
77.5														
77.3														
77.1														
76.9														
76.7														
76.5														
76.3														
76.1														
75.9														
75.7														
75.5														
75.3														
75.1														
74.9														
74.7														
74.5														
74.3														
74.1	<b>CLAYEY SILT:</b> trace seams/partings of silt, grey, moist, very stiff	9	SS	23										

Bentonite  
 W. L. 75.2 m  
 Sep 26, 2018

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** +3, x3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-24-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 13

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)				
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>
73	<b>CLAYEY SILT:</b> trace seams/partings of silt, grey, moist, very stiff(Continued)		10	SS	26													
72																		
71.0	<b>SILT :</b> trace to some clay, trace sand, grey, very moist to wet, compact to dense		11	SS	18									175				
71																		
70																		
69			12	SS	30													
68.0	<b>CLAYEY SILT TO SILTY CLAY</b> :trace sand, grey, moist, very stiff to hard		13	SS	21									>225				
68																		
67																		
66			14	SS	42									>225				
65	<b>SILT TO CLAYEY SILT:</b> some clay, grey, moist, compact to dense		15	SS	29													
64																		

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure



<p>PROJECT: Preliminary Geotechnical Investigation- Proposed Development          CLIENT: Lakeview Community Partners Ltd.          PROJECT LOCATION: 800 Hydro Road, Mississauga, ON          DATUM: Geodetic          BOREHOLE LOCATION: See Drawing 1</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150 mm          Date: Jul-24-2018</p> <p style="text-align: right;">REF. NO.: 18-519-10          ENCL NO.: 13</p>
--	--

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC NATURAL LIQUID LIMIT MOISTURE CONTENT			POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)			
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80	100	W <sub>p</sub>	w			W <sub>L</sub>	GR	SA	SI
62.8	<b>SILT TO CLAYEY SILT:</b> some clay, grey, moist, compact to dense(Continued)		16	SS	34							o								
20.4	<b>END OF BOREHOLE:</b> Notes: 1) 50 mm dia monitoring well installed upon completion. 2) Water level in monitoring well at 8m on Sept. 26, 2018.																			

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Jul-16-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 14

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20 40 60 80 100	20 40 60 80 100						
80.2															
0.0	FILL: sand & gravel, trace silt, grey, moist		1	AS			80								
79.4															
0.8	FILL: silty clay, trace gravel, grey, moist, stiff		2	SS	8		79								
78.7															
1.5	CLAYEY SILT TILL: sandy, trace gravel, brown, moist, very stiff		3	SS	21		78								
77.9															
2.3	CLAYEY SILT TO SILT: trace sand, grey, moist, very stiff		4	SS	18		78						200		
77.9															
5	SANDY SILT TO SILTY SAND TILL: trace clay, trace gravel, grey, wet, very dense		6	SS	64		75						200		
75.6															
4.6															
74.1	CLAYEY SILT TILL: sandy, frequent sand seams, trace gravel, grey, moist, hard		7	SS	38		74						>225		
74.1															
72.6	SANDY SILT: trace to some clay, brownish grey, wet, dense		8	SS	49		72								
72.6															
9.1	SILTY CLAY: frequent seams of silt, grey, moist, hard		9	SS	37		71						>225		
71.1															

W. L. 75.6 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES





+3, ×3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Jul-16-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 14

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)					
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)							W <sub>p</sub>	W	W <sub>L</sub>	GR SA SI CL	
69.5	<b>SILTY CLAY:</b> frequent seams of silt, grey, moist, hard(Continued)																		
10.7	<b>SILT TO CLAYEY SILT:</b> seams of sand, trace gravel, grey, moist, very dense		10	SS	70/279mm														
69.1	<b>END OF BOREHOLE:</b> Notes: 1) Borehole terminated due to eruption of gas with mud and water from hole. 2) Water level at 4.6 mbgl during drilling																		
11.1																			

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement    

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
DATUM: Geodetic	Date: Jul-11-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 15

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80			
80.4														
0.0	<b>FILL:</b> sand and gravel, trace rootlets, grey, moist		1	AS										
79.6														
0.8	<b>FILL:</b> silty clay, trace gravel, pieces of wood, grey, moist, loose		2	SS	8									
78.9														
1.5	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, brown, moist, very stiff		3	SS	29								>225	
78.1														
2.3	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		4	SS	50/50 mm									
77.2														
3.2	<b>END OF BOREHOLE:</b> Notes: 1) Borehole dry and open upon completion.		5	SS	50/50 mm									

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, x 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

<b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development <b>CLIENT:</b> Lakeview Community Partners Ltd. <b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON <b>DATUM:</b> Geodetic <b>BOREHOLE LOCATION:</b> See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 200 mm Date: Jul-11-2018 REF. NO.: 18-519-10 ENCL NO.: 16
--	---

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (C <sub>u</sub> ) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)								
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60	80	100	20	40	60	80	100
80.4	FILL: sand and gravel, trace rootlets, grey, moist		1	AS																			
79.6																							
78.9	FILL: clayey silt, trace organics, grey, moist, compact		2	SS	18																		
78.1	CLAYEY SILT TILL: sandy, trace gravel, grey, moist, stiff		3	SS	9																		
77.3																							
76.6	SILT: trace to some clay, trace sand, brown, moist, compact		4	SS	22																		
74.3	SILTY SAND: some gravel, brown, moist, very dense		5	SS	50/ 100 mm																		
73.6																							
71.3	SILTY CLAY: trace sand, grey, moist, hard to very stiff		6	SS	33																		
70.6																							
70.0	SILT TO CLAYEY SILT: trace sand, grey, moist, compact to very dense		7	SS	21																		
69.3																							
68.6	SILT TO CLAYEY SILT: trace sand, grey, moist, compact to very dense		8	SS	22																		
67.9																							
67.2	SILT TO CLAYEY SILT: trace sand, grey, moist, compact to very dense		9	SS	50/ 50 mm																		
66.5																							
65.8	SILT TO CLAYEY SILT: trace sand, grey, moist, compact to very dense		10	SS	50/ 50 mm																		
65.1																							
64.4	SHALE: Georgian Bay Formation, weathered, grey																						
63.7	END OF BOREHOLE																						

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ● = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-23-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 17

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
82.9	<b>TOPSOIL:</b> 100 mm														
82.9 0.1	<b>FILL:</b> clayey silt, mixed with topsoil, brown, moist, compact		1	SS	19										
82			2	SS	10										
81			3	SS	15										
80.6	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, brown, moist, very stiff to hard		4	SS	21										
79.4	frequent wet sand seams		5	SS	28										
78.3	<b>SAND:</b> trace silt, brown, wet, compact														
78.3 4.6	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, grey, moist, hard		6	SS	30										
77			7	SS	36										
75.3	<b>SANDY SILT TILL:</b> some clay, trace gravel, sand seams, grey, very moist to wet, dense		8	SS	38										
73.8	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, grey, moist, very stiff to hard		9	SS	30										

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-23-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 17

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)				
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>
70.7	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, grey, moist, very stiff to hard(Continued)		10	SS	33													
12.2	<b>CLAYEY SILT:</b> trace sand, occasional seams of silt, grey, moist, very stiff to hard		11	SS	21													
			12	SS	29													
			13	SS	30													
			14	SS	28													
			15	SS	24													
	frequent seams of silt below 16.8 m																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
DATUM: Geodetic	Date: Jul-23-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 17

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80							100
62.5		16	16	SS	25													
20.4	<b>END OF BOREHOLE:</b> Notes: 1) Monitoring well was installed beside BH18-16. 2) Water level in the monitoring well at 2.7m on Sept. 26, 2018.																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-16-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 18

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
80.3	<b>ASPHALT:</b> 100 mm														
80.0	<b>GRANULAR BASE:</b> 250 mm														
0.3	<b>FILL:</b> sandy silt, trace topsoil/organics, greyish brown, moist		1	AS											
79.5	<b>FILL:</b> silty clay, trace organics, trace gravel, grey, moist, loose		2	SS	7										
78.8	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, brown, moist, very stiff to hard		3	SS	18										
1.5			4	SS	50/ 25mm								>225		
			5	SS	82/ 280mm										
			6	SS	26										
74.2	<b>CLAYEY SILT:</b> sandy, grey, moist, hard		7	SS	34										
6.1			8	SS	36										
9.1	<b>SILT:</b> some clay, trace sand, grey, moist to wet, compact		9	SS	26										

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+3, ×3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-16-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 18

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
70	<b>SILT:</b> some clay, trace sand, grey, moist to wet, compact(Continued)		10	SS	27										
68.1	<b>SILTY CLAY &amp; SILT:</b> interbedded, trace sand, grey, moist, hard		11	SS	37										
65.1	<b>SILT TO SANDY SILT:</b> trace clay, grey, wet, very dense		13	SS	53										
63.5	<b>SILTY CLAY:</b> trace sand, grey, moist, hard		14	SS	73										
62.0	<b>SILT:</b> trace to some clay, grey, wet, very dense		15	SS	70/ 280mm										
60.8	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, grey, moist, hard														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-16-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 18

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80						
59.9	CLAYEY SILT TILL:sandy, trace gravel, grey,moist, hard(Continued)		16	SS	50/50mm												
20.4	<b>END OF BOREHOLE</b> Notes: 1) Water level at 9.1m during drilling.																

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



**PROJECT:** Preliminary Geotechnical Investigation- Proposed Development  
**CLIENT:** Lakeview Community Partners Ltd.  
**PROJECT LOCATION:** 800 Hydro Road, Mississauga, ON  
**DATUM:** Geodetic  
**BOREHOLE LOCATION:** See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-11-2018

**REF. NO.:** 18-519-10  
**ENCL NO.:** 19

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (C <sub>u</sub> ) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20 40 60 80 100	20 40 60 80 100						
81.1															
0.0	FILL: sand and gravel, moist		1	AS			81								
80.3															
0.8	FILL: clayey silt, trace to some organics, greyish brown, moist, loose		2	SS	9		80								
79.4															
1.7	CLAYEY SILT TILL: sandy, trace gravel, grey, moist, stiff to hard		3	SS	11		79					125			
			4	SS	29		78					>225			
			5	SS	33		77					>225			
76.5															
4.6	SILTY CLAY: seams of silt, trace sand, grey, moist, very stiff		6	SS	15		76					175			
75.0															
6.1	SILT: trace to some clay, grey, wet, compact		7	SS	19		75								
			8	SS	25		74								
72.0															
9.1	SAND AND GRAVEL: some silt, grey, wet, very dense		9	SS	86		72								

W. L. 75.0 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity

○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
DATUM: Geodetic	Date: Jul-11-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 19

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80			
71	<b>SAND AND GRAVEL:</b> some silt, grey, wet, very dense(Continued)													
70.4														
10.7	<b>SILT:</b> trace to some clay, trace sand, grey, wet, very dense		10	SS	76									
68.9														
12.2	<b>SILTY CLAY:</b> trace sand, grey, moist, hard		11	SS	51									
67.4														
13.7	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		12	SS	50/50									
67.1														
14.0	<b>END OF BOREHOLE:</b> Notes: 1) Water level at 6.1m during drilling.													

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement

**GRAPH NOTES** +<sup>3</sup>, ×<sup>3</sup>: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-11-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 20

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
80.7															
0.0	<b>FILL:</b> sand and gravel, grey, moist	[Cross-hatch pattern]	1	AS											
79.9															
0.8	<b>FILL:</b> silty clay, trace organics, trace gravel, greyish brown, moist, firm	[Diagonal lines]	2	SS	8										
79.0															
1.7	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, brown, moist, stiff to hard	[Dotted pattern]	3	SS	10								125		
79.0															
			4	SS	26								>225		
			5	SS	32								>225		
76.2															
74.5	<b>GEORGIAN BAY FORMATION:</b> shale interbedded with limestone/siltstone layers, grey	[Horizontal lines]	6	SS	50/100mm										
4.6	Total Core Recovery = 83% Solid Core Recovery = 29%		1	RC											
75.5	RQD = 17% Hard Layer (Limestone/Siltstone) = less than 10% Maximum Thickness of Hard Layer = 50mm														
5.2	Total Core Recovery = 85% Solid Core Recovery = 23% RQD = 18% Hard Layer (Limestone/Siltstone) = less than 10% Maximum Thickness of Hard Layer = 50mm		2	RC											
74.0	Total Core Recovery = 100% Solid Core Recovery = 28% RQD = 19% Hard Layer (Limestone/Siltstone) = less than 10% Maximum Thickness of Hard Layer = 50mm														
6.7			3	RC											
72.5															
8.2	Total Core Recovery = 100% Solid Core Recovery = 28% RQD = 28% Hard Layer (Limestone/Siltstone) = 32% Maximum Thickness of Hard Layer = 380mm														
71.0			4	RC											
9.7															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD GP J DS.GDT - 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development CLIENT: Lakeview Community Partners Ltd. PROJECT LOCATION: 800 Hydro Road, Mississauga, ON DATUM: Geodetic BOREHOLE LOCATION: See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 200 mm Date: Jul-11-2018 REF. NO.: 18-519-10 ENCL NO.: 20
---	---

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)							WATER CONTENT (%)	
						20 40 60 80 100 ○ UNCONFINED + FIELD VANE & Sensitivity ● QUICK TRIAXIAL × LAB VANE	W <sub>p</sub> W      W <sub>L</sub> PLASTIC LIMIT      NATURAL MOISTURE CONTENT      LIQUID LIMIT								GR SA SI CL	
69.5	Total Core Recovery = 100% Solid Core Recovery = 40% RQD = 30% Hard Layer (Limestone/Siltstone)= 15% Maximum Thickness of Hard Layer = 125mm(Continued)		5	RC												
11.2	<b>END OF BOREHOLE:</b> Notes: 1) Monitoring well was installed in the borehole upon completion. 2) Water level in the monitoring well at 4.7m on Sept. 26, 2018.															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jun-26-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 21

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
80.3	ASPHALT: 70mm GRANULAR BASE: 300mm	[Hatched]	1	AS											
79.9	FILL: clayey silt, some sand, trace gravel, greyish brown, moist	[Dotted]													
79.5	CLAYEY SILT TILL: sandy, trace gravel, grey, moist, hard	[Diagonal Lines]	2	SS	33										
79.1			3	SS	45										
78.7			4	SS	83									>225	
77.2	SAND: trace silt, grey, wet, compact	[Dotted]													
76.9	SILTY CLAY : trace sand, grey, moist, very stiff	[Diagonal Lines]	5	SS	28										
76.5															
75.7	SILT TO CLAYEY SILT: trace sand, occasional wet sand seams, grey, moist, hard	[Diagonal Lines]	6	SS	52									>225	Wet Spoon
75.3															
74.2	SILT: trace to some clay, some sand, grey, wet, dense to very dense	[Diagonal Lines]	7	SS	57										
73.8															
73.4			8	SS	48										
71.2	SILT TO CLAYEY SILT: trace sand, grey, moist to very moist, hard	[Diagonal Lines]	9	SS	39									>225	
70.8															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES +3, ×3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



<p>PROJECT: Preliminary Geotechnical Investigation- Proposed Development          CLIENT: Lakeview Community Partners Ltd.          PROJECT LOCATION: 800 Hydro Road, Mississauga, ON          DATUM: Geodetic          BOREHOLE LOCATION: See Drawing 1</p>	<p><b>DRILLING DATA</b>          Method: Hollow Stem Auger          Diameter: 200 mm          Date: Jun-26-2018</p> <p style="text-align: right;">REF. NO.: 18-519-10          ENCL NO.: 21</p>
--	---

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80				100
69.6	<b>SILT TO CLAYEY SILT:</b> trace sand, grey, moist to very moist, hard(Continued)														
69.4	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		10	SS	50/60							o			
10.9	<b>END OF BOREHOLE</b> Notes: 1) Water level at 3.1m during drilling.														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, x 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

<b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
<b>CLIENT:</b> Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
<b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
<b>DATUM:</b> Geodetic	Date: Jun-26-2018
<b>BOREHOLE LOCATION:</b> See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 22

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
79.7							20 40 60 80 100							
0.0	<b>TOPSOIL:</b> 350mm													
79.4			1	SS	8									
0.3	<b>FILL:</b> silty clay mixed with topsoil, trace gravel, brown, moist, loose													
79.0														
0.7	<b>FILL:</b> sand and gravel mixed with weathered shale, brown, moist, compact		2	SS	23									
78.2														
1.5	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		3	SS	50/ 100mm									
77.3														
2.4	<b>END OF BOREHOLE</b> Notes: 1) Borehole dry and open upon completion.		4	SS	50/ 100mm									

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

<b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development <b>CLIENT:</b> Lakeview Community Partners Ltd. <b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON <b>DATUM:</b> Geodetic <b>BOREHOLE LOCATION:</b> See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 200 mm Date: Jul-10-2018 REF. NO.: 18-519-10 ENCL NO.: 23
--	---

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)								
77.5																
0.0	<b>FILL:</b> sand and gravel, cobbles		1	AS												
76.7																
0.8	<b>FILL:</b> 19mm crusher run limestone, grey, wet, loose to compact		2	SS	6											
75.2																
2.3	<b>SAND AND GRAVEL:</b> trace silt, grey, wet, very dense		4	SS	50/ 100mm											
73.7																
3.8	<b>SILTY CLAY :</b> trace to some sand, grey, moist, hard		6	SS	39											
73.3																
4.2	<b>SHALE:</b> Georgian Bay Formation, weathered, grey															
4.4	<b>END OF BOREHOLE:</b> Notes: 1) Water level at 0.8m during drilling.															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jul-10-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 27

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
77.3							20 40 60 80 100							
0.0	<b>FILL:</b> sand and gravel, grey, moist, loose		1	AS										
1			2	SS	7									
75.8														
1.5	<b>FILL:</b> silty sand, trace gravel, brown, moist, compact		3	SS	11									
2														
75.0														
2.3	<b>SAND:</b> trace silt, brown, wet, very loose		4	SS	WH									
3														
74.2														
3.1	<b>SILTY CLAY:</b> trace sand, grey, moist, firm		5	SS	6									
4														
73.5														
3.8														
73.3	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		6	SS	50/100mm									
4.0	<b>END OF BOREHOLE:</b> Note: 1 ) Water level at 2.3 m during drilling													

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

<b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
<b>CLIENT:</b> Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
<b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
<b>DATUM:</b> Geodetic	Date: Jun-26-2018
<b>BOREHOLE LOCATION:</b> See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 25

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (C <sub>u</sub> ) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20							40	60
82.8 0.1	<b>ASPHALTIC CONCRETE:</b> 70mm <b>GRANULAR BASE:</b> 600mm		1	AS												
82.1 0.7	<b>FILL:</b> clayey silt mixed with sand and gravel, brown, moist, very stiff to firm		2	SS	17											
	grey and wet below 1.5 m		3	SS	15											
	fragments of Concrete		4	SS	6											
79.7 3.3	<b>SAND AND GRAVEL:</b> cobbles, brown, wet, very dense <b>END OF BOREHOLE</b> Notes: 1) Auger refusal at 3.3m on possible shale bedrock.		5	SS	57											

W. L. 81.3 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger/Rock Coring  
 Diameter: 200 mm  
 Date: Jul-09-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 24

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
								SHEAR STRENGTH (kPa)							
77.5 0.0	FILL: sand and gravel, brown, moist		1	AS											
76.8 0.7	FILL: clayey silt, some sand and gravel, greyish brown, moist, compact		2	SS	17										
76.0 1.5	CLAYEY SILT TILL: sandy, trace gravel, greyish brown to grey, moist, stiff to very stiff		3	SS	12										
	grey below 2.3 m		4	SS	8										
			5	SS	8										
			6	AS											
			7	SS	21										
71.2 6.3	<b>GEORGIAN BAY FORMATION:</b> shale interbedded with limestone/siltstone layers, grey		8	SS	69										
71.0 6.5	<b>SHALE BEDROCK:</b> Total Core Recovery = 96% Solid Core Recovery = 70% RQD = 37% Hard Layer (Limestone/Siltstone) = 27% Maximum Thickness of Hard Layer = 270mm			RC											
69.5 8.0	<b>SHALE BEDROCK:</b> Total Core Recovery = 100% Solid Core Recovery = 77% RQD = 77% Hard Layer (Limestone/Siltstone) = 27% Maximum Thickness of Hard Layer = 230mm			RC											
68.0 9.5															

Bentonite

July 09, 2018

July 10, 2018

DS SOIL LOG - 18-519-10 800 HYDRO ROAD GP J DS.GDT - 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+3, x3: Numbers refer to Sensitivity  
 ○ s=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger/Rock Coring  
 Diameter: 200 mm  
 Date: Jul-09-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 24

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)			
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT
						20	40	60	80	100	W <sub>p</sub>	w	W <sub>L</sub>	GR SA SI CL		
66.6	<b>SHALE BEDROCK:</b> Total Core Recovery = 100% Solid Core Recovery = 93% RQD = 93% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 50mm(Continued) <b>SHALE BEDROCK:</b> Total Core Recovery = 100% Solid Core Recovery = 98% RQD = 98% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 100mm <b>SHALE BEDROCK:</b> Total Core Recovery = 100% Solid Core Recovery = 97% RQD = 97% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 100mm		RUN 3	RC												
10.9																
65.2					RUN 4	RC										
12.3																
63.6			RUN 5	RC												
13.9	<b>END OF BOREHOLE</b> Notes: 1) Monitoring well was installed in the borehole upon completion. 2) Monitoring well was not accessible on Sept. 26, 2018. Area is covered with a stock-pile.															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 200 mm  
 Date: Jun-26-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 26

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)									
77.2																	
76.9	<b>ASPHALTIC CONCRETE: 70mm</b>		1	AS													
76.8	<b>GRANULAR BASE: 300mm</b>																
76.8	<b>SILTY CLAY: trace sand, shale fragments, grey, moist, hard</b>		2	SS	21												
75.7	<b>SHALE: Georgian Bay Formation, weathered, grey</b>		3	SS	50/												
75.5	<b>END OF BOREHOLE</b>																
1.7	Notes: 1) Borehole dry and open upon completion.																

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

<p>PROJECT: Preliminary Geotechnical Investigation- Proposed Development          CLIENT: Lakeview Community Partners Ltd.          PROJECT LOCATION: 800 Hydro Road, Mississauga, ON          DATUM: Geodetic          BOREHOLE LOCATION: See Drawing 1</p>	<p><b>DRILLING DATA</b>          Method: Hollow Stem Auger          Diameter: 200 mm          Date: Jul-17-2018</p> <p style="text-align: right;">REF. NO.: 18-519-10          ENCL NO.: 28</p>
--	---

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)						
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	GR	SA
77.3	<b>FILL:</b> silty sand and gravel, grey, moist		1	AS																
76.5																				
0.8	<b>FILL:</b> silty clay, trace gravel, trace organics, grey, moist to wet, stiff to firm		2	SS	15															
					3	SS	7													
					4	SS	5													
73.5	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		5	SS	5															
3.8																				
73.2	<b>END OF BOREHOLE:</b> Notes: 1) Water level at 2.3 m during drilling		6	SS	50/125mm															
4.1																				

W. L. 75.0 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement  1st  2nd  3rd  4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger/Rock Coring  
 Diameter: 200 mm  
 Date: Jul-06-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 29

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)								
77.2							20	40	60	80	100					
0.0	<b>FILL:</b> sand and gravel, brown		1	AS												
76.4																
0.8	<b>FILL:</b> 19mm crusher run limestone, brick/concrete fragments, grey, wet, compact		2	SS	22											
75.7																
1.5	<b>FILL:</b> sandy silt mixed with gravel, trace clay, grey, wet, very dense		3	AS	50/ 25mm											
74.9																
2.3	<b>SAND AND GRAVEL:</b> grey, wet, very loose		4	SS	2											
74.9																
3																
5																
72.9																
4.3	<b>GEORGIAN BAY FORMATION:</b> shale interbedded with limestone/siltstone layers, grey		RUN 1	RC												
72.2	Total Core Recovery = 67% Solid Core Recovery = 33% RQD = 33% Hard Layer (Limestone/Siltstone)=15% Maximum Thickness of Hard Layer = 140mm															
5.0																
6																
70.8																
6.4	Total Core Recovery = 100% Solid Core Recovery = 84% RQD = 73% Hard Layer (Limestone/Siltstone)= 15% Maximum Thickness of Hard Layer = 140mm		RUN 2	RC												
70.8																
7																
69.2																
8.0	Total Core Recovery = 100% Solid Core Recovery = 94% RQD = 94% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 50mm		RUN 3	RC												
69.2																
8																
67.8																
9.4	Total Core Recovery = 100% Solid Core Recovery = 93% RQD = 93% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 50mm		RUN 4	RC												
67.8																
9																
10																

W. L. 74.9 m  
Sep 26, 2018

Bentonite

Filter Pack

Slotted Pipe

July 06, 2018

July 09, 2018

DS SOIL LOG - 18-519-10 800 HYDRO ROAD GP J DS.GDT - 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger/Rock Coring
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 200 mm
DATUM: Geodetic	Date: Jul-06-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 29

SOIL PROFILE		SAMPLES				GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)								
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60	80	100	20	40	60	80	100
66.3	Total Core Recovery = 100% Solid Core Recovery = 93% RQD = 93% Hard Layer (Limestone/Siltstone)= 15% Maximum Thickness of Hard Layer = 100mm (Continued)		RUN 5	RC			67																
10.9	<b>END OF BOREHOLE:</b> Notes: 1) Monitoring well was installed in the borehole upon completion. 2) Water level in the monitoring well at 2.3m on Sept. 26, 2018.																						

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jul-04-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 30

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)			
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80						100	20	40	60
79.5																				
0.0	<b>TOPSOIL:</b> 300mm																			
79.2			1	SS	52															
0.3	<b>FILL:</b> silty clay, trace sand, grey, moist, compact																			
78.4			2	SS	14															
1.1	<b>SILTY CLAY TILL:</b> sandy, trace gravel, occasional cobble/boulder, brown, moist, stiff to hard																			
78.4			3	SS	33															
77.7			4	SS	55															
76.6			5	SS	62															
75.7			6	SS	50/100mm															
75.8	<b>SHALE:</b> Georgian Bay Formation, weathered, grey																			
4.0	<b>END OF BOREHOLE</b> Notes: 1) Borehole dry and open upon completion.																			

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, x 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jul-04-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 31

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100
80.1	<b>TOPSOIL:</b> 200mm														
79.9	<b>FILL:</b> silty clay, trace gravel, dark grey, moist, loose		1	SS	8										
79.3	<b>CLAYEY SILT TILL:</b> trace gravel, brown, moist, very stiff to hard		2	SS	27										
0.8			3	SS	31										
				4	SS	72									
				5	SS	50/									
77.0	<b>SHALE:</b> Georgian Bay Formation, weathered, grey														
76.3	<b>END OF BOREHOLE</b> Notes: 1) Borehole dry and open upon completion.														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-27-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 32

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC NATURAL LIQUID LIMIT MOISTURE CONTENT			POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80	100	W <sub>p</sub>	w				W <sub>L</sub>
77.9	<b>TOPSOIL</b> :125 mm																	
70.9 0.1	<b>FILL</b> : clayey silt, trace gravel, trace cobbles, brown to grey, moist, loose to compact		1	SS	11							○						
			2	SS	20							○						
			3	SS	13							○						
			4	SS	10							○						
			5	SS	5							○						
73.7 73.6	<b>SHALE</b> : Georgian Bay Formation, weathered, grey																	
4.3	<b>END OF BOREHOLE:</b> Notes: 1) Water level at 4.1 m upon completion of borehole.																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-27-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 33

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
80.3	<b>TOPSOIL</b> :150 mm														
80.2	<b>FILL</b> : clayey silt, trace asphalt/concrete fragments, trace organics, grey to dark grey, moist, compact		1	SS	18										
78.8	<b>CLAYEY SILT TILL</b> : sandy, trace gravel, brown, moist, very stiff		2	SS	12										
78.0	<b>SILTY CLAY</b> :some sand, brown, moist, hard		3	SS	25										
75.7	<b>SHALE</b> : Georgian Bay Formation, weathered, grey		4	SS	44										
74.6	<b>SHALE</b> : Georgian Bay Formation, weathered, grey		5	SS	50/ 100mm										
74.6	<b>SHALE</b> : Georgian Bay Formation, weathered, grey		6	SS	50/ 75mm										
4.8	<b>END OF BOREHOLE:</b> Notes: 1) Borehole dry and open upon completion.														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger/Rock Coring  
 Diameter: 150mm  
 Date: Jun-27-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 34

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20						
81.3														
81.0	<b>TOPSOIL:</b> 230mm													
80.9														
0.2	<b>FILL:</b> clayey silt, trace gravel, trace organics, brown, very moist, compact		1	SS	15									
80.6														
0.7	<b>FILL:</b> sandy gravel/cobbles, grey, moist, compact		2	SS	19									
79.8														
1.5	<b>CLAYEY SILT:</b> trace sand, trace gravel, brown, moist, hard		3	SS	44									
78.2														
3.1	<b>CLAYEY SILT:</b> trace sand, trace gravel, brown, moist, hard		4	SS	50/ 125mm									
78.2														
3.1	<b>GEORGIAN BAY FORMATION:</b> shale interbedded with limestone/siltstone layers, grey Bedrock coring started at 3.8 m		5	SS	50/ 75mm									
77.5														
3.8	Total Core Recovery = 62% Solid Core Recovery = 0% RQD = 0% Hard Layer (Limestone/Siltstone)= less than 5% Maximum Thickness of Hard Layer = 50mm		RUN 1	RC										
76.4														
4.9	Total Core Recovery = 90% Solid Core Recovery = 68% RQD = 68% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 50mm		RUN 2	RC										
74.9														
6.4	Total Core Recovery = 100% Solid Core Recovery = 61% RQD = 56% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 50mm		RUN 3	RC										
73.3														
8.0	Total Core Recovery = 100% Solid Core Recovery = 94% RQD = 94% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 100mm		RUN 4	RC										
71.7														
9.6														

W. L. 79.3 m  
Sep 26, 2018

Bentonite

Filter Pack

Slotted Pipe

June 27, 2018

July 30, 2018

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** +3, x3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development CLIENT: Lakeview Community Partners Ltd. PROJECT LOCATION: 800 Hydro Road, Mississauga, ON DATUM: Geodetic BOREHOLE LOCATION: See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger/Rock Coring Diameter: 150mm Date: Jun-27-2018 REF. NO.: 18-519-10 ENCL NO.: 34
---	--

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
						20 40 60 80 100 ○ UNCONFINED + FIELD VANE & Sensitivity ● QUICK TRIAXIAL × LAB VANE	W <sub>p</sub> W      W <sub>L</sub> ———— ————— WATER CONTENT (%)							GR SA SI CL
70.4	Total Core Recovery = 100% Solid Core Recovery = 88% RQD = 88% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 100mm (Continued)		5	RC		71								
10.9	<b>END OF BOREHOLE</b> Notes: 1) Monitoring well was installed in the borehole upon completion. 2) Water level in the monitoring well at 2.0m on Sept. 26, 2018.													

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement    1st    2nd    3rd    4th

**GRAPH NOTES**    + 3 , × 3 : Numbers refer to Sensitivity    ○ ● = 3% Strain at Failure

<b>PROJECT:</b> Preliminary Geotechnical Investigation- Proposed Development <b>CLIENT:</b> Lakeview Community Partners Ltd. <b>PROJECT LOCATION:</b> 800 Hydro Road, Mississauga, ON <b>DATUM:</b> Geodetic <b>BOREHOLE LOCATION:</b> See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 150mm Date: Jun-27-2018 REF. NO.: 18-519-10 ENCL NO.: 35
--	--

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
80.3														
80.0	<b>TOPSOIL:</b> 230mm													
0.2	<b>FILL:</b> clayey silt, trace gravel, trace cobbles, asphalt fragments, dark brown to dark grey, very moist, compact	1	1	SS	11									
		2	2	SS	16									
		3	3	SS	14									
78.5	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, occasional cobble/boulder, brown, moist, stiff to hard	4	4	SS	58									
1.8		5	5	SS	50/ 100mm									
		6	6	SS	50/ 50mm									
75.7	<b>SHALE:</b> Georgian Bay Formation, weathered, grey													
4.8	<b>END OF BOREHOLE</b> Notes: 1) Borehole dry and open upon completion.													

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-21-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 36

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100
81.8	<b>TOPSOIL:</b> 250mm														
0.0 81.6	<b>FILL:</b> sandy silt mixed with topsoil, brown, moist, compact		1	SS	14										
0.3															
81.0	<b>FILL:</b> silt to clayey silt, trace gravel, trace topsoil/organics, grey, moist, compact		2	SS	12										
0.8															
1															
2															
3															
78.7	<b>SANDY SILT TILL :</b> trace to some clay, trace gravel, grey, moist, very dense		5	SS	50/ 125mm										
3.1															
4															
77.2	<b>SILTY CLAY TILL:</b> sandy, trace gravel, grey, moist, hard		6	SS	65										
4.6															
5															
6															
7															
75															
74															
73															
72.7	<b>SILT :</b> some clay, trace gravel, grey, wet, dense		9	SS	36										
9.1															
10															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ.DS.GDT. 18-10-12

Mud Rotary Drilling

Continued Next Page  
 GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3 , × 3 : Numbers refer to Sensitivity ○ ● = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-21-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 36

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
71.1	<b>SILT</b> : some clay, trace gravel, grey, wet, dense(Continued)														
10.7	<b>SILTY SAND TILL</b> : trace clay, trace gravel, grey, wet, very dense		10	SS	75										
69.6	<b>SILTY CLAY TILL</b> : sandy, trace gravel, grey, moist, hard		11	SS	40										
12.2	seams of sand at 13.7 m														
12.2			12	SS	50/ 150mm										
66.6	<b>SILT</b> :trace clay, trace sand, grey, wet, dense		13	SS	44										
15.2															
65.0	<b>SILTY CLAY TILL</b> : sandy, seams of sand, trace gravel, grey, moist, hard		14	SS	84										
16.8															
63.5	<b>SILTY CLAY</b> :trace sand, grey, moist, hard		15	SS	64										
18.3															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development CLIENT: Lakeview Community Partners Ltd. PROJECT LOCATION: 800 Hydro Road, Mississauga, ON DATUM: Geodetic BOREHOLE LOCATION: See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 150mm Date: Jun-21-2018 REF. NO.: 18-519-10 ENCL NO.: 36
---	--

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC NATURAL LIQUID LIMIT MOISTURE CONTENT LIMIT			POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)					W <sub>p</sub>	w				W <sub>L</sub>
61.4	<b>SILTY CLAY:</b> trace sand, grey, moist, hard (Continued)	[Hatched Box]	16	SS	52								o		>225			
20.4	<b>END OF BOREHOLE:</b> Notes: 1 ) Water level at 9 mbgl during drilling																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-25-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 37

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60
81.8	<b>TOPSOIL:</b> 200mm															
81.8	<b>FILL:</b> clayey silt, trace topsoil/organics, shale fragments, dark brown, moist, compact		1	SS	16											
80.3	<b>CLAYEY SILT TILL :</b> sandy, trace gravel, brown, moist, stiff		2	SS	12											
79.5	<b>SANDY SILT TO SILTY SAND:</b> trace clay, brown, wet, very dense		3	SS	10											
78.7	<b>SAND AND GRAVEL:</b> trace silt, grey, wet, very dense		4	SS	50/ 100mm											
77.2	<b>SILTY CLAY TILL :</b> sandy, trace gravel, grey, moist, hard		5	SS	52											
75.7	<b>SANDY SILT :</b> trace clay, grey, wet, very dense		6	SS	34											
74.2	<b>SILTY CLAY TILL :</b> sandy, trace gravel, grey, moist, hard		7	SS	58											
74.2	<b>SILTY CLAY TILL :</b> sandy, trace gravel, grey, moist, hard		8	SS	44											
72	interbed of sand at 9.1 m		9	SS	66											

W. L. 79.5 m during drilling

Wet Spoon

0 23 70 7

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES +3, x3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-25-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 37

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)										
62.0	SILTY CLAY TILL : sandy, trace gravel, grey, moist, hard(Continued)																	
11			10	SS	90													
12																		
13			11	SS	73													
14																		
15			12	SS	23													
16																		
17			13	SS	31													
18																		
19			14	SS	30													
20																		
19.8	15	SS	30															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th


GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity  
 ○ ● = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development CLIENT: Lakeview Community Partners Ltd. PROJECT LOCATION: 800 Hydro Road, Mississauga, ON DATUM: Geodetic BOREHOLE LOCATION: See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 150mm Date: Jun-25-2018 REF. NO.: 18-519-10 ENCL NO.: 37
---	--

SOIL PROFILE		SAMPLES				GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)										
								20 40 60 80 100 ○ UNCONFINED    + FIELD VANE & Sensitivity ● QUICK TRIAXIAL    × LAB VANE					W <sub>p</sub>	W	W <sub>L</sub>			
61.4	<b>SILTY CLAY:</b> trace sand, grey, moist, very stiff(Continued)	▨	16	SS	26									○	200			
20.4	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 2.3 mbgl during drilling																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12



**GRAPH NOTES**    + 3, × 3: Numbers refer to Sensitivity    ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150 mm  
 Date: Jul-26-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 38

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
83.3															
83.0	<b>TOPSOIL:</b> 152mm														
83.0	<b>FILL:</b> clayey silt, trace rootlet, trace asphalt, brown, moist, stiff		1	SS	12										
0.2			2	SS	12										
81.8	<b>SILT :</b> some sand, trace clay, brown, wet, loose		3	SS	5										
1.5			4	SS	18										
81.0	<b>CLAYEY SILT TILL :</b> some sand, trace gravel, trace cobble, brown to grey, moist, very stiff to hard		5	SS	50/ 127mm										
2.3			6	SS	32										
4.6	<b>SILT :</b> some sand, trace clay, grey, very moist to wet, dense		7	SS	50/ 127mm										
78.7			8	SS	50/ 100mm										
4.6	<b>SHALE:</b> Georgian Bay Formation, weathered, grey														
77.2	<b>CLAYEY SILT TILL :</b> some sand, trace gravel, trace cobble, grey, moist, hard														
6.1															
75.7															
75.6															
75.3															
7.8	<b>END OF BOREHOLE</b> Notes: 1) Borehole open and dry upon completion														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD GP J D.S.GDT. 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-29-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 39

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)								
85.7																
0.0	<b>TOPSOIL:</b> 350 mm															
85.4			1	SS	10											
0.3	<b>FILL:</b> silty sand, trace topsoil/rootlets, some gravel, brown, moist, compact															
84.9			2	SS	4											
0.8	<b>FILL:</b> sandy silt, trace clay, brown, wet, loose															
84.2			3	SS	9											
1.5	<b>FILL:</b> clayey silt, trace organics, grey, moist, stiff															
82.3			4	SS	11											
3.4	<b>SANDY SILT:</b> trace clay, brown, moist, compact															
82.3			5	SS	10											
3.4																
81.1			6	SS	50/ 150mm											
4.6	<b>CLAYEY SILT TILL:</b> trace gravel, brown, moist, hard															
81.1																
79.6																
79.6																
79.4																
6.3	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		7	SS	50/ 60mm											
6.3	<b>END OF BOREHOLE</b> Notes: 1) Borehole dry and open upon completion.															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-29-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 40

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)									
83.5	TOPSOIL: 350mm																
0.0 83.2	FILL: clayey silt, brown, moist, stiff		1	SS	10												
0.3	CLAYEY SILT TILL: sandy, trace gravel, brown, moist, very stiff to hard  grey below 2.3 m		2	SS	24												
82.7			3	SS	28												
0.8			4	SS	33												
1			5	SS	50/ 125mm												
80.4	SHALE: Georgian Bay Formation, weathered, grey																
3.1 80.1	END OF BOREHOLE Notes: 1 ) Borehole open and dry upon completion																

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** +<sup>3</sup>, ×<sup>3</sup>: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



PROJECT: Preliminary Geotechnical Investigation- Proposed Development CLIENT: Lakeview Community Partners Ltd. PROJECT LOCATION: 800 Hydro Road, Mississauga, ON DATUM: Geodetic BOREHOLE LOCATION: See Drawing 1	<b>DRILLING DATA</b> Method: Hollow Stem Auger Diameter: 150mm Date: Jun-29-2018 REF. NO.: 18-519-10 ENCL NO.: 41
---	--

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)						
83.9	TOPSOIL: 350mm													
0.0														
83.6	FILL: clayey silt, trace organics, brown, moist, firm		1	SS	7									
0.3														
83.1	CLAYEY SILT TILL: sandy, trace gravel, brown, moist, stiff to hard  trace shale fragments below 2.6 m		2	SS	14									
0.8														
1				3	SS	23								
2				4	SS	35								
3				5	SS	43								
80.1														
3.8	SHALE: Georgian Bay Formation, weathered, grey		6	SS	50/100mm									
79.9														
4.0	END OF BOREHOLE Notes: 1 ) Borehole open and dry upon completion													

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3 , × 3 : Numbers refer to Sensitivity      ○ ●=3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Hollow Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jun-29-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 42

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)				
(m) ELEV DEPTH	DESCRIPTION	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>
83.0																	
0.0	<b>TOPSOIL:</b> 400mm																
82.6	<b>FILL:</b> sand and gravel, trace concrete/ brick pieces, brown, moist, compact	1	SS	14													
0.4		2	SS	17													
81.5	<b>SILT TO CLAYEY SILT:</b> brown, moist, stiff	3	SS	13													
1.5		4	SS	25													
80.7	<b>SILTY CLAY TILL:</b> trace gravel, grey, moist, very stiff to hard	5	SS	50/ 100mm													
2.3		6	SS	50/ 50mm													
79.2	<b>GEORGIAN BAY FORMATION:</b> shale interbedded with limestone/siltstone layers, grey Bedrock Coring started at 4.3 m																
3.8																	
78.7																	
4.3	<b>SHALE BEDROCK:</b> Total Core Recovery = 83% Solid Core Recovery = 75% RQD = 50% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 50mm	RUN 1	RC														
78.1																	
4.9	Total Core Recovery = 100% Solid Core Recovery = 93% RQD = 65% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 75mm	RUN 2	RC														
76.6																	
6.4	<b>SHALE BEDROCK:</b> Total Core Recovery = 100% Solid Core Recovery = 57% RQD = 72% Hard Layer (Limestone/Siltstone)= less than 10% Maximum Thickness of Hard Layer = 75mm	RUN 3	RC														
75.1																	
75.1	<b>END OF BOREHOLE</b>																
7.9																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD GP J DS.GDT - 18-10-12

June 29, 2018  
-----  
July 27, 2018

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, x 3: Numbers refer to Sensitivity      ○ ● = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development CLIENT: Lakeview Community Partners Ltd. PROJECT LOCATION: 800 Hydro Road, Mississauga, ON DATUM: Geodetic BOREHOLE LOCATION: See Drawing 1	<b>DRILLING DATA</b> Method: Solid Stem Auger Diameter: 150mm Date: Jul-17-2018 REF. NO.: 18-519-10 ENCL NO.: 43
---	---

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kNm <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20 40 60 80 100	20 40 60 80 100							W <sub>p</sub>
81.4	FILL: sand and gravel, grey, moist	[Cross-hatched pattern]	1	AS												
80.6																
0.8	SILTY CLAY TILL : sandy, trace gravel, brown, moist, hard to very stiff  grey below 2.3 m	[Diagonal lines pattern]	2	SS	16											
1			3	SS	48									>225		
2			4	SS	33										>225	
3			5	SS	36										>225	
4			6	SS	24										200	
5			7	SS	22										200	
6																
73.8	SANDY SILT : trace to some clay, grey, wet, compact to very dense	[Horizontal lines pattern]	8	SS	24											
7.6																
			9	SS	94											

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

W. L. 73.8 m during drilling

Continued Next Page  
 GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3 , x 3 : Numbers refer to Sensitivity ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Solid Stem Auger  
 Diameter: 150mm  
 Date: Jul-17-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 43

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
70.7	<b>SANDY SILT</b> : trace to some clay, grey, wet, compact to very dense(Continued)														
10.7	<b>SILT TO SANDY SILT</b> : trace to some clay, grey, moist to very moist, very dense		10	SS	50										
			11	SS	50/ 27mm										
67.7	<b>CLAYEY SILT</b> : trace sand, grey, moist, hard		12	SS	77								>225		
13.7															
			13	SS	36										
			14	SS	31								>225		
			15	SS	51										
61.6															
19.8															

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES**

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development	<b>DRILLING DATA</b>
CLIENT: Lakeview Community Partners Ltd.	Method: Solid Stem Auger
PROJECT LOCATION: 800 Hydro Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-17-2018
BOREHOLE LOCATION: See Drawing 1	REF. NO.: 18-519-10
	ENCL NO.: 43

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT	NATURAL MOISTURE CONTENT	LIQUID LIMIT	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80							100
61.0	<b>SILT</b> : some clay, grey, wet, very dense(Continued)		16	SS	62													
20.4	<b>END OF BOREHOLE:</b> Notes: 1 ) Water level at 7.6 mbgl during drilling																	

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
Measurement

**GRAPH NOTES** + 3 , × 3 : Numbers refer to Sensitivity      ○ ● =3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jun-28-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 44

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40						
82.4															
82.0	<b>TOPSOIL:</b> 200mm														
81.6	<b>FILL:</b> silty clay, trace gravel, brown, moist, loose		1	SS	5										
81.6	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, brown, moist, very stiff to stiff  grey below 2.3 m		2	SS	18										
81.2			3	SS	22										
80.8			4	SS	13										
79.3			5	SS	21										
77.8	<b>SILT:</b> some clay, trace sand, grey, moist, compact														
77.8	<b>SILTY SAND TO SANDY SILT:</b> trace clay, trace gravel, grey, wet, dense		6	SS	32										
76.3															
76.1	<b>SHALE:</b> Georgian Bay Formation		7	SS	50/ 60mm										
6.3	<b>END OF BOREHOLE</b> Notes: 1 ) Water level at 4.6 mbgl during drilling														

W. L. 77.8 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, x 3: Numbers refer to Sensitivity      ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jul-05-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 45

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
81.1	<b>TOPSOIL:</b> 200mm													
80.9	<b>FILL :</b> clayey silt mixed with asphalt, trace organics, some sand, dark grey, moist, compact	[Cross-hatched pattern]	1	SS	17									
80.2			2	SS	11									
79.6	<b>CLAYEY SILT TILL :</b> sandy, trace gravel, greyish brown, moist, very stiff	[Diagonal lines pattern]	3	SS	17									
78.8			4	SS	34									
78.0	<b>SANDY SILT TILL :</b> trace to some clay, trace gravel, brown, moist, dense	[Diagonal lines pattern]	5	SS	50/ 150mm									
77.0			6	SS	66									
76.5	<b>SAND :</b> trace silt, trace gravel, grey, wet, very dense	[Dotted pattern]	7	SS	87									
75.0			8	SS	50/ 50mm									
72.0	<b>SAND AND GRAVEL :</b> trace silt, grey, wet, very dense	[Dotted pattern]	9	SS	50/ 150mm									
9.1														

W. L. 78.0 m during drilling

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, × 3: Numbers refer to Sensitivity  
 ○ = 3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jul-05-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 45

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60
71	<b>SAND AND GRAVEL:</b> trace silt, grey, wet, very dense(Continued)		10	SS	50/100mm											
70																
68.9 12.2	<b>SILTY SAND:</b> trace clay, grey, wet, very dense		11	SS	57											
69																
67.4 13.7	<b>SILT :</b> trace clay, grey, wet, very dense		12	SS	50/150mm											
68																
65.8 15.3	<b>SILTY CLAY TILL :</b> some sand to sandy, trace gravel, grey, moist hard		13	SS	79											>225
66																
64.3 16.8	<b>SILTY CLAY:</b> trace sand, grey, moist, hard		14	SS	47											>225
65																
62.8 18.3	<b>SILT TO CLAYEY SILT:</b> trace sand, grey, very moist, very dense		15	SS	50											>225
63																
62																

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ D.S.GDT. 18-10-12

Continued Next Page

GROUNDWATER ELEVATIONS  
 Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3, x 3: Numbers refer to Sensitivity ○ = 3% Strain at Failure





<p>PROJECT: Preliminary Geotechnical Investigation- Proposed Development          CLIENT: Lakeview Community Partners Ltd.          PROJECT LOCATION: 800 Hydro Road, Mississauga, ON          DATUM: Geodetic          BOREHOLE LOCATION: See Drawing 1</p>	<p><b>DRILLING DATA</b>          Method: Hollow Stem Auger          Diameter: 150mm          Date: Jul-05-2018</p> <p style="text-align: right;">REF. NO.: 18-519-10          ENCL NO.: 45</p>
--	--

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT					POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20	40	60	80				100
60.7	<b>SILT TO CLAYEY SILT:</b> trace sand, grey, very moist, very dense(Continued)		16	SS	64							○		>225	
20.4	<b>END OF BOREHOLE:</b> Notes: 1 ) Water level at 3.1 mbgl during drilling														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3 , × 3 : Numbers refer to Sensitivity      ○ ● =3% Strain at Failure

PROJECT: Preliminary Geotechnical Investigation- Proposed Development  
 CLIENT: Lakeview Community Partners Ltd.  
 PROJECT LOCATION: 800 Hydro Road, Mississauga, ON  
 DATUM: Geodetic  
 BOREHOLE LOCATION: See Drawing 1

**DRILLING DATA**  
 Method: Hollow Stem Auger  
 Diameter: 150mm  
 Date: Jul-04-2018  
 REF. NO.: 18-519-10  
 ENCL NO.: 46

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	METHANE AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40	60	80				100
80.8	<b>TOPSOIL:</b> 200 mm														
80.8	<b>FILL:</b> silty clay, trace asphalt, some gravel, dark grey, moist, firm		1	SS	5										
80.0	<b>FILL :</b> sandy silt, dark grey, moist, very dense		2	SS	50/50mm										
80.8			3	SS	50/75mm										
78.5	<b>SANDY SILT TILL :</b> some clay, trace gravel, grey, moist, compact to dense		4	SS	29										
78.5			5	SS	31										
76.3	<b>SHALE:</b> Georgian Bay Formation, weathered, grey		6	SS	50/25mm										
76.3	<b>END OF BOREHOLE:</b> Notes: 1) Borehole dry and open upon completion.														

DS SOIL LOG - 18-519-10 800 HYDRO ROAD.GPJ DS.GDT 18-10-12

**GROUNDWATER ELEVATIONS**  
 Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



<p>PROJECT: Geotechnical Investigation          CLIENT: Rangeview Estate Precinct Development          PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON          DATUM: Geodetic          BH LOCATION: See Drawing 1</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150mm          Date: Jul-19-2022</p> <p style="text-align: right;">REF. NO.: 22-200-100          ENCL NO.:</p>
---	---

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60
0.0	ASPHALT: 180mm															
0.2	GRANULAR BASE: sand and gravel, 380mm		1	SS	23											
0.6	FILL: crusher run limestone, brown, wet, compact															
0.8	FILL: silty clay, some organics, some sand, trace gravel, grey, moist, stiff to very stiff		2	SS	10											
			3	SS	22											
2.3	SILTY CLAY TILL: some sand, some gravel, brown, moist, hard		4	SS	50											
	trace shale fragments below 3.0m		5	SS	75											13 18 47 22
3.7	<b>END OF BOREHOLE:</b> Notes: 1) Auger refusal @3.7m due to possible shale bedrock. 2) 50mm dia. monitoring well installed upon completion. 3) Water Level Readings:  Date: Water Level(mbg):															

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12



PROJECT: Geotechnical Investigation	<b>DRILLING DATA</b>
CLIENT: Rangeview Estate Precinct Development	Method: Solid Stem Auger
PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-15-2022
BH LOCATION: See Drawing 1	REF. NO.: 22-200-100
	ENCL NO.:

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)								
0.0	<b>GRANULAR FILL:</b> sand and gravel, 280mm		1	SS	21											
0.3	<b>FILL:</b> sand & gravel, trace brick pieces, grey, moist, compact															
0.8	<b>FILL:</b> silty clay, trace organics, grey, moist, firm			2	SS	5										
1.5	<b>CLAYEY SILT:</b> trace sand, trace gravel, brown, moist, stiff			3	SS	11										
2.3	<b>CLAYEY SILT TILL:</b> sandy, trace gravel, occasional cobble, brown, moist, hard			4	SS	44										
				5	SS	86										
				6	SS	47										
				7	SS	50										
	grey below 6.1m		8	SS	46											
8.2	<b>END OF BOREHOLE:</b>															

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12

**GROUNDWATER ELEVATIONS**  
Measurement 1st 2nd 3rd 4th

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity    ○ ●=3% Strain at Failure



PROJECT: Geotechnical Investigation	<b>DRILLING DATA</b>
CLIENT: Rangeview Estate Precinct Development	Method: Solid Stem Auger
PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-18-2022
BH LOCATION: See Drawing 1	REF. NO.: 22-200-100
	ENCL NO.:

SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT w	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60
0.0	ASPHALT: 150mm															
0.2	GRANULAR BASE: sand and gravel, 250mm		1	SS	9											
0.4	FILL: silty clay, some organics, some sand, trace gravel, grey, moist, stiff															
1.2	SILT TO CLAYEY SILT: trace sand, brown, moist, stiff to hard		2	SS	11											
			3	SS	30										0	7 76 17
2.3	CLAYEY SILT: trace sand, trace gravel, brown, moist, hard		4	SS	77											
3.1	SHALE BEDROCK: grey, weathered		5	SS	50/30mm											
3.2	Weathered END OF BOREHOLE:															

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12



<b>PROJECT:</b> Geotechnical Investigation	<b>DRILLING DATA</b>
<b>CLIENT:</b> Rangeview Estate Precinct Development	Method: Solid Stem Auger
<b>PROJECT LOCATION:</b> 855 Rangeview Road, Mississauga, ON	Diameter: 150mm
<b>DATUM:</b> Geodetic	Date: Jul-18-2022
<b>BH LOCATION:</b> See Drawing 1	REF. NO.: 22-200-100
	ENCL NO.:

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (C <sub>u</sub> ) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)		
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	20							40	60
0.0	ASPHALT: 150mm															
0.2	GRANULAR BASE: sand and gravel, 380mm		1	SS	12											
0.5	FILL: crusher run limestone															
0.8	FILL: clayey silt, trace organics, grey, moist, firm to very stiff		2	SS	7											
1.7	SILTY CLAY TILL: some sand, trace to some gravel, trace shale fragments, brown, moist, very stiff to hard		3	SS	29											
			4	SS	54											10 10 56 24
3.1	auger refusal at 3.1m on possible shale bedrock <b>END OF BOREHOLE:</b> Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water Level(mbgl):															

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12

**GROUNDWATER ELEVATIONS**  
Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ● = 3% Strain at Failure



PROJECT: Geotechnical Investigation	<b>DRILLING DATA</b>
CLIENT: Rangeview Estate Precinct Development	Method: Solid Stem Auger
PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-18-2022
BH LOCATION: See Drawing 1	REF. NO.: 22-200-100
	ENCL NO.:

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
0.0	ASPHALT: 130mm													
0.1	GRANULAR BASE: sand and gravel, 380mm		1	SS	16									
0.5	FILL: silty clay, some organics, trace asphalt, grey, moist, firm to very stiff		2	SS	6									
1.5	SILT TO CLAYEY SILT: trace sand, trace gravel, brown to grey, moist, very stiff to hard		3	SS	15									
			4	SS	31									
			5	SS	29									
4.4	no recovery @ 4.3m auger refusal on possible shale bedrock <b>END OF BOREHOLE:</b>		6	SS	50/ 25mm									

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12

GROUNDWATER ELEVATIONS  
Measurement

GRAPH NOTES + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



PROJECT: Geotechnical Investigation	<b>DRILLING DATA</b>
CLIENT: Rangeview Estate Precinct Development	Method: Solid Stem Auger
PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-19-2022
BH LOCATION: See Drawing 1	REF. NO.: 22-200-100
	ENCL NO.:

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (C <sub>u</sub> ) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)										
(m) ELEV DEPTH	DESCRIPTION	NUMBER	TYPE	"N" BLOWS 0.3 m			20	40							60	80	100	20	40	60	80	100	10	20
0.0	ASPHALT: 150mm																							
0.2	GRANULAR BASE: sand and gravel, 380mm	1	SS	13																				
0.5	FILL: sand, some asphalt pieces, trace gravel, dark brown, moist, loose to compact																							
1.0	SILTY CLAY: trace sand, trace gravel, brown, moist, stiff to very stiff	2	SS	8																				
		3	SS	20																				
		4	SS	25																				
3.1	CLAYEY SILT TILL/SHALE COMPLEX: trace sand, trace gravel, grey, moist, hard	5	SS	69																				
4.5	SHALE BEDROCK: grey, weathered	6	SS	50/																				
4.7	END OF BOREHOLE:			50mm																				

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12

GROUNDWATER ELEVATIONS  
Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure





PROJECT: Geotechnical Investigation	<b>DRILLING DATA</b>
CLIENT: Rangeview Estate Precinct Development	Method: Solid Stem Auger
PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-15-2022
BH LOCATION: See Drawing 1	REF. NO.: 22-200-100
	ENCL NO.:

(m) ELEV DEPTH	SOIL PROFILE DESCRIPTION	STRATA PLOT	SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
			NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)									
0.0	ASPHALT: 180mm																GR SA SI CL
0.2	GRANULAR BASE: sand and gravel, 460mm		1	SS	4												
0.6	FILL: crusher run limestone																
0.8	SILT TO CLAYEY SILT: trace sand, trace gravel, brown, moist, very stiff to hard		2	SS	17												2 8 62 28
			3	SS	30												
2.3	CLAYEY SILT TILL: sandy, trace gravel, brown, moist, hard SHALE BEDROCK: Georgian Bay Formation, grey, weathered TCR=75%, SCR=14%, RQD=0		4	SS	50/ 25mm												
2.4			R1	RC	50/ 75mm												
3.4	TCR=96%, SCR=98%, RQD=28% Hard layer=18%, Maximum hard layer thickness=50mm		R2	RC													
4.9	TCR=93%, SCR=90%, RQD=63% Hard layer=1%, Maximum hard layer thickness=25mm		R3	RC													
6.4	TCR=100%, SCR=98%, RQD=70% Hard layer=9%, Maximum hard layer thickness=25mm		R4	RC													
7.8	END OF BOREHOLE:																

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12

GROUNDWATER ELEVATIONS  
Measurement 1st 2nd 3rd 4th

GRAPH NOTES + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure



<p>PROJECT: Geotechnical Investigation          CLIENT: Rangeview Estate Precinct Development          PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON          DATUM: Geodetic          BH LOCATION: See Drawing 1</p>	<p><b>DRILLING DATA</b>          Method: Solid Stem Auger          Diameter: 150mm          Date: Jul-15-2022</p> <p style="text-align: right;">REF. NO.: 22-200-100          ENCL NO.:</p>
---	---

(m) ELEV DEPTH	SOIL PROFILE DESCRIPTION	STRATA PLOT	SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT				POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%)			
			NUMBER	TYPE	"N" BLOWS 0.3 m			SHEAR STRENGTH (kPa)	PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>				WATER CONTENT (%)	GR	SA
0.0	ASPHALT: 200mm																
0.2	GRANULAR BASE: sand and gravel, 380mm		1	SS	8												
0.6	FILL: silty clay, some organics, brown, moist, stiff																
0.8	CLAYEY SILT TILL: some sand, trace gravel, brown, moist, stiff to hard		2	SS	11												
	trace shale fragments below 1.5m																
			3	SS	50												
2.3	SHALE BEDROCK: grey, weathered		4	SS	50/ 50mm												
3.1	END OF BOREHOLE: Notes: 1) 50mm dia. monitoring well installed upon completion. 2) Water Level Readings:  Date: Water Level(mbg):																

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12

**GROUNDWATER ELEVATIONS**  
 Measurement

**GRAPH NOTES** + 3, × 3: Numbers refer to Sensitivity      ○ ●=3% Strain at Failure



PROJECT: Geotechnical Investigation	<b>DRILLING DATA</b>
CLIENT: Rangeview Estate Precinct Development	Method: Solid Stem Auger
PROJECT LOCATION: 855 Rangeview Road, Mississauga, ON	Diameter: 150mm
DATUM: Geodetic	Date: Jul-15-2022
BH LOCATION: See Drawing 1	REF. NO.: 22-200-100
	ENCL NO.:

SOIL PROFILE		SAMPLES			GROUND WATER CONDITIONS	ELEVATION	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT W <sub>p</sub>	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W <sub>L</sub>	POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m <sup>3</sup> )	REMARKS AND GRAIN SIZE DISTRIBUTION (%) GR SA SI CL
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE			"N" BLOWS 0.3 m	SHEAR STRENGTH (kPa)						
0.0	ASPHALT: 130mm													
0.1	GRANULAR FILL: sand and gravel, 330mm		1	SS	12									
0.5	FILL: clayey silt, trace organics, trace gravel, brown, moist, stiff													
0.8	CLAYEY SILT TILL/SHALE COMPLEX: trace sand, trace gravel, brown to grey, moist, stiff to hard		2	SS	14									no recovery
			3	SS	53									
2.3	SHALE BEDROCK: weathered, grey		4	SS	50/ 150mm									
2.6	END OF BOREHOLE:													

DRAFT

DS SOIL LOG-2021-DRAFT 22-200-100 GEO COPY.GPJ DS.GDT 22-8-12

GROUNDWATER ELEVATIONS  
Measurement

GRAPH NOTES + 3, × 3: Numbers refer to Sensitivity ○ ●=3% Strain at Failure

---

---

Appendix B  
Water Supply Support Information

---

---

## **Appendix B-1**

Lakeview Community – Water Modelling Methodology and Analysis

(TMIG, 2021)

---

## MEMORANDUM

---

DATE	May 6, 2021
TO	<b>Jeff Ormonde (Urbantech)</b>
CC	
SUBJECT	Lakeview Community Water Modelling Methodology and Analysis – 8050 Units
FROM	Cassandra Leal, P.Eng
PROJECT NUMBER	17201

---

### 1 Introduction

The Municipal Infrastructure Group Ltd. (TMIG) has been retained to conduct an analysis to review the water servicing capacity of the proposed watermain network (Urbantech, January 2020) relative to the contemplated development densities.

This memorandum will outline the modelling methodology adopted for the Lakeview Community. The water model was used to confirm that the proposed pipe network can supply the design water demands at appropriate pressures expected under various scenarios.

This memorandum has been updated with the updated population, provided from Urbantech May 2021. The watermain network is assumed to be unchanged.

### 2 Design Criteria

The Region of Peel produced the Inspiration Lakeview Water and Wastewater Servicing Analysis (May 2018). Within this document, the Region outlined the design criteria that apply to the proposed development:

- 265 Lpcd for average day water consumption
- A maximum day peaking factor of 1.8 for residential and 1.4 for employment growth
- A peak hour factor of 3.0

Also, there are limits to the velocity and pressures:

- Under Maximum Day demand, pipe velocity should remain below 1.5 m/s
- Under Maximum Day demand, pressure in the system should not drop below 280 kPa (40 psi)
- Pressure in the system should not drop below 140 kPa (20 psi) under a maximum day plus fire condition

Standards outlined in the Region's [Inspiration Lakeview Water and Wastewater Servicing Analysis \(May 2018\)](#) report and Inspiration Lakeview Conceptual Municipal Servicing Strategy (TMIG, July 2014) were used in substitution.

### 3 Population Breakdown

Using the information provided by Urbantech (May 2021), the populations in the water model were modified to match the populations used in the sanitary sewer design sheet and drainage map (dated August 2020). The information provided by Urbantech does not include the External Lands between the subject lands and Lakeshore Road. The sanitary drainage map used to obtain the population is found in **Appendix A**.

Detailed population and demand calculations can be found in **Appendix B**. The future demands for the external lands between Lakeshore Road and the Lakeview Community Lands (called "External") were calculated using the population

breakdown from the Inspiration Lakeview Village Masterplan Concept. This information is also included in **Appendix B** and is unchanged from previous submissions.

A summary of the water demands is provided in **Table 1**:

**TABLE 1 WATER DEMANDS – SUMMARY**

	Lakeview Community	External
<b>Total Residential Population</b>	22,042	10,048
<b>Residential Avg Day Demand</b>	67.6 L/s	30.8 L/s
<b>Employment Avg Day Demand</b>	24.7 L/s	0 L/s
<b>Residential Max Day Demand</b>	121.7 L/s	55.47 L/s
<b>Employment Max Day Demand</b>	34.5 L/s	0 L/s
<b>Residential Peak Hour Demand</b>	202.8 L/s	92.46 L/s
<b>Employment Peak Hour Demand</b>	74.0 L/s	0 L/s

## 4 Water Model Development

InfoWater has been selected for modelling the water distribution system for the study area. The key input factors for the model are described below:

### 4.1 Pipe Network

The preliminary watermain layout was provided by Urbantech and is included in **Appendix C**.

### 4.2 Water Demands

The average daily demands were calculated for each development block (internal), as shown in **Appendix B**. These demands were assigned to nodes adjacent to the respective parcels. The average day demand set is populated with the residential demands assigned to Demand 1 and employment demands assigned to Demand 2.

Based on the standards outlined in Inspiration Lakeview Water and Wastewater Servicing Analysis (May 2018) the peaking factor for the Maximum day is 1.8 for residential and 1.4 for employment. The peaking factor for Peak hour is 3 for both residential and employment.

The average day demand set was multiplied with the respective peaking factors to create separate maximum day and Peak hour demand sets.

Design fire demands have been proposed to be minimum of 300 L/s. This is common for commercial properties, and high-rise residential development.

Using the Inspiration Lakeview Master Plan population breakdown, the external lands were included in the model. For simplicity, the external demands were added as two demands in the model, an east and a west demand (Junction J-34 and J-198, respectively). The population breakdown included residential and employment. For this review, the appropriate rates and factors were used.

A table listing the nodes at which the development blocks were allocated is provided in **Appendix B**.

### 4.3 Boundary Conditions

The proposed development is located within Peel Region pressure zone PZ1. Since we are modelling a local area from within a larger distribution network, suitable boundary conditions were established at the study area limits (where the proposed internal network will connect to existing sub-transmission mains). The proposed connection locations are:

- To the 600 mm watermain along Lakeshore Road East, at Lakefront Promenade;
- To the 600 mm watermain along Lakeshore Road East, at Hydro Road;

Fixed head reservoirs were established at these two locations. The HGL elevations at these reservoirs were established through pressure logging data provided by Region of Peel. The details of the boundary conditions are in **Table 2**.

**TABLE 2 HGL ELEVATIONS AT BOUNDARY CONDITIONS**

Boundary Location	HGL Elevation	Source
Lakeshore Road East, at Lakefront Promenade	142 m	Region of Peel email dated September 11 <sup>th</sup>
Lakeshore Road East, at Hydro Road	142 m	Region of Peel email dated September 11 <sup>th</sup>

## 5 Modelling Results

The proposed watermain network and demands were simulated to determine the resulting pressures under various demand conditions. We also considered a condition where the Lakeshore Road watermain is unavailable and the lands area serviced only through the feed from the plant.

Pressure maps indicating modelled pressure at every node for the Scenarios are provided in Figure 1 through Figure 4. The InfoWater Junction output for all scenarios and Pipe output for Maximum day scenario is provided in **Appendix D**.

### 5.1 Normal Conditions Scenarios

Average day demand, maximum day demand, maximum day demand plus fire flow and peak hour demand scenarios were run with the two proposed connections to the existing 600mm Lakeshore Road watermain, at Lakefront Promenade and Hydro Road. These scenarios did not consider a feed from the west at Lakefront Promenade and Rangeview Road.

The summary of modelling results is provided in **Table 3**.

**TABLE 3 MODELLING RESULTS SUMMARY**

Water Demand Modeling Scenario	Minimum Water System Requirements	Modeling Results
Average Day Demand	Recommended Normal Pressures within System 275 kPa to 690 kPa (40 psi to 100 psi)	System Pressure = 510 kPa to 647 kPa (74 psi to 93 psi)
Maximum Day Demand	Recommended Normal Pressures within System 275 kPa to 690 kPa (40 psi to 100 psi)	System Pressure = 507 kPa to 643 kPa (74 psi to 93 psi)
	Flow velocity remains below 1.5 m/s within the distribution network	Flow velocity within the distribution network is between 0.01 m/s to 0.89 m/s.
Peak Hour Demand	Recommended Normal Pressures within System 275 kPa to 690 kPa (40 psi to 100 psi)	System Pressure = 498 kPa to 637 kPa (72 psi to 92 psi)
Maximum Day Demand plus Fire Flow	Required Fire Flow to be provided at a residual pressure of no less than 140 kPa	
	Fire flow requirements for the proposed development $Q_r > 300$ L/s	Available Fire Flow = 532 L/s to 2,710 L/s



## 5.2 Emergency Conditions Scenario

To simulate an emergency or maintenance condition where one or both water supply points to Lakeshore Road are not available, the two boundary conditions and watermain along Lakeshore Road East were turned off and the boundary condition to the west (supply from Lakefront Promenade and south of Rangeview Road) was turned on.

The HGL at this boundary condition was established through pressure logging data provided by the Region of Peel. The details of the boundary condition are in **Table 4**.

**TABLE 4 HGL ELEVATION AT WEST BOUNDARY CONDITION**

Boundary Location	HGL Elevation	Source
Water Treatment Plant, south of Rangeview Road	148 m	Region of Peel email dated September 11 <sup>th</sup>

Under this condition, the pressures were between 488 – 643 kPa (71 to 93 psi). This is still within the acceptable pressure range. Figure 5 is the pressure map for this scenario. This scenario illustrates that the watermain network and sizing is acceptable for the population and demands for Lakeview Community. Under normal conditions, all three of these supply points would be available.

## 6 Conclusions and Recommendations

The modelled results all lie within acceptable range, but the pressures could exceed 600 kPa (90 psi) along Street A. The available fire flows at the nodes within the Study Area will be between 532 L/s and 2,710 L/s. The actual block-by-block fire flow requirements should be verified relative to these values.

The watermain network and sizing appears to be adequate for the population and demands used in this model.

**FIGURE 1 AVERAGE DAY DEMAND SCENARIO PRESSURE**




<b>Legend</b>		<b>Junction</b>		<p>Average Day Demand Scenario</p> <p><b>Inspiration Lakeview</b></p> <p><b>Water System Modelling</b></p>
<b>Pipe</b>	<b>RUN_DIAM</b>	<b>RUN_ELEV</b>		
<span style="color: red;">—</span>	200	<span style="color: red;">●</span>	less than 40 psi	
<span style="color: green;">—</span>	300	<span style="color: orange;">●</span>	40-50 psi	
<span style="color: blue;">—</span>	400	<span style="color: yellow;">●</span>	50-90 psi	
<span style="color: teal;">—</span>	600	<span style="color: blue;">●</span>	90-100 psi	
		<span style="color: black;">●</span>	greater than 100 psi	

**FIGURE 2 MAXIMUM DAY DEMAND SCENARIO PRESSURE**



<b>Legend</b>		<b>Junction</b>		<p>Maximum Day Demand Scenario</p> <p><b>Inspiration Lakeview</b></p> <p><b>Water System Modelling</b></p>
<b>Pipe</b>	<b>RUN_DIAM</b>	<b>RUN_ELEV</b>		
<span style="color: red;">—</span>	200	<span style="color: red;">●</span>	less than 40 psi	
<span style="color: green;">—</span>	300	<span style="color: orange;">●</span>	40-50 psi	
<span style="color: blue;">—</span>	400	<span style="color: green;">●</span>	50-90 psi	
<span style="color: teal;">—</span>	600	<span style="color: blue;">●</span>	90-100 psi	
		<span style="color: black;">●</span>	greater than 100 psi	

**FIGURE 3 PEAK HOUR DEMAND SCENARIO PRESSURE**

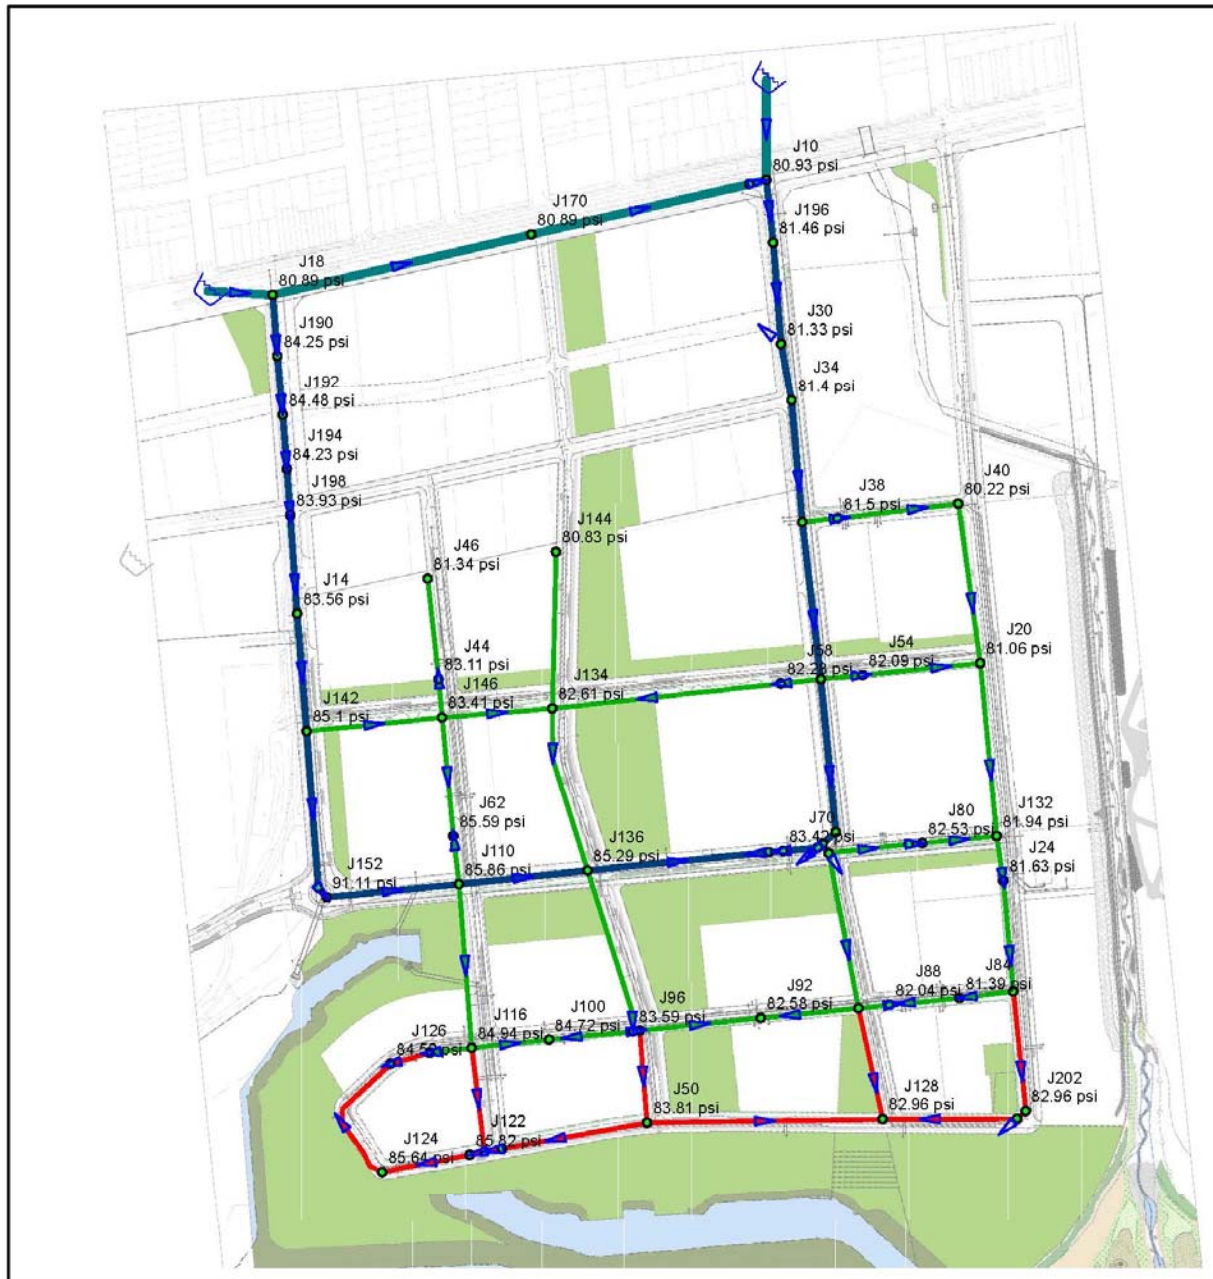


<b>Legend</b>		<b>Junction</b>		<p>Peak Hour Demand Scenario</p> <p><b>Inspiration Lakeview</b></p> <p><b>Water System Modelling</b></p>
<b>Pipe</b>	<b>RUN_DIAM</b>	<b>RUN_ELEV</b>		
<span style="color: red;">—</span>	200	<span style="color: red;">●</span>	less than 40 psi	
<span style="color: green;">—</span>	300	<span style="color: orange;">●</span>	40-50 psi	
<span style="color: blue;">—</span>	400	<span style="color: green;">●</span>	50-90 psi	
<span style="color: teal;">—</span>	600	<span style="color: blue;">●</span>	90-100 psi	
		<span style="color: black;">●</span>	greater than 100 psi	

**FIGURE 4      MAXIMUM DAY PLUS FIRE FLOW SCENARIO AVAILABLE FIREFLOW**



<b>Legend</b>		<p>Maximum Day Demand Scenario Plus Fire Flow</p> <p><b>Inspiration Lakeview Water System Modelling</b></p>
<b>Pipe</b>	<b>Junction</b>	
<b>RUN_DIAM</b>	<b>AVAIL_FLOW</b>	
<span style="color: red;">—</span> 200	<span style="color: red;">●</span> less than 300 L/s	
<span style="color: green;">—</span> 300	<span style="color: green;">●</span> greater than 300 L/s	
<span style="color: blue;">—</span> 400		
<span style="color: teal;">—</span> 600		

**FIGURE 5 PEAK HOUR DEMAND UNDER EMERGENCY CONDITIONS**

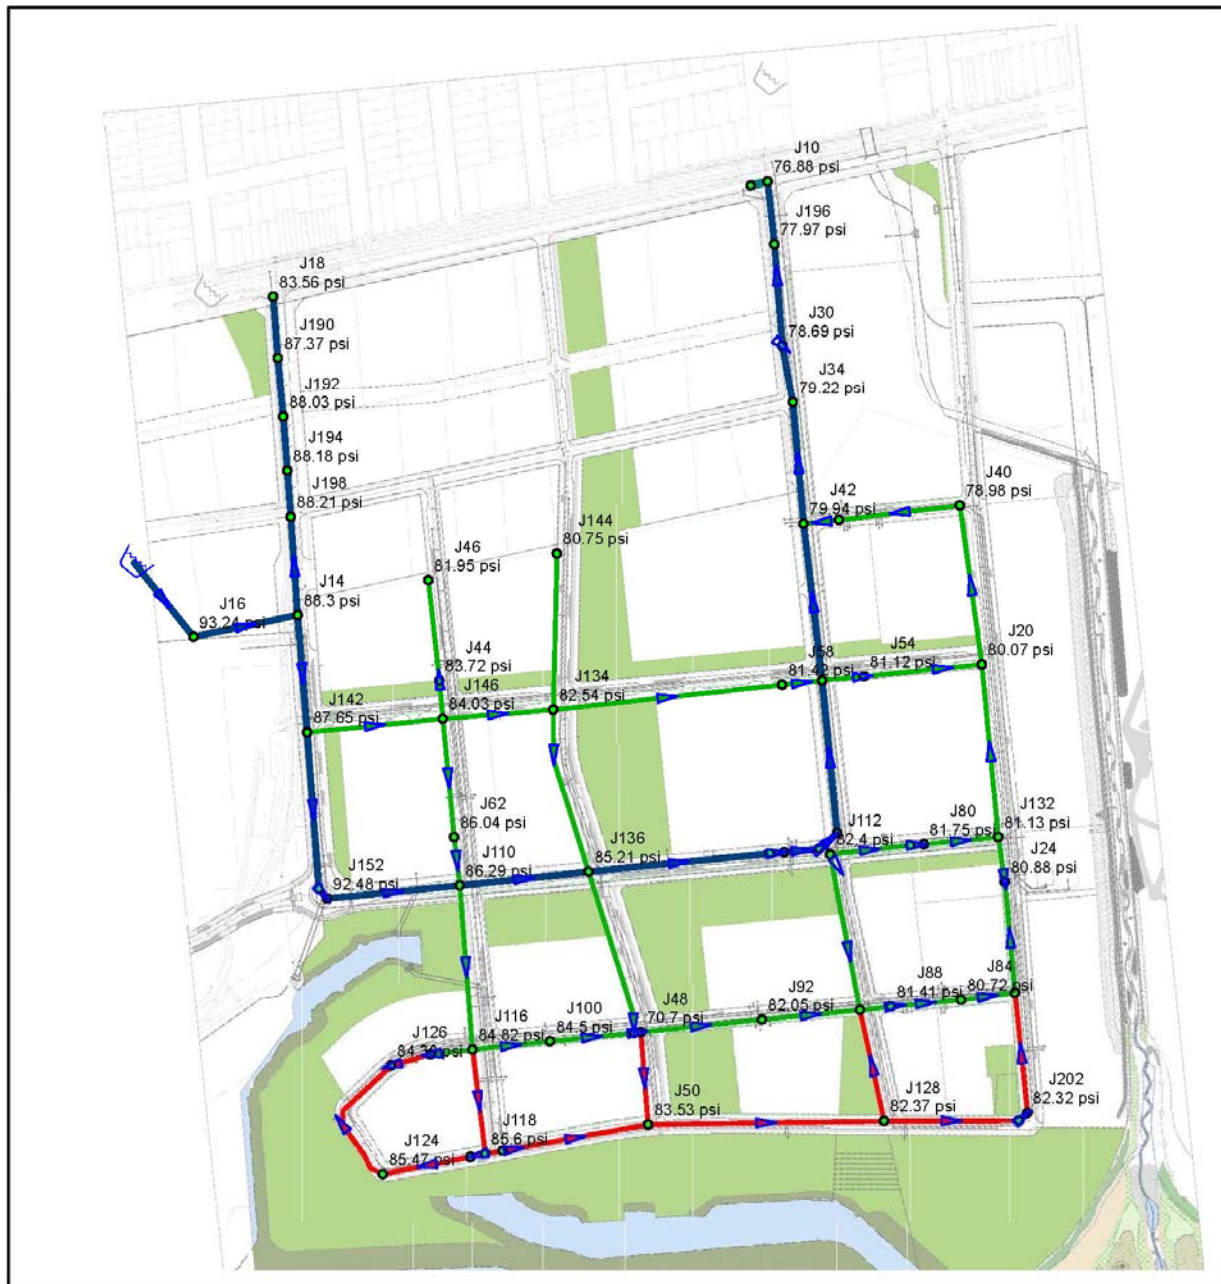

<b>Legend</b>		<p><b>Junction</b></p> <p><b>RUN_ELEV</b></p> <ul style="list-style-type: none"> <li><span style="color: red;">●</span> less than 40 psi</li> <li><span style="color: orange;">●</span> 40-50 psi</li> <li><span style="color: green;">●</span> 50-90 psi</li> <li><span style="color: blue;">●</span> 90-100 psi</li> <li><span style="color: black;">●</span> greater than 100 psi</li> </ul>
<b>Pipe</b>		
<span style="color: red;">—</span> 200		
<span style="color: green;">—</span> 300		
<span style="color: blue;">—</span> 400		
<span style="color: teal;">—</span> 600		

Peak Hour Demand Scenario  
under Emergency Conditions

**Inspiration Lakeview  
Water System Modelling**



## **APPENDIX A**





## APPENDIX B

PN 17201  
 Date 6-May-21  
 By CBL

1

Design Criteria  
 Residential  
 ADD 265  
 MDD Factor 1.8  
 PHD Factor 3  
 Employment  
 265 Upcd  
 1.4  
 3

Populations from this file: G:\Projects\2017\17201 - Lakeview Community - Missisauga\Design\17201\_05\_06 - 17201 - CALC - Water and Wastewater.xlsx

Block Number	Junction in Model	Residential Population			DMD 1			DMD 2			SCALE TO 7995			PHD	FF
		ADD	MDD	PHD	ADD	MDD	PHD	ADD	MDD	PHD	Combined	MODIFIED	ADD		
1	J44	380	0	0	0	0	0	0	0	0	0	0	0	0	0
2	J44	620	3.07	5.52	1000	300	J44	0	0	0	0	0	0	0	0
3	J58	1,052	3.23	5.81	1,062	300	J58	0	0	0	0	0	0	0	0
4	J30	836	2.56	4.62	836	300	J30	0	0	0	0	0	0	0	0
5	J54	384	1.18	2.12	384	300	J54	0	0	0	0	0	0	0	0
6	J62	2,128	0.00	0.00	384	300	J62	0	0	0	0	0	0	0	0
7	J62	2,161	13.16	23.68	4,289	300	J62	101	101	108	108	0.33	0.46	0.99	0
8	J64	2,712	8.32	14.97	2,712	300	J64	0	0	0	0	0	0	0	0
9	J74	2,220	6.81	12.26	2,220	300	J74	0	0	0	0	0	0	0	0
10	J104	1,161	3.56	6.41	1,161	300	J104	0	0	0	0	0	0	0	0
11	J126	1,367	4.19	7.55	1,367	300	J126	69	69	74	74	0.23	0.32	0.68	0
12	J100	1,745	0	0	2,939	300	J100	0	0	0	0	0	0	0	0
13	J100	1,194	9.01	16.22	2,939	300	J100	81	81	87	87	0.27	0.37	0.80	0
14	J92	1,359	0	0	2,415	300	J92	0	0	0	0	0	0	0	0
15	J92	1,056	7.41	13.33	2,415	300	J92	66	66	147	147	0.48	0.67	1.44	0
16	J88	956	0	0	956	300	J88	45	45	0	0	0	0	0	0
17	J88	0	2.93	5.28	880	300	J88	36	36	81	81	0.27	0.37	0.80	0
18	J196	711	2.18	3.93	711	300	J196	46	46	46	46	0.14	0.20	0.42	0
19	J84	0	0	0	0	300	J84	152	152	0	0	0	0	0	0
20	J84	0	0	0	0	300	J84	51	51	203	217	0.67	0.93	2.00	0
21	J80	0	0	0	0	300	J80	55	55	155	155	0.18	0.25	0.54	0
22	J24	0	0	0	0	300	J24	2,790	2,790	2,980	2,980	9.14	12.80	27.42	0
23	J40	0	0	0	0	300	J40	2,000	2,000	2,144	2,144	6.66	9.92	1.97	0
24	J20	0	0	0	0	300	J20	2,993	2,993	3,197	3,197	9.81	13.73	29.42	0
39	J128	0	0	0	0	300	J128	551	551	589	589	1.81	2.53	5.42	0
31 (park)	J134	0	0	0	0	300	J134	214	214	214	214	0.70	0.98	2.10	0
		22042	67.61	121.69	22042	7531	7531	7531	7531	7531	8041	24.66	34.53	73.99	0
		22042	67.61	121.69	202.82	7800.00	7800.00	7800.00	7800.00	7800.00	8041	24.66	34.53	73.99	0
			16.26	29.26	48.77							0.00	0.00	0.00	0
			14.56	26.21	43.69							0.00	0.00	0.00	0
			98.42	177.16	295.27							24.66	34.53	73.99	0

Lakeview  
 External - West  
 External - East  
**TOTAL**

PN 17201  
 Date 2020 09 08  
 By CL

	RESIDENTIAL	EMPLOYMENT	JUNCTION
Pvt 01	593	0	West
Pvt 02	492	0	West
Pvt 03	366	0	West
Pvt 04	468	0	West
Pvt 05	858	0	East
Pvt 06	346	0	West
Pvt 07	500	0	West
Pvt 08	297	0	West
Pvt 09	297	0	West
Pvt 10	534	0	West
Pvt 11	641	0	East
Pvt 12	649	0	West
Pvt 13	303	0	West
Pvt 14	347	0	West
Pvt 15	608	0	East
Pvt 16	1,493	0	East
Pvt 17	1,254	0	East
	10,048	0	



	ADD	MDD Factor - Res	MDD Factor - Empl	PHD	265 Lpcd	1.8	1.4	3	POPULATION	DMD 1	DMD 2	DMD 1	DMD 2	DMD 1	DMD 2	PHD RES	PHD EMP	
JUNCTION	RES	EMP	ADD RES	ADD EMP	MDD RES	MDD EMP	PHD RES	PHD EMP	RES	EMP	RES	EMP	RES	EMP	RES	EMP	RES	EMP
west	5,300	0	16.26	0.00	29.26	0.00	48.77	0.00	5,300	0	16.26	0.00	29.26	0.00	48.77	0.00	48.77	0.00
east	4,748	0	14.56	0.00	26.21	0.00	43.69	0.00	4,748	0	14.56	0.00	26.21	0.00	43.69	0.00	43.69	0.00
	10,048	0	30.82	0.00	55.47	0.00	92.46	0.00	10,048	0	30.82	0.00	55.47	0.00	92.46	0.00	92.46	0.00
			30.82		55.47		92.46				30.82		55.47		92.46		92.46	

## APPENDIX C



**LEGEND**

- PROPOSED 400mm WATERMAIN
- PROPOSED 300mm WATERMAIN
- PROPOSED 300mm WATERMAIN
- EXISTING WATERMAIN
- FUTURE WATERMAIN

**NOTE:**

- THE EXISTING 400mm WATERMAIN SHOWN WITHIN THE EXISTING EASEMENT SHALL BE REPLACED BY A DEDICATED 400mm WATERMAIN ON LAKEFRONT PROMENADE, STREET B, AND STREET I AS SHOWN ON THIS PLAN. THE EXISTING WATERMAIN IS A DEDICATED FEED FROM THE WATER TREATMENT TO WASTEWATER TREATMENT PLANT AND SHALL REMAIN IN OPERATION UNTIL THE NEW 400mm WATERMAIN IS COMMISSIONED.



LAKEVIEW COMMUNITY PARTNERS LTD.  
CITY OF MISSISSAUGA

**PRELIMINARY WATER SERVICING PLAN**

PROJECT No.	DATE	SCALE	DWG No.
17-549	JAN. 2020	1:2000	WM-1



## **APPENDIX D**

17201 - Inspiration Lakeview Water Modelling - May 2021 InfoWater Output - Avg Day Demand Run				
ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
J10	0	85	141.99	81.02
J100	9.31	80.1	141.7	87.57
J104	3.57	79.92	141.7	87.82
J110	0	79.47	141.72	88.49
J112	0	81.34	141.71	85.83
J114	0	81.23	141.72	85.99
J116	0	79.95	141.7	87.78
J118	0	79.36	141.7	88.63
J120	0	78.33	141.7	90.09
J122	0	79.33	141.7	88.66
J124	0	79.44	141.7	88.5
J126	4.44	80.21	141.69	87.41
J128	1.81	81.35	141.7	85.79
J130	0	82.01	141.7	84.86
J132	0	82.11	141.71	84.72
J134	0.7	81.8	141.73	85.19
J136	0	79.85	141.72	87.96
J138	0	82.78	141.7	83.76
J14	0	81.75	141.81	85.37
J142	0	80.35	141.77	87.31
J144	0	83.05	141.73	83.41
J146	0	81.26	141.73	85.97
J150	0	78.92	141.74	89.3
J152	0	75.92	141.74	93.56
J154	0	82.07	141.73	84.82
J156	0	81.32	141.72	85.85
J158	0	81.44	141.72	85.69
J160	0	85.04	141.99	80.96
J170	0	85.04	141.99	80.96
J18	0	85.04	141.99	80.96
J190	0	82.36	141.95	84.72
J192	0	81.89	141.91	85.32
J194	0	81.79	141.88	85.41
J196	2.33	84.23	141.94	82.04
J198	16.26	81.77	141.84	85.41
J20	9.81	82.84	141.72	83.7
J200	0	81.35	141.7	85.79
J202	0	81.35	141.7	85.79
J24	9.14	82.29	141.7	84.46
J30	2.57	83.73	141.86	82.64
J34	14.56	83.36	141.82	83.11
J38	0	82.86	141.76	83.74
J40	0.66	83.61	141.74	82.65
J42	0	82.93	141.77	83.64
J44	3.08	81.47	141.73	85.67
J46	0	82.71	141.73	83.9
J48	0	89.79	141.7	73.79
J50	0	80.75	141.7	86.64
J54	1.18	82.17	141.73	84.66
J58	3.24	82.05	141.73	84.84
J62	13.2	79.65	141.72	88.24
J64	8.68	81.1	141.72	86.17
J70	0	81.15	141.72	86.1
J74	6.83	81.63	141.71	85.4
J80	0.18	81.7	141.71	85.3
J84	0.67	82.46	141.7	84.21
J88	3.21	82	141.7	84.87
J92	7.91	81.61	141.7	85.42
J96	0	80.91	141.7	86.42



17201 - Inspiration Lakeview Water Modelling - May 2021 InfoWater Output - Max Day Demand Run				
ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
J10	0	85	141.98	81
J100	16.64	80.1	141.19	86.84
J104	6.43	79.92	141.18	87.09
J110	0	79.47	141.25	87.82
J112	0	81.34	141.23	85.14
J114	0	81.23	141.24	85.31
J116	0	79.95	141.19	87.05
J118	0	79.36	141.19	87.9
J120	0	78.33	141.19	89.37
J122	0	79.33	141.19	87.93
J124	0	79.44	141.18	87.77
J126	7.9	80.21	141.17	86.67
J128	2.53	81.35	141.19	85.08
J130	0	82.01	141.2	84.14
J132	0	82.11	141.21	84.02
J134	0.98	81.8	141.26	84.53
J136	0	79.85	141.24	87.28
J138	0	82.78	141.2	83.04
J14	0	81.75	141.48	84.9
J142	0	80.35	141.36	86.74
J144	0	83.05	141.26	82.75
J146	0	81.26	141.27	85.31
J150	0	78.92	141.3	88.68
J152	0	75.92	141.3	92.94
J154	0	82.07	141.28	84.17
J156	0	81.32	141.24	85.17
J158	0	81.44	141.24	85.01
J160	0	85.04	141.98	80.94
J170	0	85.04	141.98	80.94
J18	0	85.04	141.98	80.95
J190	0	82.36	141.87	84.6
J192	0	81.89	141.76	85.1
J194	0	81.79	141.66	85.11
J196	4.14	84.23	141.83	81.89
J198	29.27	81.77	141.57	85.02
J20	13.73	82.84	141.26	83.04
J200	0	81.35	141.2	85.08
J202	0	81.35	141.2	85.08
J24	12.8	82.29	141.2	83.75
J30	4.63	83.73	141.62	82.31
J34	26.21	83.36	141.51	82.67
J38	0	82.86	141.36	83.17
J40	0.92	83.61	141.31	82.04
J42	0	82.93	141.38	83.08
J44	5.54	81.47	141.27	85.01
J46	0	82.71	141.27	83.24
J48	0	89.79	141.2	73.07
J50	0	80.75	141.19	85.92
J54	2.12	82.17	141.27	84.01
J58	5.83	82.05	141.27	84.18
J62	23.76	79.65	141.24	87.56
J64	15.49	81.1	141.24	85.49
J70	0	81.15	141.24	85.42
J74	12.29	81.63	141.21	84.7
J80	0.25	81.7	141.21	84.6
J84	0.93	82.46	141.2	83.5
J88	5.66	82	141.2	84.15
J92	14.04	81.61	141.19	84.7
J96	0	80.91	141.2	85.7

**17201 - Inspiration Lakeview Water Modelling - May 2021  
InfoWater Output - Max Day Demand Run - Pipe Report**

ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)
24	J44	J146	37.79	300	120	-5.54	0.08	0	0.04
25	J112	J114	11.08	300	120	-27.51	0.39	0.01	0.68
26	J110	J116	162.84	300	120	19.26	0.27	0.06	0.35
27	J116	J118	103.23	200	120	0.87	0.03	0	0.01
28	J120	J118	17.79	200	120	1.66	0.05	0	0.03
29	J118	J122	14.95	200	120	2.54	0.08	0	0.06
30	J122	J124	88.59	200	120	2.54	0.08	0.01	0.06
31	J126	J124	144.09	200	120	-2.54	0.08	0.01	0.06
32	J120	J50	146.51	200	120	-1.66	0.05	0	0.03
33	J128	J130	112.4	200	120	-1.83	0.06	0	0.03
34	J130	J112	156.59	300	120	-13.93	0.2	0.03	0.19
35	J112	J74	79.98	300	120	13.58	0.19	0.01	0.18
36	J14	J198	97.33	400	120	-71.06	0.57	0.09	0.97
37	J136	J134	166.63	300	120	-11.63	0.16	0.02	0.14
38	J138	J24	110.22	300	120	-4.22	0.06	0	0.02
40	J142	J146	135.17	300	120	27.84	0.39	0.09	0.7
41	J134	J144	154.56	300	120	0	0	0	0
42	J126	J104	40.45	200	120	-5.36	0.17	0.01	0.24
6	J40	J38	120.78	300	120	-20.41	0.29	0.05	0.39
8	J48	J50	91.46	200	120	1.12	0.04	0	0.01
P101	RES9002	J18	64.43	600	120	114.25	0.4	0.02	0.33
P105	J18	J170	263.81	600	120	13.92	0.05	0	0.01
P107	J160	J10	17.35	600	120	13.92	0.05	0	0.01
P121	J170	J160	222.37	600	120	13.92	0.05	0	0.01
P13	J146	J134	109.84	300	120	7.32	0.1	0.01	0.06
P143	J190	J18	61.03	400	120	-100.33	0.8	0.11	1.85
P145	J192	J190	58.87	400	120	-100.33	0.8	0.11	1.85
P147	J194	J192	53.81	400	120	-100.33	0.8	0.1	1.85
P15	J146	J62	118.8	300	120	14.99	0.21	0.03	0.22
P155	J196	J30	100.45	400	120	107.63	0.86	0.21	2.1
P157	J198	J194	45.99	400	120	-100.33	0.8	0.08	1.85
P159	J128	J200	133.31	200	120	-1.24	0.04	0	0.02
P163	J202	J138	119.12	200	120	-1.24	0.04	0	0.02
P165	J136	J96	166.15	300	120	16.72	0.24	0.05	0.27
P167	J200	J202	11.25	200	120	-1.24	0.04	0	0.02
P17	J62	J110	47.94	300	120	-8.77	0.12	0	0.08
P19	J20	J54	117.59	300	120	-10.23	0.14	0.01	0.11
P21	J14	J142	116.76	400	120	71.06	0.57	0.11	0.97
P25	J150	J152	12.66	400	120	43.22	0.34	0	0.39
P27	J152	J110	132.14	400	120	43.22	0.34	0.05	0.39
P29	J110	J136	128.24	400	120	15.18	0.12	0.01	0.06
P31	J136	J64	180.81	400	120	10.09	0.08	0	0.03
P33	J64	J70	14.43	400	120	-5.4	0.04	0	0.01
P35	J70	J156	34.75	400	120	-5.4	0.04	0	0.01
P37	J156	J114	6.2	400	120	-5.4	0.04	0	0.01
P39	J114	J158	17.17	400	120	-32.91	0.26	0	0.23
P41	J158	J154	153.05	400	120	-32.91	0.26	0.04	0.23
P43	J154	J42	156.43	400	120	-56.39	0.45	0.1	0.64
P45	J42	J34	120.68	400	120	-76.79	0.61	0.14	1.13
P47	J34	J30	57.66	400	120	-103	0.82	0.11	1.94
P51	J134	J58	228.31	300	120	-5.3	0.07	0.01	0.03
P53	J58	J154	39.98	300	120	-11.13	0.16	0.01	0.13
P55	J104	J116	41.94	300	120	-11.79	0.17	0.01	0.14
P57	J116	J100	77.25	300	120	6.6	0.09	0	0.05
P59	J100	J96	84.08	300	120	-10.04	0.14	0.01	0.11
P61	J96	J48	6.45	300	120	6.68	0.09	0	0.05
P63	J48	J92	120.82	300	120	5.56	0.08	0	0.04
P65	J92	J130	97.59	300	120	-8.48	0.12	0.01	0.08
P69	J88	J84	69.9	300	120	-2.05	0.03	0	0.01
P71	J84	J138	53.85	300	120	-2.98	0.04	0	0.01
P73	J24	J132	44.79	300	120	-17.02	0.24	0.01	0.28
P75	J132	J20	172.6	300	120	-15.98	0.23	0.04	0.25
P77	J20	J40	159.11	300	120	-19.49	0.28	0.06	0.36
P79	J50	J128	234.05	200	120	-0.54	0.02	0	0
P81	J38	J42	35.3	300	120	-20.41	0.29	0.01	0.39
P83	J54	J154	41.53	300	120	-12.35	0.17	0.01	0.15
P85	J74	J80	13.52	300	120	1.29	0.02	0	0
P87	J80	J132	74.26	300	120	1.04	0.01	0	0
P89	J10	J196	62.59	400	120	111.77	0.89	0.14	2.26
P93	J88	J130	30.88	300	120	-3.61	0.05	0	0.02
P95	J142	J150	156.08	400	120	43.22	0.34	0.06	0.39
P97	J46	J44	100.05	300	120	0	0	0	0
P99	RES9006	J10	99.44	600	120	97.85	0.35	0.02	0.24

17201 - Inspiration Lakeview Water Modelling - May 2021 InfoWater Output - Peak Hour Demand Run				
ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
J10	0	85	141.93	80.93
J100	27.93	80.1	139.69	84.72
J104	10.71	79.92	139.69	84.96
J110	0	79.47	139.87	85.86
J112	0	81.34	139.81	83.12
J114	0	81.23	139.83	83.31
J116	0	79.95	139.71	84.94
J118	0	79.36	139.7	85.78
J120	0	78.33	139.7	87.25
J122	0	79.33	139.7	85.82
J124	0	79.44	139.69	85.64
J126	13.32	80.21	139.66	84.52
J128	5.43	81.35	139.71	82.96
J130	0	82.01	139.72	82.03
J132	0	82.11	139.76	81.94
J134	2.1	81.8	139.91	82.61
J136	0	79.85	139.85	85.29
J138	0	82.78	139.71	80.93
J14	0	81.75	140.53	83.56
J142	0	80.35	140.21	85.1
J144	0	83.05	139.91	80.83
J146	0	81.26	139.93	83.41
J150	0	78.92	140.03	86.87
J152	0	75.92	140.02	91.11
J154	0	82.07	139.94	82.27
J156	0	81.32	139.83	83.17
J158	0	81.44	139.84	83.02
J160	0	85.04	141.93	80.88
J170	0	85.04	141.94	80.89
J18	0	85.04	141.94	80.89
J190	0	82.36	141.63	84.25
J192	0	81.89	141.32	84.48
J194	0	81.79	141.05	84.23
J196	6.99	84.23	141.53	81.46
J198	48.78	81.77	140.81	83.93
J20	29.43	82.84	139.87	81.06
J200	0	81.35	139.71	82.96
J202	0	81.35	139.71	82.96
J24	27.42	82.29	139.72	81.63
J30	7.71	83.73	140.94	81.33
J34	43.68	83.36	140.62	81.4
J38	0	82.86	140.18	81.5
J40	1.98	83.61	140.04	80.22
J42	0	82.93	140.23	81.45
J44	9.24	81.47	139.93	83.11
J46	0	82.71	139.93	81.34
J48	0	89.79	139.71	70.97
J50	0	80.75	139.71	83.81
J54	3.54	82.17	139.92	82.09
J58	9.72	82.05	139.93	82.28
J62	39.6	79.65	139.86	85.59
J64	26.04	81.1	139.83	83.49
J70	0	81.15	139.83	83.42
J74	20.49	81.63	139.76	82.63
J80	0.54	81.7	139.76	82.53
J84	2.01	82.46	139.71	81.39
J88	9.63	82	139.71	82.04
J92	23.73	81.61	139.7	82.58
J96	0	80.91	139.72	83.59

17201 - Inspiration Lakeview Water Modelling - May 2021 - Max Daily Demand with Fireflow Simulation Run							
Note.: At any given node the Available Flow (at 140 kPa/20 psi) must be greater than Total demand.							
ID	Static Demand (L/s)	Static Pressure (psi)	Static Head (m)	Fire-Flow Demand (L/s)	Residual Pressure (psi)	Available Flow at Hydrant (L/s)	Available Flow Pressure (psi)
J100	16.64	86.84	141.19	300	76.51	958.97	20.31
J104	6.43	87.09	141.18	300	74.22	815.54	20.3
J126	7.9	86.67	141.17	300	61.36	532.60	20.3
J128	2.53	85.08	141.19	300	62.77	556.76	20.3
J134	0.98	84.53	141.26	300	77.15	1,142.28	20.31
J194	0	85.11	141.66	300	81.65	1,888.24	20.31
J196	4.14	81.89	141.83	300	80.03	2,710.09	20.31
J20	13.73	83.04	141.26	300	75.15	1,090.90	20.31
J24	12.8	83.75	141.2	300	74.12	965.73	20.31
J30	4.63	82.31	141.62	300	78.81	1,867.18	20.31
J34	26.21	82.67	141.51	300	78.50	1,701.62	20.31
J40	0.92	82.04	141.31	300	72.78	935.17	20.31
J44	5.54	85.01	141.27	300	74.83	912.19	20.31
J54	2.12	84.01	141.27	300	76.67	1,145.08	20.31
J58	5.83	84.18	141.27	300	76.73	1,137.01	20.31
J62	23.76	87.56	141.24	300	79.80	1,172.44	20.31
J64	15.49	85.49	141.24	300	78.83	1,291.49	20.31
J74	12.29	84.7	141.21	300	75.8	1,028.76	20.31
J80	0.25	84.6	141.21	300	75.63	1,008.51	20.31
J84	0.93	83.5	141.2	300	73.13	900.97	20.31
J88	5.66	84.15	141.2	300	74.60	969.62	20.31
J92	14.04	84.7	141.19	300	74.44	939.27	20.31

17201 - Inspiration Lakeview Water Modelling - May 2021				
InfoWater Output - Peak Hour Demand Run				
Emergency Conditions				
ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
J10	0	85	139.08	76.88
J100	27.93	80.1	139.54	84.5
J104	10.71	79.92	139.6	84.84
J110	0	79.47	140.17	86.29
J112	0	81.34	139.3	82.4
J114	0	81.23	139.32	82.58
J116	0	79.95	139.62	84.82
J118	0	79.36	139.57	85.6
J120	0	78.33	139.56	87.05
J122	0	79.33	139.57	85.63
J124	0	79.44	139.57	85.47
J126	13.32	80.21	139.56	84.38
J128	5.43	81.35	139.29	82.37
J130	0	82.01	139.29	81.43
J132	0	82.11	139.19	81.13
J134	2.1	81.8	139.86	82.54
J136	0	79.85	139.79	85.21
J138	0	82.78	139.23	80.25
J14	0	81.75	143.87	88.3
J142	0	80.35	142	87.65
J144	0	83.05	139.86	80.75
J146	0	81.26	140.36	84.03
J150	0	78.92	141.05	88.32
J152	0	75.92	140.98	92.48
J154	0	82.07	139.26	81.31
J156	0	81.32	139.33	82.46
J158	0	81.44	139.31	82.27
J16	0	80.46	146.05	93.24
J160	0	85.04	139.08	76.82
J18	0	85.04	143.82	83.56
J190	0	82.36	143.82	87.37
J192	0	81.89	143.82	88.03
J194	0	81.79	143.82	88.18
J196	6.99	84.23	139.08	77.97
J198	48.78	81.77	143.82	88.21
J20	29.43	82.84	139.17	80.07
J200	0	81.35	139.26	82.33
J202	0	81.35	139.26	82.32
J24	27.42	82.29	139.19	80.88
J30	7.71	83.73	139.08	78.69
J34	43.68	83.36	139.08	79.22
J38	0	82.86	139.17	80.05
J40	1.98	83.61	139.17	78.98
J42	0	82.93	139.16	79.94
J44	9.24	81.47	140.36	83.72
J46	0	82.71	140.36	81.95
J48	0	89.79	139.53	70.7
J50	0	80.75	139.51	83.53
J54	3.54	82.17	139.23	81.12
J58	9.72	82.05	139.33	81.42
J62	39.6	79.65	140.17	86.04
J64	26.04	81.1	139.39	82.87
J70	0	81.15	139.37	82.77
J74	20.49	81.63	139.21	81.85
J80	0.54	81.7	139.21	81.75
J84	2.01	82.46	139.25	80.72
J88	9.63	82	139.27	81.41
J92	23.73	81.61	139.33	82.05

## **Appendix B-2**

E-mail Correspondence with the Region of Peel: Equivalent Population Values

## Jonathan Nishio

---

**From:** Janaani Pathmanapan  
**Sent:** October 3, 2022 10:17 AM  
**To:** Jonathan Nishio  
**Subject:** FW: Request for some information - San Trunk under Lakeshore Road East draining to Beechwood SPS

Hi Jonathan,

We received a response back for the townhouse densities – 3.5ppu

---

**From:** Motamedi, Kolsoom <kolsoom.motamedi@peelregion.ca>  
**Sent:** October 3, 2022 10:03 AM  
**To:** Koryun Shahbikian <kshahbikian@schaeffers.com>; Polga, Miriam <miriam.polga@peelregion.ca>; Borowiec, Laura <laura.borowiec@peelregion.ca>; Lee, Justin <Justin.Lee@peelregion.ca>; Leyburne, Troy <troy.leyburne@peelregion.ca>  
**Cc:** Michael May <mikem@deltaurban.com>; Andrew Lam <andrewl@deltaurban.com>; Myron Pestaluky <myronp@deltaurban.com>; Hovig Tozcu <hhtozcu@schaeffers.com>; Janaani Pathmanapan <jpathmanapan@schaeffers.com>; Heather Milukow <hmilukow@schaeffers.com>; LeDrew, Lyle <lyle.ledrew@peelregion.ca>  
**Subject:** RE: Request for some information - San Trunk under Lakeshore Road East draining to Beechwood SPS

Hi Koryun,

For your information, The plan is that all flow from the Beach Street Sewage Pumping Station drainage areas will be conveyed by gravity to the Beechwood SPS, through the proposed Aviation Trunk and Lakeshore Road East trunk. My understanding is that the entire flow from the Rangeview development is planned to be conveyed to the future Lakeshore Road gravity sewer.

For the townhouse please use 3.5 people per unit.

Thanks and Regards,

**Kolsoom Motamedi, P.Eng., PMP**  
Project Manager  
Infrastructure Planning - Growth  
Public Works, Region of Peel  
10 Peel Centre Drive, Suite A, 4<sup>th</sup> Floor  
Brampton, ON L6T 4B9  
Tel. (905) 791-7800, ext. 4196  
[Kolsoom.Motamedi@peelregion.ca](mailto:Kolsoom.Motamedi@peelregion.ca)

---

**From:** Koryun Shahbikian <[kshahbikian@schaeffers.com](mailto:kshahbikian@schaeffers.com)>  
**Sent:** Monday, October 3, 2022 9:46 AM

**To:** Motamedi, Kolsoom <[kolsoom.motamedi@peelregion.ca](mailto:kolsoom.motamedi@peelregion.ca)>; Polga, Miriam <[miriam.polga@peelregion.ca](mailto:miriam.polga@peelregion.ca)>; Borowiec, Laura <[laura.borowiec@peelregion.ca](mailto:laura.borowiec@peelregion.ca)>; Lee, Justin <[Justin.Lee@peelregion.ca](mailto:Justin.Lee@peelregion.ca)>; Leyburne, Troy <[troy.leyburne@peelregion.ca](mailto:troy.leyburne@peelregion.ca)>

**Cc:** Michael May <[mikem@deltaurban.com](mailto:mikem@deltaurban.com)>; Andrew Lam <[andrewl@deltaurban.com](mailto:andrewl@deltaurban.com)>; Myron Pestaluky <[myronp@deltaurban.com](mailto:myronp@deltaurban.com)>; Hovig Tozcu <[hhtozcu@schaeffers.com](mailto:hhtozcu@schaeffers.com)>; Janaani Pathmanapan <[jpathmanapan@schaeffers.com](mailto:jpathmanapan@schaeffers.com)>; Heather Milukow <[hmilukow@schaeffers.com](mailto:hmilukow@schaeffers.com)>; LeDrew, Lyle <[lyle.ledrew@peelregion.ca](mailto:lyle.ledrew@peelregion.ca)>

**Subject:** RE: Request for some information - San Trunk under Lakeshore Road East draining to Beechwood SPS

**CAUTION: EXTERNAL MAIL. DO NOT CLICK ON LINKS OR OPEN ATTACHMENTS YOU DO NOT TRUST.**

Hi Kolsoom,

Thanks for your prompt reply.

I will try to provide some clarifications but we will try to provide answers to all your four items through a separate email later.

Concerning item 4, we estimated the population based on units but we used the ppu that we got from the region for another project. The ppu was slightly less than what you have mentioned so we are going to revise our population based on 2.7 ppu per apartment unit. Please also let us know what ppu we should consider for townhouses.

Concerning trunk sewer, in our previous meetings with the region, we were told that all flows from range view should be drained to Beechwood SPS. If you recall, we originally had a plan to split the flow and use the lakeshore trunk as well as Beach Street SPS.

I will talk to LOG for phasing questions and we will provide information.

Thanks,

Koryun Shahbikian, LLB, LLM, M.Eng., P.Eng.  
Partner



6 Ronrose Drive, Concord, Ontario, L4K4R3  
(905) 738-6100 – Ext. 203  
Cell: (647) 212-0404

[www.schaeffers.com](http://www.schaeffers.com)

This email, including any attachment(s), may contain information which is privileged, confidential, proprietary or otherwise subject to restricted disclosure under applicable law, and it is intended solely for the attention and information of the named recipient(s). If you are not the intended recipient, or have received it in error, please notify Schaeffer & Associates Ltd. by replying to this email and permanently delete the original and any copies of transmissions including any attachments from your email system(s) and device(s), and destroy any printed or digital copies. Any unauthorized distribution, disclosure or copying of this message and attachment(s) by anyone other than the recipient is strictly prohibited.

Please note that for security reason, Schaeffer & Associates Ltd. is blocking all emails containing attachments with a .zip extension. When sending a .ZIP file please rename the extension to .ZZZ or use an FTP or other file transfer sites

---

**From:** Motamedi, Kolsoom <[kolsoom.motamedi@peelregion.ca](mailto:kolsoom.motamedi@peelregion.ca)>

**Sent:** October 3, 2022 9:00 AM

**To:** Koryun Shahbikian <[kshahbikian@schaeffers.com](mailto:kshahbikian@schaeffers.com)>; Polga, Miriam <[miriam.polga@peelregion.ca](mailto:miriam.polga@peelregion.ca)>; Borowiec, Laura <[laura.borowiec@peelregion.ca](mailto:laura.borowiec@peelregion.ca)>; Lee, Justin <[Justin.Lee@peelregion.ca](mailto:Justin.Lee@peelregion.ca)>; Leyburne, Troy



[<troy.leyburne@peelregion.ca>](mailto:troy.leyburne@peelregion.ca)

**Cc:** Michael May <[mikem@deltaurban.com](mailto:mikem@deltaurban.com)>; Andrew Lam <[andrewl@deltaurban.com](mailto:andrewl@deltaurban.com)>; Myron Pestaluky <[myronp@deltaurban.com](mailto:myronp@deltaurban.com)>; Hovig Tozcu <[hhtozcu@schaeffers.com](mailto:hhtozcu@schaeffers.com)>; Janaani Pathmanapan <[jpathmanapan@schaeffers.com](mailto:jpathmanapan@schaeffers.com)>; Heather Milukow <[hmilukow@schaeffers.com](mailto:hmilukow@schaeffers.com)>; LeDrew, Lyle <[lyle.ledrew@peelregion.ca](mailto:lyle.ledrew@peelregion.ca)>

**Subject:** RE: Request for some information - San Trunk under Lakeshore Road East draining to Beechwood SPS

Hi Koryun,

Thank you for updating us about Rangview development. Troy Leyburne is the project manager for this project, so I have copied him and also Lyle LeDrew, Manager of wastewater Engineering Service.

The detailed drawings are not ready yet. I had a meeting with Engineering Service and the following information should be clarified.

- 1- Rangeview project phasing, when service be required
- 2- Coordination with regards to the connection point location
- 3- What is your plan for conveying sanitary flows to the future trunk on Lakeshore Road East
- 4- The final proposed population, at this stage people per unit, be considered ( 2.7 ppu for apartment buildings and 4.2 for single detached)

Please do not hesitate to contact me if you have any questions.

Thanks and Regards,

**Kolsoom Motamedi, P.Eng., PMP**

Project Manager

Infrastructure Planning - Growth

Public Works, Region of Peel

10 Peel Centre Drive, Suite A, 4<sup>th</sup> Floor

Brampton, ON L6T 4B9

Tel. (905) 791-7800, ext. 4196

[Kolsoom.Motamedi@peelregion.ca](mailto:Kolsoom.Motamedi@peelregion.ca)

---

**From:** Koryun Shahbikian <[kshahbikian@schaeffers.com](mailto:kshahbikian@schaeffers.com)>

**Sent:** Saturday, October 1, 2022 9:21 AM

**To:** Motamedi, Kolsoom <[kolsoom.motamedi@peelregion.ca](mailto:kolsoom.motamedi@peelregion.ca)>; Polga, Miriam <[miriam.polga@peelregion.ca](mailto:miriam.polga@peelregion.ca)>; Borowiec, Laura <[laura.borowiec@peelregion.ca](mailto:laura.borowiec@peelregion.ca)>; Lee, Justin <[Justin.Lee@peelregion.ca](mailto:Justin.Lee@peelregion.ca)>

**Cc:** Michael May <[mikem@deltaurban.com](mailto:mikem@deltaurban.com)>; Andrew Lam <[andrewl@deltaurban.com](mailto:andrewl@deltaurban.com)>; Myron Pestaluky <[myronp@deltaurban.com](mailto:myronp@deltaurban.com)>; Hovig Tozcu <[hhtozcu@schaeffers.com](mailto:hhtozcu@schaeffers.com)>; Janaani Pathmanapan <[jpathmanapan@schaeffers.com](mailto:jpathmanapan@schaeffers.com)>; Heather Milukow <[hmilukow@schaeffers.com](mailto:hmilukow@schaeffers.com)>

**Subject:** RE: Request for some information - San Trunk under Lakeshore Road East draining to Beechwood SPS

**CAUTION: EXTERNAL MAIL. DO NOT CLICK ON LINKS OR OPEN ATTACHMENTS YOU DO NOT TRUST.**

## **Appendix B-3**

### Water Demand Calculations

**Equivalent Population Calculations**

Project Title: 4938 - Rangeview  
 Last Edited: 2024-04-26  
 Municipality: Region of Peel

Project: 4938 Rangeview Mississauga  
 2024-04-26

**Design Criteria**

Unit Type	Population Density	Unit	Source
Rowhouses/Other Multiples	3.5	ppu	Per correspondence with Region of Peel (Oct 3, 2022)
Apartment	2.7	ppu	Per correspondence with Region of Peel (Oct 3, 2022)

Land Use	Population Density	Unit	Source
Single Family (>10m frontage)	50	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Single Family (<10m frontage)	70	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Semi-detached	70	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Row dwellings	175	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Apartments	475	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Commercial	50	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)

Parcel	Landowners	Parcel Area (Gross)		Net Developable		Parcel Area (Townhouse)		Parcel Area (Apartments)		Low-rise Units		Mid-rise Units	Tall Building Units	Commercial	Equivalent Population										
		sq.m.	ha	sq.m.	ha	ha	ha	(Up to 4-Storeys)					(5- to 8-Storeys)	(9- to 15-Storeys)	Floor Area	Unit Type Method					Land Use Method				
								units	units	units	units	units	units	units	sq. m.	Townhouses	Apartments	Commercial	Institutional	Total	Townhouses	Apartments	Commercial	Institutional	Total
1	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	6,198.99	0.62	5,211.39	0.52	0	0	0	0	0	0	98	160	363.67					699						250
2	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	8,451.90	0.85	7,632.77	0.76	0.38	0.38	0	0	52	0	162	0	594.63	182	438	3		623	67	182	3		252	
3	1127792 ONTARIO LIMITED (Dino Collini)	4,339.04	0.43	3,868.37	0.39	0	0.39	0	0	0	0	148	0	550.55		400	3		400		184	3		187	
4	896 Lakeshore Road East	4,338.68	0.43	3,868.33	0.39	0	0.39	0	0	0	0	151	0	562.90		408	3		411		184	3		187	
5	910 - 920 Lakeshore Road East	8,686.81	0.87	4,755.51	0.48	0	0.48	0	0	0	0	0	204	1,731.60		551	9		560		226	9		235	
6	946 Lakeshore Road East	7,040.36	0.70	5,723.87	0.57	0	0.57	0	0	0	83	144	144	1,207.11		613	7		620		272	7		279	
7	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	10,735.57	1.07	9,334.79	0.93	0.65	0.28	0	0	80	0	162	0	578.31	280	438	3		721	115	134	3		252	
8	447111 ONTARIO LIMITED (Norstar)	7,833.20	0.78	7,133.15	0.71	0.21	0.50	0	0	36	0	136	0	487.48	126	368	3		497	38	238	3		279	
9	RANGEVIEW 1035 HOLDING INC./RANGEVIEW 1045 HOLDING INC./1207238 ONTARIO INC. (Oasis Banquet Hall)	8,590.92	0.86	2,089.15	0.21	0	0.21	0	0	0	0	0	172	443.49		465	3		468		100	3		103	
10	ILSCO OF CANADA LIMITED (Thomas Quinn)	6,980.11	0.70	5,820.65	0.58	0	0.58	0	0	0	85	170	170	750.14		689	4		693		277	4		281	
11	1076 Lakeshore Road East	13,573.97	1.36	8,378.98	0.84	0.34	0.50	9	0	0	0	0	230	2,277.43	32	621	12		665	59	239	12		310	
12	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	15,357.62	1.54	8,586.32	0.86	0.43	0.43	0	0	40	0	199	0	0.00	140	538			678	76	204			280	
13	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	4,189.30	0.42	2,036.86	0.20	0.20	0.20	0	22	0	0	0	0	0.00	77				77	36				36	
14	895 Rangeview Road	4,465.52	0.45	3,975.17	0.40	0.40	0.40	0	0	48	0	0	0	0.00	168				168	70				70	
15	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	5,653.29	0.57	3,747.11	0.37	0	0.37	0	0	0	0	0	199	0.00		538			538		178			178	
16	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	7,259.45	0.73	7,109.98	0.71	0.28	0.43	0	0	56	0	0	253	0.00	196	684			880	50	203			253	
17	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	3,627.10	0.36	775.00	0.08	0.08	0.19	0	0	0	0	0	0	0.00					63					33	
18	2547046 ONTARIO INC./2545488 ONTARIO INC. (Vittorio Torchia)	3,627.76	0.36	1,856.79	0.19	0.19	0.36	0	18	0	0	0	0	0.00					63	33				33	
19	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	5,075.55	0.51	3,554.25	0.36	0	0.36	0	0	0	0	0	190	0.00		513			513		169			169	
20	RANGEVIEW 1035 HOLDING INC./RANGEVIEW 1045 HOLDING INC./1207238 ONTARIO INC. (Oasis Banquet Hall)	4,587.89	0.46	1,612.07	0.16	0	0.16	0	0	0	0	0	182	0.00		492			492		77			77	
21	RANGEVIEW 1035 HOLDING INC./RANGEVIEW 1045 HOLDING INC./1207238 ONTARIO INC. (Oasis Banquet Hall)	4,829.66	0.48	4,205.37	0.42	0	0.42	0	0	54	0	0	0	0.00		146			146	50	200			200	
22	2547046 ONTARIO INC./2545488 ONTARIO INC. (Vittorio Torchia)	6,054.50	0.61	5,655.26	0.57	0.28	0.28	0	0	20	0	0	177	0.00		478			548	50	135			185	
23	850 Rangeview Road	10,354.01	1.04	9,964.00	1.00	1.00	1.00	24	0	28	0	0	0	0.00	182			182	175					175	
24	WHITEROCK 880 RANGEVIEW INC. (Dream)	13,146.95	1.31	12,996.05	1.30	0.71	0.58	9	0	36	0	240	0	0.00	158	648			806	126	278			404	
25	890 Rangeview Road (Canada Post)	8,627.44	0.86	7,383.00	0.74	0.15	0.15	0	0	0	47	0	168	0.00		581		450	1031		71		450	521	
26	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	7,258.96	0.73	7,128.44	0.71	0.14	0.57	0	20	0	0	83	186	0.00	70	727			797	25	271			296	
27	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	3,621.46	0.36	2,087.67	0.21	0.06	0.15	0	0	0	0	0	0	0.00					0						
28	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	3,625.21	0.36	3,573.99	0.36	0.11	0.25	0	16	0	0	86	0	0.00	56	233			289	19	119			138	
29	1008 Rangeview Road	3,621.63	0.36	3,569.56	0.36	0	0.36	0	0	0	0	0	177	0.00		478			478		170			170	
30	1024 Rangeview Road	3,623.21	0.36	276.43	0.03	0	0.03	0	0	0	0	0	0	0.00					0						
31	2120412 ONTARIO INC. (Xtreme Tire)	7,248.77	0.72	6,069.04	0.61	0	0.61	0	0	0	58	0	180	0.00		643			643		289			289	
32	1062 Rangeview Road	3,273.04	0.33	3,232.41	0.32	0.32	0.32	4	0	12	0	0	0	0.00	56				56	57				57	
33	KOTYCK INVESTMENTS LTD. (Laurie McPherson)	3,491.56	0.35	3,437.21	0.34	0	0.34	0	0	0	0	0	186	0.00		503			503		164			164	
<b>TOTALS</b>		<b>219,389.43</b>	<b>21.94</b>	<b>166,648.93</b>	<b>16.66</b>	<b>5.79</b>	<b>10.25</b>	<b>46</b>	<b>76</b>	<b>136</b>	<b>272</b>	<b>159</b>	<b>1,633</b>	<b>2,978</b>	<b>9,547</b>	<b>1,856</b>	<b>12,890</b>	<b>52</b>	<b>15,248</b>	<b>996</b>	<b>4,812</b>	<b>52</b>	<b>450</b>	<b>6,310</b>	

**LEGEND**  
 Non-participating Landowners

**Notes:**  
 Parcel area for breakdown between townhouses and apartments was based on spatial estimates  
 Parcel 25 was assumed to include a senior public school with 900 students (minimum per Region's standards)

**Water Supply Calculations**

Project Title: 4938 - Rangeview  
 Last Edited: 2024-04-26  
 Municipality: Region of Peel

**Water Supply Parameters**

*Residential Parameters*  
 Water Demand 280 L/cap./d  
 Max Day Factor 2.0  
 Peak Hour Factor 3.0

*ICI Parameters*  
 Water Demand 300 L/cap./d  
 Max Day Factor 1.4  
 Peak Hour Factor 3.0

**Water Demand**  
 Residential 280 L/cap./d Per Region of Peel Watermain Design Criteria (June 2010)  
 ICI 300 L/emp./d Per Region of Peel Watermain Design Criteria (June 2010)

**Peaking Factors**  
 Residential Max Day Factor 2.00 Per Region of Peel Watermain Design Criteria (June 2010)  
 Residential Peak Hour Factor 3.00 Per Region of Peel Watermain Design Criteria (June 2010)  
 ICI Max Day Factor 1.40 Per Region of Peel Watermain Design Criteria (June 2010)  
 ICI Peak Hour Factor 3.00 Per Region of Peel Watermain Design Criteria (June 2010)

**Demands - Rangeview** [Redacted] Non-participating Landowners  
 \*Population data per Rangeview Statistics from Bousefields (July 17, 2023)

Parcel	Residential Population	Flow (L/s)				
		Average Day Demand	Max Day Demand	Peak Hour Demand	Fire Flow	MDD + Fire Flow
1	699	2.27	4.53	6.80	317	321.53
2	623	2.02	4.04	6.06	317	321.04
3	403	1.31	2.61	3.92	317	319.61
4	411	1.33	2.66	4.00	317	319.66
5	560	1.81	3.63	5.44	317	320.63
6	620	2.01	4.02	6.03	317	321.02
7	721	2.34	4.67	7.01	317	321.67
8	497	1.61	3.22	4.83	317	320.22
9	468	1.52	3.03	4.55	317	320.03
10	693	2.25	4.49	6.74	317	321.49
11	665	2.16	4.31	6.47	317	321.31
12	678	2.20	4.39	6.59	317	321.39
13	77	0.25	0.50	0.75	317	317.50
14	168	0.54	1.09	1.63	317	318.09
15	538	1.74	3.49	5.23	317	320.49
16	880	2.85	5.70	8.56	317	322.70
17		0.00	0.00	0.00	317	317.00
18	63	0.20	0.41	0.61	317	317.41
19	513	1.66	3.33	4.99	317	320.33
20	492	1.59	3.19	4.78	317	320.19
21	146	0.47	0.95	1.42	317	317.95
22	548	1.78	3.55	5.33	317	320.55
23	182	0.59	1.18	1.77	317	318.18
24	806	2.61	5.22	7.84	317	322.22
25	1031	3.34	6.68	10.02	317	323.68
26	797	2.58	5.17	7.75	317	322.17
27		0.00	0.00	0.00	317	317.00
28	289	0.94	1.87	2.81	317	318.87
29	478	1.55	3.10	4.65	317	320.10
30		0.00	0.00	0.00	317	317.00
31	643	2.08	4.17	6.25	317	321.17
32	56	0.18	0.36	0.54	317	317.36
33	503	1.63	3.26	4.89	317	320.26
<b>Total</b>	<b>15248</b>	<b>49.41</b>	<b>98.83</b>	<b>148.24</b>		

**Residential Demands - Lakeview**  
 \*Population data per TMIG Lakeview Community Water Modelling Methodology and Analysis Memo (May 6, 2021)

Block Number	Residential Population	Flow (L/s)				
		Average Day Demand	Max Day Demand	Peak Hour	Fire Flow	MDD + Fire Flow
1	380	1.23	2.46	3.69	300	302.46
2	620	2.01	4.02	6.03	300	304.02
3	1052	3.41	6.82	10.23	300	306.82
4	836	2.71	5.42	8.13	300	305.42
5	384	1.24	2.49	3.73	300	302.49
6	2128	6.90	13.79	20.69	300	313.79
7	2161	7.00	14.01	21.01	300	314.01
8	2712	8.79	17.58	26.37	300	317.58
9	2220	7.19	14.39	21.58	300	314.39
10	1161	3.76	7.53	11.29	300	307.53
11	1367	4.43	8.86	13.29	300	308.86
12	1745	5.66	11.31	16.97	300	311.31
13	1194	3.87	7.74	11.61	300	307.74
14	1359	4.40	8.81	13.21	300	308.81
15	1056	3.42	6.84	10.27	300	306.84
16	956	3.10	6.20	9.29	300	306.20
17	0	0.00	0.00	0.00	300	300.00
18	711	2.30	4.61	6.91	300	304.61
19	0	0.00	0.00	0.00	300	300.00
20	0	0.00	0.00	0.00	300	300.00
21	0	0.00	0.00	0.00	300	300.00
22	0	0.00	0.00	0.00	300	300.00
23	0	0.00	0.00	0.00	300	300.00
24	0	0.00	0.00	0.00	300	300.00
39	0	0.00	0.00	0.00	300	300.00
31 (park)	0	0.00	0.00	0.00	300	300.00
<b>Total</b>	<b>22042</b>	<b>71.43</b>	<b>142.86</b>	<b>214.30</b>		

**Employment Demands - Lakeview**  
 \*Population data per TMIG Lakeview Community Water Modelling Methodology and Analysis Memo (May 6, 2021)

Block Number	Employment Population	Flow (L/s)		
		Average Day Demand	Max Day Demand	Peak Hour Demand
1	0	0.00	0.00	0.00
2	0	0.00	0.00	0.00
3	0	0.00	0.00	0.00
4	0	0.00	0.00	0.00
5	0	0.00	0.00	0.00
6	0	0.00	0.00	0.00
7	108	0.35	0.49	1.05
8	0	0.00	0.00	0.00
9	0	0.00	0.00	0.00
10	0	0.00	0.00	0.00
11	74	0.24	0.34	0.72
12	0	0.00	0.00	0.00
13	87	0.28	0.39	0.85
14	0	0.00	0.00	0.00
15	157	0.51	0.71	1.53
16	0	0.00	0.00	0.00
17	87	0.28	0.39	0.85
18	46	0.15	0.21	0.45
19	0	0.00	0.00	0.00
20	217	0.70	0.98	2.11
21	59	0.19	0.27	0.57
22	2980	9.66	13.52	28.97
23	214	0.69	0.97	2.08
24	3197	10.36	14.50	31.08
39	589	1.91	2.67	5.73
31 (park)	229	0.74	1.04	2.23
<b>Total</b>	<b>8044</b>	<b>26.07</b>	<b>36.50</b>	<b>78.21</b>

**Demands - External Lands per Lakeview Report, PVT 16/17**  
 \*Population data per TMIG Lakeview Community Water Modelling Methodology and Analysis Memo (May 6, 2021)

ID	Residential Population	Flow (L/s)				
		Average Day Demand	Max Day Demand	Peak Hour Demand	Fire Flow	MDD + Fire Flow
Pvt 16	1493	4.84	9.68	14.52	300	309.68
Pvt 17	1254	4.06	8.13	12.19	300	308.13
<b>Total</b>	<b>2747</b>	<b>8.90</b>	<b>17.80</b>	<b>26.71</b>		

## **Appendix B-4**


### Hydrant Test Results

**Rangeview Mississauga**  
**Project No. 4938**

Date of Test: 04/23/2021  
 Test Location: Residual: 1000 Lakeshore Road East, Mississauga  
 Flow: 1000 Lakeshore Road East, Mississauga

**Test Results**

	Flow		Residual Pressure	
	US. GPM	L/s	psi	kPa
Measured Data	0	0	82	565
	674	43	81	558
	1538	97	80	552
Extrapolated Data	4047	255	70	483
	5614	354	60	414
	6874	434	50	345
	7961	502	40	276
	8934	564	30	207
	9824	620	20	138

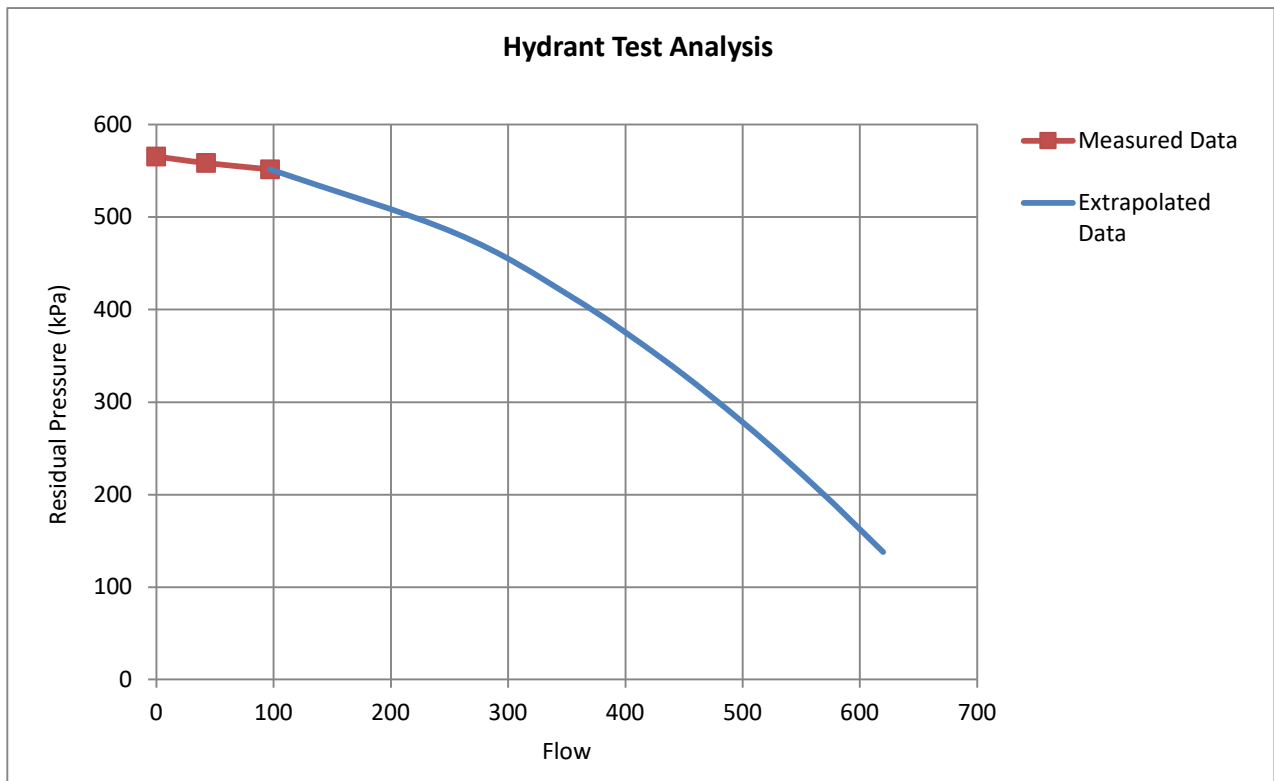

**Appendix B-5** InfoWater  
Model Outputs - Option 1

# Legend

## Pipe


— <all other values>

## TYPE

— Active

— Domain

— Inactive

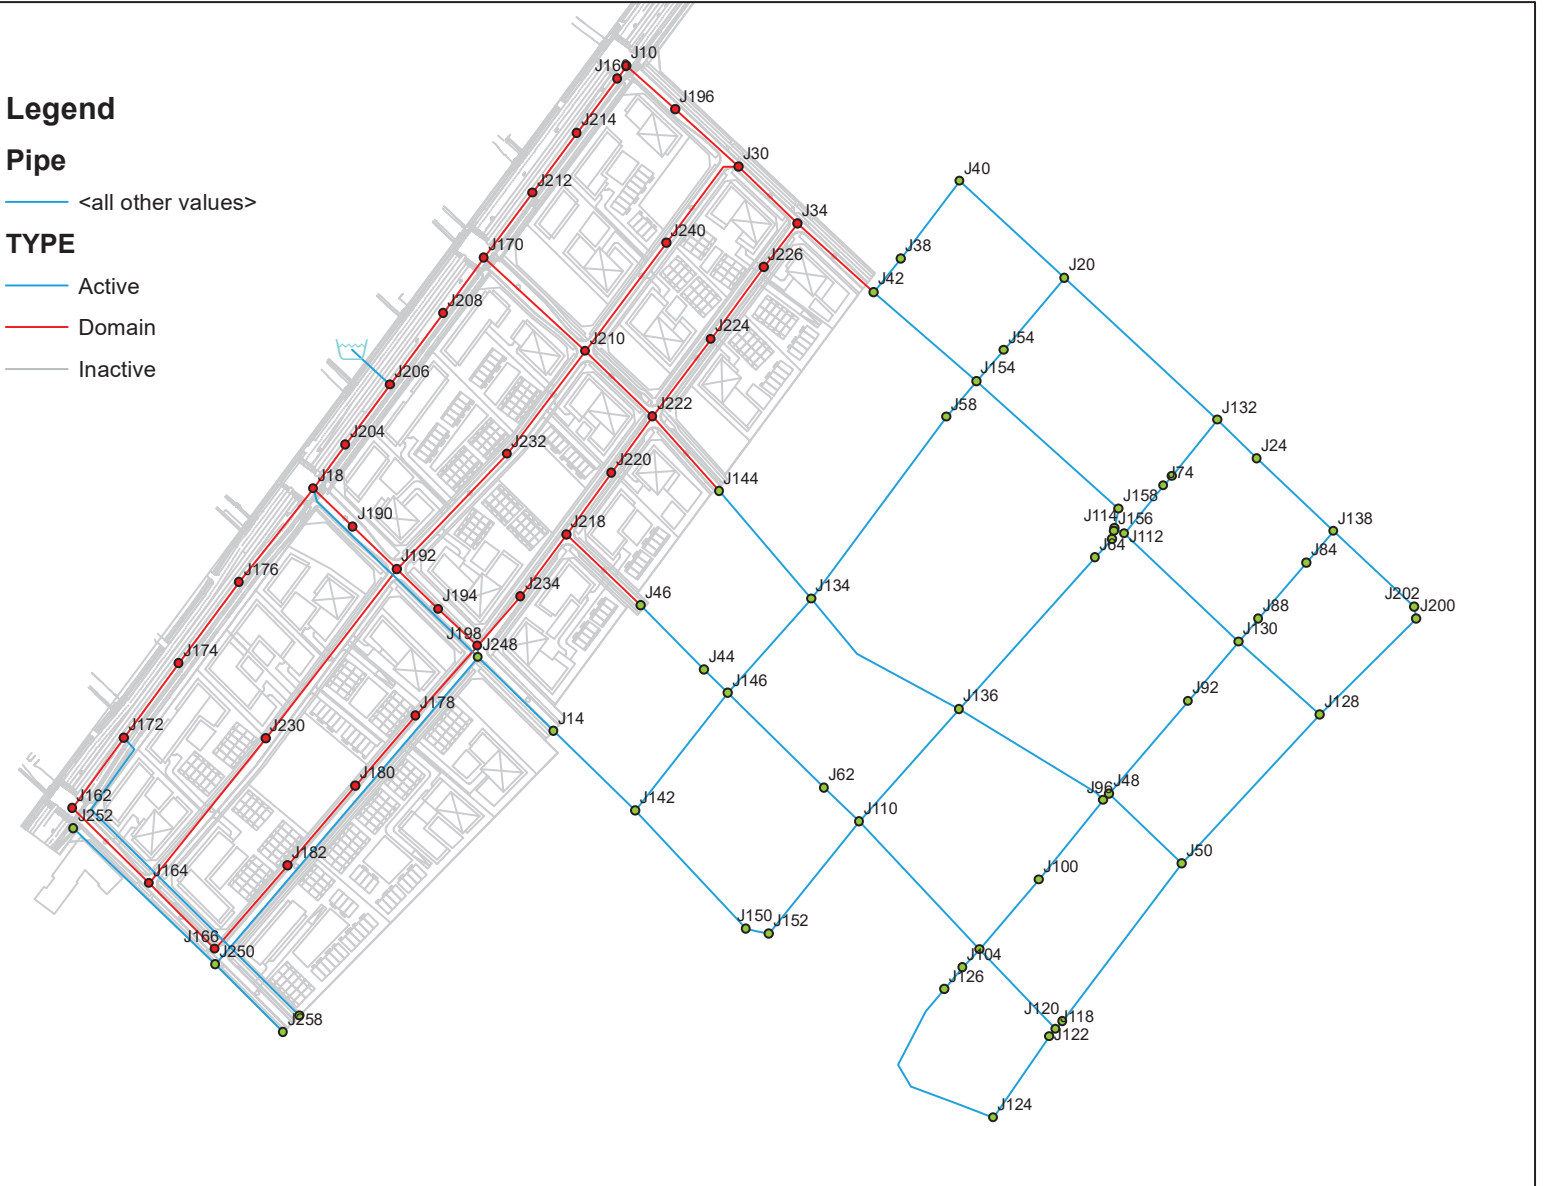



## Legend

### Pipe


— <all other values>

### TYPE

— Active

— Domain


— Inactive

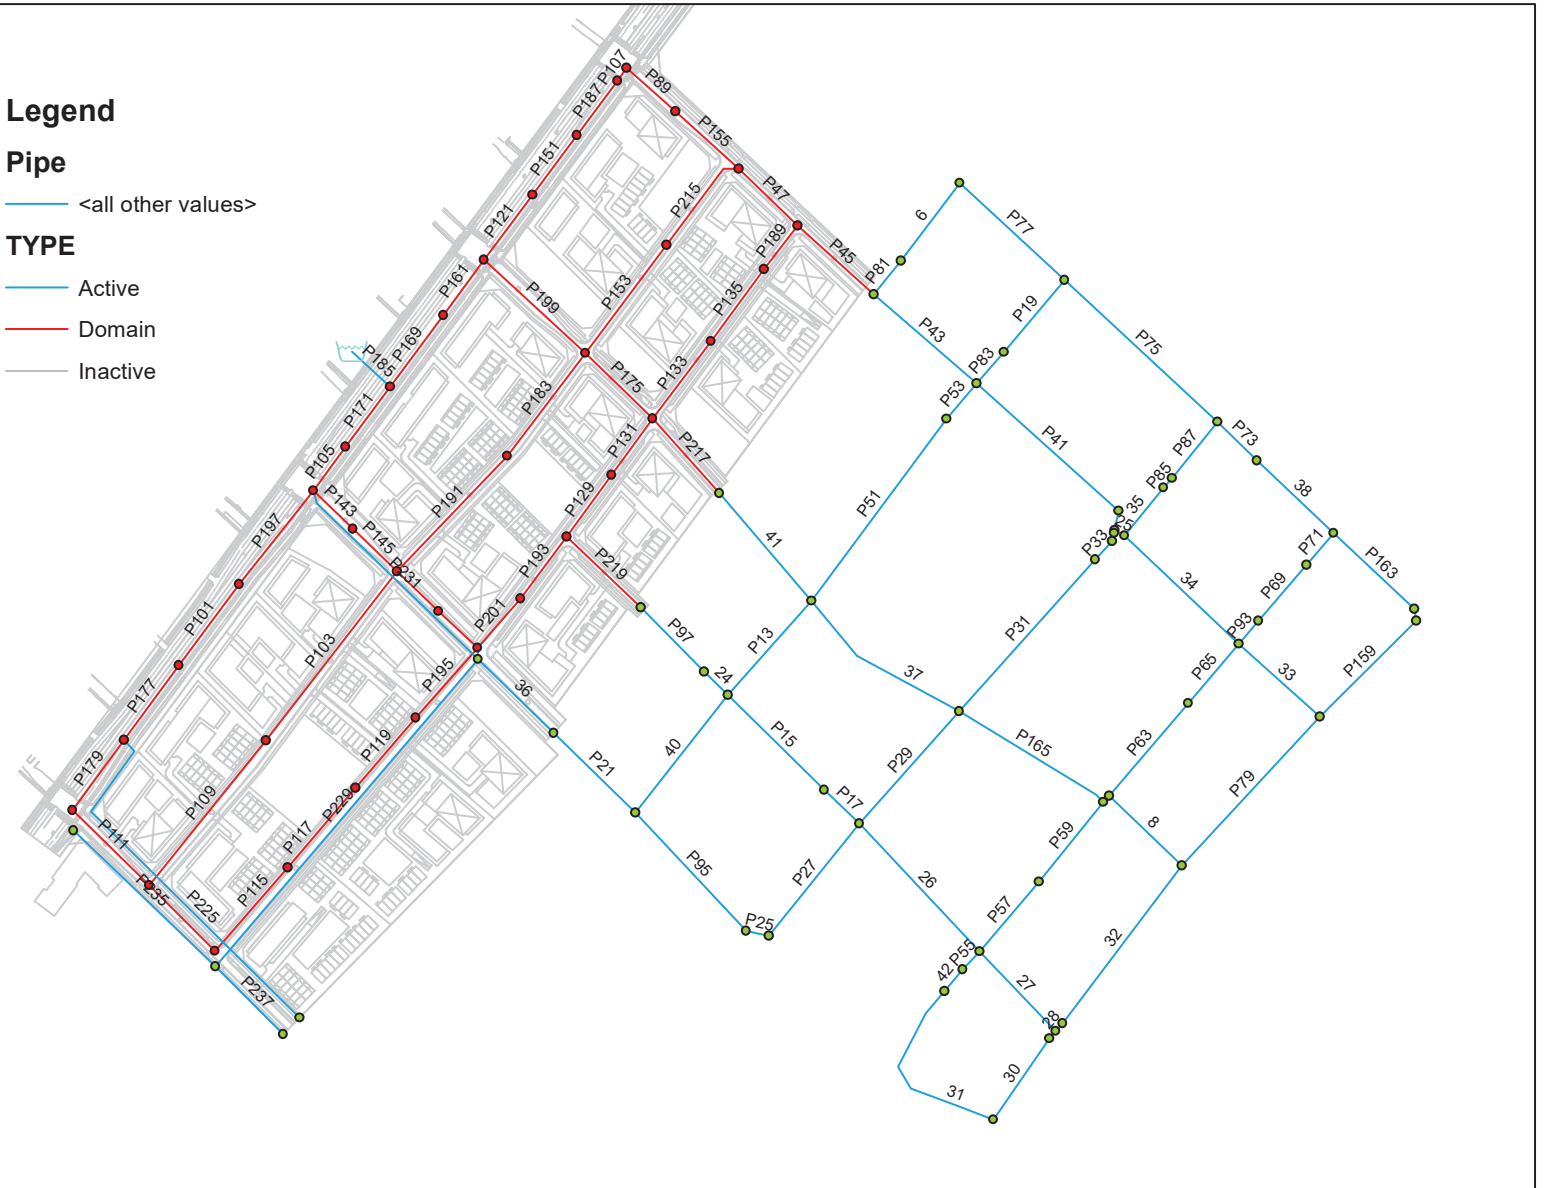

**Legend**

**Pipe  
RUN\_DIAM**

- 200
- 250
- 300
- 400
- 600
- 900

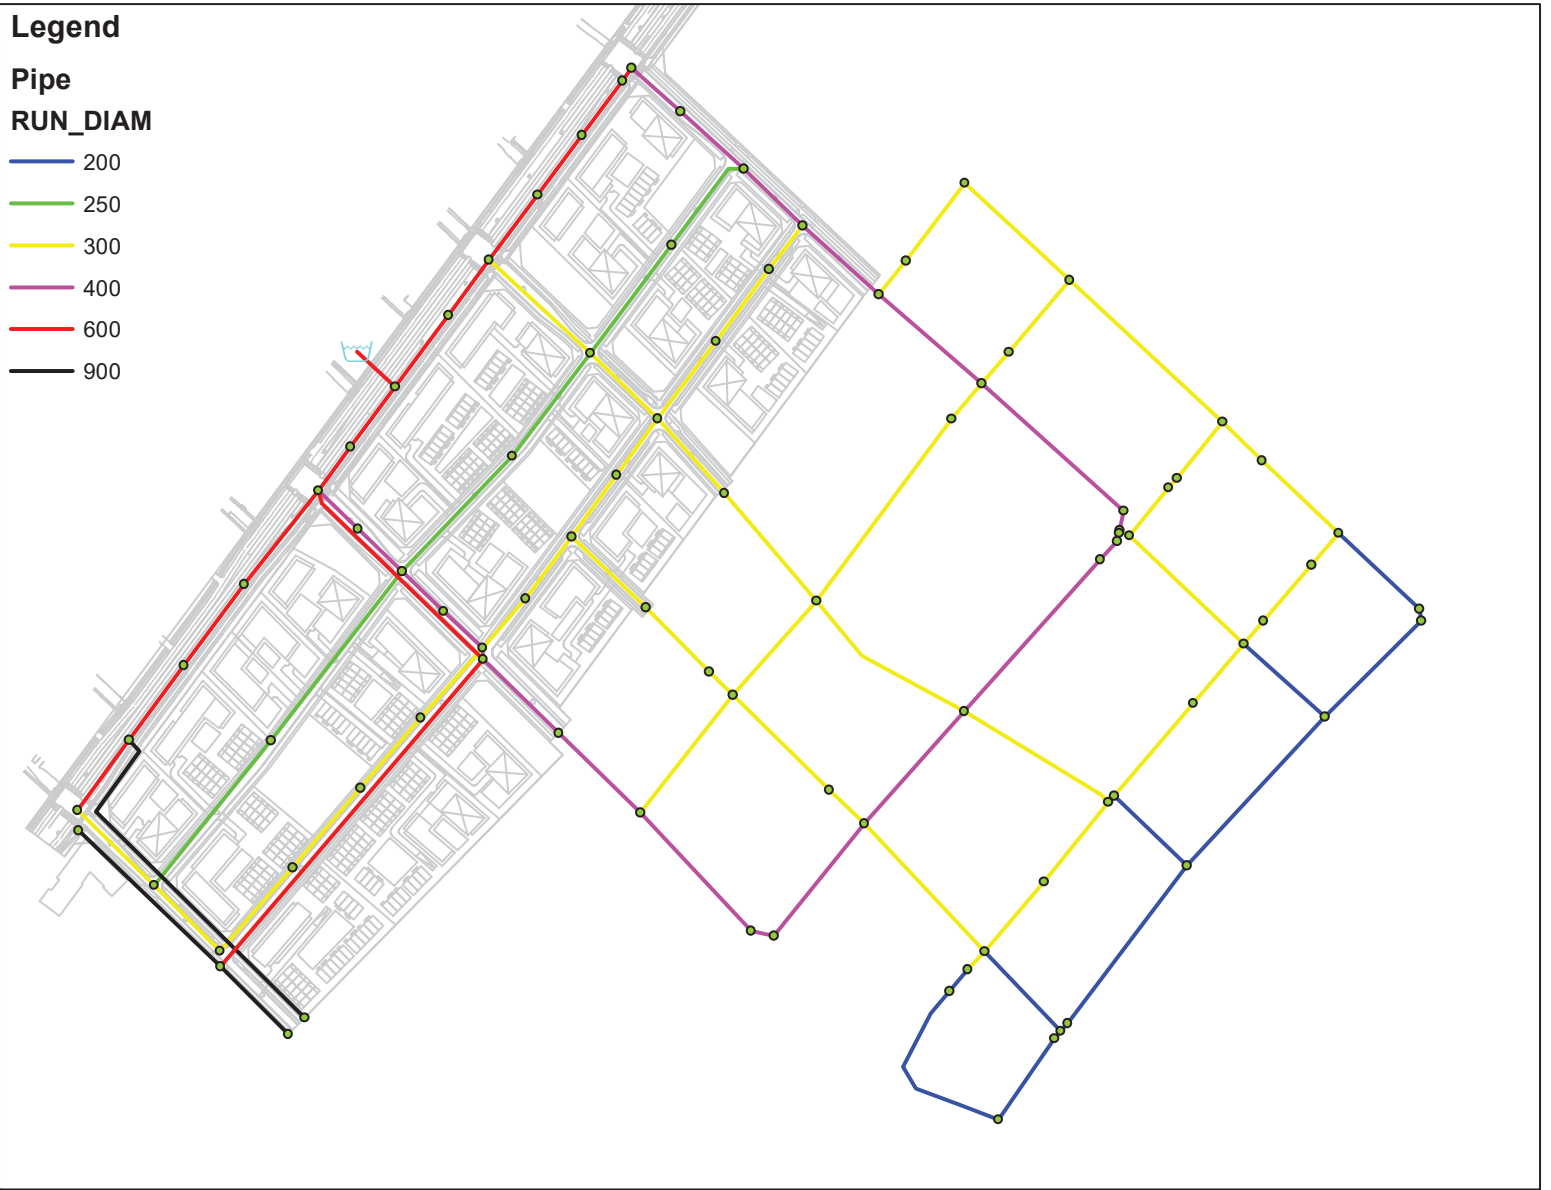

ADD - NODE

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
1	<input type="checkbox"/>	J10	0.00	84.86	144.07	84.17
2	<input type="checkbox"/>	J100	9.81	80.10	143.93	90.74
3	<input type="checkbox"/>	J104	3.76	79.92	143.93	91.00
4	<input type="checkbox"/>	J110	0.00	79.47	143.96	91.68
5	<input type="checkbox"/>	J112	0.00	81.34	143.95	89.00
6	<input type="checkbox"/>	J114	0.00	81.23	143.95	89.16
7	<input type="checkbox"/>	J116	0.00	79.95	143.93	90.96
8	<input type="checkbox"/>	J118	0.00	79.36	143.93	91.80
9	<input type="checkbox"/>	J120	0.00	78.33	143.93	93.26
10	<input type="checkbox"/>	J122	0.00	79.33	143.93	91.84
11	<input type="checkbox"/>	J124	0.00	79.44	143.93	91.68
12	<input type="checkbox"/>	J126	4.67	80.21	143.93	90.58
13	<input type="checkbox"/>	J128	1.91	81.35	143.93	88.97
14	<input type="checkbox"/>	J130	0.00	82.01	143.93	88.03
15	<input type="checkbox"/>	J132	0.00	82.11	143.94	87.89
16	<input type="checkbox"/>	J134	0.74	81.80	143.97	88.39
17	<input type="checkbox"/>	J136	0.00	79.85	143.95	91.13
18	<input type="checkbox"/>	J138	0.00	82.78	143.93	86.93
19	<input type="checkbox"/>	J14	0.00	81.75	144.03	88.53
20	<input type="checkbox"/>	J142	0.00	80.35	144.00	90.48
21	<input type="checkbox"/>	J144	0.00	83.05	144.00	86.64
22	<input type="checkbox"/>	J146	0.00	81.26	143.98	89.16
23	<input type="checkbox"/>	J150	0.00	78.92	143.98	92.48
24	<input type="checkbox"/>	J152	0.00	75.92	143.98	96.75
25	<input type="checkbox"/>	J154	0.00	82.07	143.96	87.98
26	<input type="checkbox"/>	J156	0.00	81.32	143.95	89.03
27	<input type="checkbox"/>	J158	0.00	81.44	143.95	88.86
28	<input type="checkbox"/>	J160	0.00	85.03	144.07	83.92
29	<input type="checkbox"/>	J162	0.00	83.72	144.06	85.78
30	<input type="checkbox"/>	J164	0.00	81.79	144.06	88.52
31	<input type="checkbox"/>	J166	0.00	80.85	144.05	89.85
32	<input type="checkbox"/>	J170	0.00	86.05	144.07	82.49
33	<input type="checkbox"/>	J172	4.28	84.43	144.06	84.77
34	<input type="checkbox"/>	J174	1.31	85.14	144.06	83.77
35	<input type="checkbox"/>	J176	3.15	85.60	144.06	83.11
36	<input type="checkbox"/>	J178	5.63	82.30	144.05	87.78
37	<input type="checkbox"/>	J18	0.00	86.12	144.07	82.37
38	<input type="checkbox"/>	J180	2.86	81.86	144.05	88.41
39	<input type="checkbox"/>	J182	2.79	81.31	144.05	89.19
40	<input type="checkbox"/>	J190	0.00	85.04	144.06	83.90
41	<input type="checkbox"/>	J192	0.00	84.17	144.06	85.13
42	<input type="checkbox"/>	J194	0.00	83.38	144.05	86.25
43	<input type="checkbox"/>	J196	0.00	84.10	144.05	85.22
44	<input type="checkbox"/>	J198	0.00	82.80	144.05	87.07
45	<input type="checkbox"/>	J20	10.36	82.84	143.95	86.87
46	<input type="checkbox"/>	J200	0.00	81.35	143.93	88.97
47	<input type="checkbox"/>	J202	0.00	81.35	143.93	88.97
48	<input type="checkbox"/>	J204	2.01	86.27	144.07	82.17
49	<input type="checkbox"/>	J206	2.34	86.44	144.09	81.95
50	<input type="checkbox"/>	J208	1.61	86.29	144.08	82.15

ADD - NODE

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
51	<input type="checkbox"/>	J210	1.52	85.54	144.04	83.16
52	<input type="checkbox"/>	J212	2.25	85.69	144.07	82.99
53	<input type="checkbox"/>	J214	2.16	85.28	144.07	83.57
54	<input type="checkbox"/>	J218	0.20	83.53	144.01	85.98
55	<input type="checkbox"/>	J220	4.15	83.90	144.01	85.45
56	<input type="checkbox"/>	J222	0.00	83.80	144.01	85.59
57	<input type="checkbox"/>	J224	4.15	83.31	144.01	86.29
58	<input type="checkbox"/>	J226	3.59	82.95	144.01	86.80
59	<input type="checkbox"/>	J230	0.00	82.77	144.06	87.13
60	<input type="checkbox"/>	J232	0.00	84.93	144.05	84.04
61	<input type="checkbox"/>	J234	5.43	83.18	144.03	86.50
62	<input type="checkbox"/>	J24	9.66	82.29	143.93	87.63
63	<input type="checkbox"/>	J240	0.00	84.37	144.03	84.81
64	<input type="checkbox"/>	J246	0.00	79.85	144.06	91.29
65	<input type="checkbox"/>	J248	0.00	82.80	144.05	87.07
66	<input type="checkbox"/>	J250	0.00	80.85	144.05	89.85
67	<input type="checkbox"/>	J252	0.00	83.72	144.05	85.77
68	<input type="checkbox"/>	J258	0.00	79.85	144.05	91.27
69	<input type="checkbox"/>	J30	0.00	83.41	144.03	86.17
70	<input type="checkbox"/>	J34	0.00	83.24	144.01	86.39
71	<input type="checkbox"/>	J38	0.00	82.86	143.98	86.88
72	<input type="checkbox"/>	J40	0.69	83.61	143.96	85.80
73	<input type="checkbox"/>	J42	0.00	82.93	143.98	86.79
74	<input type="checkbox"/>	J44	3.24	81.47	143.98	88.87
75	<input type="checkbox"/>	J46	0.00	82.71	144.00	87.13
76	<input type="checkbox"/>	J48	0.00	80.79	143.93	89.76
77	<input type="checkbox"/>	J50	0.00	80.75	143.93	89.82
78	<input type="checkbox"/>	J54	1.24	82.17	143.96	87.84
79	<input type="checkbox"/>	J58	3.41	82.05	143.96	88.01
80	<input type="checkbox"/>	J62	14.25	79.65	143.96	91.42
81	<input type="checkbox"/>	J64	8.79	81.10	143.95	89.35
82	<input type="checkbox"/>	J70	0.00	81.15	143.95	89.28
83	<input type="checkbox"/>	J74	7.19	81.63	143.94	88.58
84	<input type="checkbox"/>	J80	0.19	81.70	143.94	88.48
85	<input type="checkbox"/>	J84	0.70	82.46	143.93	87.39
86	<input type="checkbox"/>	J88	3.38	82.00	143.93	88.04
87	<input type="checkbox"/>	J92	8.34	81.61	143.93	88.60
88	<input type="checkbox"/>	J96	0.00	80.91	143.93	89.59

ADD - PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status
1	<input type="checkbox"/>	24	J44	J146	37.79	300.00	120.00	8.67	0.12	0.00	0.08	Open
2	<input type="checkbox"/>	25	J112	J114	11.08	300.00	120.00	-18.66	0.26	0.00	0.33	Open
3	<input type="checkbox"/>	26	J110	J116	162.84	300.00	120.00	12.36	0.17	0.03	0.16	Open
4	<input type="checkbox"/>	27	J116	J118	103.23	200.00	120.00	0.92	0.03	0.00	0.01	Open
5	<input type="checkbox"/>	28	J120	J118	17.79	200.00	120.00	0.51	0.02	0.00	0.00	Open
6	<input type="checkbox"/>	29	J118	J122	14.95	200.00	120.00	1.43	0.05	0.00	0.02	Open
7	<input type="checkbox"/>	30	J122	J124	88.59	200.00	120.00	1.43	0.05	0.00	0.02	Open
8	<input type="checkbox"/>	31	J124	J126	144.09	200.00	120.00	1.43	0.05	0.00	0.02	Open
9	<input type="checkbox"/>	32	J50	J120	146.51	200.00	120.00	0.51	0.02	0.00	0.00	Open
10	<input type="checkbox"/>	33	J130	J128	112.40	200.00	120.00	0.95	0.03	0.00	0.01	Open
11	<input type="checkbox"/>	34	J130	J112	156.59	300.00	120.00	-8.83	0.12	0.01	0.08	Open
12	<input type="checkbox"/>	35	J74	J112	79.98	300.00	120.00	-9.84	0.14	0.01	0.10	Open
13	<input type="checkbox"/>	36	J248	J14	98.08	400.00	120.00	35.18	0.28	0.03	0.27	Open
14	<input type="checkbox"/>	37	J134	J136	166.63	300.00	120.00	10.70	0.15	0.02	0.12	Open
15	<input type="checkbox"/>	38	J138	J24	110.22	300.00	120.00	-0.45	0.01	0.00	0.00	Open
16	<input type="checkbox"/>	40	J142	J146	135.17	300.00	120.00	11.28	0.16	0.02	0.13	Open
17	<input type="checkbox"/>	41	J144	J134	154.56	300.00	120.00	11.92	0.17	0.02	0.15	Open
18	<input type="checkbox"/>	42	J126	J104	40.45	200.00	120.00	-3.24	0.10	0.00	0.09	Open
19	<input type="checkbox"/>	6	J40	J38	120.78	300.00	120.00	-10.22	0.14	0.01	0.11	Open
20	<input type="checkbox"/>	8	J48	J50	91.46	200.00	120.00	1.11	0.04	0.00	0.01	Open
21	<input type="checkbox"/>	P101	J176	J174	94.00	600.00	120.00	12.69	0.04	0.00	0.01	Open
22	<input type="checkbox"/>	P103	J230	J192	198.76	250.00	110.00	1.00	0.02	0.00	0.00	Open
23	<input type="checkbox"/>	P105	J18	J204	50.72	600.00	120.00	-80.51	0.28	0.01	0.17	Open
24	<input type="checkbox"/>	P107	J160	J10	17.35	600.00	120.00	33.35	0.12	0.00	0.03	Open
25	<input type="checkbox"/>	P109	J164	J230	173.09	250.00	110.00	1.00	0.02	0.00	0.00	Open
26	<input type="checkbox"/>	P111	J162	J164	99.75	300.00	120.00	7.10	0.10	0.01	0.06	Open
27	<input type="checkbox"/>	P113	J164	J166	86.36	300.00	120.00	6.10	0.09	0.00	0.04	Open
28	<input type="checkbox"/>	P115	J166	J182	102.73	300.00	120.00	6.10	0.09	0.00	0.04	Open
29	<input type="checkbox"/>	P117	J182	J180	97.29	300.00	120.00	3.31	0.05	0.00	0.01	Open
30	<input type="checkbox"/>	P119	J180	J178	85.87	300.00	120.00	0.45	0.01	0.00	0.00	Open
31	<input type="checkbox"/>	P121	J170	J212	75.22	600.00	120.00	37.76	0.13	0.00	0.04	Open
32	<input type="checkbox"/>	P129	J218	J220	71.02	300.00	120.00	2.97	0.04	0.00	0.01	Open
33	<input type="checkbox"/>	P13	J146	J134	109.84	300.00	120.00	6.56	0.09	0.01	0.05	Open
34	<input type="checkbox"/>	P131	J220	J222	64.95	300.00	120.00	-1.18	0.02	0.00	0.00	Open
35	<input type="checkbox"/>	P133	J222	J224	89.72	300.00	120.00	4.22	0.06	0.00	0.02	Open
36	<input type="checkbox"/>	P135	J224	J226	83.02	300.00	120.00	0.07	0.00	0.00	0.00	Open
37	<input type="checkbox"/>	P143	J18	J190	61.03	400.00	120.00	17.89	0.14	0.00	0.08	Open
38	<input type="checkbox"/>	P145	J190	J192	58.87	400.00	120.00	17.89	0.14	0.00	0.08	Open
39	<input type="checkbox"/>	P147	J192	J194	53.65	400.00	120.00	14.08	0.11	0.00	0.05	Open
40	<input type="checkbox"/>	P15	J146	J62	118.80	300.00	120.00	13.39	0.19	0.02	0.18	Open
41	<input type="checkbox"/>	P151	J214	J212	69.37	600.00	120.00	-35.51	0.13	0.00	0.04	Open
42	<input type="checkbox"/>	P153	J210	J240	125.40	250.00	110.00	3.48	0.07	0.01	0.04	Open
43	<input type="checkbox"/>	P155	J196	J30	100.45	400.00	120.00	33.35	0.27	0.02	0.24	Open
44	<input type="checkbox"/>	P157	J194	J198	49.89	400.00	120.00	14.08	0.11	0.00	0.05	Open
45	<input type="checkbox"/>	P159	J128	J200	133.31	200.00	120.00	-0.37	0.01	0.00	0.00	Open
46	<input type="checkbox"/>	P161	J208	J170	63.93	600.00	120.00	55.29	0.20	0.01	0.08	Open
47	<input type="checkbox"/>	P163	J202	J138	119.12	200.00	120.00	-0.37	0.01	0.00	0.00	Open
48	<input type="checkbox"/>	P165	J136	J96	166.15	300.00	120.00	10.93	0.15	0.02	0.12	Open
49	<input type="checkbox"/>	P167	J200	J202	11.25	200.00	120.00	-0.37	0.01	0.00	0.00	Open
50	<input type="checkbox"/>	P169	J206	J208	82.80	600.00	120.00	56.90	0.20	0.01	0.09	Open
51	<input type="checkbox"/>	P17	J62	J110	47.94	300.00	120.00	-0.86	0.01	0.00	0.00	Open
52	<input type="checkbox"/>	P171	J206	J204	69.37	600.00	120.00	82.52	0.29	0.01	0.18	Open
53	<input type="checkbox"/>	P175	J210	J222	86.86	300.00	120.00	17.33	0.25	0.03	0.29	Open
54	<input type="checkbox"/>	P177	J172	J174	85.77	600.00	120.00	-11.38	0.04	0.00	0.00	Open
55	<input type="checkbox"/>	P179	J162	J172	81.18	600.00	120.00	-7.10	0.03	0.00	0.00	Open

ADD - PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status
56	<input type="checkbox"/>	P183	J232	J210	120.26	250.00	110.00	4.81	0.10	0.01	0.08	Open
57	<input type="checkbox"/>	P185	RES9002	J206	48.21	600.00	120.00	141.76	0.50	0.02	0.49	Open
58	<input type="checkbox"/>	P187	J214	J160	62.93	600.00	120.00	33.35	0.12	0.00	0.03	Open
59	<input type="checkbox"/>	P189	J226	J34	51.07	300.00	120.00	-3.52	0.05	0.00	0.02	Open
60	<input type="checkbox"/>	P19	J20	J54	117.59	300.00	120.00	-8.49	0.12	0.01	0.08	Open
61	<input type="checkbox"/>	P191	J192	J232	147.89	250.00	110.00	4.81	0.10	0.01	0.08	Open
62	<input type="checkbox"/>	P193	J218	J234	71.16	300.00	120.00	-15.08	0.21	0.02	0.22	Open
63	<input type="checkbox"/>	P195	J178	J198	86.78	300.00	120.00	-5.18	0.07	0.00	0.03	Open
64	<input type="checkbox"/>	P197	J176	J18	110.72	600.00	120.00	-15.84	0.06	0.00	0.01	Open
65	<input type="checkbox"/>	P199	J170	J210	128.03	300.00	120.00	17.52	0.25	0.04	0.30	Open
66	<input type="checkbox"/>	P201	J234	J198	61.08	300.00	120.00	-20.51	0.29	0.02	0.40	Open
67	<input type="checkbox"/>	P21	J14	J142	106.09	400.00	120.00	35.18	0.28	0.03	0.27	Open
68	<input type="checkbox"/>	P215	J240	J30	102.65	250.00	110.00	3.48	0.07	0.00	0.04	Open
69	<input type="checkbox"/>	P217	J222	J144	93.00	300.00	120.00	11.92	0.17	0.01	0.15	Open
70	<input type="checkbox"/>	P219	J218	J46	95.10	300.00	120.00	11.91	0.17	0.01	0.14	Open
71	<input type="checkbox"/>	P225	J246	J172	356.21	900.00	130.00	0.00	0.00	0.00	0.00	Open
72	<input type="checkbox"/>	P229	J250	J248	375.46	600.00	120.00	0.00	0.00	0.00	0.00	Open
73	<input type="checkbox"/>	P231	J248	J18	220.67	600.00	120.00	-46.78	0.17	0.01	0.06	Open
74	<input type="checkbox"/>	P235	J252	J250	182.26	900.00	130.00	0.00	0.00	0.00	0.00	Open
75	<input type="checkbox"/>	P237	J250	J258	89.25	900.00	130.00	0.00	0.00	0.00	0.00	Open
76	<input type="checkbox"/>	P239	J248	J198	10.64	400.00	120.00	11.60	0.09	0.00	0.03	Open
77	<input type="checkbox"/>	P25	J150	J152	12.66	400.00	120.00	23.91	0.19	0.00	0.13	Open
78	<input type="checkbox"/>	P27	J152	J110	132.14	400.00	120.00	23.91	0.19	0.02	0.13	Open
79	<input type="checkbox"/>	P29	J110	J136	128.24	400.00	120.00	10.68	0.09	0.00	0.03	Open
80	<input type="checkbox"/>	P31	J136	J64	180.81	400.00	120.00	10.45	0.08	0.01	0.03	Open
81	<input type="checkbox"/>	P33	J64	J70	14.43	400.00	120.00	1.66	0.01	0.00	0.00	Open
82	<input type="checkbox"/>	P35	J70	J156	34.75	400.00	120.00	1.66	0.01	0.00	0.00	Open
83	<input type="checkbox"/>	P37	J156	J114	6.20	400.00	120.00	1.66	0.01	0.00	0.00	Open
84	<input type="checkbox"/>	P39	J114	J158	17.17	400.00	120.00	-17.00	0.14	0.00	0.07	Open
85	<input type="checkbox"/>	P41	J154	J158	153.05	400.00	120.00	17.00	0.14	0.01	0.07	Open
86	<input type="checkbox"/>	P43	J42	J154	156.43	400.00	120.00	23.10	0.18	0.02	0.12	Open
87	<input type="checkbox"/>	P45	J34	J42	120.68	400.00	120.00	33.31	0.27	0.03	0.24	Open
88	<input type="checkbox"/>	P47	J30	J34	57.66	400.00	120.00	36.83	0.29	0.02	0.29	Open
89	<input type="checkbox"/>	P51	J58	J134	228.31	300.00	120.00	-7.05	0.10	0.01	0.05	Open
90	<input type="checkbox"/>	P53	J154	J58	39.98	300.00	120.00	-3.64	0.05	0.00	0.02	Open
91	<input type="checkbox"/>	P55	J104	J116	41.94	300.00	120.00	-7.00	0.10	0.00	0.05	Open
92	<input type="checkbox"/>	P57	J116	J100	77.25	300.00	120.00	4.44	0.06	0.00	0.02	Open
93	<input type="checkbox"/>	P59	J100	J96	84.08	300.00	120.00	-5.37	0.08	0.00	0.03	Open
94	<input type="checkbox"/>	P61	J96	J48	6.45	300.00	120.00	5.57	0.08	0.00	0.03	Open
95	<input type="checkbox"/>	P63	J48	J92	120.82	300.00	120.00	4.46	0.06	0.00	0.02	Open
96	<input type="checkbox"/>	P65	J92	J130	97.59	300.00	120.00	-3.88	0.05	0.00	0.02	Open
97	<input type="checkbox"/>	P69	J84	J88	69.90	300.00	120.00	-0.62	0.01	0.00	0.00	Open
98	<input type="checkbox"/>	P71	J138	J84	53.85	300.00	120.00	0.08	0.00	0.00	0.00	Open
99	<input type="checkbox"/>	P73	J132	J24	44.79	300.00	120.00	10.11	0.14	0.00	0.11	Open
100	<input type="checkbox"/>	P75	J20	J132	172.60	300.00	120.00	7.66	0.11	0.01	0.06	Open
101	<input type="checkbox"/>	P77	J40	J20	159.11	300.00	120.00	9.53	0.13	0.02	0.10	Open
102	<input type="checkbox"/>	P79	J50	J128	234.05	200.00	120.00	0.60	0.02	0.00	0.00	Open
103	<input type="checkbox"/>	P81	J38	J42	35.30	300.00	120.00	-10.22	0.14	0.00	0.11	Open
104	<input type="checkbox"/>	P83	J54	J154	41.53	300.00	120.00	-9.73	0.14	0.00	0.10	Open
105	<input type="checkbox"/>	P85	J80	J74	13.52	300.00	120.00	-2.65	0.04	0.00	0.01	Open
106	<input type="checkbox"/>	P87	J132	J80	74.26	300.00	120.00	-2.46	0.03	0.00	0.01	Open
107	<input type="checkbox"/>	P89	J10	J196	62.59	400.00	120.00	33.35	0.27	0.02	0.24	Open
108	<input type="checkbox"/>	P93	J88	J130	30.88	300.00	120.00	-4.00	0.06	0.00	0.02	Open
109	<input type="checkbox"/>	P95	J142	J150	156.08	400.00	120.00	23.91	0.19	0.02	0.13	Open
110	<input type="checkbox"/>	P97	J46	J44	100.05	300.00	120.00	11.91	0.17	0.01	0.14	Open

MDD - NODE

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
1	<input type="checkbox"/>	J10	0.00	84.86	143.97	84.02
2	<input type="checkbox"/>	J100	19.44	80.10	143.54	90.19
3	<input type="checkbox"/>	J104	7.53	79.92	143.54	90.44
4	<input type="checkbox"/>	J110	0.00	79.47	143.63	91.21
5	<input type="checkbox"/>	J112	0.00	81.34	143.60	88.50
6	<input type="checkbox"/>	J114	0.00	81.23	143.61	88.67
7	<input type="checkbox"/>	J116	0.00	79.95	143.55	90.41
8	<input type="checkbox"/>	J118	0.00	79.36	143.55	91.25
9	<input type="checkbox"/>	J120	0.00	78.33	143.55	92.71
10	<input type="checkbox"/>	J122	0.00	79.33	143.55	91.29
11	<input type="checkbox"/>	J124	0.00	79.44	143.54	91.12
12	<input type="checkbox"/>	J126	9.20	80.21	143.53	90.01
13	<input type="checkbox"/>	J128	2.67	81.35	143.55	88.43
14	<input type="checkbox"/>	J130	0.00	82.01	143.56	87.50
15	<input type="checkbox"/>	J132	0.00	82.11	143.57	87.38
16	<input type="checkbox"/>	J134	1.04	81.80	143.68	87.97
17	<input type="checkbox"/>	J136	0.00	79.85	143.62	90.65
18	<input type="checkbox"/>	J138	0.00	82.78	143.56	86.40
19	<input type="checkbox"/>	J14	0.00	81.75	143.84	88.27
20	<input type="checkbox"/>	J142	0.00	80.35	143.75	90.13
21	<input type="checkbox"/>	J144	0.00	83.05	143.75	86.29
22	<input type="checkbox"/>	J146	0.00	81.26	143.70	88.76
23	<input type="checkbox"/>	J150	0.00	78.92	143.69	92.07
24	<input type="checkbox"/>	J152	0.00	75.92	143.68	96.33
25	<input type="checkbox"/>	J154	0.00	82.07	143.64	87.53
26	<input type="checkbox"/>	J156	0.00	81.32	143.61	88.55
27	<input type="checkbox"/>	J158	0.00	81.44	143.61	88.38
28	<input type="checkbox"/>	J160	0.00	85.03	143.97	83.79
29	<input type="checkbox"/>	J162	0.00	83.72	143.96	85.63
30	<input type="checkbox"/>	J164	0.00	81.79	143.94	88.35
31	<input type="checkbox"/>	J166	0.00	80.85	143.93	89.67
32	<input type="checkbox"/>	J170	0.00	86.05	143.99	82.37
33	<input type="checkbox"/>	J172	8.57	84.43	143.96	84.63
34	<input type="checkbox"/>	J174	2.61	85.14	143.96	83.62
35	<input type="checkbox"/>	J176	6.29	85.60	143.96	82.97
36	<input type="checkbox"/>	J178	11.26	82.30	143.91	87.58
37	<input type="checkbox"/>	J18	0.00	86.12	143.97	82.23
38	<input type="checkbox"/>	J180	5.72	81.86	143.91	88.21
39	<input type="checkbox"/>	J182	5.57	81.31	143.91	89.00
40	<input type="checkbox"/>	J190	0.00	85.04	143.95	83.75
41	<input type="checkbox"/>	J192	0.00	84.17	143.94	84.96
42	<input type="checkbox"/>	J194	0.00	83.38	143.93	86.07
43	<input type="checkbox"/>	J196	0.00	84.10	143.92	85.04
44	<input type="checkbox"/>	J198	0.00	82.80	143.92	86.89
45	<input type="checkbox"/>	J20	14.50	82.84	143.61	86.40
46	<input type="checkbox"/>	J200	0.00	81.35	143.56	88.43
47	<input type="checkbox"/>	J202	0.00	81.35	143.56	88.43
48	<input type="checkbox"/>	J204	4.02	86.27	143.99	82.06
49	<input type="checkbox"/>	J206	4.67	86.44	144.03	81.87
50	<input type="checkbox"/>	J208	3.22	86.29	144.01	82.05

MDD - NODE

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
51	<input type="checkbox"/>	J210	3.03	85.54	143.87	82.92
52	<input type="checkbox"/>	J212	4.49	85.69	143.98	82.87
53	<input type="checkbox"/>	J214	4.31	85.28	143.97	83.44
54	<input type="checkbox"/>	J218	0.41	83.53	143.79	85.67
55	<input type="checkbox"/>	J220	8.30	83.90	143.79	85.14
56	<input type="checkbox"/>	J222	0.00	83.80	143.79	85.28
57	<input type="checkbox"/>	J224	8.30	83.31	143.79	85.97
58	<input type="checkbox"/>	J226	7.18	82.95	143.79	86.48
59	<input type="checkbox"/>	J230	0.00	82.77	143.94	86.96
60	<input type="checkbox"/>	J232	0.00	84.93	143.90	83.83
61	<input type="checkbox"/>	J234	10.87	83.18	143.84	86.24
62	<input type="checkbox"/>	J24	13.52	82.29	143.56	87.10
63	<input type="checkbox"/>	J240	0.00	84.37	143.86	84.57
64	<input type="checkbox"/>	J246	0.00	79.85	143.96	91.14
65	<input type="checkbox"/>	J248	0.00	82.80	143.92	86.89
66	<input type="checkbox"/>	J250	0.00	80.85	143.92	89.66
67	<input type="checkbox"/>	J252	0.00	83.72	143.92	85.58
68	<input type="checkbox"/>	J258	0.00	79.85	143.92	91.08
69	<input type="checkbox"/>	J30	0.00	83.41	143.84	85.91
70	<input type="checkbox"/>	J34	0.00	83.24	143.79	86.08
71	<input type="checkbox"/>	J38	0.00	82.86	143.69	86.48
72	<input type="checkbox"/>	J40	0.97	83.61	143.66	85.36
73	<input type="checkbox"/>	J42	0.00	82.93	143.70	86.40
74	<input type="checkbox"/>	J44	6.48	81.47	143.71	88.47
75	<input type="checkbox"/>	J46	0.00	82.71	143.75	86.77
76	<input type="checkbox"/>	J48	0.00	80.79	143.56	89.23
77	<input type="checkbox"/>	J50	0.00	80.75	143.55	89.28
78	<input type="checkbox"/>	J54	2.49	82.17	143.63	87.38
79	<input type="checkbox"/>	J58	6.82	82.05	143.65	87.56
80	<input type="checkbox"/>	J62	28.29	79.65	143.63	90.95
81	<input type="checkbox"/>	J64	17.58	81.10	143.61	88.86
82	<input type="checkbox"/>	J70	0.00	81.15	143.61	88.79
83	<input type="checkbox"/>	J74	14.39	81.63	143.57	88.06
84	<input type="checkbox"/>	J80	0.27	81.70	143.57	87.96
85	<input type="checkbox"/>	J84	0.98	82.46	143.56	86.86
86	<input type="checkbox"/>	J88	6.59	82.00	143.56	87.51
87	<input type="checkbox"/>	J92	16.37	81.61	143.55	88.05
88	<input type="checkbox"/>	J96	0.00	80.91	143.56	89.06



MDD - PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status
1	<input type="checkbox"/>	24	J44	J146	37.79	300.00	120.00	15.50	0.22	0.01	0.24	Open
2	<input type="checkbox"/>	25	J112	J114	11.08	300.00	120.00	-32.52	0.46	0.01	0.93	Open
3	<input type="checkbox"/>	26	J110	J116	162.84	300.00	120.00	22.91	0.32	0.08	0.49	Open
4	<input type="checkbox"/>	27	J116	J118	103.23	200.00	120.00	1.16	0.04	0.00	0.01	Open
5	<input type="checkbox"/>	28	J120	J118	17.79	200.00	120.00	1.78	0.06	0.00	0.03	Open
6	<input type="checkbox"/>	29	J118	J122	14.95	200.00	120.00	2.94	0.09	0.00	0.08	Open
7	<input type="checkbox"/>	30	J122	J124	88.59	200.00	120.00	2.94	0.09	0.01	0.08	Open
8	<input type="checkbox"/>	31	J124	J126	144.09	200.00	120.00	2.94	0.09	0.01	0.08	Open
9	<input type="checkbox"/>	32	J50	J120	146.51	200.00	120.00	1.78	0.06	0.00	0.03	Open
10	<input type="checkbox"/>	33	J130	J128	112.40	200.00	120.00	1.83	0.06	0.00	0.03	Open
11	<input type="checkbox"/>	34	J130	J112	156.59	300.00	120.00	-15.74	0.22	0.04	0.24	Open
12	<input type="checkbox"/>	35	J74	J112	79.98	300.00	120.00	-16.78	0.24	0.02	0.27	Open
13	<input type="checkbox"/>	36	J248	J14	98.08	400.00	120.00	65.12	0.52	0.08	0.83	Open
14	<input type="checkbox"/>	37	J134	J136	166.63	300.00	120.00	19.83	0.28	0.06	0.37	Open
15	<input type="checkbox"/>	38	J138	J24	110.22	300.00	120.00	-4.05	0.06	0.00	0.02	Open
16	<input type="checkbox"/>	40	J142	J146	135.17	300.00	120.00	20.84	0.29	0.06	0.41	Open
17	<input type="checkbox"/>	41	J144	J134	154.56	300.00	120.00	21.83	0.31	0.07	0.44	Open
18	<input type="checkbox"/>	42	J126	J104	40.45	200.00	120.00	-6.26	0.20	0.01	0.32	Open
19	<input type="checkbox"/>	6	J40	J38	120.78	300.00	120.00	-17.65	0.25	0.04	0.30	Open
20	<input type="checkbox"/>	8	J48	J50	91.46	200.00	120.00	1.45	0.05	0.00	0.02	Open
21	<input type="checkbox"/>	P101	J176	J174	94.00	600.00	120.00	24.66	0.09	0.00	0.02	Open
22	<input type="checkbox"/>	P103	J230	J192	198.76	250.00	110.00	1.72	0.04	0.00	0.01	Open
23	<input type="checkbox"/>	P105	J18	J204	50.72	600.00	120.00	-152.47	0.54	0.03	0.56	Open
24	<input type="checkbox"/>	P107	J160	J10	17.35	600.00	120.00	61.98	0.22	0.00	0.11	Open
25	<input type="checkbox"/>	P109	J164	J230	173.09	250.00	110.00	1.72	0.04	0.00	0.01	Open
26	<input type="checkbox"/>	P111	J162	J164	99.75	300.00	120.00	13.48	0.19	0.02	0.18	Open
27	<input type="checkbox"/>	P113	J164	J166	86.36	300.00	120.00	11.76	0.17	0.01	0.14	Open
28	<input type="checkbox"/>	P115	J166	J182	102.73	300.00	120.00	11.76	0.17	0.01	0.14	Open
29	<input type="checkbox"/>	P117	J182	J180	97.29	300.00	120.00	6.19	0.09	0.00	0.04	Open
30	<input type="checkbox"/>	P119	J180	J178	85.87	300.00	120.00	0.47	0.01	0.00	0.00	Open
31	<input type="checkbox"/>	P121	J170	J212	75.22	600.00	120.00	70.78	0.25	0.01	0.13	Open
32	<input type="checkbox"/>	P129	J218	J220	71.02	300.00	120.00	5.20	0.07	0.00	0.03	Open
33	<input type="checkbox"/>	P13	J146	J134	109.84	300.00	120.00	11.42	0.16	0.01	0.13	Open
34	<input type="checkbox"/>	P131	J220	J222	64.95	300.00	120.00	-3.10	0.04	0.00	0.01	Open
35	<input type="checkbox"/>	P133	J222	J224	89.72	300.00	120.00	7.37	0.10	0.01	0.06	Open
36	<input type="checkbox"/>	P135	J224	J226	83.02	300.00	120.00	-0.93	0.01	0.00	0.00	Open
37	<input type="checkbox"/>	P143	J18	J190	61.03	400.00	120.00	33.64	0.27	0.01	0.24	Open
38	<input type="checkbox"/>	P145	J190	J192	58.87	400.00	120.00	33.64	0.27	0.01	0.24	Open
39	<input type="checkbox"/>	P147	J192	J194	53.65	400.00	120.00	26.49	0.21	0.01	0.16	Open
40	<input type="checkbox"/>	P15	J146	J62	118.80	300.00	120.00	24.93	0.35	0.07	0.57	Open
41	<input type="checkbox"/>	P151	J214	J212	69.37	600.00	120.00	-66.29	0.23	0.01	0.12	Open
42	<input type="checkbox"/>	P153	J210	J240	125.40	250.00	110.00	6.32	0.13	0.02	0.13	Open
43	<input type="checkbox"/>	P155	J196	J30	100.45	400.00	120.00	61.98	0.49	0.08	0.76	Open
44	<input type="checkbox"/>	P157	J194	J198	49.89	400.00	120.00	26.49	0.21	0.01	0.16	Open
45	<input type="checkbox"/>	P159	J128	J200	133.31	200.00	120.00	-1.18	0.04	0.00	0.01	Open
46	<input type="checkbox"/>	P161	J208	J170	63.93	600.00	120.00	103.57	0.37	0.02	0.27	Open
47	<input type="checkbox"/>	P163	J202	J138	119.12	200.00	120.00	-1.18	0.04	0.00	0.01	Open
48	<input type="checkbox"/>	P165	J136	J96	166.15	300.00	120.00	20.08	0.28	0.06	0.38	Open
49	<input type="checkbox"/>	P167	J200	J202	11.25	200.00	120.00	-1.18	0.04	0.00	0.01	Open
50	<input type="checkbox"/>	P169	J206	J208	82.80	600.00	120.00	106.79	0.38	0.02	0.29	Open
51	<input type="checkbox"/>	P17	J62	J110	47.94	300.00	120.00	-3.36	0.05	0.00	0.01	Open
52	<input type="checkbox"/>	P171	J206	J204	69.37	600.00	120.00	156.49	0.55	0.04	0.58	Open
53	<input type="checkbox"/>	P175	J210	J222	86.86	300.00	120.00	32.30	0.46	0.08	0.92	Open
54	<input type="checkbox"/>	P177	J172	J174	85.77	600.00	120.00	-22.05	0.08	0.00	0.02	Open
55	<input type="checkbox"/>	P179	J162	J172	81.18	600.00	120.00	-13.48	0.05	0.00	0.01	Open

## MDD - PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status
56	<input type="checkbox"/>	P183	J232	J210	120.26	250.00	110.00	8.87	0.18	0.03	0.24	Open
57	<input type="checkbox"/>	P185	RES9002	J206	48.21	600.00	120.00	267.95	0.95	0.08	1.58	Open
58	<input type="checkbox"/>	P187	J214	J160	62.93	600.00	120.00	61.98	0.22	0.01	0.11	Open
59	<input type="checkbox"/>	P189	J226	J34	51.07	300.00	120.00	-8.11	0.11	0.00	0.07	Open
60	<input type="checkbox"/>	P19	J20	J54	117.59	300.00	120.00	-13.26	0.19	0.02	0.18	Open
61	<input type="checkbox"/>	P191	J192	J232	147.89	250.00	110.00	8.87	0.18	0.04	0.24	Open
62	<input type="checkbox"/>	P193	J218	J234	71.16	300.00	120.00	-27.59	0.39	0.05	0.69	Open
63	<input type="checkbox"/>	P195	J178	J198	86.78	300.00	120.00	-10.79	0.15	0.01	0.12	Open
64	<input type="checkbox"/>	P197	J176	J18	110.72	600.00	120.00	-30.95	0.11	0.00	0.03	Open
65	<input type="checkbox"/>	P199	J170	J210	128.03	300.00	120.00	32.79	0.46	0.12	0.95	Open
66	<input type="checkbox"/>	P201	J234	J198	61.08	300.00	120.00	-38.46	0.54	0.08	1.27	Open
67	<input type="checkbox"/>	P21	J14	J142	106.09	400.00	120.00	65.12	0.52	0.09	0.83	Open
68	<input type="checkbox"/>	P215	J240	J30	102.65	250.00	110.00	6.32	0.13	0.01	0.13	Open
69	<input type="checkbox"/>	P217	J222	J144	93.00	300.00	120.00	21.83	0.31	0.04	0.44	Open
70	<input type="checkbox"/>	P219	J218	J46	95.10	300.00	120.00	21.98	0.31	0.04	0.45	Open
71	<input type="checkbox"/>	P225	J246	J172	356.21	900.00	130.00	0.00	0.00	0.00	0.00	Open
72	<input type="checkbox"/>	P229	J250	J248	375.46	600.00	120.00	0.00	0.00	0.00	0.00	Open
73	<input type="checkbox"/>	P231	J248	J18	220.67	600.00	120.00	-87.88	0.31	0.04	0.20	Open
74	<input type="checkbox"/>	P235	J252	J250	182.26	900.00	130.00	0.00	0.00	0.00	0.00	Open
75	<input type="checkbox"/>	P237	J250	J258	89.25	900.00	130.00	0.00	0.00	0.00	0.00	Open
76	<input type="checkbox"/>	P239	J248	J198	10.64	400.00	120.00	22.76	0.18	0.00	0.12	Open
77	<input type="checkbox"/>	P25	J150	J152	12.66	400.00	120.00	44.27	0.35	0.01	0.41	Open
78	<input type="checkbox"/>	P27	J152	J110	132.14	400.00	120.00	44.27	0.35	0.05	0.41	Open
79	<input type="checkbox"/>	P29	J110	J136	128.24	400.00	120.00	18.01	0.14	0.01	0.08	Open
80	<input type="checkbox"/>	P31	J136	J64	180.81	400.00	120.00	17.76	0.14	0.01	0.07	Open
81	<input type="checkbox"/>	P33	J64	J70	14.43	400.00	120.00	0.18	0.00	0.00	0.00	Open
82	<input type="checkbox"/>	P35	J70	J156	34.75	400.00	120.00	0.18	0.00	0.00	0.00	Open
83	<input type="checkbox"/>	P37	J156	J114	6.20	400.00	120.00	0.18	0.00	0.00	0.00	Open
84	<input type="checkbox"/>	P39	J114	J158	17.17	400.00	120.00	-32.35	0.26	0.00	0.23	Open
85	<input type="checkbox"/>	P41	J154	J158	153.05	400.00	120.00	32.35	0.26	0.03	0.23	Open
86	<input type="checkbox"/>	P43	J42	J154	156.43	400.00	120.00	42.54	0.34	0.06	0.38	Open
87	<input type="checkbox"/>	P45	J34	J42	120.68	400.00	120.00	60.19	0.48	0.09	0.72	Open
88	<input type="checkbox"/>	P47	J30	J34	57.66	400.00	120.00	68.31	0.54	0.05	0.91	Open
89	<input type="checkbox"/>	P51	J58	J134	228.31	300.00	120.00	-12.38	0.18	0.04	0.16	Open
90	<input type="checkbox"/>	P53	J154	J58	39.98	300.00	120.00	-5.56	0.08	0.00	0.04	Open
91	<input type="checkbox"/>	P55	J104	J116	41.94	300.00	120.00	-13.79	0.20	0.01	0.19	Open
92	<input type="checkbox"/>	P57	J116	J100	77.25	300.00	120.00	7.96	0.11	0.01	0.07	Open
93	<input type="checkbox"/>	P59	J100	J96	84.08	300.00	120.00	-11.48	0.16	0.01	0.14	Open
94	<input type="checkbox"/>	P61	J96	J48	6.45	300.00	120.00	8.60	0.12	0.00	0.08	Open
95	<input type="checkbox"/>	P63	J48	J92	120.82	300.00	120.00	7.15	0.10	0.01	0.06	Open
96	<input type="checkbox"/>	P65	J92	J130	97.59	300.00	120.00	-9.22	0.13	0.01	0.09	Open
97	<input type="checkbox"/>	P69	J84	J88	69.90	300.00	120.00	1.90	0.03	0.00	0.00	Open
98	<input type="checkbox"/>	P71	J138	J84	53.85	300.00	120.00	2.88	0.04	0.00	0.01	Open
99	<input type="checkbox"/>	P73	J132	J24	44.79	300.00	120.00	17.57	0.25	0.01	0.30	Open
100	<input type="checkbox"/>	P75	J20	J132	172.60	300.00	120.00	15.45	0.22	0.04	0.23	Open
101	<input type="checkbox"/>	P77	J40	J20	159.11	300.00	120.00	16.68	0.24	0.04	0.27	Open
102	<input type="checkbox"/>	P79	J50	J128	234.05	200.00	120.00	-0.33	0.01	0.00	0.00	Open
103	<input type="checkbox"/>	P81	J38	J42	35.30	300.00	120.00	-17.65	0.25	0.01	0.30	Open
104	<input type="checkbox"/>	P83	J54	J154	41.53	300.00	120.00	-15.75	0.22	0.01	0.24	Open
105	<input type="checkbox"/>	P85	J80	J74	13.52	300.00	120.00	-2.39	0.03	0.00	0.01	Open
106	<input type="checkbox"/>	P87	J132	J80	74.26	300.00	120.00	-2.12	0.03	0.00	0.01	Open
107	<input type="checkbox"/>	P89	J10	J196	62.59	400.00	120.00	61.98	0.49	0.05	0.76	Open
108	<input type="checkbox"/>	P93	J88	J130	30.88	300.00	120.00	-4.69	0.07	0.00	0.03	Open
109	<input type="checkbox"/>	P95	J142	J150	156.08	400.00	120.00	44.27	0.35	0.06	0.41	Open
110	<input type="checkbox"/>	P97	J46	J44	100.05	300.00	120.00	21.98	0.31	0.05	0.45	Open

PHD - NODE

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
1	<input type="checkbox"/>	J10	0.00	84.86	143.77	83.74
2	<input type="checkbox"/>	J100	29.42	80.10	142.75	89.06
3	<input type="checkbox"/>	J104	11.29	79.92	142.74	89.31
4	<input type="checkbox"/>	J110	0.00	79.47	142.95	90.25
5	<input type="checkbox"/>	J112	0.00	81.34	142.86	87.45
6	<input type="checkbox"/>	J114	0.00	81.23	142.88	87.65
7	<input type="checkbox"/>	J116	0.00	79.95	142.76	89.29
8	<input type="checkbox"/>	J118	0.00	79.36	142.75	90.12
9	<input type="checkbox"/>	J120	0.00	78.33	142.75	91.58
10	<input type="checkbox"/>	J122	0.00	79.33	142.75	90.16
11	<input type="checkbox"/>	J124	0.00	79.44	142.74	89.98
12	<input type="checkbox"/>	J126	14.01	80.21	142.71	88.85
13	<input type="checkbox"/>	J128	5.73	81.35	142.75	87.28
14	<input type="checkbox"/>	J130	0.00	82.01	142.76	86.36
15	<input type="checkbox"/>	J132	0.00	82.11	142.79	86.26
16	<input type="checkbox"/>	J134	2.23	81.80	143.07	87.11
17	<input type="checkbox"/>	J136	0.00	79.85	142.92	89.66
18	<input type="checkbox"/>	J138	0.00	82.78	142.75	85.25
19	<input type="checkbox"/>	J14	0.00	81.75	143.47	87.73
20	<input type="checkbox"/>	J142	0.00	80.35	143.25	89.42
21	<input type="checkbox"/>	J144	0.00	83.05	143.25	85.57
22	<input type="checkbox"/>	J146	0.00	81.26	143.12	87.93
23	<input type="checkbox"/>	J150	0.00	78.92	143.10	91.23
24	<input type="checkbox"/>	J152	0.00	75.92	143.08	95.48
25	<input type="checkbox"/>	J154	0.00	82.07	142.97	86.58
26	<input type="checkbox"/>	J156	0.00	81.32	142.88	87.52
27	<input type="checkbox"/>	J158	0.00	81.44	142.89	87.36
28	<input type="checkbox"/>	J160	0.00	85.03	143.77	83.51
29	<input type="checkbox"/>	J162	0.00	83.72	143.75	85.34
30	<input type="checkbox"/>	J164	0.00	81.79	143.71	88.03
31	<input type="checkbox"/>	J166	0.00	80.85	143.68	89.32
32	<input type="checkbox"/>	J170	0.00	86.05	143.83	82.14
33	<input type="checkbox"/>	J172	12.85	84.43	143.76	84.34
34	<input type="checkbox"/>	J174	3.92	85.14	143.76	83.33
35	<input type="checkbox"/>	J176	9.44	85.60	143.76	82.68
36	<input type="checkbox"/>	J178	16.89	82.30	143.64	87.20
37	<input type="checkbox"/>	J18	0.00	86.12	143.77	81.95
38	<input type="checkbox"/>	J180	8.58	81.86	143.64	87.83
39	<input type="checkbox"/>	J182	8.36	81.31	143.65	88.62
40	<input type="checkbox"/>	J190	0.00	85.04	143.73	83.44
41	<input type="checkbox"/>	J192	0.00	84.17	143.70	84.63
42	<input type="checkbox"/>	J194	0.00	83.38	143.68	85.72
43	<input type="checkbox"/>	J196	0.00	84.10	143.65	84.66
44	<input type="checkbox"/>	J198	0.00	82.80	143.66	86.52
45	<input type="checkbox"/>	J20	31.08	82.84	142.87	85.34
46	<input type="checkbox"/>	J200	0.00	81.35	142.75	87.29
47	<input type="checkbox"/>	J202	0.00	81.35	142.75	87.29
48	<input type="checkbox"/>	J204	6.03	86.27	143.84	81.84
49	<input type="checkbox"/>	J206	7.01	86.44	143.93	81.73
50	<input type="checkbox"/>	J208	4.83	86.29	143.87	81.86

PHD - NODE

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
51	<input type="checkbox"/>	J210	4.55	85.54	143.54	82.46
52	<input type="checkbox"/>	J212	6.74	85.69	143.81	82.62
53	<input type="checkbox"/>	J214	6.47	85.28	143.79	83.17
54	<input type="checkbox"/>	J218	0.61	83.53	143.35	85.05
55	<input type="checkbox"/>	J220	12.44	83.90	143.35	84.51
56	<input type="checkbox"/>	J222	0.00	83.80	143.35	84.66
57	<input type="checkbox"/>	J224	12.45	83.31	143.34	85.33
58	<input type="checkbox"/>	J226	10.76	82.95	143.34	85.84
59	<input type="checkbox"/>	J230	0.00	82.77	143.71	86.63
60	<input type="checkbox"/>	J232	0.00	84.93	143.61	83.42
61	<input type="checkbox"/>	J234	16.30	83.18	143.48	85.72
62	<input type="checkbox"/>	J24	28.97	82.29	142.75	85.95
63	<input type="checkbox"/>	J240	0.00	84.37	143.50	84.06
64	<input type="checkbox"/>	J246	0.00	79.85	143.76	90.85
65	<input type="checkbox"/>	J248	0.00	82.80	143.66	86.52
66	<input type="checkbox"/>	J250	0.00	80.85	143.66	89.30
67	<input type="checkbox"/>	J252	0.00	83.72	143.66	85.22
68	<input type="checkbox"/>	J258	0.00	79.85	143.66	90.72
69	<input type="checkbox"/>	J30	0.00	83.41	143.47	85.38
70	<input type="checkbox"/>	J34	0.00	83.24	143.34	85.44
71	<input type="checkbox"/>	J38	0.00	82.86	143.09	85.62
72	<input type="checkbox"/>	J40	2.08	83.61	142.99	84.41
73	<input type="checkbox"/>	J42	0.00	82.93	143.12	85.56
74	<input type="checkbox"/>	J44	9.72	81.47	143.14	87.67
75	<input type="checkbox"/>	J46	0.00	82.71	143.25	86.06
76	<input type="checkbox"/>	J48	0.00	80.79	142.76	88.10
77	<input type="checkbox"/>	J50	0.00	80.75	142.76	88.15
78	<input type="checkbox"/>	J54	3.73	82.17	142.94	86.39
79	<input type="checkbox"/>	J58	10.23	82.05	142.98	86.62
80	<input type="checkbox"/>	J62	42.75	79.65	142.95	89.99
81	<input type="checkbox"/>	J64	26.37	81.10	142.88	87.83
82	<input type="checkbox"/>	J70	0.00	81.15	142.88	87.76
83	<input type="checkbox"/>	J74	21.58	81.63	142.79	86.95
84	<input type="checkbox"/>	J80	0.57	81.70	142.79	86.85
85	<input type="checkbox"/>	J84	2.11	82.46	142.75	85.71
86	<input type="checkbox"/>	J88	10.14	82.00	142.75	86.36
87	<input type="checkbox"/>	J92	25.01	81.61	142.74	86.91
88	<input type="checkbox"/>	J96	0.00	80.91	142.77	87.93

PHD - PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status
1	<input type="checkbox"/>	24	J44	J146	37.79	300.00	120.00	26.02	0.37	0.02	0.62	Open
2	<input type="checkbox"/>	25	J112	J114	11.08	300.00	120.00	-55.99	0.79	0.03	2.55	Open
3	<input type="checkbox"/>	26	J110	J116	162.84	300.00	120.00	37.08	0.52	0.19	1.19	Open
4	<input type="checkbox"/>	27	J116	J118	103.23	200.00	120.00	2.75	0.09	0.01	0.07	Open
5	<input type="checkbox"/>	28	J120	J118	17.79	200.00	120.00	1.55	0.05	0.00	0.02	Open
6	<input type="checkbox"/>	29	J118	J122	14.95	200.00	120.00	4.30	0.14	0.00	0.16	Open
7	<input type="checkbox"/>	30	J122	J124	88.59	200.00	120.00	4.30	0.14	0.01	0.16	Open
8	<input type="checkbox"/>	31	J124	J126	144.09	200.00	120.00	4.30	0.14	0.02	0.16	Open
9	<input type="checkbox"/>	32	J50	J120	146.51	200.00	120.00	1.55	0.05	0.00	0.02	Open
10	<input type="checkbox"/>	33	J130	J128	112.40	200.00	120.00	2.82	0.09	0.01	0.07	Open
11	<input type="checkbox"/>	34	J130	J112	156.59	300.00	120.00	-26.48	0.37	0.10	0.64	Open
12	<input type="checkbox"/>	35	J74	J112	79.98	300.00	120.00	-29.52	0.42	0.06	0.78	Open
13	<input type="checkbox"/>	36	J248	J14	98.08	400.00	120.00	105.55	0.84	0.20	2.03	Open
14	<input type="checkbox"/>	37	J134	J136	166.63	300.00	120.00	32.09	0.45	0.15	0.91	Open
15	<input type="checkbox"/>	38	J138	J24	110.22	300.00	120.00	-1.36	0.02	0.00	0.00	Open
16	<input type="checkbox"/>	40	J142	J146	135.17	300.00	120.00	33.83	0.48	0.14	1.00	Open
17	<input type="checkbox"/>	41	J144	J134	154.56	300.00	120.00	35.77	0.51	0.17	1.11	Open
18	<input type="checkbox"/>	42	J126	J104	40.45	200.00	120.00	-9.71	0.31	0.03	0.72	Open
19	<input type="checkbox"/>	6	J40	J38	120.78	300.00	120.00	-30.66	0.43	0.10	0.83	Open
20	<input type="checkbox"/>	8	J48	J50	91.46	200.00	120.00	3.33	0.11	0.01	0.10	Open
21	<input type="checkbox"/>	P101	J176	J174	94.00	600.00	120.00	38.06	0.13	0.00	0.04	Open
22	<input type="checkbox"/>	P103	J230	J192	198.76	250.00	110.00	2.99	0.06	0.01	0.03	Open
23	<input type="checkbox"/>	P105	J18	J204	50.72	600.00	120.00	-241.54	0.85	0.07	1.30	Open
24	<input type="checkbox"/>	P107	J160	J10	17.35	600.00	120.00	100.06	0.35	0.00	0.25	Open
25	<input type="checkbox"/>	P109	J164	J230	173.09	250.00	110.00	2.99	0.06	0.01	0.03	Open
26	<input type="checkbox"/>	P111	J162	J164	99.75	300.00	120.00	21.29	0.30	0.04	0.42	Open
27	<input type="checkbox"/>	P113	J164	J166	86.36	300.00	120.00	18.30	0.26	0.03	0.32	Open
28	<input type="checkbox"/>	P115	J166	J182	102.73	300.00	120.00	18.30	0.26	0.03	0.32	Open
29	<input type="checkbox"/>	P117	J182	J180	97.29	300.00	120.00	9.94	0.14	0.01	0.10	Open
30	<input type="checkbox"/>	P119	J180	J178	85.87	300.00	120.00	1.36	0.02	0.00	0.00	Open
31	<input type="checkbox"/>	P121	J170	J212	75.22	600.00	120.00	113.27	0.40	0.02	0.32	Open
32	<input type="checkbox"/>	P129	J218	J220	71.02	300.00	120.00	8.88	0.13	0.01	0.08	Open
33	<input type="checkbox"/>	P13	J146	J134	109.84	300.00	120.00	19.68	0.28	0.04	0.37	Open
34	<input type="checkbox"/>	P131	J220	J222	64.95	300.00	120.00	-3.56	0.05	0.00	0.02	Open
35	<input type="checkbox"/>	P133	J222	J224	89.72	300.00	120.00	12.66	0.18	0.01	0.16	Open
36	<input type="checkbox"/>	P135	J224	J226	83.02	300.00	120.00	0.21	0.00	0.00	0.00	Open
37	<input type="checkbox"/>	P143	J18	J190	61.03	400.00	120.00	53.68	0.43	0.04	0.58	Open
38	<input type="checkbox"/>	P145	J190	J192	58.87	400.00	120.00	53.68	0.43	0.03	0.58	Open
39	<input type="checkbox"/>	P147	J192	J194	53.65	400.00	120.00	42.25	0.34	0.02	0.37	Open
40	<input type="checkbox"/>	P15	J146	J62	118.80	300.00	120.00	40.16	0.57	0.16	1.38	Open
41	<input type="checkbox"/>	P151	J214	J212	69.37	600.00	120.00	-106.53	0.38	0.02	0.29	Open
42	<input type="checkbox"/>	P153	J210	J240	125.40	250.00	110.00	10.45	0.21	0.04	0.32	Open
43	<input type="checkbox"/>	P155	J196	J30	100.45	400.00	120.00	100.06	0.80	0.18	1.84	Open
44	<input type="checkbox"/>	P157	J194	J198	49.89	400.00	120.00	42.25	0.34	0.02	0.37	Open
45	<input type="checkbox"/>	P159	J128	J200	133.31	200.00	120.00	-1.12	0.04	0.00	0.01	Open
46	<input type="checkbox"/>	P161	J208	J170	63.93	600.00	120.00	165.84	0.59	0.04	0.65	Open
47	<input type="checkbox"/>	P163	J202	J138	119.12	200.00	120.00	-1.12	0.04	0.00	0.01	Open
48	<input type="checkbox"/>	P165	J136	J96	166.15	300.00	120.00	32.80	0.46	0.16	0.95	Open
49	<input type="checkbox"/>	P167	J200	J202	11.25	200.00	120.00	-1.12	0.04	0.00	0.01	Open
50	<input type="checkbox"/>	P169	J206	J208	82.80	600.00	120.00	170.67	0.60	0.06	0.69	Open
51	<input type="checkbox"/>	P17	J62	J110	47.94	300.00	120.00	-2.59	0.04	0.00	0.01	Open
52	<input type="checkbox"/>	P171	J206	J204	69.37	600.00	120.00	247.57	0.88	0.09	1.37	Open
53	<input type="checkbox"/>	P175	J210	J222	86.86	300.00	120.00	51.99	0.74	0.19	2.22	Open
54	<input type="checkbox"/>	P177	J172	J174	85.77	600.00	120.00	-34.14	0.12	0.00	0.03	Open
55	<input type="checkbox"/>	P179	J162	J172	81.18	600.00	120.00	-21.29	0.08	0.00	0.01	Open

PHD - PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status
56	<input type="checkbox"/>	P183	J232	J210	120.26	250.00	110.00	14.42	0.29	0.07	0.59	Open
57	<input type="checkbox"/>	P185	RES9002	J206	48.21	600.00	120.00	425.25	1.50	0.18	3.72	Open
58	<input type="checkbox"/>	P187	J214	J160	62.93	600.00	120.00	100.06	0.35	0.02	0.25	Open
59	<input type="checkbox"/>	P189	J226	J34	51.07	300.00	120.00	-10.55	0.15	0.01	0.12	Open
60	<input type="checkbox"/>	P19	J20	J54	117.59	300.00	120.00	-25.47	0.36	0.07	0.59	Open
61	<input type="checkbox"/>	P191	J192	J232	147.89	250.00	110.00	14.42	0.29	0.09	0.59	Open
62	<input type="checkbox"/>	P193	J218	J234	71.16	300.00	120.00	-45.23	0.64	0.12	1.71	Open
63	<input type="checkbox"/>	P195	J178	J198	86.78	300.00	120.00	-15.53	0.22	0.02	0.24	Open
64	<input type="checkbox"/>	P197	J176	J18	110.72	600.00	120.00	-47.50	0.17	0.01	0.06	Open
65	<input type="checkbox"/>	P199	J170	J210	128.03	300.00	120.00	52.57	0.74	0.29	2.27	Open
66	<input type="checkbox"/>	P201	J234	J198	61.08	300.00	120.00	-61.53	0.87	0.19	3.03	Open
67	<input type="checkbox"/>	P21	J14	J142	106.09	400.00	120.00	105.55	0.84	0.22	2.03	Open
68	<input type="checkbox"/>	P215	J240	J30	102.65	250.00	110.00	10.45	0.21	0.03	0.32	Open
69	<input type="checkbox"/>	P217	J222	J144	93.00	300.00	120.00	35.77	0.51	0.10	1.11	Open
70	<input type="checkbox"/>	P219	J218	J46	95.10	300.00	120.00	35.74	0.51	0.11	1.11	Open
71	<input type="checkbox"/>	P225	J246	J172	356.21	900.00	130.00	0.00	0.00	0.00	0.00	Open
72	<input type="checkbox"/>	P229	J250	J248	375.46	600.00	120.00	0.00	0.00	0.00	0.00	Open
73	<input type="checkbox"/>	P231	J248	J18	220.67	600.00	120.00	-140.36	0.50	0.11	0.48	Open
74	<input type="checkbox"/>	P235	J252	J250	182.26	900.00	130.00	0.00	0.00	0.00	0.00	Open
75	<input type="checkbox"/>	P237	J250	J258	89.25	900.00	130.00	0.00	0.00	0.00	0.00	Open
76	<input type="checkbox"/>	P239	J248	J198	10.64	400.00	120.00	34.81	0.28	0.00	0.26	Open
77	<input type="checkbox"/>	P25	J150	J152	12.66	400.00	120.00	71.72	0.57	0.01	0.99	Open
78	<input type="checkbox"/>	P27	J152	J110	132.14	400.00	120.00	71.72	0.57	0.13	0.99	Open
79	<input type="checkbox"/>	P29	J110	J136	128.24	400.00	120.00	32.06	0.26	0.03	0.22	Open
80	<input type="checkbox"/>	P31	J136	J64	180.81	400.00	120.00	31.35	0.25	0.04	0.21	Open
81	<input type="checkbox"/>	P33	J64	J70	14.43	400.00	120.00	4.98	0.04	0.00	0.01	Open
82	<input type="checkbox"/>	P35	J70	J156	34.75	400.00	120.00	4.98	0.04	0.00	0.01	Open
83	<input type="checkbox"/>	P37	J156	J114	6.20	400.00	120.00	4.98	0.04	0.00	0.01	Open
84	<input type="checkbox"/>	P39	J114	J158	17.17	400.00	120.00	-51.01	0.41	0.01	0.53	Open
85	<input type="checkbox"/>	P41	J154	J158	153.05	400.00	120.00	51.01	0.41	0.08	0.53	Open
86	<input type="checkbox"/>	P43	J42	J154	156.43	400.00	120.00	69.30	0.55	0.15	0.93	Open
87	<input type="checkbox"/>	P45	J34	J42	120.68	400.00	120.00	99.96	0.80	0.22	1.83	Open
88	<input type="checkbox"/>	P47	J30	J34	57.66	400.00	120.00	110.51	0.88	0.13	2.21	Open
89	<input type="checkbox"/>	P51	J58	J134	228.31	300.00	120.00	-21.14	0.30	0.10	0.42	Open
90	<input type="checkbox"/>	P53	J154	J58	39.98	300.00	120.00	-10.91	0.15	0.00	0.12	Open
91	<input type="checkbox"/>	P55	J104	J116	41.94	300.00	120.00	-21.00	0.30	0.02	0.41	Open
92	<input type="checkbox"/>	P57	J116	J100	77.25	300.00	120.00	13.32	0.19	0.01	0.18	Open
93	<input type="checkbox"/>	P59	J100	J96	84.08	300.00	120.00	-16.10	0.23	0.02	0.25	Open
94	<input type="checkbox"/>	P61	J96	J48	6.45	300.00	120.00	16.70	0.24	0.00	0.27	Open
95	<input type="checkbox"/>	P63	J48	J92	120.82	300.00	120.00	13.37	0.19	0.02	0.18	Open
96	<input type="checkbox"/>	P65	J92	J130	97.59	300.00	120.00	-11.64	0.16	0.01	0.14	Open
97	<input type="checkbox"/>	P69	J84	J88	69.90	300.00	120.00	-1.87	0.03	0.00	0.00	Open
98	<input type="checkbox"/>	P71	J138	J84	53.85	300.00	120.00	0.24	0.00	0.00	0.00	Open
99	<input type="checkbox"/>	P73	J132	J24	44.79	300.00	120.00	30.33	0.43	0.04	0.82	Open
100	<input type="checkbox"/>	P75	J20	J132	172.60	300.00	120.00	22.96	0.32	0.08	0.49	Open
101	<input type="checkbox"/>	P77	J40	J20	159.11	300.00	120.00	28.58	0.40	0.12	0.73	Open
102	<input type="checkbox"/>	P79	J50	J128	234.05	200.00	120.00	1.78	0.06	0.01	0.03	Open
103	<input type="checkbox"/>	P81	J38	J42	35.30	300.00	120.00	-30.66	0.43	0.03	0.83	Open
104	<input type="checkbox"/>	P83	J54	J154	41.53	300.00	120.00	-29.20	0.41	0.03	0.76	Open
105	<input type="checkbox"/>	P85	J80	J74	13.52	300.00	120.00	-7.94	0.11	0.00	0.07	Open
106	<input type="checkbox"/>	P87	J132	J80	74.26	300.00	120.00	-7.37	0.10	0.00	0.06	Open
107	<input type="checkbox"/>	P89	J10	J196	62.59	400.00	120.00	100.06	0.80	0.12	1.84	Open
108	<input type="checkbox"/>	P93	J88	J130	30.88	300.00	120.00	-12.01	0.17	0.00	0.15	Open
109	<input type="checkbox"/>	P95	J142	J150	156.08	400.00	120.00	71.72	0.57	0.15	0.99	Open
110	<input type="checkbox"/>	P97	J46	J44	100.05	300.00	120.00	35.74	0.51	0.11	1.11	Open

MDD + FIRE

	ID	Static Demand (L/s)	Static Pressure (psi)	Static Head (m)	Fire-Flow Demand (L/s)	Residual Pressure (psi)	Hydrant Available Flow (L/s)	Hydrant Pressure at Available Flow (psi)	Critical Pipe ID at Available Flow	Critical Pipe Velocity at Available Flow (m/s)	Junctions with Pressure Violation
1	J230	0.00	86.96	143.94	317.00	71.98	485.51	54.43	P109	5.00	0
2	J232	0.00	83.83	143.90	317.00	73.04	472.04	61.70	P183	4.99	0
3	J240	0.00	84.57	143.86	317.00	74.60	464.54	64.97	P215	4.99	0
4	J210	3.03	82.92	143.87	317.00	80.11	936.70	65.77	P199	5.00	0
5	J180	5.72	88.21	143.91	317.00	80.71	595.46	66.09	P119	4.99	0
6	J224	8.30	85.97	143.79	317.00	80.81	655.16	69.04	P133	5.03	0
7	J220	8.30	85.14	143.79	317.00	80.86	659.79	71.08	P131	4.99	0
8	J182	5.57	89.00	143.91	317.00	80.96	691.16	57.75	P115	5.02	0
9	J18	0.00	82.23	143.97	317.00	81.34	1,554.59	72.69	P105	5.04	0
10	J208	3.22	82.05	144.01	317.00	81.35	1,546.75	74.38	P169	5.02	0
11	J204	4.02	82.06	143.99	317.00	81.37	1,471.21	75.33	P171	5.05	0
12	J170	0.00	82.37	143.99	317.00	81.45	1,645.65	71.17	P161	5.02	0
13	J206	4.67	81.87	144.03	317.00	81.52	1,156.83	79.61	P185	5.02	0
14	J212	4.49	82.87	143.98	317.00	81.72	1,636.85	68.52	P121	5.00	0
15	J176	6.29	82.97	143.96	317.00	81.75	1,542.14	68.16	P197	5.03	0
16	J226	7.18	86.48	143.79	317.00	81.92	547.58	75.66	P189	5.03	0
17	J178	11.26	87.58	143.91	317.00	81.95	500.59	75.80	P195	5.04	0
18	J218	0.41	85.67	143.79	317.00	82.07	863.00	66.76	P193	5.00	0
19	J214	4.31	83.44	143.97	317.00	82.13	1,727.08	64.84	P151	5.00	0
20	J174	2.61	83.62	143.96	317.00	82.18	1,596.23	63.58	P101	5.02	0
21	J222	0.00	85.28	143.79	317.00	82.29	1,000.70	66.15	P175	5.01	0
22	J190	0.00	83.75	143.95	317.00	82.32	1,033.29	74.20	P143	5.00	0
23	J160	0.00	83.79	143.97	317.00	82.36	1,810.79	61.04	P187	5.04	0
24	J10	0.00	84.02	143.97	317.00	82.57	1,828.71	60.24	P107	5.05	0
25	J166	0.00	89.67	143.93	317.00	82.72	568.17	70.25	P113	5.05	0
26	J234	10.87	86.24	143.84	317.00	82.72	574.89	77.13	P201	5.00	0
27	J196	0.00	85.04	143.92	317.00	82.99	931.37	73.94	P89	5.02	0
28	J172	8.57	84.63	143.96	317.00	82.99	1,640.92	60.00	P177	5.01	0
29	J34	0.00	86.08	143.79	317.00	83.35	1,120.06	66.29	P47	5.02	0
30	J30	0.00	85.91	143.84	317.00	83.43	1,192.41	65.77	P155	5.01	0
31	J192	0.00	84.96	143.94	317.00	83.47	1,416.33	67.89	P145	5.00	0
32	J164	0.00	88.35	143.94	317.00	83.74	618.88	73.55	P111	5.04	0
33	J162	0.00	85.63	143.96	317.00	83.84	1,675.39	56.43	P179	5.00	0
34	J194	0.00	86.07	143.93	317.00	84.54	1,104.94	74.88	P157	4.97	0
35	J198	0.00	86.89	143.92	317.00	85.57	1,020.53	79.46	P239	5.00	0

## **Appendix B-6**

Water Age Analysis

- Option 1



# Water Turnover Calculations

**Project Title:** 4938 - Rangeview Mississauga  
**Last Edited:** 2024-04-29

**Municipality:** Region of Peel

**Average Consumption:** 0.28 L/cap/day (Residential Land Use)  
 0.3 L/cap/day (Employment Land Use)  
**Minimum Consumption:** 0.196 L/cap/day<sup>1</sup>

Turnover Rate Calculation								
Service	Length	Diameter	Area	Volume	Average Consumption (100% Population)	Minimum Consumption (70% Population)	Minimum Consumption (20% Population)	Days for Turnover
	(m)	(mm)	(m <sup>2</sup> )	(m <sup>3</sup> )	(m <sup>3</sup> /day)	(m <sup>3</sup> /day)	(m <sup>3</sup> /day)	(Day)
Complete System	1257	200	0.03	39.50	13462.68	9423.88	1884.78	0.55
	868	250	0.05	42.61				
	4642	300	0.07	328.12				
	1772	400	0.13	222.62				
	1459	600	0.28	412.66				

1 - Minimum consumption calculated using: average day consumption \* 0.7

**Appendix B-5** InfoWater  
Model Outputs - Option 2

# Legend

## Pipe


— <all other values>

## TYPE

— Active

— Domain

— Inactive

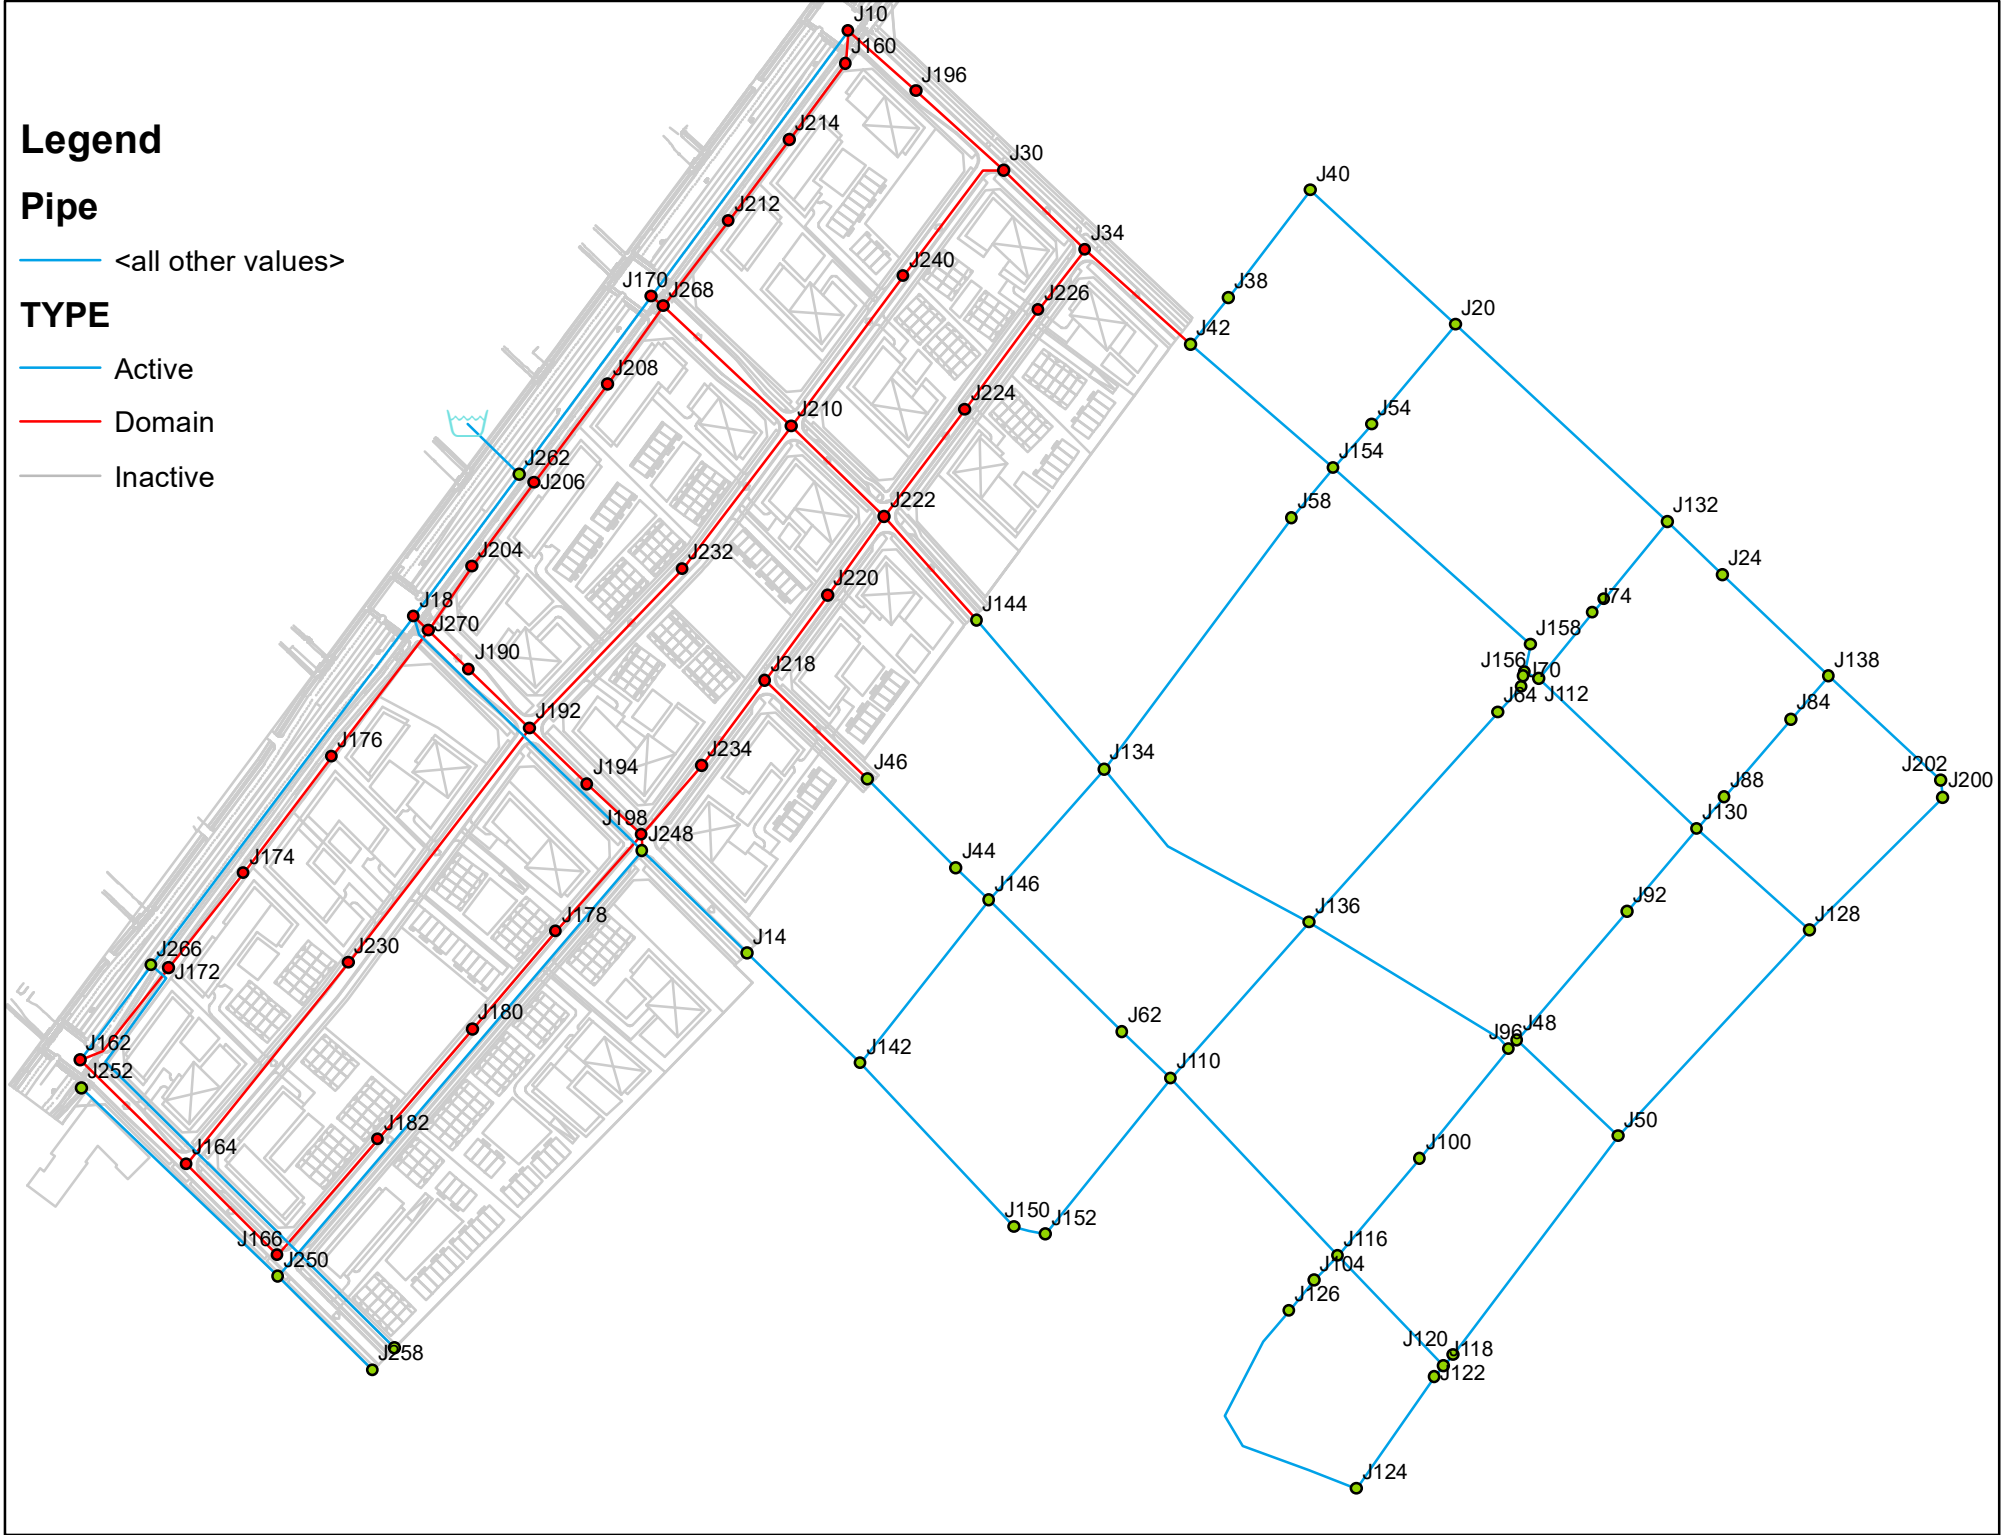

# Legend

## Pipe


— <all other values>

## TYPE

— Active

— Domain

— Inactive

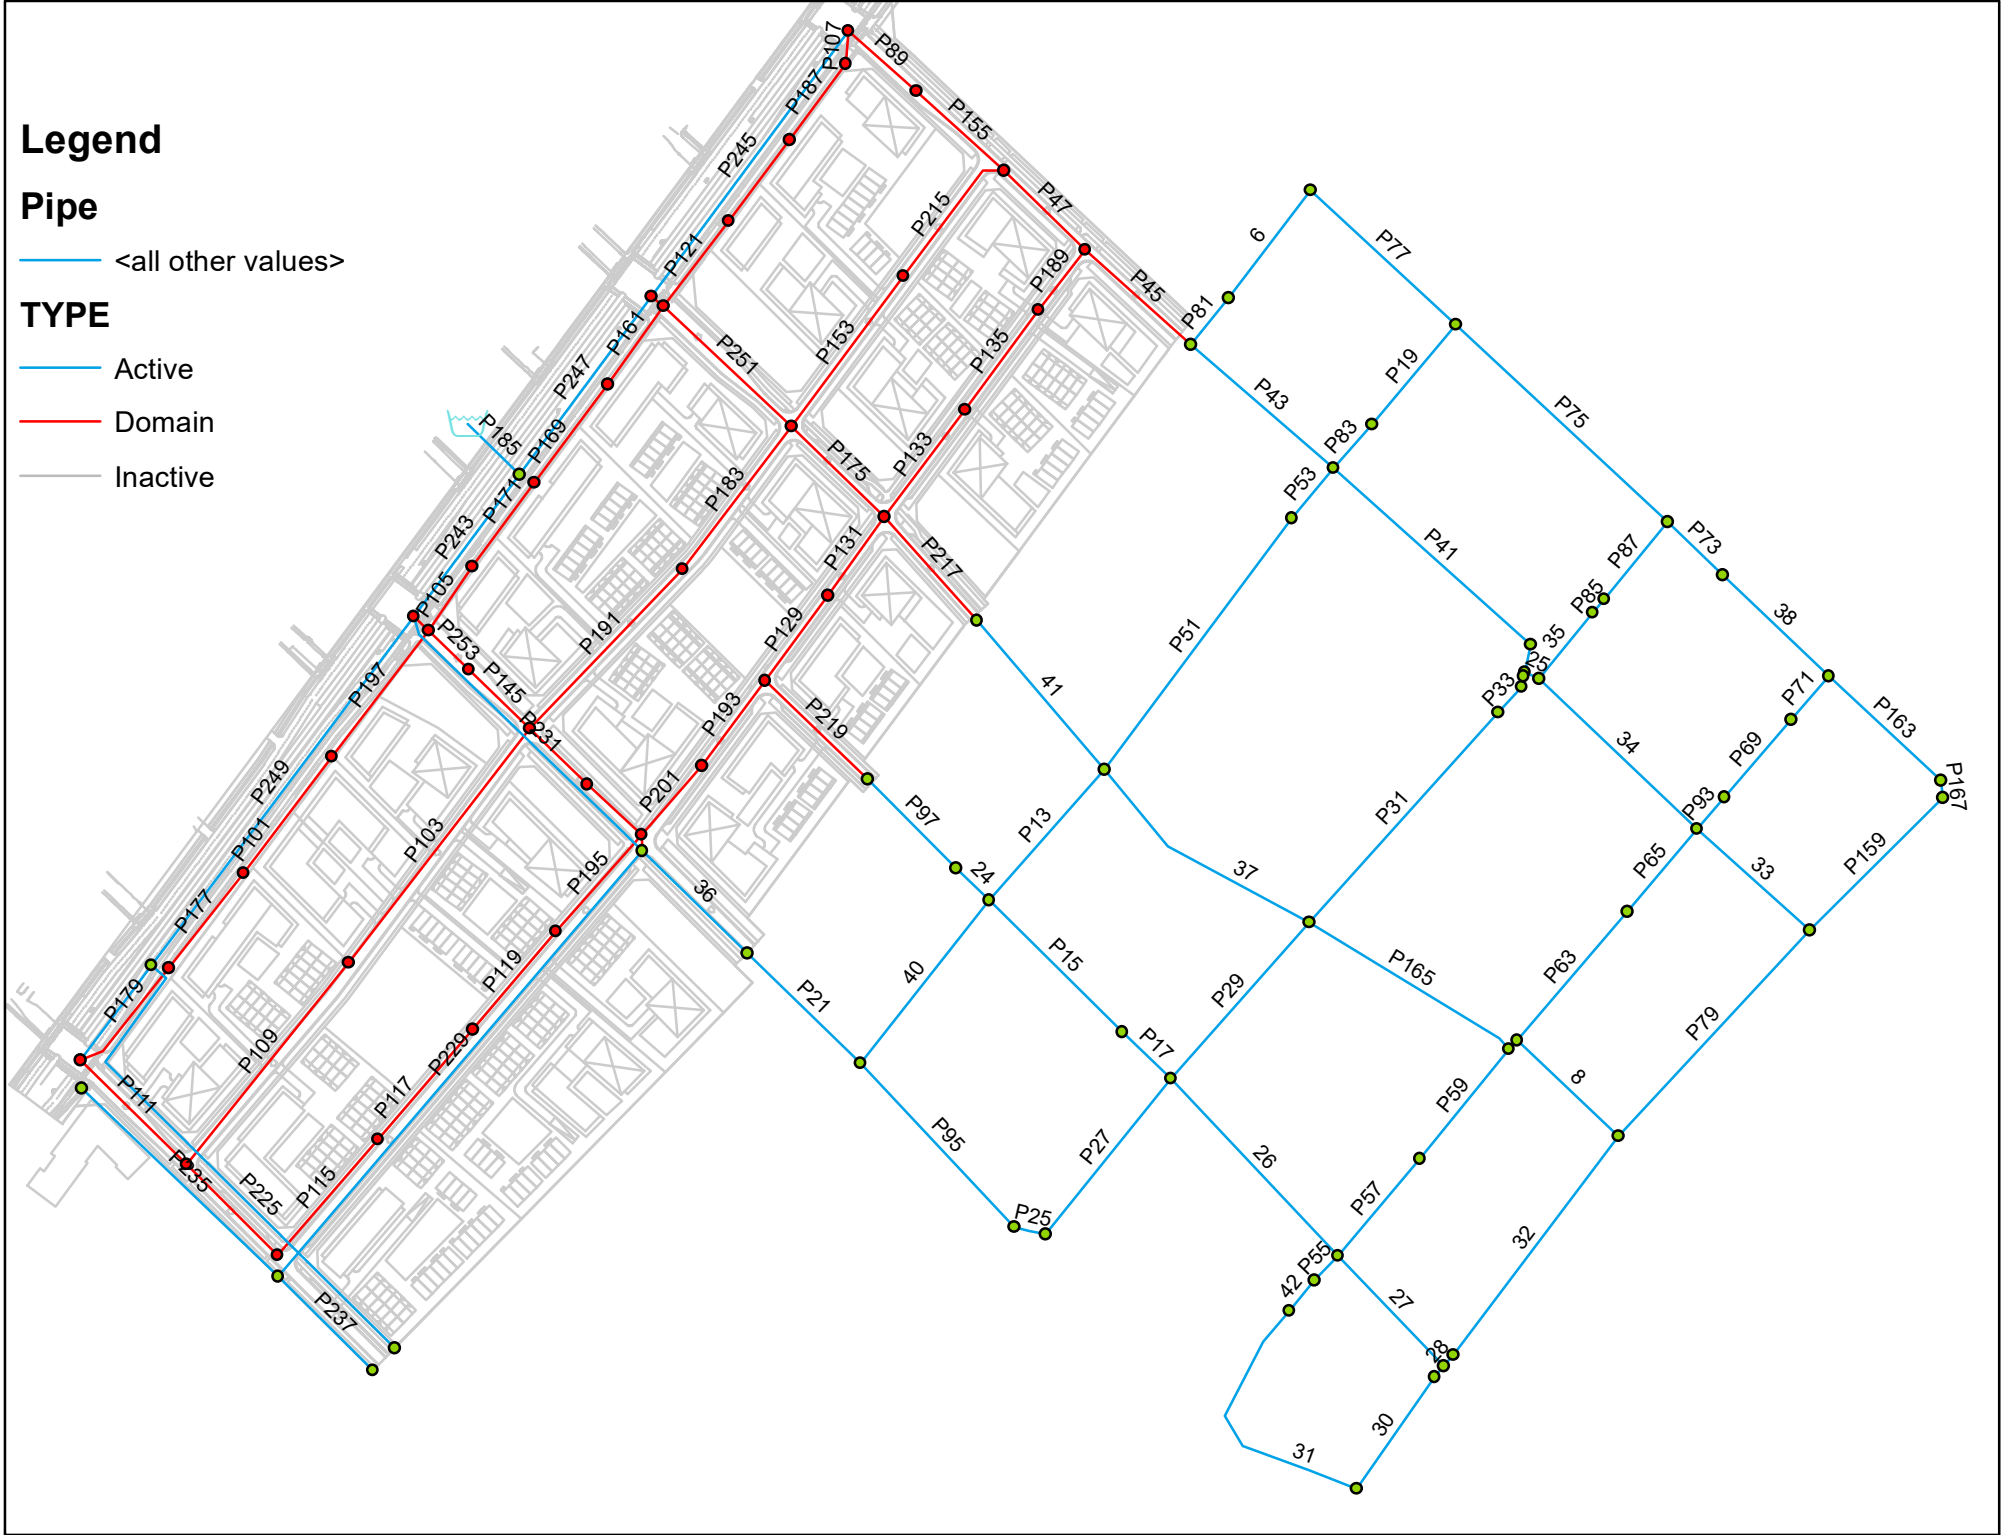


# Legend

## Pipe

### RUN\_DIAM

- 200mm
- 250mm
- 300mm
- 400mm
- 600mm
- 900mm

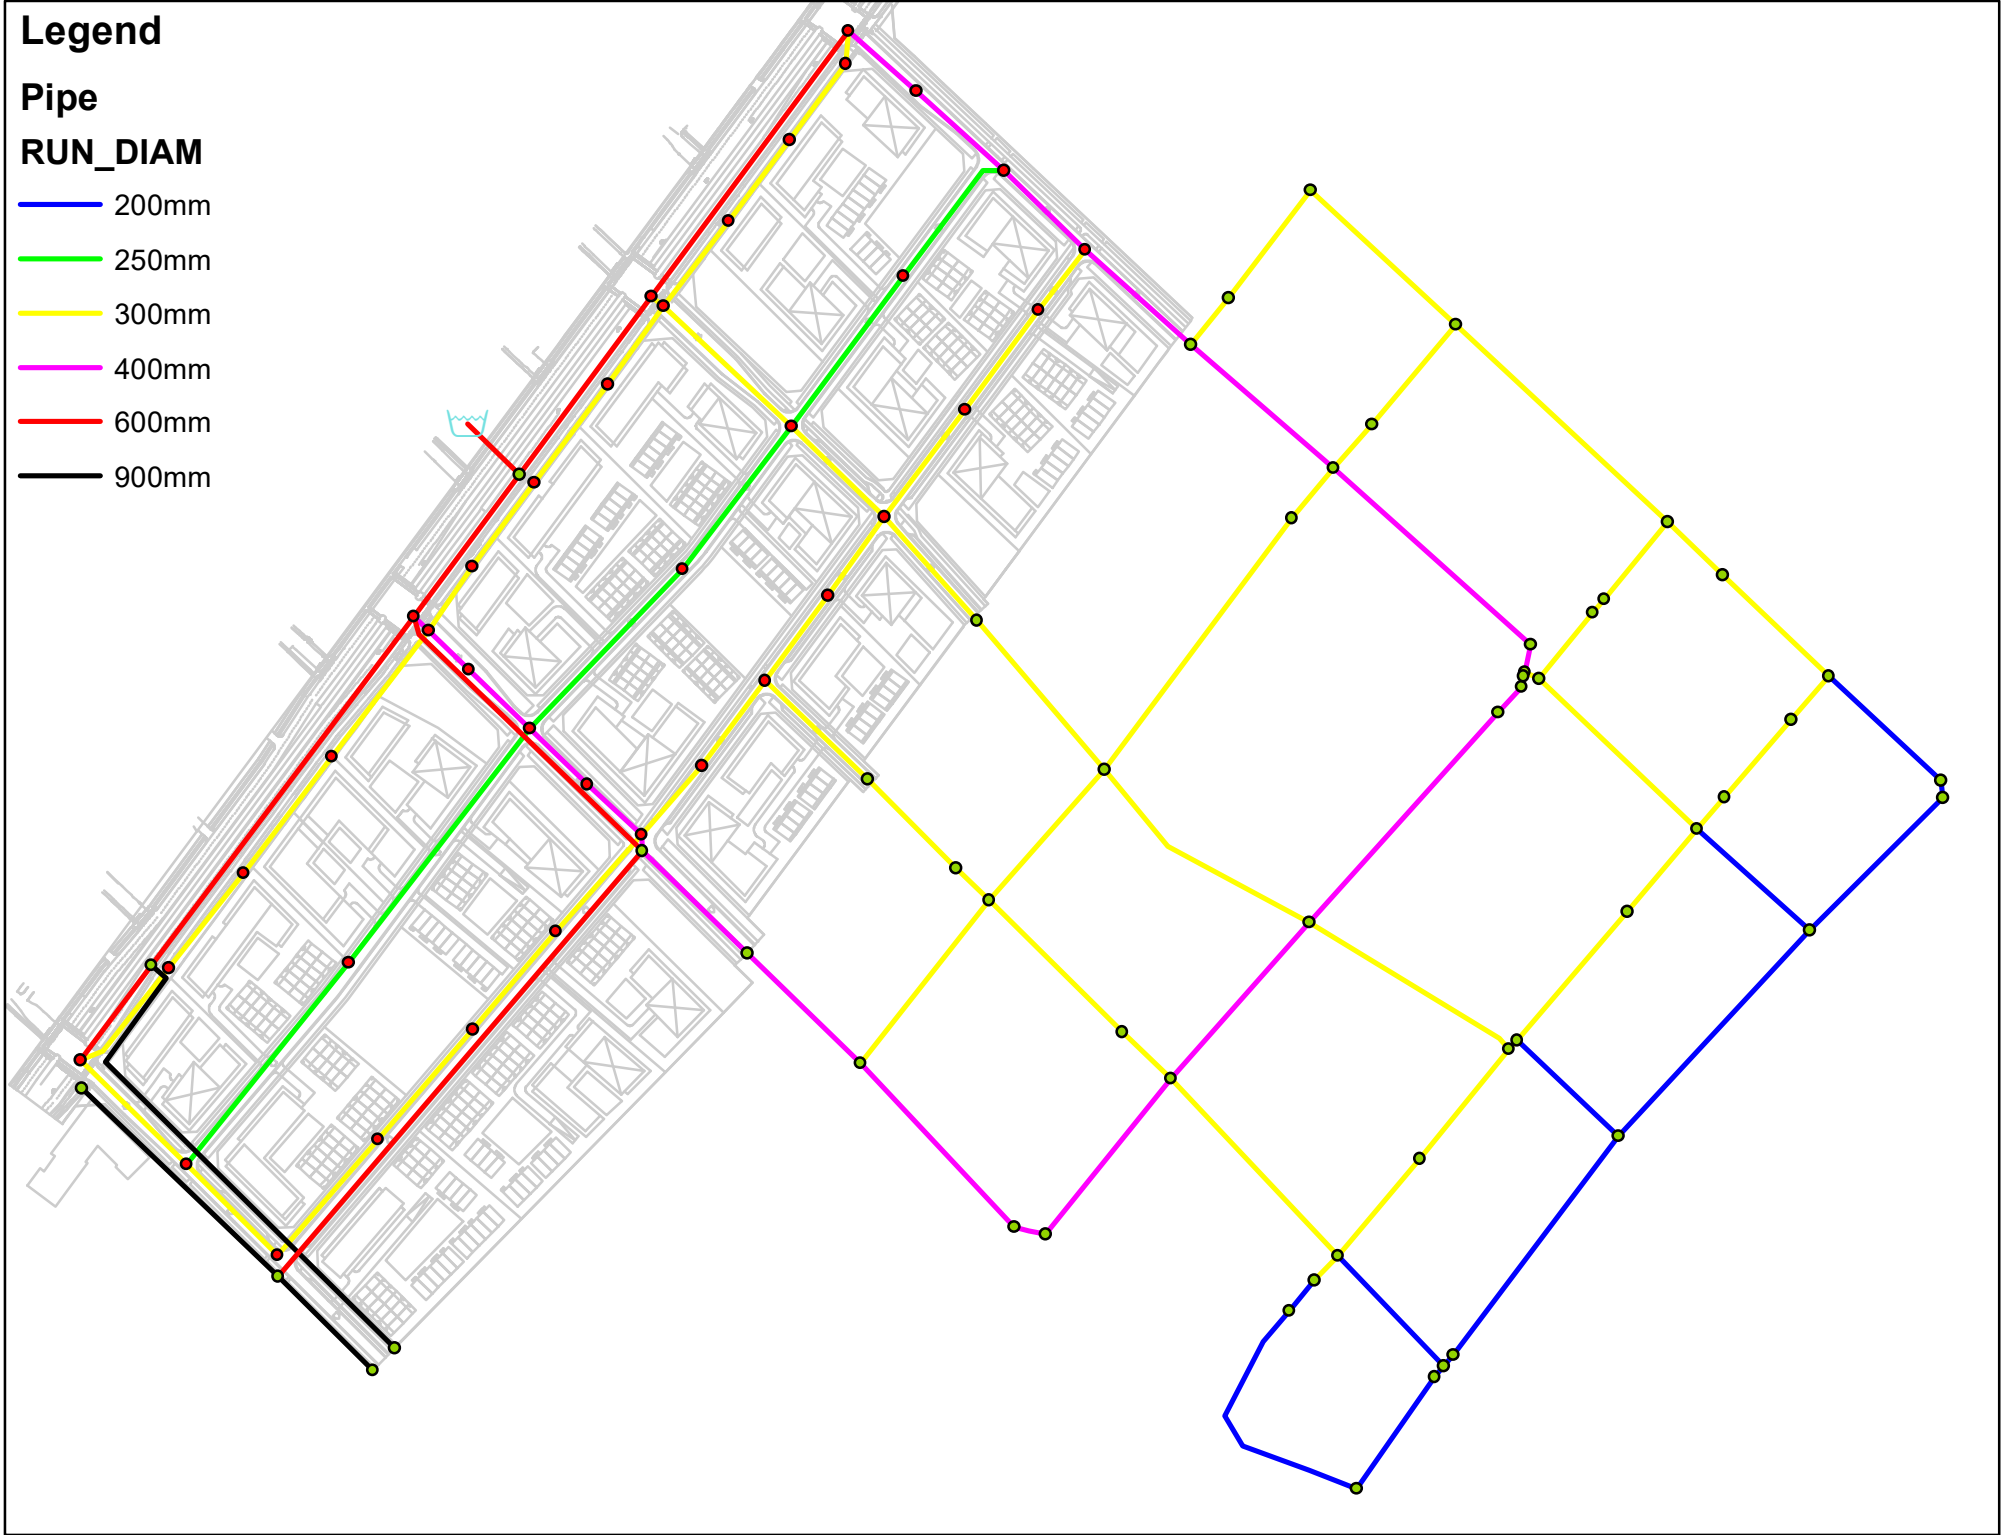

ADD-JUNCTION

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
1	<input type="checkbox"/>	J206	2.34	86.44	144.06	81.92
2	<input type="checkbox"/>	J262	0.00	86.44	144.09	81.95
3	<input type="checkbox"/>	J208	1.61	86.29	144.06	82.13
4	<input type="checkbox"/>	J204	2.01	86.27	144.06	82.16
5	<input type="checkbox"/>	J270	0.00	86.12	144.06	82.37
6	<input type="checkbox"/>	J18	0.00	86.12	144.07	82.37
7	<input type="checkbox"/>	J170	0.00	86.05	144.07	82.48
8	<input type="checkbox"/>	J268	0.00	86.02	144.07	82.51
9	<input type="checkbox"/>	J212	2.25	85.69	144.06	82.98
10	<input type="checkbox"/>	J176	3.15	85.60	144.06	83.11
11	<input type="checkbox"/>	J210	1.52	85.54	144.03	83.15
12	<input type="checkbox"/>	J214	2.16	85.28	144.06	83.57
13	<input type="checkbox"/>	J174	1.31	85.14	144.06	83.76
14	<input type="checkbox"/>	J190	0.00	85.04	144.06	83.90
15	<input type="checkbox"/>	J160	0.00	85.03	144.06	83.92
16	<input type="checkbox"/>	J232	0.00	84.93	144.04	84.04
17	<input type="checkbox"/>	J10	0.00	84.86	144.06	84.16
18	<input type="checkbox"/>	J172	4.28	84.43	144.06	84.77
19	<input type="checkbox"/>	J266	0.00	84.43	144.06	84.77
20	<input type="checkbox"/>	J240	0.00	84.37	144.03	84.81
21	<input type="checkbox"/>	J192	0.00	84.17	144.06	85.13
22	<input type="checkbox"/>	J196	0.00	84.10	144.05	85.22
23	<input type="checkbox"/>	J220	4.15	83.90	144.01	85.45
24	<input type="checkbox"/>	J222	0.00	83.80	144.01	85.59
25	<input type="checkbox"/>	J252	0.00	83.72	144.05	85.77
26	<input type="checkbox"/>	J162	0.00	83.72	144.06	85.78
27	<input type="checkbox"/>	J40	0.69	83.61	143.96	85.80
28	<input type="checkbox"/>	J218	0.20	83.53	144.01	85.98
29	<input type="checkbox"/>	J30	0.00	83.41	144.02	86.17
30	<input type="checkbox"/>	J194	0.00	83.38	144.05	86.25
31	<input type="checkbox"/>	J224	4.15	83.31	144.01	86.29
32	<input type="checkbox"/>	J34	0.00	83.24	144.01	86.39
33	<input type="checkbox"/>	J234	5.43	83.18	144.03	86.50
34	<input type="checkbox"/>	J144	0.00	83.05	144.00	86.64
35	<input type="checkbox"/>	J42	0.00	82.93	143.98	86.79
36	<input type="checkbox"/>	J226	3.59	82.95	144.01	86.80
37	<input type="checkbox"/>	J20	10.36	82.84	143.95	86.87
38	<input type="checkbox"/>	J38	0.00	82.86	143.98	86.88
39	<input type="checkbox"/>	J138	0.00	82.78	143.93	86.93
40	<input type="checkbox"/>	J198	0.00	82.80	144.05	87.07
41	<input type="checkbox"/>	J248	0.00	82.80	144.05	87.07
42	<input type="checkbox"/>	J46	0.00	82.71	144.00	87.12
43	<input type="checkbox"/>	J230	0.00	82.77	144.06	87.12
44	<input type="checkbox"/>	J84	0.70	82.46	143.93	87.39
45	<input type="checkbox"/>	J24	9.66	82.29	143.93	87.63
46	<input type="checkbox"/>	J178	5.63	82.30	144.05	87.78
47	<input type="checkbox"/>	J54	1.24	82.17	143.96	87.83
48	<input type="checkbox"/>	J132	0.00	82.11	143.94	87.89
49	<input type="checkbox"/>	J154	0.00	82.07	143.96	87.98
50	<input type="checkbox"/>	J58	3.41	82.05	143.96	88.01

ADD-JUNCTION

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
51	<input type="checkbox"/>	J130	0.00	82.01	143.93	88.03
52	<input type="checkbox"/>	J88	3.38	82.00	143.93	88.04
53	<input type="checkbox"/>	J134	0.74	81.80	143.97	88.39
54	<input type="checkbox"/>	J180	2.86	81.86	144.05	88.41
55	<input type="checkbox"/>	J80	0.19	81.70	143.94	88.48
56	<input type="checkbox"/>	J164	0.00	81.79	144.06	88.52
57	<input type="checkbox"/>	J14	0.00	81.75	144.03	88.53
58	<input type="checkbox"/>	J74	7.19	81.63	143.94	88.57
59	<input type="checkbox"/>	J92	8.34	81.61	143.93	88.59
60	<input type="checkbox"/>	J158	0.00	81.44	143.95	88.86
61	<input type="checkbox"/>	J44	3.24	81.47	143.98	88.87
62	<input type="checkbox"/>	J128	1.91	81.35	143.93	88.96
63	<input type="checkbox"/>	J200	0.00	81.35	143.93	88.96
64	<input type="checkbox"/>	J202	0.00	81.35	143.93	88.96
65	<input type="checkbox"/>	J112	0.00	81.34	143.95	89.00
66	<input type="checkbox"/>	J156	0.00	81.32	143.95	89.03
67	<input type="checkbox"/>	J114	0.00	81.23	143.95	89.16
68	<input type="checkbox"/>	J146	0.00	81.26	143.98	89.16
69	<input type="checkbox"/>	J182	2.79	81.31	144.05	89.19
70	<input type="checkbox"/>	J70	0.00	81.15	143.95	89.27
71	<input type="checkbox"/>	J64	8.79	81.10	143.95	89.35
72	<input type="checkbox"/>	J96	0.00	80.91	143.93	89.59
73	<input type="checkbox"/>	J48	0.00	80.79	143.93	89.76
74	<input type="checkbox"/>	J50	0.00	80.75	143.93	89.82
75	<input type="checkbox"/>	J250	0.00	80.85	144.05	89.85
76	<input type="checkbox"/>	J166	0.00	80.85	144.05	89.85
77	<input type="checkbox"/>	J142	0.00	80.35	144.00	90.48
78	<input type="checkbox"/>	J126	4.67	80.21	143.93	90.58
79	<input type="checkbox"/>	J100	9.81	80.10	143.93	90.74
80	<input type="checkbox"/>	J116	0.00	79.95	143.93	90.96
81	<input type="checkbox"/>	J104	3.76	79.92	143.93	91.00
82	<input type="checkbox"/>	J136	0.00	79.85	143.95	91.13
83	<input type="checkbox"/>	J258	0.00	79.85	144.05	91.27
84	<input type="checkbox"/>	J246	0.00	79.85	144.06	91.29
85	<input type="checkbox"/>	J62	14.25	79.65	143.96	91.42
86	<input type="checkbox"/>	J110	0.00	79.47	143.96	91.67
87	<input type="checkbox"/>	J124	0.00	79.44	143.93	91.68
88	<input type="checkbox"/>	J118	0.00	79.36	143.93	91.79
89	<input type="checkbox"/>	J122	0.00	79.33	143.93	91.84
90	<input type="checkbox"/>	J150	0.00	78.92	143.98	92.48
91	<input type="checkbox"/>	J120	0.00	78.33	143.93	93.26
92	<input type="checkbox"/>	J152	0.00	75.92	143.97	96.75

ADD-PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status	Flow Reversal Count
1	<input type="checkbox"/>	24	J44	J146	37.79	300.00	120.00	8.64	0.12	0.00	0.08	Open	0
2	<input type="checkbox"/>	25	J112	J114	11.08	300.00	120.00	-18.66	0.26	0.00	0.33	Open	0
3	<input type="checkbox"/>	26	J110	J116	162.84	300.00	120.00	12.37	0.17	0.03	0.16	Open	0
4	<input type="checkbox"/>	27	J116	J118	103.23	200.00	120.00	0.92	0.03	0.00	0.01	Open	0
5	<input type="checkbox"/>	28	J120	J118	17.79	200.00	120.00	0.51	0.02	0.00	0.00	Open	0
6	<input type="checkbox"/>	29	J118	J122	14.95	200.00	120.00	1.43	0.05	0.00	0.02	Open	0
7	<input type="checkbox"/>	30	J122	J124	88.59	200.00	120.00	1.43	0.05	0.00	0.02	Open	0
8	<input type="checkbox"/>	31	J124	J126	144.09	200.00	120.00	1.43	0.05	0.00	0.02	Open	0
9	<input type="checkbox"/>	32	J50	J120	146.51	200.00	120.00	0.51	0.02	0.00	0.00	Open	0
10	<input type="checkbox"/>	33	J130	J128	112.40	200.00	120.00	0.94	0.03	0.00	0.01	Open	0
11	<input type="checkbox"/>	34	J130	J112	156.59	300.00	120.00	-8.82	0.12	0.01	0.08	Open	0
12	<input type="checkbox"/>	35	J74	J112	79.98	300.00	120.00	-9.84	0.14	0.01	0.10	Open	0
13	<input type="checkbox"/>	36	J248	J14	98.08	400.00	120.00	35.32	0.28	0.03	0.27	Open	0
14	<input type="checkbox"/>	37	J134	J136	166.63	300.00	120.00	10.68	0.15	0.02	0.12	Open	0
15	<input type="checkbox"/>	38	J138	J24	110.22	300.00	120.00	-0.44	0.01	0.00	0.00	Open	0
16	<input type="checkbox"/>	40	J142	J146	135.17	300.00	120.00	11.35	0.16	0.02	0.13	Open	0
17	<input type="checkbox"/>	41	J144	J134	154.56	300.00	120.00	11.88	0.17	0.02	0.14	Open	0
18	<input type="checkbox"/>	42	J126	J104	40.45	200.00	120.00	-3.24	0.10	0.00	0.09	Open	0
19	<input type="checkbox"/>	6	J40	J38	120.78	300.00	120.00	-10.20	0.14	0.01	0.11	Open	0
20	<input type="checkbox"/>	8	J48	J50	91.46	200.00	120.00	1.11	0.04	0.00	0.01	Open	0
21	<input type="checkbox"/>	P101	J176	J174	98.07	300.00	120.00	0.98	0.01	0.00	0.00	Open	0
22	<input type="checkbox"/>	P103	J230	J192	198.76	250.00	110.00	1.05	0.02	0.00	0.00	Open	0
23	<input type="checkbox"/>	P105	J204	J270	51.89	300.00	120.00	-1.38	0.02	0.00	0.00	Open	0
24	<input type="checkbox"/>	P107	J160	J10	21.74	300.00	120.00	-0.46	0.01	0.00	0.00	Open	0
25	<input type="checkbox"/>	P109	J164	J230	173.09	250.00	110.00	1.05	0.02	0.00	0.00	Open	0
26	<input type="checkbox"/>	P111	J162	J164	99.75	300.00	120.00	7.19	0.10	0.01	0.06	Open	0
27	<input type="checkbox"/>	P113	J164	J166	86.36	300.00	120.00	6.14	0.09	0.00	0.04	Open	0
28	<input type="checkbox"/>	P115	J166	J182	102.73	300.00	120.00	6.14	0.09	0.00	0.04	Open	0
29	<input type="checkbox"/>	P117	J182	J180	97.29	300.00	120.00	3.35	0.05	0.00	0.01	Open	0
30	<input type="checkbox"/>	P119	J180	J178	85.87	300.00	120.00	0.49	0.01	0.00	0.00	Open	0
31	<input type="checkbox"/>	P121	J212	J268	72.14	300.00	120.00	-3.95	0.06	0.00	0.02	Open	0
32	<input type="checkbox"/>	P129	J218	J220	71.02	300.00	120.00	3.18	0.05	0.00	0.01	Open	0
33	<input type="checkbox"/>	P13	J146	J134	109.84	300.00	120.00	6.60	0.09	0.01	0.05	Open	0
34	<input type="checkbox"/>	P131	J220	J222	64.95	300.00	120.00	-0.97	0.01	0.00	0.00	Open	0
35	<input type="checkbox"/>	P133	J222	J224	89.72	300.00	120.00	4.17	0.06	0.00	0.02	Open	0
36	<input type="checkbox"/>	P135	J224	J226	83.02	300.00	120.00	0.02	0.00	0.00	0.00	Open	0
37	<input type="checkbox"/>	P143	J18	J270	13.46	400.00	120.00	23.61	0.19	0.00	0.13	Open	0
38	<input type="checkbox"/>	P145	J190	J192	58.87	400.00	120.00	18.11	0.14	0.00	0.08	Open	0
39	<input type="checkbox"/>	P147	J192	J194	53.65	400.00	120.00	14.13	0.11	0.00	0.05	Open	0
40	<input type="checkbox"/>	P15	J146	J62	118.80	300.00	120.00	13.38	0.19	0.02	0.18	Open	0
41	<input type="checkbox"/>	P151	J214	J212	67.91	300.00	120.00	-1.70	0.02	0.00	0.00	Open	0
42	<input type="checkbox"/>	P153	J210	J240	125.40	250.00	110.00	3.31	0.07	0.00	0.04	Open	0
43	<input type="checkbox"/>	P155	J196	J30	100.45	400.00	120.00	33.52	0.27	0.02	0.24	Open	0
44	<input type="checkbox"/>	P157	J194	J198	49.89	400.00	120.00	14.13	0.11	0.00	0.05	Open	0
45	<input type="checkbox"/>	P159	J128	J200	133.31	200.00	120.00	-0.37	0.01	0.00	0.00	Open	0
46	<input type="checkbox"/>	P161	J208	J268	64.21	300.00	120.00	-4.58	0.06	0.00	0.02	Open	0
47	<input type="checkbox"/>	P163	J202	J138	119.12	200.00	120.00	-0.37	0.01	0.00	0.00	Open	0
48	<input type="checkbox"/>	P165	J136	J96	166.15	300.00	120.00	10.94	0.15	0.02	0.12	Open	0
49	<input type="checkbox"/>	P167	J200	J202	11.25	200.00	120.00	-0.37	0.01	0.00	0.00	Open	0
50	<input type="checkbox"/>	P169	J206	J208	82.38	300.00	120.00	-2.97	0.04	0.00	0.01	Open	0
51	<input type="checkbox"/>	P17	J62	J110	47.94	300.00	120.00	-0.87	0.01	0.00	0.00	Open	0
52	<input type="checkbox"/>	P171	J206	J204	69.88	300.00	120.00	0.63	0.01	0.00	0.00	Open	0
53	<input type="checkbox"/>	P175	J210	J222	86.86	300.00	120.00	17.02	0.24	0.02	0.28	Open	0
54	<input type="checkbox"/>	P177	J172	J174	81.01	300.00	120.00	0.33	0.00	0.00	0.00	Open	0
55	<input type="checkbox"/>	P179	J172	J162	87.33	300.00	120.00	-4.61	0.07	0.00	0.03	Open	0
56	<input type="checkbox"/>	P183	J232	J210	120.26	250.00	110.00	5.02	0.10	0.01	0.08	Open	0
57	<input type="checkbox"/>	P185	RES9002	J262	48.40	600.00	120.00	141.76	0.50	0.02	0.49	Open	0
58	<input type="checkbox"/>	P187	J214	J160	63.52	300.00	120.00	-0.46	0.01	0.00	0.00	Open	0
59	<input type="checkbox"/>	P189	J226	J34	51.07	300.00	120.00	-3.57	0.05	0.00	0.02	Open	0
60	<input type="checkbox"/>	P19	J20	J54	117.59	300.00	120.00	-8.49	0.12	0.01	0.08	Open	0
61	<input type="checkbox"/>	P191	J192	J232	147.89	250.00	110.00	5.02	0.10	0.01	0.08	Open	0
62	<input type="checkbox"/>	P193	J218	J234	71.16	300.00	120.00	-15.26	0.22	0.02	0.23	Open	0
63	<input type="checkbox"/>	P195	J178	J198	86.78	300.00	120.00	-5.14	0.07	0.00	0.03	Open	0
64	<input type="checkbox"/>	P197	J176	J270	106.19	300.00	120.00	-4.13	0.06	0.00	0.02	Open	0



ADD-PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status	Flow Reversal Count
65	<input type="checkbox"/>	P199	J170	J268	10.33	300.00	120.00	25.35	0.36	0.01	0.59	Open	0
66	<input type="checkbox"/>	P201	J234	J198	61.08	300.00	120.00	-20.69	0.29	0.02	0.40	Open	0
67	<input type="checkbox"/>	P21	J14	J142	106.09	400.00	120.00	35.32	0.28	0.03	0.27	Open	0
68	<input type="checkbox"/>	P215	J240	J30	102.65	250.00	110.00	3.31	0.07	0.00	0.04	Open	0
69	<input type="checkbox"/>	P217	J222	J144	93.00	300.00	120.00	11.88	0.17	0.01	0.14	Open	0
70	<input type="checkbox"/>	P219	J218	J46	95.10	300.00	120.00	11.88	0.17	0.01	0.14	Open	0
71	<input type="checkbox"/>	P225	J246	J266	355.06	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
72	<input type="checkbox"/>	P229	J250	J248	375.46	600.00	120.00	0.00	0.00	0.00	0.00	Open	0
73	<input type="checkbox"/>	P231	J248	J18	220.67	600.00	120.00	-47.01	0.17	0.01	0.06	Open	0
74	<input type="checkbox"/>	P235	J252	J250	182.26	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
75	<input type="checkbox"/>	P237	J250	J258	89.25	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
76	<input type="checkbox"/>	P239	J248	J198	10.64	400.00	120.00	11.70	0.09	0.00	0.03	Open	0
77	<input type="checkbox"/>	P241	J162	J266	79.26	600.00	120.00	-11.80	0.04	0.00	0.00	Open	0
78	<input type="checkbox"/>	P243	J18	J262	118.60	600.00	120.00	-82.43	0.29	0.02	0.18	Open	0
79	<input type="checkbox"/>	P245	J170	J10	221.78	600.00	120.00	33.98	0.12	0.01	0.03	Open	0
80	<input type="checkbox"/>	P247	J262	J170	148.23	600.00	120.00	59.33	0.21	0.01	0.10	Open	0
81	<input type="checkbox"/>	P249	J266	J18	292.37	600.00	120.00	-11.80	0.04	0.00	0.00	Open	0
82	<input type="checkbox"/>	P25	J150	J152	12.66	400.00	120.00	23.97	0.19	0.00	0.13	Open	0
83	<input type="checkbox"/>	P251	J268	J210	117.75	300.00	120.00	16.82	0.24	0.03	0.27	Open	0
84	<input type="checkbox"/>	P253	J270	J190	37.69	400.00	120.00	18.11	0.14	0.00	0.08	Open	0
85	<input type="checkbox"/>	P27	J152	J110	132.14	400.00	120.00	23.97	0.19	0.02	0.13	Open	0
86	<input type="checkbox"/>	P29	J110	J136	128.24	400.00	120.00	10.74	0.09	0.00	0.03	Open	0
87	<input type="checkbox"/>	P31	J136	J64	180.81	400.00	120.00	10.48	0.08	0.01	0.03	Open	0
88	<input type="checkbox"/>	P33	J64	J70	14.43	400.00	120.00	1.69	0.01	0.00	0.00	Open	0
89	<input type="checkbox"/>	P35	J70	J156	34.75	400.00	120.00	1.69	0.01	0.00	0.00	Open	0
90	<input type="checkbox"/>	P37	J156	J114	6.20	400.00	120.00	1.69	0.01	0.00	0.00	Open	0
91	<input type="checkbox"/>	P39	J114	J158	17.17	400.00	120.00	-16.97	0.14	0.00	0.07	Open	0
92	<input type="checkbox"/>	P41	J154	J158	153.05	400.00	120.00	16.97	0.14	0.01	0.07	Open	0
93	<input type="checkbox"/>	P43	J42	J154	156.43	400.00	120.00	23.05	0.18	0.02	0.12	Open	0
94	<input type="checkbox"/>	P45	J34	J42	120.68	400.00	120.00	33.26	0.26	0.03	0.24	Open	0
95	<input type="checkbox"/>	P47	J30	J34	57.66	400.00	120.00	36.82	0.29	0.02	0.29	Open	0
96	<input type="checkbox"/>	P51	J58	J134	228.31	300.00	120.00	-7.06	0.10	0.01	0.05	Open	0
97	<input type="checkbox"/>	P53	J154	J58	39.98	300.00	120.00	-3.65	0.05	0.00	0.02	Open	0
98	<input type="checkbox"/>	P55	J104	J116	41.94	300.00	120.00	-7.00	0.10	0.00	0.05	Open	0
99	<input type="checkbox"/>	P57	J116	J100	77.25	300.00	120.00	4.45	0.06	0.00	0.02	Open	0
100	<input type="checkbox"/>	P59	J100	J96	84.08	300.00	120.00	-5.36	0.08	0.00	0.03	Open	0
101	<input type="checkbox"/>	P61	J96	J48	6.45	300.00	120.00	5.57	0.08	0.00	0.03	Open	0
102	<input type="checkbox"/>	P63	J48	J92	120.82	300.00	120.00	4.46	0.06	0.00	0.02	Open	0
103	<input type="checkbox"/>	P65	J92	J130	97.59	300.00	120.00	-3.88	0.05	0.00	0.02	Open	0
104	<input type="checkbox"/>	P69	J84	J88	69.90	300.00	120.00	-0.62	0.01	0.00	0.00	Open	0
105	<input type="checkbox"/>	P71	J138	J84	53.85	300.00	120.00	0.08	0.00	0.00	0.00	Open	0
106	<input type="checkbox"/>	P73	J132	J24	44.79	300.00	120.00	10.10	0.14	0.00	0.11	Open	0
107	<input type="checkbox"/>	P75	J20	J132	172.60	300.00	120.00	7.64	0.11	0.01	0.06	Open	0
108	<input type="checkbox"/>	P77	J40	J20	159.11	300.00	120.00	9.51	0.13	0.02	0.10	Open	0
109	<input type="checkbox"/>	P79	J50	J128	234.05	200.00	120.00	0.60	0.02	0.00	0.00	Open	0
110	<input type="checkbox"/>	P81	J38	J42	35.30	300.00	120.00	-10.20	0.14	0.00	0.11	Open	0
111	<input type="checkbox"/>	P83	J54	J154	41.53	300.00	120.00	-9.73	0.14	0.00	0.10	Open	0
112	<input type="checkbox"/>	P85	J80	J74	13.52	300.00	120.00	-2.65	0.04	0.00	0.01	Open	0
113	<input type="checkbox"/>	P87	J132	J80	74.26	300.00	120.00	-2.46	0.03	0.00	0.01	Open	0
114	<input type="checkbox"/>	P89	J10	J196	62.59	400.00	120.00	33.52	0.27	0.02	0.24	Open	0
115	<input type="checkbox"/>	P93	J88	J130	30.88	300.00	120.00	-4.00	0.06	0.00	0.02	Open	0
116	<input type="checkbox"/>	P95	J142	J150	156.08	400.00	120.00	23.97	0.19	0.02	0.13	Open	0
117	<input type="checkbox"/>	P97	J46	J44	100.05	300.00	120.00	11.88	0.17	0.01	0.14	Open	0

MDD-JUNCTION

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
1	<input type="checkbox"/>	J206	4.67	86.44	143.96	81.77
2	<input type="checkbox"/>	J262	0.00	86.44	144.03	81.87
3	<input type="checkbox"/>	J208	3.22	86.29	143.96	81.99
4	<input type="checkbox"/>	J204	4.02	86.27	143.96	82.01
5	<input type="checkbox"/>	J270	0.00	86.12	143.96	82.22
6	<input type="checkbox"/>	J18	0.00	86.12	143.96	82.23
7	<input type="checkbox"/>	J170	0.00	86.05	143.99	82.36
8	<input type="checkbox"/>	J268	0.00	86.02	143.97	82.37
9	<input type="checkbox"/>	J212	4.49	85.69	143.96	82.84
10	<input type="checkbox"/>	J210	3.03	85.54	143.86	82.91
11	<input type="checkbox"/>	J176	6.29	85.60	143.95	82.95
12	<input type="checkbox"/>	J214	4.31	85.28	143.96	83.42
13	<input type="checkbox"/>	J174	2.61	85.14	143.95	83.60
14	<input type="checkbox"/>	J190	0.00	85.04	143.95	83.74
15	<input type="checkbox"/>	J160	0.00	85.03	143.96	83.78
16	<input type="checkbox"/>	J232	0.00	84.93	143.90	83.83
17	<input type="checkbox"/>	J10	0.00	84.86	143.96	84.02
18	<input type="checkbox"/>	J240	0.00	84.37	143.85	84.56
19	<input type="checkbox"/>	J172	8.57	84.43	143.95	84.61
20	<input type="checkbox"/>	J266	0.00	84.43	143.96	84.63
21	<input type="checkbox"/>	J192	0.00	84.17	143.93	84.96
22	<input type="checkbox"/>	J196	0.00	84.10	143.91	85.03
23	<input type="checkbox"/>	J220	8.30	83.90	143.79	85.13
24	<input type="checkbox"/>	J222	0.00	83.80	143.79	85.28
25	<input type="checkbox"/>	J40	0.97	83.61	143.65	85.36
26	<input type="checkbox"/>	J252	0.00	83.72	143.92	85.58
27	<input type="checkbox"/>	J162	0.00	83.72	143.96	85.63
28	<input type="checkbox"/>	J218	0.41	83.53	143.79	85.66
29	<input type="checkbox"/>	J30	0.00	83.41	143.84	85.90
30	<input type="checkbox"/>	J224	8.30	83.31	143.78	85.97
31	<input type="checkbox"/>	J34	0.00	83.24	143.79	86.07
32	<input type="checkbox"/>	J194	0.00	83.38	143.93	86.07
33	<input type="checkbox"/>	J234	10.87	83.18	143.84	86.23
34	<input type="checkbox"/>	J144	0.00	83.05	143.75	86.29
35	<input type="checkbox"/>	J42	0.00	82.93	143.70	86.39
36	<input type="checkbox"/>	J20	14.50	82.84	143.61	86.39
37	<input type="checkbox"/>	J138	0.00	82.78	143.55	86.40
38	<input type="checkbox"/>	J38	0.00	82.86	143.69	86.47
39	<input type="checkbox"/>	J226	7.18	82.95	143.78	86.48
40	<input type="checkbox"/>	J46	0.00	82.71	143.75	86.77
41	<input type="checkbox"/>	J84	0.98	82.46	143.55	86.85
42	<input type="checkbox"/>	J198	0.00	82.80	143.92	86.89
43	<input type="checkbox"/>	J248	0.00	82.80	143.92	86.89
44	<input type="checkbox"/>	J230	0.00	82.77	143.94	86.95
45	<input type="checkbox"/>	J24	13.52	82.29	143.56	87.10
46	<input type="checkbox"/>	J132	0.00	82.11	143.57	87.37
47	<input type="checkbox"/>	J54	2.49	82.17	143.63	87.37
48	<input type="checkbox"/>	J130	0.00	82.01	143.55	87.49
49	<input type="checkbox"/>	J88	6.59	82.00	143.55	87.50
50	<input type="checkbox"/>	J154	0.00	82.07	143.64	87.53

MDD-JUNCTION

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
51	<input type="checkbox"/>	J58	6.82	82.05	143.64	87.56
52	<input type="checkbox"/>	J178	11.26	82.30	143.91	87.58
53	<input type="checkbox"/>	J80	0.27	81.70	143.57	87.95
54	<input type="checkbox"/>	J134	1.04	81.80	143.68	87.97
55	<input type="checkbox"/>	J92	16.37	81.61	143.55	88.05
56	<input type="checkbox"/>	J74	14.39	81.63	143.57	88.05
57	<input type="checkbox"/>	J180	5.72	81.86	143.91	88.21
58	<input type="checkbox"/>	J14	0.00	81.75	143.84	88.26
59	<input type="checkbox"/>	J164	0.00	81.79	143.94	88.35
60	<input type="checkbox"/>	J158	0.00	81.44	143.61	88.38
61	<input type="checkbox"/>	J128	2.67	81.35	143.55	88.42
62	<input type="checkbox"/>	J200	0.00	81.35	143.55	88.43
63	<input type="checkbox"/>	J202	0.00	81.35	143.55	88.43
64	<input type="checkbox"/>	J44	6.48	81.47	143.70	88.47
65	<input type="checkbox"/>	J112	0.00	81.34	143.59	88.50
66	<input type="checkbox"/>	J156	0.00	81.32	143.60	88.54
67	<input type="checkbox"/>	J114	0.00	81.23	143.60	88.67
68	<input type="checkbox"/>	J146	0.00	81.26	143.69	88.75
69	<input type="checkbox"/>	J70	0.00	81.15	143.60	88.78
70	<input type="checkbox"/>	J64	17.58	81.10	143.60	88.85
71	<input type="checkbox"/>	J182	5.57	81.31	143.91	88.99
72	<input type="checkbox"/>	J96	0.00	80.91	143.55	89.05
73	<input type="checkbox"/>	J48	0.00	80.79	143.55	89.22
74	<input type="checkbox"/>	J50	0.00	80.75	143.55	89.28
75	<input type="checkbox"/>	J250	0.00	80.85	143.92	89.66
76	<input type="checkbox"/>	J166	0.00	80.85	143.93	89.67
77	<input type="checkbox"/>	J126	9.20	80.21	143.53	90.01
78	<input type="checkbox"/>	J142	0.00	80.35	143.75	90.13
79	<input type="checkbox"/>	J100	19.44	80.10	143.54	90.19
80	<input type="checkbox"/>	J116	0.00	79.95	143.55	90.41
81	<input type="checkbox"/>	J104	7.53	79.92	143.54	90.44
82	<input type="checkbox"/>	J136	0.00	79.85	143.62	90.65
83	<input type="checkbox"/>	J62	28.29	79.65	143.63	90.95
84	<input type="checkbox"/>	J258	0.00	79.85	143.92	91.08
85	<input type="checkbox"/>	J124	0.00	79.44	143.54	91.12
86	<input type="checkbox"/>	J246	0.00	79.85	143.96	91.14
87	<input type="checkbox"/>	J110	0.00	79.47	143.63	91.20
88	<input type="checkbox"/>	J118	0.00	79.36	143.55	91.25
89	<input type="checkbox"/>	J122	0.00	79.33	143.54	91.29
90	<input type="checkbox"/>	J150	0.00	78.92	143.69	92.07
91	<input type="checkbox"/>	J120	0.00	78.33	143.55	92.71
92	<input type="checkbox"/>	J152	0.00	75.92	143.68	96.33

MDD-PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status	Flow Reversal Count
1	<input type="checkbox"/>	24	J44	J146	37.79	300.00	120.00	15.44	0.22	0.01	0.23	Open	0
2	<input type="checkbox"/>	25	J112	J114	11.08	300.00	120.00	-32.53	0.46	0.01	0.93	Open	0
3	<input type="checkbox"/>	26	J110	J116	162.84	300.00	120.00	22.93	0.32	0.08	0.49	Open	0
4	<input type="checkbox"/>	27	J116	J118	103.23	200.00	120.00	1.16	0.04	0.00	0.01	Open	0
5	<input type="checkbox"/>	28	J120	J118	17.79	200.00	120.00	1.77	0.06	0.00	0.03	Open	0
6	<input type="checkbox"/>	29	J118	J122	14.95	200.00	120.00	2.94	0.09	0.00	0.08	Open	0
7	<input type="checkbox"/>	30	J122	J124	88.59	200.00	120.00	2.94	0.09	0.01	0.08	Open	0
8	<input type="checkbox"/>	31	J124	J126	144.09	200.00	120.00	2.94	0.09	0.01	0.08	Open	0
9	<input type="checkbox"/>	32	J50	J120	146.51	200.00	120.00	1.77	0.06	0.00	0.03	Open	0
10	<input type="checkbox"/>	33	J130	J128	112.40	200.00	120.00	1.82	0.06	0.00	0.03	Open	0
11	<input type="checkbox"/>	34	J130	J112	156.59	300.00	120.00	-15.73	0.22	0.04	0.24	Open	0
12	<input type="checkbox"/>	35	J74	J112	79.98	300.00	120.00	-16.79	0.24	0.02	0.27	Open	0
13	<input type="checkbox"/>	36	J248	J14	98.08	400.00	120.00	65.40	0.52	0.08	0.84	Open	0
14	<input type="checkbox"/>	37	J134	J136	166.63	300.00	120.00	19.81	0.28	0.06	0.37	Open	0
15	<input type="checkbox"/>	38	J138	J24	110.22	300.00	120.00	-4.03	0.06	0.00	0.02	Open	0
16	<input type="checkbox"/>	40	J142	J146	135.17	300.00	120.00	20.99	0.30	0.06	0.41	Open	0
17	<input type="checkbox"/>	41	J144	J134	154.56	300.00	120.00	21.74	0.31	0.07	0.44	Open	0
18	<input type="checkbox"/>	42	J126	J104	40.45	200.00	120.00	-6.26	0.20	0.01	0.32	Open	0
19	<input type="checkbox"/>	6	J40	J38	120.78	300.00	120.00	-17.63	0.25	0.04	0.30	Open	0
20	<input type="checkbox"/>	8	J48	J50	91.46	200.00	120.00	1.45	0.05	0.00	0.02	Open	0
21	<input type="checkbox"/>	P101	J176	J174	98.07	300.00	120.00	2.00	0.03	0.00	0.01	Open	0
22	<input type="checkbox"/>	P103	J230	J192	198.76	250.00	110.00	1.84	0.04	0.00	0.01	Open	0
23	<input type="checkbox"/>	P105	J204	J270	51.89	300.00	120.00	-2.75	0.04	0.00	0.01	Open	0
24	<input type="checkbox"/>	P107	J160	J10	21.74	300.00	120.00	-1.43	0.02	0.00	0.00	Open	0
25	<input type="checkbox"/>	P109	J164	J230	173.09	250.00	110.00	1.84	0.04	0.00	0.01	Open	0
26	<input type="checkbox"/>	P111	J162	J164	99.75	300.00	120.00	13.69	0.19	0.02	0.19	Open	0
27	<input type="checkbox"/>	P113	J164	J166	86.36	300.00	120.00	11.85	0.17	0.01	0.14	Open	0
28	<input type="checkbox"/>	P115	J166	J182	102.73	300.00	120.00	11.85	0.17	0.01	0.14	Open	0
29	<input type="checkbox"/>	P117	J182	J180	97.29	300.00	120.00	6.28	0.09	0.00	0.04	Open	0
30	<input type="checkbox"/>	P119	J180	J178	85.87	300.00	120.00	0.56	0.01	0.00	0.00	Open	0
31	<input type="checkbox"/>	P121	J212	J268	72.14	300.00	120.00	-7.37	0.10	0.00	0.06	Open	0
32	<input type="checkbox"/>	P129	J218	J220	71.02	300.00	120.00	5.63	0.08	0.00	0.04	Open	0
33	<input type="checkbox"/>	P13	J146	J134	109.84	300.00	120.00	11.51	0.16	0.01	0.14	Open	0
34	<input type="checkbox"/>	P131	J220	J222	64.95	300.00	120.00	-2.67	0.04	0.00	0.01	Open	0
35	<input type="checkbox"/>	P133	J222	J224	89.72	300.00	120.00	7.29	0.10	0.01	0.06	Open	0
36	<input type="checkbox"/>	P135	J224	J226	83.02	300.00	120.00	-1.01	0.01	0.00	0.00	Open	0
37	<input type="checkbox"/>	P143	J18	J270	13.46	400.00	120.00	45.05	0.36	0.01	0.42	Open	0
38	<input type="checkbox"/>	P145	J190	J192	58.87	400.00	120.00	34.01	0.27	0.01	0.25	Open	0
39	<input type="checkbox"/>	P147	J192	J194	53.65	400.00	120.00	26.55	0.21	0.01	0.16	Open	0
40	<input type="checkbox"/>	P15	J146	J62	118.80	300.00	120.00	24.92	0.35	0.07	0.57	Open	0
41	<input type="checkbox"/>	P151	J214	J212	67.91	300.00	120.00	-2.88	0.04	0.00	0.01	Open	0
42	<input type="checkbox"/>	P153	J210	J240	125.40	250.00	110.00	5.99	0.12	0.01	0.12	Open	0
43	<input type="checkbox"/>	P155	J196	J30	100.45	400.00	120.00	62.27	0.50	0.08	0.76	Open	0
44	<input type="checkbox"/>	P157	J194	J198	49.89	400.00	120.00	26.55	0.21	0.01	0.16	Open	0
45	<input type="checkbox"/>	P159	J128	J200	133.31	200.00	120.00	-1.17	0.04	0.00	0.01	Open	0
46	<input type="checkbox"/>	P161	J208	J268	64.21	300.00	120.00	-9.16	0.13	0.01	0.09	Open	0
47	<input type="checkbox"/>	P163	J202	J138	119.12	200.00	120.00	-1.17	0.04	0.00	0.01	Open	0
48	<input type="checkbox"/>	P165	J136	J96	166.15	300.00	120.00	20.09	0.28	0.06	0.38	Open	0
49	<input type="checkbox"/>	P167	J200	J202	11.25	200.00	120.00	-1.17	0.04	0.00	0.01	Open	0
50	<input type="checkbox"/>	P169	J206	J208	82.38	300.00	120.00	-5.94	0.08	0.00	0.04	Open	0
51	<input type="checkbox"/>	P17	J62	J110	47.94	300.00	120.00	-3.37	0.05	0.00	0.01	Open	0
52	<input type="checkbox"/>	P171	J206	J204	69.88	300.00	120.00	1.27	0.02	0.00	0.00	Open	0
53	<input type="checkbox"/>	P175	J210	J222	86.86	300.00	120.00	31.71	0.45	0.08	0.89	Open	0
54	<input type="checkbox"/>	P177	J172	J174	81.01	300.00	120.00	0.61	0.01	0.00	0.00	Open	0
55	<input type="checkbox"/>	P179	J172	J162	87.33	300.00	120.00	-9.18	0.13	0.01	0.09	Open	0
56	<input type="checkbox"/>	P183	J232	J210	120.26	250.00	110.00	9.30	0.19	0.03	0.26	Open	0
57	<input type="checkbox"/>	P185	RES9002	J262	48.40	600.00	120.00	267.95	0.95	0.08	1.58	Open	0
58	<input type="checkbox"/>	P187	J214	J160	63.52	300.00	120.00	-1.43	0.02	0.00	0.00	Open	0
59	<input type="checkbox"/>	P189	J226	J34	51.07	300.00	120.00	-8.19	0.12	0.00	0.07	Open	0
60	<input type="checkbox"/>	P19	J20	J54	117.59	300.00	120.00	-13.26	0.19	0.02	0.18	Open	0
61	<input type="checkbox"/>	P191	J192	J232	147.89	250.00	110.00	9.30	0.19	0.04	0.26	Open	0
62	<input type="checkbox"/>	P193	J218	J234	71.16	300.00	120.00	-27.96	0.40	0.05	0.70	Open	0
63	<input type="checkbox"/>	P195	J178	J198	86.78	300.00	120.00	-10.70	0.15	0.01	0.12	Open	0
64	<input type="checkbox"/>	P197	J176	J270	106.19	300.00	120.00	-8.29	0.12	0.01	0.07	Open	0

MDD-PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status	Flow Reversal Count
65	<input type="checkbox"/>	P199	J170	J268	10.33	300.00	120.00	47.95	0.68	0.02	1.91	Open	0
66	<input type="checkbox"/>	P201	J234	J198	61.08	300.00	120.00	-38.83	0.55	0.08	1.29	Open	0
67	<input type="checkbox"/>	P21	J14	J142	106.09	400.00	120.00	65.40	0.52	0.09	0.84	Open	0
68	<input type="checkbox"/>	P215	J240	J30	102.65	250.00	110.00	5.99	0.12	0.01	0.12	Open	0
69	<input type="checkbox"/>	P217	J222	J144	93.00	300.00	120.00	21.74	0.31	0.04	0.44	Open	0
70	<input type="checkbox"/>	P219	J218	J46	95.10	300.00	120.00	21.92	0.31	0.04	0.45	Open	0
71	<input type="checkbox"/>	P225	J246	J266	355.06	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
72	<input type="checkbox"/>	P229	J250	J248	375.46	600.00	120.00	0.00	0.00	0.00	0.00	Open	0
73	<input type="checkbox"/>	P231	J248	J18	220.67	600.00	120.00	-88.38	0.31	0.04	0.20	Open	0
74	<input type="checkbox"/>	P235	J252	J250	182.26	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
75	<input type="checkbox"/>	P237	J250	J258	89.25	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
76	<input type="checkbox"/>	P239	J248	J198	10.64	400.00	120.00	22.98	0.18	0.00	0.12	Open	0
77	<input type="checkbox"/>	P241	J162	J266	79.26	600.00	120.00	-22.87	0.08	0.00	0.02	Open	0
78	<input type="checkbox"/>	P243	J18	J262	118.60	600.00	120.00	-156.30	0.55	0.07	0.58	Open	0
79	<input type="checkbox"/>	P245	J170	J10	221.78	600.00	120.00	63.70	0.23	0.02	0.11	Open	0
80	<input type="checkbox"/>	P247	J262	J170	148.23	600.00	120.00	111.65	0.39	0.05	0.31	Open	0
81	<input type="checkbox"/>	P249	J266	J18	292.37	600.00	120.00	-22.87	0.08	0.00	0.02	Open	0
82	<input type="checkbox"/>	P25	J150	J152	12.66	400.00	120.00	44.41	0.35	0.01	0.41	Open	0
83	<input type="checkbox"/>	P251	J268	J210	117.75	300.00	120.00	31.42	0.44	0.10	0.87	Open	0
84	<input type="checkbox"/>	P253	J270	J190	37.69	400.00	120.00	34.01	0.27	0.01	0.25	Open	0
85	<input type="checkbox"/>	P27	J152	J110	132.14	400.00	120.00	44.41	0.35	0.05	0.41	Open	0
86	<input type="checkbox"/>	P29	J110	J136	128.24	400.00	120.00	18.11	0.14	0.01	0.08	Open	0
87	<input type="checkbox"/>	P31	J136	J64	180.81	400.00	120.00	17.83	0.14	0.01	0.08	Open	0
88	<input type="checkbox"/>	P33	J64	J70	14.43	400.00	120.00	0.25	0.00	0.00	0.00	Open	0
89	<input type="checkbox"/>	P35	J70	J156	34.75	400.00	120.00	0.25	0.00	0.00	0.00	Open	0
90	<input type="checkbox"/>	P37	J156	J114	6.20	400.00	120.00	0.25	0.00	0.00	0.00	Open	0
91	<input type="checkbox"/>	P39	J114	J158	17.17	400.00	120.00	-32.27	0.26	0.00	0.23	Open	0
92	<input type="checkbox"/>	P41	J154	J158	153.05	400.00	120.00	32.27	0.26	0.03	0.23	Open	0
93	<input type="checkbox"/>	P43	J42	J154	156.43	400.00	120.00	42.45	0.34	0.06	0.38	Open	0
94	<input type="checkbox"/>	P45	J34	J42	120.68	400.00	120.00	60.07	0.48	0.09	0.71	Open	0
95	<input type="checkbox"/>	P47	J30	J34	57.66	400.00	120.00	68.26	0.54	0.05	0.91	Open	0
96	<input type="checkbox"/>	P51	J58	J134	228.31	300.00	120.00	-12.40	0.18	0.04	0.16	Open	0
97	<input type="checkbox"/>	P53	J154	J58	39.98	300.00	120.00	-5.58	0.08	0.00	0.04	Open	0
98	<input type="checkbox"/>	P55	J104	J116	41.94	300.00	120.00	-13.79	0.20	0.01	0.19	Open	0
99	<input type="checkbox"/>	P57	J116	J100	77.25	300.00	120.00	7.97	0.11	0.01	0.07	Open	0
100	<input type="checkbox"/>	P59	J100	J96	84.08	300.00	120.00	-11.47	0.16	0.01	0.14	Open	0
101	<input type="checkbox"/>	P61	J96	J48	6.45	300.00	120.00	8.62	0.12	0.00	0.08	Open	0
102	<input type="checkbox"/>	P63	J48	J92	120.82	300.00	120.00	7.16	0.10	0.01	0.06	Open	0
103	<input type="checkbox"/>	P65	J92	J130	97.59	300.00	120.00	-9.21	0.13	0.01	0.09	Open	0
104	<input type="checkbox"/>	P69	J84	J88	69.90	300.00	120.00	1.88	0.03	0.00	0.00	Open	0
105	<input type="checkbox"/>	P71	J138	J84	53.85	300.00	120.00	2.86	0.04	0.00	0.01	Open	0
106	<input type="checkbox"/>	P73	J132	J24	44.79	300.00	120.00	17.55	0.25	0.01	0.30	Open	0
107	<input type="checkbox"/>	P75	J20	J132	172.60	300.00	120.00	15.42	0.22	0.04	0.23	Open	0
108	<input type="checkbox"/>	P77	J40	J20	159.11	300.00	120.00	16.66	0.24	0.04	0.27	Open	0
109	<input type="checkbox"/>	P79	J50	J128	234.05	200.00	120.00	-0.32	0.01	0.00	0.00	Open	0
110	<input type="checkbox"/>	P81	J38	J42	35.30	300.00	120.00	-17.63	0.25	0.01	0.30	Open	0
111	<input type="checkbox"/>	P83	J54	J154	41.53	300.00	120.00	-15.75	0.22	0.01	0.24	Open	0
112	<input type="checkbox"/>	P85	J80	J74	13.52	300.00	120.00	-2.40	0.03	0.00	0.01	Open	0
113	<input type="checkbox"/>	P87	J132	J80	74.26	300.00	120.00	-2.13	0.03	0.00	0.01	Open	0
114	<input type="checkbox"/>	P89	J10	J196	62.59	400.00	120.00	62.27	0.50	0.05	0.76	Open	0
115	<input type="checkbox"/>	P93	J88	J130	30.88	300.00	120.00	-4.71	0.07	0.00	0.03	Open	0
116	<input type="checkbox"/>	P95	J142	J150	156.08	400.00	120.00	44.41	0.35	0.06	0.41	Open	0
117	<input type="checkbox"/>	P97	J46	J44	100.05	300.00	120.00	21.92	0.31	0.04	0.45	Open	0

PHD-JUNCTION

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
1	<input type="checkbox"/>	J206	7.01	86.44	143.75	81.48
2	<input type="checkbox"/>	J208	4.83	86.29	143.76	81.70
3	<input type="checkbox"/>	J204	6.03	86.27	143.75	81.72
4	<input type="checkbox"/>	J262	0.00	86.44	143.93	81.73
5	<input type="checkbox"/>	J270	0.00	86.12	143.76	81.93
6	<input type="checkbox"/>	J18	0.00	86.12	143.77	81.95
7	<input type="checkbox"/>	J268	0.00	86.02	143.77	82.10
8	<input type="checkbox"/>	J170	0.00	86.05	143.82	82.13
9	<input type="checkbox"/>	J210	4.55	85.54	143.53	82.43
10	<input type="checkbox"/>	J212	6.74	85.69	143.76	82.56
11	<input type="checkbox"/>	J176	9.44	85.60	143.74	82.65
12	<input type="checkbox"/>	J214	6.47	85.28	143.76	83.14
13	<input type="checkbox"/>	J174	3.92	85.14	143.74	83.30
14	<input type="checkbox"/>	J232	0.00	84.93	143.60	83.41
15	<input type="checkbox"/>	J190	0.00	85.04	143.73	83.44
16	<input type="checkbox"/>	J160	0.00	85.03	143.76	83.49
17	<input type="checkbox"/>	J10	0.00	84.86	143.76	83.73
18	<input type="checkbox"/>	J240	0.00	84.37	143.49	84.05
19	<input type="checkbox"/>	J172	12.85	84.43	143.74	84.31
20	<input type="checkbox"/>	J266	0.00	84.43	143.76	84.34
21	<input type="checkbox"/>	J40	2.08	83.61	142.98	84.40
22	<input type="checkbox"/>	J220	12.44	83.90	143.34	84.50
23	<input type="checkbox"/>	J192	0.00	84.17	143.70	84.62
24	<input type="checkbox"/>	J222	0.00	83.80	143.34	84.64
25	<input type="checkbox"/>	J196	0.00	84.10	143.65	84.65
26	<input type="checkbox"/>	J218	0.61	83.53	143.35	85.03
27	<input type="checkbox"/>	J252	0.00	83.72	143.66	85.21
28	<input type="checkbox"/>	J138	0.00	82.78	142.74	85.24
29	<input type="checkbox"/>	J224	12.45	83.31	143.33	85.32
30	<input type="checkbox"/>	J20	31.08	82.84	142.87	85.33
31	<input type="checkbox"/>	J162	0.00	83.72	143.75	85.34
32	<input type="checkbox"/>	J30	0.00	83.41	143.46	85.37
33	<input type="checkbox"/>	J34	0.00	83.24	143.33	85.43
34	<input type="checkbox"/>	J42	0.00	82.93	143.11	85.55
35	<input type="checkbox"/>	J144	0.00	83.05	143.24	85.56
36	<input type="checkbox"/>	J38	0.00	82.86	143.08	85.61
37	<input type="checkbox"/>	J84	2.11	82.46	142.74	85.70
38	<input type="checkbox"/>	J234	16.30	83.18	143.47	85.71
39	<input type="checkbox"/>	J194	0.00	83.38	143.68	85.72
40	<input type="checkbox"/>	J226	10.76	82.95	143.33	85.83
41	<input type="checkbox"/>	J24	28.97	82.29	142.74	85.94
42	<input type="checkbox"/>	J46	0.00	82.71	143.24	86.05
43	<input type="checkbox"/>	J132	0.00	82.11	142.78	86.25
44	<input type="checkbox"/>	J130	0.00	82.01	142.75	86.35
45	<input type="checkbox"/>	J88	10.14	82.00	142.74	86.35
46	<input type="checkbox"/>	J54	3.73	82.17	142.93	86.38
47	<input type="checkbox"/>	J198	0.00	82.80	143.66	86.52
48	<input type="checkbox"/>	J248	0.00	82.80	143.66	86.52
49	<input type="checkbox"/>	J154	0.00	82.07	142.97	86.57
50	<input type="checkbox"/>	J58	10.23	82.05	142.97	86.61

PHD-JUNCTION

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
51	<input type="checkbox"/>	J230	0.00	82.77	143.71	86.62
52	<input type="checkbox"/>	J80	0.57	81.70	142.79	86.84
53	<input type="checkbox"/>	J92	25.01	81.61	142.74	86.90
54	<input type="checkbox"/>	J74	21.58	81.63	142.79	86.94
55	<input type="checkbox"/>	J134	2.23	81.80	143.07	87.10
56	<input type="checkbox"/>	J178	16.89	82.30	143.64	87.20
57	<input type="checkbox"/>	J128	5.73	81.35	142.74	87.27
58	<input type="checkbox"/>	J200	0.00	81.35	142.74	87.28
59	<input type="checkbox"/>	J202	0.00	81.35	142.74	87.28
60	<input type="checkbox"/>	J158	0.00	81.44	142.89	87.35
61	<input type="checkbox"/>	J112	0.00	81.34	142.85	87.44
62	<input type="checkbox"/>	J156	0.00	81.32	142.88	87.51
63	<input type="checkbox"/>	J114	0.00	81.23	142.88	87.64
64	<input type="checkbox"/>	J44	9.72	81.47	143.13	87.66
65	<input type="checkbox"/>	J14	0.00	81.75	143.46	87.73
66	<input type="checkbox"/>	J70	0.00	81.15	142.88	87.75
67	<input type="checkbox"/>	J64	26.37	81.10	142.88	87.82
68	<input type="checkbox"/>	J180	8.58	81.86	143.64	87.82
69	<input type="checkbox"/>	J146	0.00	81.26	143.11	87.92
70	<input type="checkbox"/>	J96	0.00	80.91	142.76	87.92
71	<input type="checkbox"/>	J164	0.00	81.79	143.71	88.03
72	<input type="checkbox"/>	J48	0.00	80.79	142.76	88.09
73	<input type="checkbox"/>	J50	0.00	80.75	142.75	88.14
74	<input type="checkbox"/>	J182	8.36	81.31	143.65	88.62
75	<input type="checkbox"/>	J126	14.01	80.21	142.71	88.84
76	<input type="checkbox"/>	J100	29.42	80.10	142.74	89.05
77	<input type="checkbox"/>	J116	0.00	79.95	142.75	89.28
78	<input type="checkbox"/>	J250	0.00	80.85	143.66	89.29
79	<input type="checkbox"/>	J104	11.29	79.92	142.73	89.30
80	<input type="checkbox"/>	J166	0.00	80.85	143.68	89.32
81	<input type="checkbox"/>	J142	0.00	80.35	143.25	89.41
82	<input type="checkbox"/>	J136	0.00	79.85	142.92	89.65
83	<input type="checkbox"/>	J124	0.00	79.44	142.73	89.97
84	<input type="checkbox"/>	J62	42.75	79.65	142.94	89.98
85	<input type="checkbox"/>	J118	0.00	79.36	142.74	90.11
86	<input type="checkbox"/>	J122	0.00	79.33	142.74	90.15
87	<input type="checkbox"/>	J110	0.00	79.47	142.95	90.24
88	<input type="checkbox"/>	J258	0.00	79.85	143.66	90.71
89	<input type="checkbox"/>	J246	0.00	79.85	143.76	90.85
90	<input type="checkbox"/>	J150	0.00	78.92	143.09	91.22
91	<input type="checkbox"/>	J120	0.00	78.33	142.74	91.57
92	<input type="checkbox"/>	J152	0.00	75.92	143.08	95.47

PHD-PIPE

ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status	Flow Reversal Count
24	J44	J146	37.79	300.00	120.00	25.92	0.37	0.02	0.61	Open	0
25	J112	J114	11.08	300.00	120.00	-56.00	0.79	0.03	2.55	Open	0
26	J110	J116	162.84	300.00	120.00	37.10	0.52	0.19	1.19	Open	0
27	J116	J118	103.23	200.00	120.00	2.76	0.09	0.01	0.07	Open	0
28	J120	J118	17.79	200.00	120.00	1.54	0.05	0.00	0.02	Open	0
29	J118	J122	14.95	200.00	120.00	4.30	0.14	0.00	0.16	Open	0
30	J122	J124	88.59	200.00	120.00	4.30	0.14	0.01	0.16	Open	0
31	J124	J126	144.09	200.00	120.00	4.30	0.14	0.02	0.16	Open	0
32	J50	J120	146.51	200.00	120.00	1.54	0.05	0.00	0.02	Open	0
33	J130	J128	112.40	200.00	120.00	2.82	0.09	0.01	0.07	Open	0
34	J130	J112	156.59	300.00	120.00	-26.47	0.37	0.10	0.64	Open	0
35	J74	J112	79.98	300.00	120.00	-29.52	0.42	0.06	0.78	Open	0
36	J248	J14	98.08	400.00	120.00	105.96	0.84	0.20	2.04	Open	0
37	J134	J136	166.63	300.00	120.00	32.05	0.45	0.15	0.91	Open	0
38	J138	J24	110.22	300.00	120.00	-1.33	0.02	0.00	0.00	Open	0
40	J142	J146	135.17	300.00	120.00	34.05	0.48	0.14	1.01	Open	0
41	J144	J134	154.56	300.00	120.00	35.64	0.50	0.17	1.10	Open	0
42	J126	J104	40.45	200.00	120.00	-9.71	0.31	0.03	0.72	Open	0
6	J40	J38	120.78	300.00	120.00	-30.62	0.43	0.10	0.83	Open	0
8	J48	J50	91.46	200.00	120.00	3.33	0.11	0.01	0.10	Open	0
P101	J176	J174	98.07	300.00	120.00	2.94	0.04	0.00	0.01	Open	0
P103	J230	J192	198.76	250.00	110.00	3.14	0.06	0.01	0.04	Open	0
P105	J204	J270	51.89	300.00	120.00	-4.12	0.06	0.00	0.02	Open	0
P107	J160	J10	21.74	300.00	120.00	-1.37	0.02	0.00	0.00	Open	0
P109	J164	J230	173.09	250.00	110.00	3.14	0.06	0.01	0.04	Open	0
P111	J162	J164	99.75	300.00	120.00	21.57	0.31	0.04	0.44	Open	0
P113	J164	J166	86.36	300.00	120.00	18.43	0.26	0.03	0.33	Open	0
P115	J166	J182	102.73	300.00	120.00	18.43	0.26	0.03	0.33	Open	0
P117	J182	J180	97.29	300.00	120.00	10.07	0.14	0.01	0.11	Open	0
P119	J180	J178	85.87	300.00	120.00	1.49	0.02	0.00	0.00	Open	0
P121	J212	J268	72.14	300.00	120.00	-11.84	0.17	0.01	0.14	Open	0
P129	J218	J220	71.02	300.00	120.00	9.54	0.13	0.01	0.10	Open	0
P13	J146	J134	109.84	300.00	120.00	19.81	0.28	0.04	0.37	Open	0
P131	J220	J222	64.95	300.00	120.00	-2.90	0.04	0.00	0.01	Open	0
P133	J222	J224	89.72	300.00	120.00	12.51	0.18	0.01	0.16	Open	0
P135	J224	J226	83.02	300.00	120.00	0.06	0.00	0.00	0.00	Open	0
P143	J18	J270	13.46	400.00	120.00	70.83	0.56	0.01	0.97	Open	0
P145	J190	J192	58.87	400.00	120.00	54.32	0.43	0.03	0.59	Open	0
P147	J192	J194	53.65	400.00	120.00	42.39	0.34	0.02	0.37	Open	0
P15	J146	J62	118.80	300.00	120.00	40.15	0.57	0.16	1.38	Open	0
P151	J214	J212	67.91	300.00	120.00	-5.10	0.07	0.00	0.03	Open	0
P153	J210	J240	125.40	250.00	110.00	9.92	0.20	0.04	0.30	Open	0
P155	J196	J30	100.45	400.00	120.00	100.56	0.80	0.19	1.85	Open	0
P157	J194	J198	49.89	400.00	120.00	42.39	0.34	0.02	0.37	Open	0
P159	J128	J200	133.31	200.00	120.00	-1.11	0.04	0.00	0.01	Open	0
P161	J208	J268	64.21	300.00	120.00	-13.75	0.19	0.01	0.19	Open	0
P163	J202	J138	119.12	200.00	120.00	-1.11	0.04	0.00	0.01	Open	0
P165	J136	J96	166.15	300.00	120.00	32.80	0.46	0.16	0.95	Open	0
P167	J200	J202	11.25	200.00	120.00	-1.11	0.04	0.00	0.01	Open	0
P169	J206	J208	82.38	300.00	120.00	-8.92	0.13	0.01	0.08	Open	0
P17	J62	J110	47.94	300.00	120.00	-2.60	0.04	0.00	0.01	Open	0
P171	J206	J204	69.88	300.00	120.00	1.91	0.03	0.00	0.00	Open	0
P175	J210	J222	86.86	300.00	120.00	51.06	0.72	0.19	2.15	Open	0
P177	J172	J174	81.01	300.00	120.00	0.98	0.01	0.00	0.00	Open	0
P179	J172	J162	87.33	300.00	120.00	-13.83	0.20	0.02	0.19	Open	0
P183	J232	J210	120.26	250.00	110.00	15.07	0.31	0.08	0.64	Open	0
P185	RES9002	J262	48.40	600.00	120.00	425.25	1.50	0.18	3.72	Open	0
P187	J214	J160	63.52	300.00	120.00	-1.37	0.02	0.00	0.00	Open	0
P189	J226	J34	51.07	300.00	120.00	-10.70	0.15	0.01	0.12	Open	0
P19	J20	J54	117.59	300.00	120.00	-25.46	0.36	0.07	0.59	Open	0
P191	J192	J232	147.89	250.00	110.00	15.07	0.31	0.09	0.64	Open	0
P193	J218	J234	71.16	300.00	120.00	-45.78	0.65	0.12	1.75	Open	0
P195	J178	J198	86.78	300.00	120.00	-15.40	0.22	0.02	0.23	Open	0
P197	J176	J270	106.19	300.00	120.00	-12.38	0.18	0.02	0.16	Open	0



PHD-PIPE

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status	Flow Reversal Count
65	<input type="checkbox"/>	P199	J170	J268	10.33	300.00	120.00	76.05	1.08	0.05	4.49	Open	0
66	<input type="checkbox"/>	P201	J234	J198	61.08	300.00	120.00	-62.08	0.88	0.19	3.08	Open	0
67	<input type="checkbox"/>	P21	J14	J142	106.09	400.00	120.00	105.96	0.84	0.22	2.04	Open	0
68	<input type="checkbox"/>	P215	J240	J30	102.65	250.00	110.00	9.92	0.20	0.03	0.30	Open	0
69	<input type="checkbox"/>	P217	J222	J144	93.00	300.00	120.00	35.64	0.50	0.10	1.10	Open	0
70	<input type="checkbox"/>	P219	J218	J46	95.10	300.00	120.00	35.64	0.50	0.10	1.10	Open	0
71	<input type="checkbox"/>	P225	J246	J266	355.06	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
72	<input type="checkbox"/>	P229	J250	J248	375.46	600.00	120.00	0.00	0.00	0.00	0.00	Open	0
73	<input type="checkbox"/>	P231	J248	J18	220.67	600.00	120.00	-141.05	0.50	0.11	0.48	Open	0
74	<input type="checkbox"/>	P235	J252	J250	182.26	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
75	<input type="checkbox"/>	P237	J250	J258	89.25	900.00	130.00	0.00	0.00	0.00	0.00	Open	0
76	<input type="checkbox"/>	P239	J248	J198	10.64	400.00	120.00	35.09	0.28	0.00	0.26	Open	0
77	<input type="checkbox"/>	P241	J162	J266	79.26	600.00	120.00	-35.40	0.13	0.00	0.04	Open	0
78	<input type="checkbox"/>	P243	J18	J262	118.60	600.00	120.00	-247.27	0.87	0.16	1.36	Open	0
79	<input type="checkbox"/>	P245	J170	J10	221.78	600.00	120.00	101.93	0.36	0.06	0.26	Open	0
80	<input type="checkbox"/>	P247	J262	J170	148.23	600.00	120.00	177.97	0.63	0.11	0.74	Open	0
81	<input type="checkbox"/>	P249	J266	J18	292.37	600.00	120.00	-35.40	0.13	0.01	0.04	Open	0
82	<input type="checkbox"/>	P25	J150	J152	12.66	400.00	120.00	71.91	0.57	0.01	1.00	Open	0
83	<input type="checkbox"/>	P251	J268	J210	117.75	300.00	120.00	50.46	0.71	0.25	2.10	Open	0
84	<input type="checkbox"/>	P253	J270	J190	37.69	400.00	120.00	54.32	0.43	0.02	0.59	Open	0
85	<input type="checkbox"/>	P27	J152	J110	132.14	400.00	120.00	71.91	0.57	0.13	1.00	Open	0
86	<input type="checkbox"/>	P29	J110	J136	128.24	400.00	120.00	32.21	0.26	0.03	0.23	Open	0
87	<input type="checkbox"/>	P31	J136	J64	180.81	400.00	120.00	31.46	0.25	0.04	0.22	Open	0
88	<input type="checkbox"/>	P33	J64	J70	14.43	400.00	120.00	5.09	0.04	0.00	0.01	Open	0
89	<input type="checkbox"/>	P35	J70	J156	34.75	400.00	120.00	5.09	0.04	0.00	0.01	Open	0
90	<input type="checkbox"/>	P37	J156	J114	6.20	400.00	120.00	5.09	0.04	0.00	0.01	Open	0
91	<input type="checkbox"/>	P39	J114	J158	17.17	400.00	120.00	-50.91	0.41	0.01	0.53	Open	0
92	<input type="checkbox"/>	P41	J154	J158	153.05	400.00	120.00	50.91	0.41	0.08	0.53	Open	0
93	<input type="checkbox"/>	P43	J42	J154	156.43	400.00	120.00	69.16	0.55	0.15	0.93	Open	0
94	<input type="checkbox"/>	P45	J34	J42	120.68	400.00	120.00	99.79	0.79	0.22	1.83	Open	0
95	<input type="checkbox"/>	P47	J30	J34	57.66	400.00	120.00	110.48	0.88	0.13	2.21	Open	0
96	<input type="checkbox"/>	P51	J58	J134	228.31	300.00	120.00	-21.17	0.30	0.10	0.42	Open	0
97	<input type="checkbox"/>	P53	J154	J58	39.98	300.00	120.00	-10.94	0.15	0.00	0.12	Open	0
98	<input type="checkbox"/>	P55	J104	J116	41.94	300.00	120.00	-21.00	0.30	0.02	0.41	Open	0
99	<input type="checkbox"/>	P57	J116	J100	77.25	300.00	120.00	13.34	0.19	0.01	0.18	Open	0
100	<input type="checkbox"/>	P59	J100	J96	84.08	300.00	120.00	-16.08	0.23	0.02	0.25	Open	0
101	<input type="checkbox"/>	P61	J96	J48	6.45	300.00	120.00	16.72	0.24	0.00	0.27	Open	0
102	<input type="checkbox"/>	P63	J48	J92	120.82	300.00	120.00	13.39	0.19	0.02	0.18	Open	0
103	<input type="checkbox"/>	P65	J92	J130	97.59	300.00	120.00	-11.62	0.16	0.01	0.14	Open	0
104	<input type="checkbox"/>	P69	J84	J88	69.90	300.00	120.00	-1.89	0.03	0.00	0.00	Open	0
105	<input type="checkbox"/>	P71	J138	J84	53.85	300.00	120.00	0.22	0.00	0.00	0.00	Open	0
106	<input type="checkbox"/>	P73	J132	J24	44.79	300.00	120.00	30.30	0.43	0.04	0.82	Open	0
107	<input type="checkbox"/>	P75	J20	J132	172.60	300.00	120.00	22.92	0.32	0.08	0.49	Open	0
108	<input type="checkbox"/>	P77	J40	J20	159.11	300.00	120.00	28.54	0.40	0.12	0.73	Open	0
109	<input type="checkbox"/>	P79	J50	J128	234.05	200.00	120.00	1.80	0.06	0.01	0.03	Open	0
110	<input type="checkbox"/>	P81	J38	J42	35.30	300.00	120.00	-30.62	0.43	0.03	0.83	Open	0
111	<input type="checkbox"/>	P83	J54	J154	41.53	300.00	120.00	-29.19	0.41	0.03	0.76	Open	0
112	<input type="checkbox"/>	P85	J80	J74	13.52	300.00	120.00	-7.95	0.11	0.00	0.07	Open	0
113	<input type="checkbox"/>	P87	J132	J80	74.26	300.00	120.00	-7.38	0.10	0.00	0.06	Open	0
114	<input type="checkbox"/>	P89	J10	J196	62.59	400.00	120.00	100.56	0.80	0.12	1.85	Open	0
115	<input type="checkbox"/>	P93	J88	J130	30.88	300.00	120.00	-12.03	0.17	0.00	0.15	Open	0
116	<input type="checkbox"/>	P95	J142	J150	156.08	400.00	120.00	71.91	0.57	0.16	1.00	Open	0
117	<input type="checkbox"/>	P97	J46	J44	100.05	300.00	120.00	35.64	0.50	0.11	1.10	Open	0

MDD+FIRE

		ID	Static Demand (L/s)	Static Pressure (psi)	Static Head (m)	Fire-Flow Demand (L/s)	Residual Pressure (psi)	Hydrant Available Flow (L/s)	Hydrant Pressure at Available Flow (psi)	Critical Pipe ID at Available Flow	Critical Pipe Velocity at Available Flow (m/s)
1	<input type="checkbox"/>	J240	0.00	84.56	143.85	317.00	74.60	464.44	65.00	P215	4.99
2	<input type="checkbox"/>	J160	0.00	83.78	143.96	317.00	81.41	468.85	79.30	P107	5.01
3	<input type="checkbox"/>	J232	0.00	83.83	143.90	317.00	73.04	472.38	61.67	P183	4.99
4	<input type="checkbox"/>	J230	0.00	86.95	143.94	317.00	72.05	485.29	54.58	P109	5.00
5	<input type="checkbox"/>	J178	11.26	87.58	143.91	317.00	81.99	500.96	75.87	P195	5.04
6	<input type="checkbox"/>	J204	4.02	82.01	143.96	317.00	78.82	518.90	74.66	P105	5.02
7	<input type="checkbox"/>	J226	7.18	86.48	143.78	317.00	81.92	547.06	75.70	P189	5.03
8	<input type="checkbox"/>	J172	8.57	84.61	143.95	317.00	79.66	548.21	72.16	P179	5.02
9	<input type="checkbox"/>	J208	3.22	81.99	143.96	317.00	78.42	550.98	72.80	P161	5.02
10	<input type="checkbox"/>	J176	6.29	82.95	143.95	317.00	77.81	564.27	69.19	P197	5.02
11	<input type="checkbox"/>	J166	0.00	89.67	143.93	317.00	82.80	566.98	70.54	P113	5.05
12	<input type="checkbox"/>	J234	10.87	86.23	143.84	317.00	82.73	573.49	77.21	P201	5.01
13	<input type="checkbox"/>	J212	4.49	82.84	143.96	317.00	79.20	592.21	72.32	P121	5.03
14	<input type="checkbox"/>	J180	5.72	88.21	143.91	317.00	80.76	596.13	66.18	P119	4.99
15	<input type="checkbox"/>	J164	0.00	88.35	143.94	317.00	83.85	614.75	74.05	P111	5.05
16	<input type="checkbox"/>	J214	4.31	83.42	143.96	317.00	79.62	626.25	71.27	P187	5.00
17	<input type="checkbox"/>	J224	8.30	85.97	143.78	317.00	80.81	655.47	69.04	P133	5.03
18	<input type="checkbox"/>	J220	8.30	85.13	143.79	317.00	80.86	659.89	71.07	P131	4.99
19	<input type="checkbox"/>	J206	4.67	81.77	143.96	317.00	77.53	670.84	66.18	P171	5.00
20	<input type="checkbox"/>	J174	2.61	83.60	143.95	317.00	77.72	680.47	61.21	P177	5.00
21	<input type="checkbox"/>	J182	5.57	88.99	143.91	317.00	81.03	689.98	58.07	P115	5.02
22	<input type="checkbox"/>	J218	0.41	85.66	143.79	317.00	82.06	860.99	66.85	P193	5.00
23	<input type="checkbox"/>	J196	0.00	85.03	143.91	317.00	83.06	909.29	74.88	P89	5.02
24	<input type="checkbox"/>	J210	3.03	82.91	143.86	317.00	80.12	922.24	66.38	P251	5.00
25	<input type="checkbox"/>	J190	0.00	83.74	143.95	317.00	82.45	974.72	76.01	P253	5.00
26	<input type="checkbox"/>	J222	0.00	85.28	143.79	317.00	82.29	999.89	66.20	P175	5.01
27	<input type="checkbox"/>	J198	0.00	86.89	143.92	317.00	85.61	1,026.92	79.61	P239	5.00
28	<input type="checkbox"/>	J34	0.00	86.07	143.79	317.00	83.36	1,108.87	66.82	P47	5.02
29	<input type="checkbox"/>	J194	0.00	86.07	143.93	317.00	84.59	1,121.57	74.99	P157	4.97
30	<input type="checkbox"/>	J30	0.00	85.90	143.84	317.00	83.46	1,171.94	66.70	P155	5.01
31	<input type="checkbox"/>	J192	0.00	84.96	143.93	317.00	83.54	1,354.50	70.01	P145	5.00
32	<input type="checkbox"/>	J18	0.00	82.23	143.96	317.00	81.40	1,649.23	72.40	P243	5.04
33	<input type="checkbox"/>	J170	0.00	82.36	143.99	317.00	81.50	1,765.73	70.60	P247	5.02
34	<input type="checkbox"/>	J162	0.00	85.63	143.96	317.00	84.08	1,895.26	55.02	P241	5.01
35	<input type="checkbox"/>	J10	0.00	84.02	143.96	317.00	82.71	2,046.77	58.73	P245	5.05

## **Appendix B-6**

Water Age Analysis

- Option 2

## Water Turnover Calculations

**Project Title:** 4938 - Rangeview Mississauga

**Last Edited:** 2024-07-02

**Municipality:** Region of Peel

**Average Consumption:** 280 L/cap/day (Residential Land Use)  
 300 L/cap/day (Employment Land Use)  
**Minimum Consumption:** 196.000 L/cap/day<sup>1</sup>

Turnover Rate Calculation								
Service	Length	Diameter	Area	Volume	Average Consumption (100% Population)	Minimum Consumption (70% Population)	Minimum Consumption (20% Population)	Days for Turnover
	(m)	(mm)	(m <sup>2</sup> )	(m <sup>3</sup> )	(m <sup>3</sup> /day)	(m <sup>3</sup> /day)	(m <sup>3</sup> /day)	(Day)
Complete System	1257	200	0.03	39.50	13462.68	9423.88	1884.78	0.59
	868	250	0.05	42.61				
	5508	300	0.07	389.36				
	1762	400	0.13	221.38				
	1505	600	0.28	425.46				

1 - Minimum consumption calculated using: average day consumption \* 0.7

---

Appendix C  
Sanitary Servicing Support Information

---

## Sanitary Flow Calculation

Rangeview Estates Master Functional Servicing Plan (Ulimite

Project No: 4938

Infiltration Rate*:	0.26	L/s/ha
Generation Rate*:	Residential	290
	Non-Residential	270
		L/capita/day


### Estimated Site Discharge

Site Discharge	Population***	Average Demand (L/S)	Harmon's Peaking Factor	Flow (L/s)	Infiltration (L/s)**	Total PeakFlow (L/s)
Townhouse	1856	6.23	2.77	17.26	5.70	<b>17.26</b>
Apartment	12890	43.27		119.89		<b>119.89</b>
Commercial	52	0.16		0.48		<b>0.48</b>
Institutional	450	1.41		4.19		<b>4.19</b>
					Total Flow =	<b>147.53</b>

\*As per Region of Peel Guidelines

\*\* Infiltration for the total site =21.94 (full Site)

\*\*\*Refer to Population Statistics

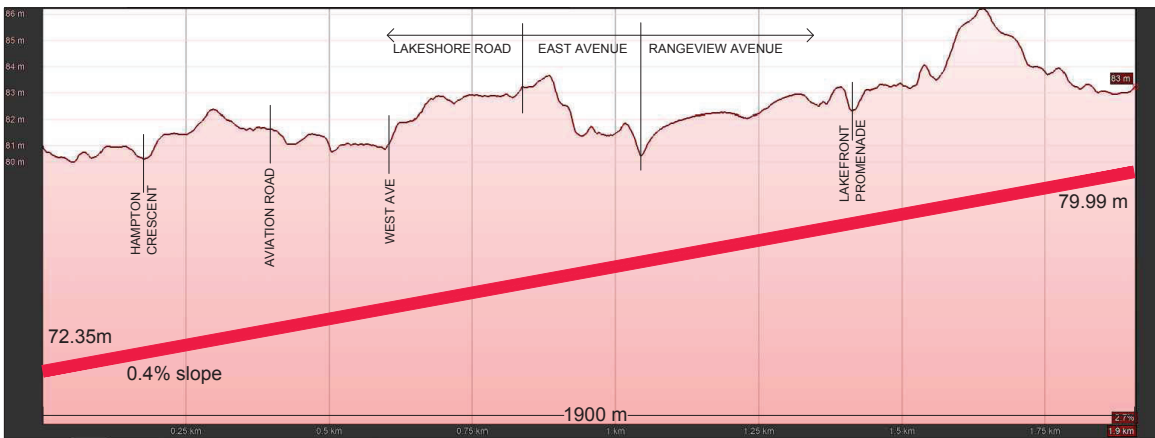

RANGEVIEW  
MIXED USE DEVELOPMENT

LEGEND

**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

ATTACHMENT C-1  
POTENTIAL TRUNK SEWER ALIGNMENT  
AND PROFILE SCHEMATIC

# SANITARY SEWER DESIGN SHEET

CITY OF MISSISSAUGA

Rangeview Road Development  
Pre-Development Condition

Designed By: P.W.  
Checked By: K.Sh  
Date: 26-Apr-24  
Project No.: 4938



STREET	SECTION		RESIDENTIAL					OTHER					Sewer Design								Remarks						
	From MH	To MH	Sect Area (ha)	Apert. (ha)	ROW (ha)	SF >10m front. (ha)	SF <10m front. (ha)	Semi Detac. (ha)	Ind. (@ 70 ppha) (ha)	Comm. (@ 50 ppha) (ha)	Inst.	Res Pop	Acc Res Pop	Non-Res Pop	Acc Non-Res Pop	Total Pop	Avg Day (L/s)	Peaking Factor	Peak Day (L/s)	ACC AREA (ha)		Infiltration (L/s)	TOTAL Peak Flow (L/s)	Pipe Dia Act. (mm)	Grade (%)	Length (m)	Capacity (L/s)
<b>Design Criteria</b>																											
<b>Residential</b>																											
Rowhouses / Other Multiples	3.5	persons/unit	As per the Region's Comment																								
Apartments	2.7	persons/unit	As per the Region's Comment																								
SF (> 10m frontage)	50	persons/ha																									
SF (< 10m frontage)	70	persons/ha																									
Semi-Detached	70	persons/ha																									
ROW Dwellings	175	persons/ha																									
Apartments	475	persons/ha																									
<b>ICI</b>																											
Industrial	70	persons/ha																									
Commercial	50	persons/ha																									
Infiltration	0.26	L/s/ha																									
Residential Generation Rate	290.00	L/c/d																									
Non-Residential Generation Rate	270.00	L/c/d																									
<b>Rangeview Rd Downstream System</b>																											
Rangeview Rd	40	39	1.49					0.68	0.61		0	0	78	78	78	0.24	4.27	1.04	1.49	0.39	1.43	250	0.28	93.6	31.29	5%	
Rangeview Rd	39	38	2.26					2.03			0	0	142	220	220	0.69	4.13	2.84	3.75	0.97	3.82	250	0.33	91.1	34.22	11%	
Rangeview Rd	38	37	1.79					1.23	0.36		0	0	105	325	325	1.02	4.06	4.13	5.54	1.44	5.57	250	0.31	91.3	32.95	17%	
Rangeview Rd	37	36	0.85					0.72			0	0	51	376	376	1.18	4.03	4.74	6.40	1.66	6.40	250	0.24	91.9	29.26	22%	
Rangeview Rd	36	35	1.63					1.45			0	0	102	478	478	1.49	3.98	5.95	8.03	2.09	8.04	250	0.37	91.0	36.26	22%	
Rangeview Rd	35	34	2.17					1.43			0	0	100	578	578	1.81	3.94	7.12	10.20	2.65	9.77	250	0.44	90.2	39.41	25%	
Rangeview Rd	34	33	1.72					1.53			0	0	107	685	685	2.14	3.90	8.35	11.92	3.10	11.45	250	0.59	91.4	45.81	25%	
Rangeview Rd	33	32	2.69					2.19			0	0	154	839	839	2.62	3.85	10.09	14.61	3.80	13.89	250	0.61	92.0	46.54	30%	
Rangeview Rd	32	31	1.43					1.04			0	0	73	912	912	2.85	3.83	10.90	16.04	4.17	15.07	250	1.10	82.9	62.45	24%	
Rangeview Rd	31	9	0.00								0	0	0	912	912	2.85	3.83	10.90	16.04	4.17	15.07	250	0.53	11.0	43.20	35%	
			<b>Subtotal</b>										<b>0</b>		<b>912</b>	<b>912</b>											
East Ave	9	10	1.84								0	0	0	912	912	2.85	3.83	10.90	17.87	4.65	15.55	250	0.30	83.5	32.73	48%	
East Ave (Treatment Plant Lateral)		10	12.85					12.85			0	0	900	1812	1812	5.66	3.62	20.49	30.73	7.99	28.48						
Easment - West of East Ave	10	11	0.35								0	0	0	1812	1812	5.66	3.62	20.49	31.07	8.08	28.57	300	0.29	90.5	52.04	55%	
Easment - West of East Ave	11	12	0.16								0	0	0	1812	1812	5.66	3.62	20.49	31.23	8.12	28.61	300	0.35	39.6	56.89	50%	
Easment - West of East Ave	12	13	0.06								0	0	0	1812	1812	5.66	3.62	20.49	31.29	8.14	28.63	300	0.37	66.1	58.71	49%	
			<b>Subtotal</b>										<b>0</b>		<b>1812</b>	<b>1812</b>											
			<i>Lateral from Montbeck North</i>		13	1.73			1.73				87	87	0	0	87										
Montbeck Cres	13	19	0.11				0.11				6	93	0	1812	1905	5.97	3.60	21.52	33.13	8.61	30.14	375	0.14	27.00	64.90	46%	
Montbeck Cres	19	20	0.62				0.62				31	124	0	1812	1936	6.08	3.60	21.86	33.75	8.77	30.64	375	0.38	40.54	107.71	28%	
Montbeck Cres	20	21	0.58				0.58				29	153	0	1812	1965	6.18	3.59	22.18	34.32	8.92	31.11	375	0.28	91.74	92.43	34%	
			<b>Subtotal</b>									<b>153</b>		<b>1812</b>	<b>1965</b>												
			<i>Lateral from North Goodwin &amp; West Montbeck*</i>		21	29.50	0.21	0.38	11.67		0.479	1.32	5.05		1230	1230											
Goodwin Rd	21	31	0.70				0.70				35	1418	0	2166	3584	11.53	3.38	38.92	64.52	16.78	55.69	375	0.46	91.44	118.81	47%	
Goodwin Rd	31	32	0.41				0.41				21	1439	0	2166	3605	11.60	3.37	39.13	64.93	16.88	56.01	375	0.29	92.35	94.49	59%	



# SANITARY SEWER DESIGN SHEET

CITY OF MISSISSAUGA

Rangeview Road Development  
Pre-Development Condition

Designed By: P.W.  
Checked By: K.Sh  
Date: 26-Apr-24  
Project No.: 4938



STREET	SECTION		RESIDENTIAL						OTHER					Sewer Design										Remarks			
	From MH	To MH	Sect Area (ha)	Apart. (ha)	ROW (ha)	SF >10m front. (ha)	SF <10m front. (ha)	Semi Detac. (ha)	Ind. (@ 70 ppha) (ha)	Comm. (@ 50 ppha) (ha)	Inst.	Res Pop	Acc Res Pop	Non-Res Pop	Acc Non-Res Pop	Total Pop	Avg Day (L/s)	Peaking Factor	Peak Day (L/s)	ACC AREA (ha)	Infiltration (L/s)	TOTAL Peak Flow (L/s)	Pipe Dia. Act. (mm)		Grade (%)	Length (m)	Capacity (L/s)
<b>Subtotal</b>			<b>64.93</b>										<b>1439</b>		<b>2166</b>	<b>3605</b>				<b>64.93</b>							
Beach St	32	25	0.44			0.44						23	1462	0	2166	3628	11.68	3.37	39.36	65.38	17.00	56.36	375	0.33	98.00	100.97	56%
Beach St to PS	25	26	0.09						0.091			0	1462	7	2173	3635	11.70	3.37	39.42	65.47	17.02	56.45	300	0.17	24.99	40.35	140%
<b>Subtotal</b>			<b>65.47</b>										<b>1462</b>		<b>2173</b>	<b>3635</b>				<b>65.47</b>							
<i>Lateral from West of PS via Aviation Rd*</i>			26	44.78	0.43	19.12	12.29	1.333		3.53		7609	7609	194	194	7803				44.78							
<b>Subtotal for Rangeview Rd Downstream System</b>				<b>110.25</b>									<b>9071</b>		<b>2367</b>	<b>11438</b>	<b>37.84</b>	<b>2.90</b>	<b>109.62</b>	<b>110.25</b>	<b>28.66</b>	<b>138.28</b>					
<b>Lakeshore Rd Western Downstream System</b>																											
Lakeshore Rd E	121	111	1.70						0.868	0.434		0	0	83	83	83	0.26	4.26	1.11	1.70	0.44	1.55	250	0.60	66.87	46.06	3%
Lakeshore Rd E	111	110	0.56						0.452			0	0	32	115	115	0.36	4.23	1.52	2.25	0.59	2.10	250	0.74	73.91	51.16	4%
Lakeshore Rd E	110	109	1.77							0.921		0	0	47	162	162	0.51	4.18	2.12	4.02	1.05	3.16	250	0.69	49.68	49.40	6%
Lakeshore Rd E*	109	108	5.12			2.78				0.982		175	175	53	215	390	1.26	4.03	5.07	9.14	2.38	7.45	250	0.37	51.11	36.17	21%
Lakeshore Rd E	108	107	2.43			2.15				0.142		108	283	8	223	506	1.65	3.97	6.54	11.56	3.01	9.55	250	0.99	50.69	59.17	16%
Lakeshore Rd E	107	106	0.27							0.144		0	283	8	231	514	1.67	3.97	6.63	11.83	3.08	9.71	250	0.84	47.06	54.50	18%
Lakeshore Rd E	106	105	2.72	0.21		1.33						166	449	0	231	680	2.23	3.90	8.70	14.55	3.78	12.48	250	0.76	65.78	51.84	24%
Lakeshore Rd E	105	104	0.28							0.106		0	449	6	237	686	2.25	3.90	8.77	14.84	3.86	12.62	250	0.80	76.38	53.19	24%
Lakeshore Rd E	104	103	8.71		0.22	2.87		0.479		1.257		215	664	63	300	964	3.17	3.81	12.06	23.54	6.12	18.18	250	0.50	15.85	42.05	43%
Montbeck Cres*	103	102	2.26		0.17					1.06		437	1101	54	354	1455	4.80	3.69	17.71	25.80	6.71	24.42	250	0.46	86.26	40.33	61%
Byngmount Ave	102	101	0.79			0.79						40	1141	0	354	1495	4.94	3.68	18.17	26.59	6.91	25.08	250	0.55	57.91	44.10	57%
Byngmount Ave	101	100	0.23			0.23						12	1153	0	354	1507	4.98	3.68	18.30	26.82	6.97	25.28	250	0.44	49.07	39.45	64%
Goodwin Ave	100	99	1.42			1.01						51	1204	0	354	1558	5.15	3.67	18.88	28.24	7.34	26.22	250	0.51	91.44	42.47	62%
Goodwin Ave	99	21	0.75			0.50						26	1230	0	354	1584	5.23	3.66	19.17	28.99	7.54	26.71	250	0.49	96.32	41.63	64%
<b>Subtotal</b>			<b>28.99</b>										<b>1230</b>		<b>354</b>	<b>1584</b>				<b>28.99</b>							
<i>Lateral from east of MH21</i>			21	34.32								0	153	0	1812	1965				34.32							
<i>Lateral from west of MH 21</i>			21	0.51		0.25						13	166	0	1812	1978				34.83							
<b>Subtotal</b>			<b>63.83</b>										<b>1396</b>		<b>2166</b>	<b>3562</b>				<b>63.83</b>							
Goodwin Rd	21	31	0.70			0.70						35	1431	0	2166	3597	11.57	3.37	39.05	64.52	16.78	55.82	375	0.46	91.44	118.81	47%
Goodwin Rd	31	32	0.41			0.41						21	1452	0	2166	3618	11.64	3.37	39.26	64.93	16.88	56.14	375	0.29	92.35	94.49	59%
<b>Subtotal</b>			<b>64.93</b>										<b>1452</b>		<b>2166</b>	<b>3618</b>				<b>64.93</b>							
Beach St	32	25	0.44			0.44						23	1475	0	2166	3641	11.72	3.37	39.49	65.38	17.00	56.49	375	0.33	98.00	100.97	56%
Beach St to PS	25	26	0.09						0.091			0	1475	7	2173	3648	11.74	3.37	39.56	65.47	17.02	56.58	300	0.17	24.99	40.35	140%
<b>Subtotal</b>			<b>65.47</b>										<b>1475</b>		<b>2173</b>	<b>3648</b>				<b>65.47</b>							
<i>Lateral from West of PS via Aviation Rd*</i>			26	44.82	0.43	19.12	12.29	1.333		3.53		7609	7609	194	194	7609				44.82							
<b>Subtotal for Lakeshore Rd Western Downstream System</b>				<b>110.29</b>									<b>9084</b>		<b>2367</b>	<b>11451</b>	<b>37.89</b>	<b>2.90</b>	<b>109.72</b>	<b>110.29</b>	<b>28.67</b>	<b>138.40</b>					
<b>Lakeshore Rd Eastern Downstream System</b>																											
Lakeshore Rd E	7	6	1.06						0.70			0	0	50	50	50	0.16	4.31	0.67	1.06	0.28	0.95	300	0.35	86.26	57.19	2%
Lakeshore Rd E	6	5	1.29						1.074			0	0	76	126	126	0.39	4.21	1.66	2.35	0.61	2.27	300	0.23	91.44	46.71	5%
Lakeshore Rd E	5	4	1.91						0.783	0.858		0	0	98	224	224	0.70	4.13	2.89	4.27	1.11	4.00	300	0.38	91.44	59.35	7%
Lakeshore Rd E	4	3	0.84						0.70			0	0	49	273	273	0.85	4.10	3.49	5.11	1.33	4.82	300	0.20	62.48	42.72	11%
Lakeshore Rd E	3	2	0.00						0.00			0	0	0	273	273	0.85	4.10	3.49	5.11	1.33	4.82	300	0.43	63.70	63.10	8%
Lakeshore Rd E	2	1	1.57						1.356			0	0	95	368	368	1.15	4.04	4.64	6.68	1.74	6.38	300	0.34	65.99	56.15	11%
Lakeshore Rd E	1	001	0.00									0	0	0	368	368	1.15	4.04	4.64	6.68	1.74	6.38	300	1.56	28.50	120.70	5%
<b>Subtotal</b>			<b>6.68</b>										<b>0</b>		<b>368</b>	<b>368</b>				<b>6.68</b>							

# SANITARY SEWER DESIGN SHEET

CITY OF MISSISSAUGA

Rangeview Road Development  
Pre-Development Condition

Designed By: P.W.  
Checked By: K.Sh  
Date: 26-Apr-24  
Project No.: 4938

**SCHAEFFERS**  
Consulting Engineers  
6 Ronrose Drive,  
Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
SCHAEFFER & ASSOCIATES LTD Fax: (905) 738-6875

STREET	SECTION		RESIDENTIAL						OTHER						Sewer Design						Remarks								
	From MH	To MH	Sect Area (ha)	Apart. (ha)	ROW (ha)	SF >10m front. (ha)	SF <10m front. (ha)	Semi Detac. (ha)	Ind. (@ 70 ppha) (ha)	Comm. (@ 50 ppha) (ha)	Inst. (ha)	Res Pop	Acc Res Pop	Non-Res Pop	Acc Non-Res Pop	Total Pop	Avg Day (L/s)	Peaking Factor	Peak Day (L/s)	ACC AREA (ha)		Infiltration (L/s)	TOTAL Peak Flow (L/s)	Pipe Dia Act. (mm)	Grade (%)	Length (m)	Capacity (L/s)		
Lakeshore Rd E*	001	002	126.88		2.04	86.34					2.409	1600	5292	5292	1785	2153	7445	24.49	3.08	75.45	133.56	34.72	110.17	600	0.34	119.00	355.99	31%	
Lakeshore Rd E	002	003	3.81										0	5292	0	2153	7445	24.49	3.08	75.45	137.37	35.72	111.16	600	0.11	91.00	203.54	55%	
<b>Subtotal for Lakeshore Rd Eastern Downstream System</b>			<b>137.37</b>											<b>5292</b>		<b>2153</b>	<b>7445</b>												

\* Denotes Development Application included from City



September 21, 2023

Our File: 2020-4938

Rangeview Landowners Group Inc.  
C/O Delta Urban Inc.  
8800 Dufferin Street, Suite 104  
Vaughan, ON  
L4K 0C5



---

6 Ronrose Drive, Vaughan, Ontario L4K 4R3  
Tel: (905) 738-6100 Fax: (905) 738-6875  
Tor. Line: (416) 213-5590 E-mail:  
general@schaeffers.com

**RE: Downstream Sanitary Sewer Analysis  
Rangeview Road Proposed Development Lands  
City of Mississauga**

---

## **1. Introduction**

Schaeffer and Associates Ltd. (SCE) has been retained to analyze sanitary servicing options for the Rangeview Road proposed development lands (herein referred to as “the site”) in the City of Mississauga. The proposed lands are bound by Lakeshore Road East to the north, Hydro Road to the east, Waterfront Trail to the south and East Avenue to the west. Lakefront Promenade runs in the north-south direction in the middle of the proposed lands. The majority of the lands currently consist of employment land uses and are proposed to be developed into mixed-use high-rise buildings.

This memo is written to present the residual capacity of the existing sewers and the population and units that could be developed within the residual capacity during the interim condition.

## **2. Existing Condition**

The existing sewer network is presented in **Figure 1**. There are three existing sanitary systems that could be utilized to service the site listed as follows:

- Sewers routing west on Rangeview Road, south on East Avenue, west on Easement and Montbeck Crescent, south on Goodwin Road and further discharging to Beach Street Pumping Station (SAN-1)
- Sewers routing west on Lakeshore Road East, south on Montbeck Crescent, west on Byngmount Avenue and south connecting the aforementioned sewer on Goodwin Road (SAN-2)
- Sewers routing east on Lakeshore Road East and further connecting to the Lakeview Pumping Station (SAN-3)

It is to be noted that the last sewer on Aviation Road connecting to the Beach Street Pumping Station was identified to be surcharged under pre-development condition in the previous submitted sanitary analysis. This leg is required to be upgraded from 300mm to 450mm in order to utilize the existing sewers connecting to the Beach Street Pumping Station (SAN-1 & SAN-2) as servicing the site during interim condition.

### 3. Scenarios

As previously discussed, the last sewer is required to be upgraded in order to service the site. The following scenarios consider the upgrade of the last sewer has already been implemented:

#### Scenario A

Existing sewers are analysed without any upgrade except the last sewer on Aviation Road.

#### Scenario B

Existing sewers are analysed based on Scenario A but with an additional upgrade on one sewer on East Avenue (83.5m) from 250mm to 300mm diameter. This sewer was identified as the most critical sewer of the existing sanitary system along Rangeview Road and Montbeck Crescent (SAN-1) under Scenario A. As a result, it is proposed to upgrade this sewer to provide more capacity for the existing sewers. However, upgrades on other sanitary systems (SAN-2 & SAN-3) are not suggested since the downstream sewer would need to be upsized as the upstream if the sewer upstream is proposed to be upgraded. It might not be economically reasonable to upgrade few downstream sewers for an interim servicing solution.

The sanitary tributary areas and sanitary sewer network of Scenario A and B are shown in **Figures 2 and 3** respectively.

### 4. Result

#### Scenario A

The following table summarises the residual capacity of the most critical sewer in different existing systems and the allowable population and units that could be developed under Scenario A. The allowable population is presented with reaching 80% and 90% of the pipe capacity since the Region may accept 90% utilization of the sewers as an interim solution. It is to be noted that, in the estimation of the equivalent unit, 2.7 persons per unit are assumed as the design criteria of the apartment since the unit breakdown of the site during interim condition has not been decided.

**Table 1 – Result of Scenario A**

Existing Sanitary System	Residual Capacity (L/s)	80% of Pipe Capacity		90% of Pipe Capacity	
		Allowable Population	Equivalent Unit	Allowable Population	Equivalent Unit
SAN-1	16.93	790	292	1000	370
SAN-2	14.59	510	188	850	314
SAN-3	37.78	2300	851	2700	1000

#### Scenario B

The following table summarises the residual capacity of the most critical sewer in different existing systems and the allowable population and units that could be developed under Scenario

B. Similar to Scenario A, the population is presented with reaching 80% and 90% of the pipe capacity and 2.7 persons per unit are assumed in the estimation of the equivalent unit.

**Table 2 – Result of Scenario B**

Existing Sanitary System	Residual Capacity (L/s)	80% of Pipe Capacity		90% of Pipe Capacity	
		Allowable Population	Equivalent Unit	Allowable Population	Equivalent Unit
SAN-1	22.84	1000	370	1450	537
SAN-2	14.59	510	188	850	314
SAN-3	37.78	2300	851	2700	1000

The detail of the capacity analysis for Scenario A and B is provided in **Attachment A**.

## 5. Flow Monitoring

The above mentioned calculation is based on the theoretical calculation using design guideline. Flow monitoring can be utilized to estimate the actual flow and assess the residual capacity in the system. To conduct flow monitoring, the Region’s acceptance and permit is required. Having said that considering the edge of sewers in this neighbourhood and being at the vicinity of Lake Ontario, there might be a chance that monitoring exercise observes higher I/I from groundwater. Thus, the monitoring exercise might weaken our argument with respect to using residual capacity. Should the landowners willing to conduct monitoring, we can approach the Region and start the conversation.

## 6. Conclusion

This memo has been prepared to present the residual capacity of the existing sewers and the population and units that could be developed within the residual capacity during the interim condition.

Three existing sewer systems were identified that could accommodate the site. It is to be noted that the last sewer on Aviation Road is required to be upgraded in order to utilize the existing sewers connecting to the Beach Street Pumping Station (SAN-2 & SAN-3) as servicing the site during interim condition. Two scenarios with different upgrading options and the residual capacity in different scenarios are presented. Furthermore, allowable population and unit are estimated based on the residual capacity in different scenarios.

We trust that you will find the contents of this memo satisfactory. Should you have any questions or comments, please do not hesitate to contact the undersigned.

Respectfully,

**SCHAEFFER & ASSOCIATES LTD.**



**Paul Wong, E.I.T**  
Water Resources Analyst



**Koryun Shahbikian, M.Eng., P.Eng., PMP**  
Partner



---


---

## *Figures*

---

---



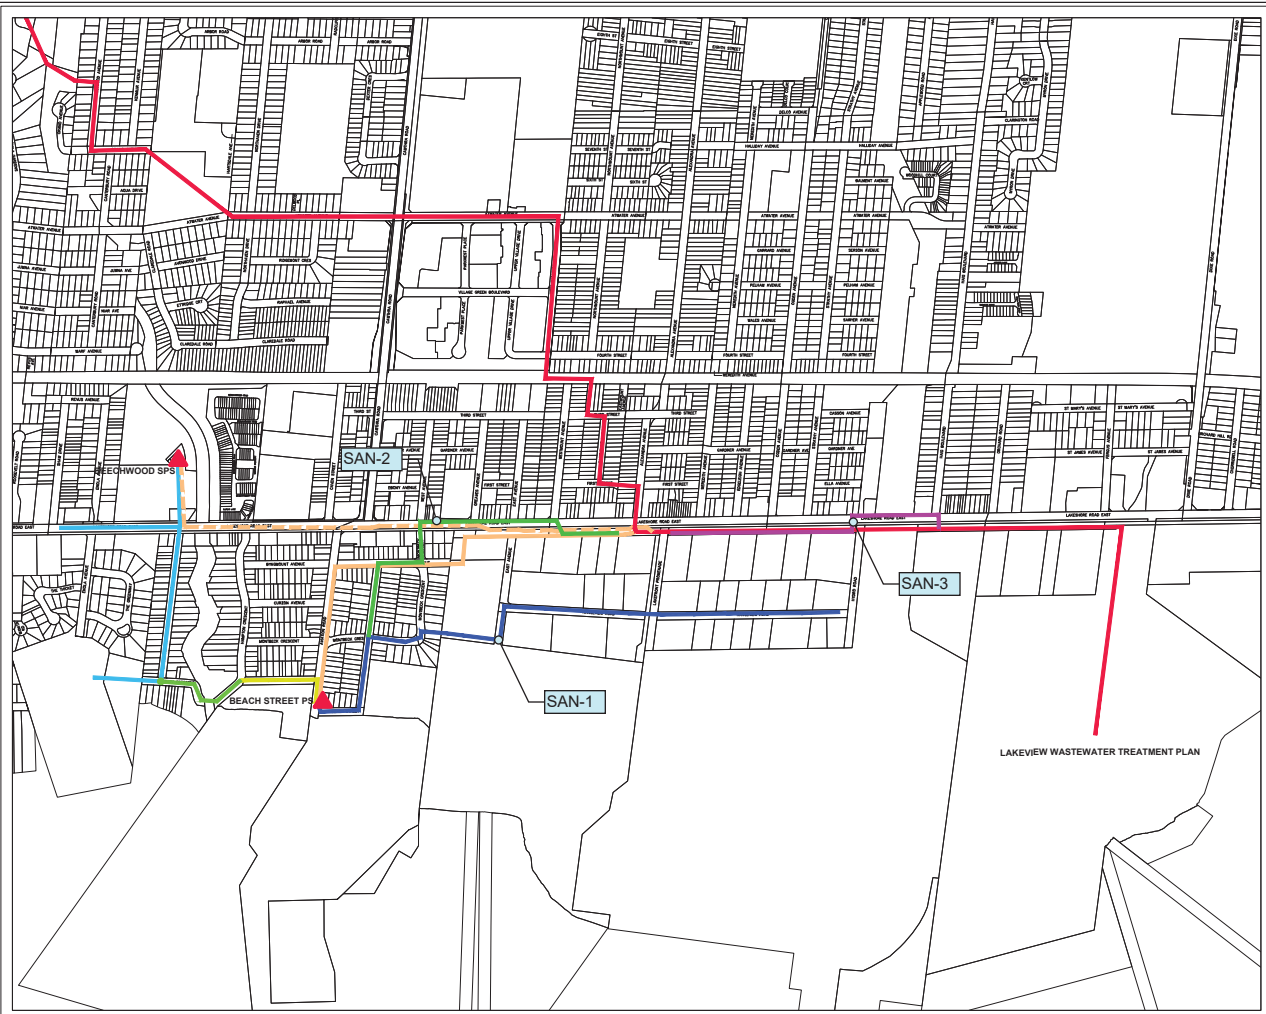


RANGEVIEW DEVELOPMENT

LEGEND

- TRUNK SEWER
- PREVIOUS TRUNK SEWER
- BEACH STREET SPS FORCEMAIN
- BEECHWOOD SPS FORCEMAIN
- DOWNSTREAM OF RANGEVIEW
- DOWNSTREAM LAKESHORE EAST
- DOWNSTREAM LAKESHORE WEST
- DIVERTED TRUNK SEWER
- TRUNK SEWER TO BEECHWOOD

**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 1- SANITARY SERVICING ROUTES

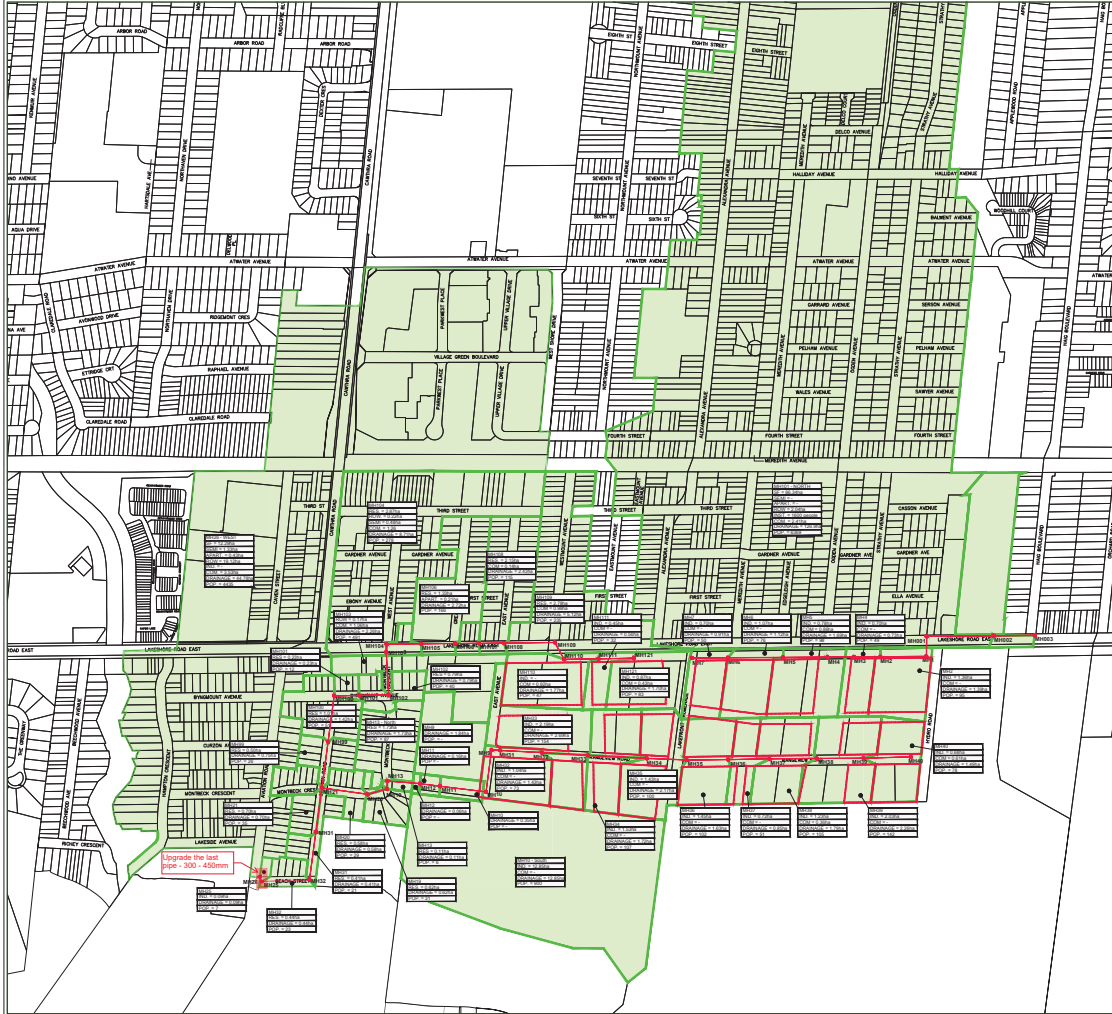


RANCEVIEW RD  
CITY OF MISSISSAUGA

- LEGEND
- SEWERSHED AREA
  - SITE BOUNDARY
  - SANITARY SEWER
  - MANHOLE
  - SEWERSHED ID

**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Rotrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 2 - EXISTING SANITARY TRIBUTARY AREAS  
( Scenario A - One Upgrade Upstream of Beach Street SP5)

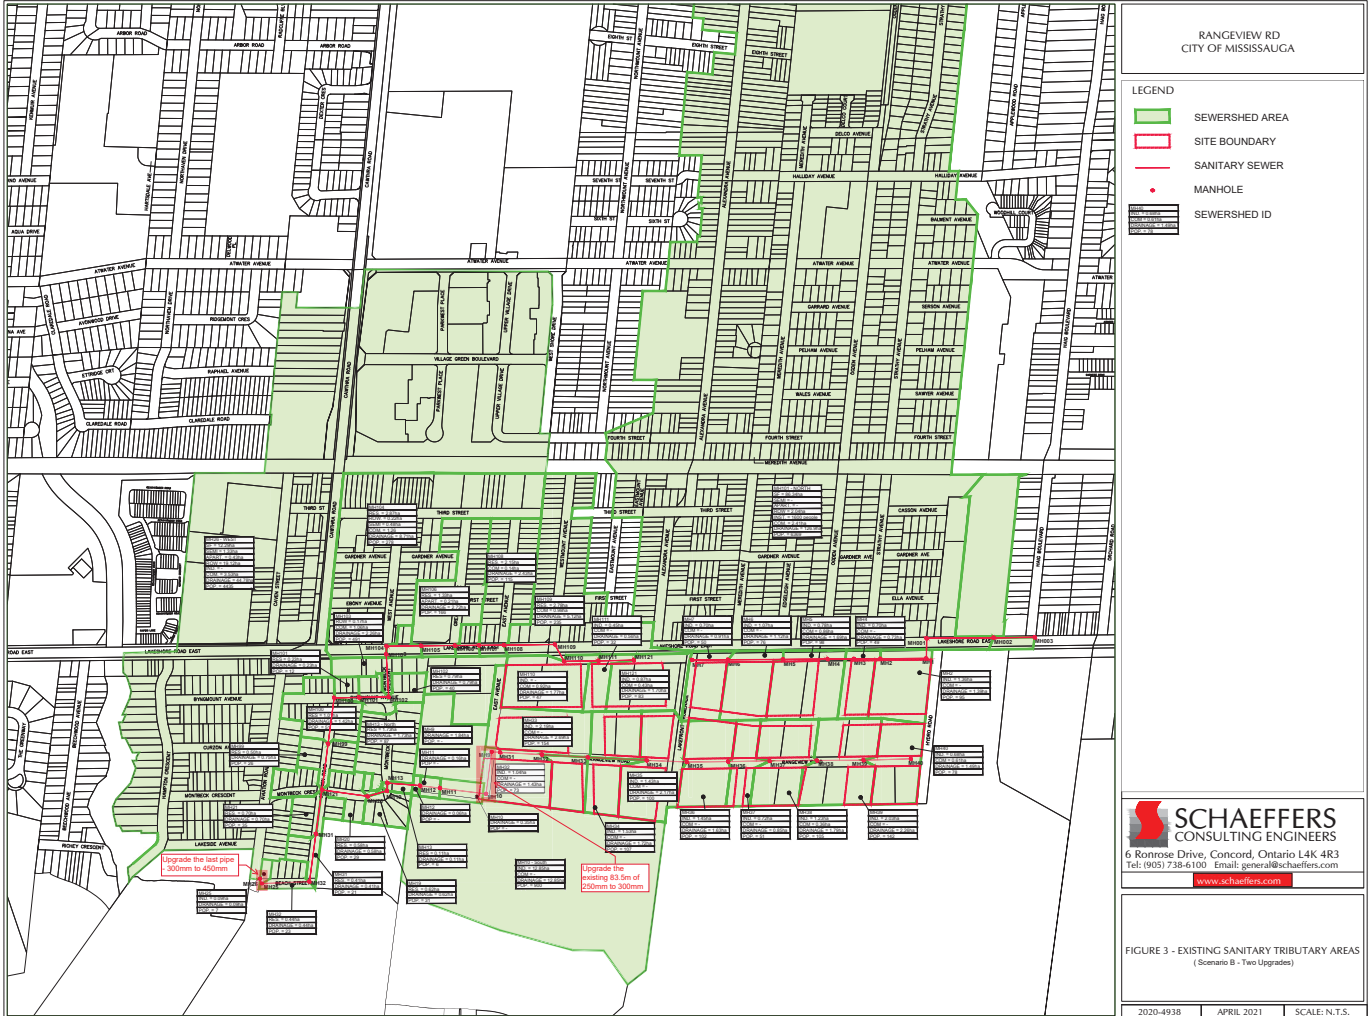

---

---

*Attachment A*

---

---

## Summary of Population & Units for Rangeview Development

Scenario A:

Location	Minimum Available Capacity (l/s)	Current populatoin	No Surcharge Conditions				80%
			Population	Equivalent Unit	Equivalent Area (ha)	Total Peak Flow (L/s)	
D/S Rangeview Rd (to Montbeck Cres & Goodwin Rd)*	16.93	912	790	292	1.10	10.29	80%
D/S Lakeshore Rd E (Western System to Montbeck Cres & Goodwin Rd)*	14.59	1513	510	188	0.71	6.54	80%
D/S of Montbeck Cres & Goodwin Rd to Beach St PS							
D/S Lakeshore Rd E (Eastern System to Lakeview PS)**	37.78	273	2300	851	3.19	28.84	80%

\* last pipe to PS should be upgraded

\*\*Equivalent Area for Lakeshore Eastern System is greater than Proposed Development Area

\*\*\*The surcharge conditions downstream of Montbeck Cres & Goodwin Rd are due to the constraints from the upstream sewers in the Rangeview and Lakeshore Rd E Western locations. In the event these two systems do not have surcharge conditions, there will be no surcharge conditions downstream of Montbeck Cres & Goodwin Rd

Population	Equivalent Unit	
1000	370	90%
850	314	90%
2700	1000	90%

Ex.Flow at critical location	Full pipe Capacity at critical location	
15.8	32.73	
24.86	39.45	
4.94	42.42	

Scenario B:

Location	Minimum Available Capacity (l/s)	Current populatoin	No Surcharge Conditions				80%
			Population	Equivalent Unit	Equivalent Area (ha)	Total Peak Flow (L/s)	
D/S Rangeview Rd (to Montbeck Cres & Goodwin Rd)*	22.84	1812	1000	370	1.39	12.43	80%
D/S Lakeshore Rd E (Western System to Montbeck Cres & Goodwin Rd)**	14.59	1513	510	188	0.71	6.54	80%
D/S of Montbeck Cres & Goodwin Rd to Beach St PS							
D/S Lakeshore Rd E (Eastern System to Lakeview PS)**	37.78	273	2300	851	3.19	28.84	80%

\* last pipe to PS as well as 83.5m of 250mm should be upgraded

\*\* last pipe to PS should be upgraded

\*\*\*Equivalent Area for Lakeshore Eastern System is greater than Proposed Development Area

\*\*\*\*The surcharge conditions downstream of Montbeck Cres & Goodwin Rd are due to the constraints from the upstream sewers in the Rangeview and Lakeshore Rd E Western locations. In the event these two systems do not have surcharge conditions, there will be no surcharge conditions downstream of Montbeck Cres & Goodwin Rd

Population	Equivalent Unit	
1450	537	90%
850	314	90%
2700	1000	90%

Ex.Flow at critical location	Full pipe Capacity at critical location	
29.19	52.04	
24.86	39.45	
4.94	42.42	

---

---

*Sanitary Design Sheets*

---

---

# SANITARY SEWER DESIGN SHEET

## CITY OF MISSISSAUGA

### RANGEVIEW ESTATES SUBDIVISION



STREET	From MH	To MH	Sect Area (ha)	No. of Apt. units	No. of T.H. units	P.P.U. for Apt.	P.P.U. for T.H.	Ind. (@ 95 ppha) (ha)	Comm. (@ 75 ppha) (ha)	Inst. (@ 50 ppha) (ha)	Parks/Rec (@ 50 ppha) (ha)	Pop	Acc Pop	Avg Day (L/s)	Peaking Factor	Peak Day (L/s)	ACC AREA (ha)	Infiltration (L/s)	TOTAL Peak Flow (L/s)	Pipe Dia (mm)	Grade (%)	Length (m)	Capacity (L/s)
		2A	0.21														0.21						
From Hydro Rd.		2A	0.34	162	0	2.7	3.5					438	438	1.88	4.00	7.50	0.34	0.09	7.6				
From 1072&1076 Rangeview		2A	0.32	0	17	2.7	3.5					60	60	0.26	4.00	1.03	0.32	0.08	1.1				
From 1062 Rangeview		2A	0.66	206	16	2.7	3.5					613	613	2.63	3.93	10.31	0.66	0.17	10.5				
From 1083 Rangeview		2A	0.32	0	0	2.7	3.5					0	1111	4.76	3.77	17.94	1.85	0.48	18.4	250	0.50	87.5	42.05
RANGEVIEW RD.	2A	3A	0.61	200	17	2.7	3.5				0.25	600	600	2.57	3.93	10.10	0.86	0.22	10.3				
From 1044 Rangeview+Park		3A	0.67	217	18	2.7	3.5				0.31	649	649	2.78	3.91	10.88	0.98	0.25	11.1				
From 1045 Rangeview+Park		3A	0.17	0	0	2.7	3.5					0	2360	10.11	3.53	35.66	3.86	1.00	36.7	300	0.50	81.0	68.38
												<b>2360</b>					<b>3.86</b>						
		4A	0.39	170	0	2.7	3.5					459	459	1.9656	3.9931	7.85	0.39	0.1014	7.95				
From 1008 Rangeview		4A	0.49	216	0	2.7	3.5					584	584	2.5009	3.9386	9.85	0.49	0.1274	9.978				
From 1025 Rangeview		4A	0.21	0	18	2.7	3.5					63	63	0.2698	4	1.08	0.21	0.0546	1.134				
From 1021 Rangeview		4A	0.15	0	0	2.7	3.5					0	3403	14.573	3.3953	49.48	5.10	1.326	50.81	375	0.50	70.2	123.98
RANGEVIEW RD.	4A	5A		0	0	2.7	3.5				0.43	0	63	0.2698	4	1.08	0.43	0.1118	1.191				
From 1021 Rangeview		5A	0.46	81	16	2.7	3.5					275	275	1.1777	4	4.71	0.46	0.1196	4.83				
From 992&996 Rangeview		5A	0.14	0	0	2.7	3.5					0	3741	16.02	3.3592	53.82	6.13	1.5938	55.41	375	0.50	68.3	123.98
												<b>3741</b>					<b>6.13</b>						
		6A	0.92	256	60	2.7	3.5					902	902	3.8627	3.8284	14.79	0.92	0.2392	15.03				
From 925 Rangeview		6A	0.82	274	16	2.7	3.5					796	796	3.4088	3.8617	13.16	0.82	0.2132	13.38				
From 895 Rangeview		6A	0.14	0	0	2.7	3.5					0	5439	23.292	3.2109	74.79	8.01	2.0826	76.87	450	0.50	69.8	201.6
		7A	0.16	0	0	2.7	3.5					0	5439	23.292	3.2109	74.79	8.17	2.1242	76.91	450	0.50	75.6	201.6
												<b>5439</b>					<b>8.17</b>						
		51A	0.63	259	0	2.7	3.5				0.57	700	700	3.00	3.89	11.67	1.20	0.31	12.0	300	2.00	7.3	136.76
From 1050 Lakeshore		275	0.00	0	0	2.7	3.5					0	700	3.00	3.89	11.67	1.20	0.31	12.0	300	0.39	64.8	60.048
		339	0.87	278	12	2.7	3.5				0.43	793	793	3.40	3.86	13.12	1.30	0.34	13.5	300	2.00	7.5	136.76
From 1076 Lakeshore		50A	0.00	0	0	2.7	3.5					0	1493	6.39	3.68	23.54	1.30	0.34	23.9	300	0.27	66.0	50.502
		339	0.00	0	0	2.7	3.5					0	1493	6.39	3.68	23.54	1.30	0.34	23.9	675	0.35	4.7	497.3
		102A										<b>1493</b>					<b>1.30</b>						

# SANITARY SEWER DESIGN SHEET

## CITY OF MISSISSAUGA

### RANGEVIEW ESTATES SUBDIVISION



STREET	From MH	To MH	Sect Area (ha)	No. of Apt. units	No. of T.H. units	P.P.U. for Apt.	P.P.U. for T.H.	Ind. (@ 95 ppha) (ha)	Comm. (@ 75 ppha) (ha)	Inst. (@ 50 ppha) (ha)	Parks/Rec (@ 50 ppha) (ha)	Pop	Acc Pop	Avg Day (L/s)	Peaking Factor	Peak Day (L/s)	ACC AREA (ha)	Infiltration (L/s)	TOTAL Peak Flow (L/s)	Pipe Dia (mm)	Grade (%)	Length (m)	Capacity (L/s)
<i>From 1000-1006 Lakeshore</i>	40A	41A	1.18	296	36	2.7	3.5					926	926	3.97	3.82	15.15	1.18	0.31	15.5	300	2.00	5.7	136.76
	41A	43A		0	0	2.7	3.5					0	926	3.97	3.82	15.15	1.18	0.31	15.5	300	0.50	86.5	68.378
<i>From 974 Lakeshore</i>	42A	43A	1.04	135	66	2.7	3.5					596	596	2.55	3.93	10.04	1.04	0.27	10.3	300	2.00	5.7	136.76
	43A	45A		0	0	2.7	3.5					0	1522	6.52	3.67	23.95	2.22	0.58	24.5	300	0.50	83.5	68.378
<i>From 946 Lakeshore</i>	44A	45A	0.62	241	0	2.7	3.5					651	651	2.79	3.91	10.91	0.62	0.16	11.1	300	2.00	5.7	136.76
	45A	46A	0.00	0	0	2.7	3.5					0	2173	9.31	3.56	33.10	2.84	0.74	33.8	300	0.50	19.7	68.378
	46A	24A	0.00	0	0	2.7	3.5					0	2173	9.31	3.56	33.10	2.84	0.74	33.8	300	0.50	21.5	68.378
	24A	25A	0.37	0	0	2.7	3.5					0	2173	9.31	3.56	33.10	3.21	0.83	33.9	300	0.50	93.7	68.378
	25A	26A	0.26	0	0	2.7	3.5					0	2173	9.31	3.56	33.10	3.47	0.90	34.0	300	0.50	94.7	68.378
	26A	8A	0.00	0	0	2.7	3.5					0	2173	9.31	3.56	33.10	3.47	0.90	34.0	300	0.50	13.7	68.378
												<b>2173</b>					<b>2.84</b>						
<i>From 930 Lakefront+Park</i>		8A	0.42	210	0	2.7	3.5				0.16	567	567	2.4281	3.9455	9.58	0.58	0.1508	9.731				
<i>From 890 Rangeview+Park</i>		8A	0.74	182	14	2.7	3.5				0.15	541	1108	4.7449	3.7708	17.89	0.89	0.2314	18.12				
RANGEVIEW RD.	8A	9A	0.17	0	0	2.7	3.5					0	9287	39.771	2.9865	118.78	12.65	3.289	122.1	525	0.50	76.7	304.1
<i>From 880 Rangeview</i>		9A	1.3	222	48	2.7	3.5					768	768	3.2889	3.871	12.73	1.30	0.338	13.07				
<i>From 895 Rangeview</i>		9A	0.45	0	22	2.7	3.5				0.4	77	77	0.3297	4	1.32	0.85	0.221	1.54				
<i>From 885 Rangeview</i>		9A	0.23	0	10	2.7	3.5				0.2	35	35	0.1499	4	0.60	0.43	0.1118	0.711				
	9A	10A	0.18	0	0	2.7	3.5					0	10167	43.539	2.9475	128.33	15.41	4.0066	132.3	525	0.50	82.0	304.1
<i>From Park Block</i>		10A		0	0	2.7	3.5				0.7	0	0	0	4	0.00	0.70	0.182	0.182				
<i>From 851-865 Rangeview</i>		10A	1.01	159	68	2.7	3.5					668	668	2.8606	3.9062	11.17	1.01	0.2626	11.44				
	10A	11A	0.21	0	0	2.7	3.5					0	10835	46.4	2.92	135.49	17.33	4.5058	140	525	0.50	96.1	304.1
<i>From 850 Rangeview</i>		12A	1.01	54	36	2.7	3.5					272	272	1.1648	4	4.66	1.01	0.2626	4.922				
	11A	12A	0.22	54	36	2.7	3.5				1	272	11379	48.73	2.8987	141.25	19.56	5.0856	146.3	525	0.50	95.5	304.1
												<b>11379</b>					<b>19.56</b>						
RANGEVIEW RD.	12A	14A	0.21	0	0	2.7	3.5					0	11379	48.73	2.8987	141.25	19.77	5.1402	146.4	525	0.50	11.5	304.1
	14A	63A	0.51	0	0	2.7	3.5					0	11379	48.73	2.8987	141.25	20.28	5.2728	146.5	900	0.14	177.9	678.71
												<b>11379</b>					<b>20.28</b>						
<i>From 910 &amp; 920 Lakeshore + Park</i>	52A	53A	0.55	232	0	2.7	3.5				0.32	627	627	2.6851	3.9216	10.53	0.87	0.2262	10.76	300	2.00	7.3	136.76
	53A	55A		0	0	2.7	3.5					0	627	2.69	3.92	10.53	0.87	0.23	10.8	300	0.50	25.3	68.378





**SCHAEFFERS**  
Consulting Engineers

SCHAEFFER & ASSOCIATES LTD.

6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
design@schaeffers.com

# SANITARY SEWER DESIGN SHEET

CITY OF MISSISSAUGA  
RANGEVIEW ESTATES SUBDIVISION



Designed By:  
Checked By:  
Date:  
File No.:

F:\4938\4938

STREET	From MH	To MH	Sect Area (ha)	No. of Apt. units	No. of T.H. units	P.P.U. for Apt.	P.P.U. for T.H.	Ind. (@ 95 ppha) (ha)	Comm. (@ 75 ppha) (ha)	Inst. (@ 50 ppha) (ha)	Parks/Rec (@ 50 ppha) (ha)	Pop	Acc Pop	Avg Day (L/s)	Peaking Factor	Peak Day (L/s)	ACC AREA (ha)	Infiltration (L/s)	TOTAL Peak	Pipe Dia	Grade	Length	Capacity
																			Flow (L/s)	(mm)	(%)	(m)	(L/s)
<i>From 896 Lakeshore</i>	54A	55A	0.43	142	0	2.7	3.5					384	384	1.64	4.00	6.58	0.43	0.11	6.7	300	2.00	7.4	136.76
	55A	57A		0	0	2.7	3.5					0	1011	4.33	3.80	16.44	1.30	0.34	16.8	300	0.50	28.8	68.378
<i>From 880 Lakeshore</i>	56A	57A	0.44	145	0	2.7	3.5					392	392	1.68	4.00	6.71	0.44	0.11	6.8	300	2.00	7.4	136.76
	57A	59A		0	0	2.7	3.5					0	1403	6.01	3.70	22.23	1.74	0.45	22.7	300	0.50	89.3	68.378
<i>From 848-872 Lakeshore</i>	58A	59A	0.83	159	48	2.7	3.5					598	598	2.56	3.93	10.07	0.83	0.22	10.3	300	2.00	7.3	136.76
	59A	61A		0	0	2.7	3.5					0	2001	8.57	3.59	30.73	2.57	0.67	31.4	300	0.50	66.9	68.378
<i>From 830-832 Lakeshore</i>	60A	61A	0.59	266	0	2.7	3.5					719	719	3.08	3.89	11.97	0.59	0.15	12.1	300	2.00	7.2	136.76
	61A	62A		0	0	2.7	3.5					0	2720	11.65	3.48	40.51	3.16	0.82	41.3	300	0.50	41.5	68.378
	62A	63A		0	0	2.7	3.5					0	2720	11.65	3.48	40.51	3.16	0.82	41.3	300	1.88	8.9	132.56
	63A	64A	0.00	0	0	2.7	3.5					0	14099	60.38	2.81	169.38	23.44	6.09	175.5	900	0.15	72.4	701.13
												<b>14099</b>					<b>23.44</b>						

---

Appendix D  
Stormwater Management Support Information

---



Project 4938 Rangeview Estates Development  
Site Plan SWM Requirements Summary



Rainfall intensity  
Rainfall Intensity-City of Mississauga

Design Storm Event	A	B	C	I (mm/hr)
2-Year	610.0	4.6	0.78	59.9
5-Year	820.0	4.6	0.78	80.5
10-Year	1010.0	4.6	0.78	99.2
25-Year	1160.0	4.6	0.78	113.9
50-Year	1300.0	4.7	0.78	127.1
100-Year	1450.0	4.9	0.780	140.7

Tc= 15 minutes  
I=A/((T+B)^C)

Description	Catchment #	Area (ha)	Pre-Development Runoff Coefficient	Post-Development Runoff Coefficient	Allowable Release (10-year flows) Rate (L/s)		Adjusted Allowable Release Rate from Site Plan(10-year flows - Longterm Ground Water Pumping) (L/s)	Required On-site storage (m3)	Volumetric Requirement (m3)* (5mm)
					A	B			
Site Plan	201	0.52	0.25	0.90	7.24	2.00	5.24	319.08	26.00
Site Plan	202	0.76	0.25	0.90	10.59	2.00	8.59	458.59	38.00
Site Plan	203	0.39	0.25	0.90	5.43	2.00	3.43	243.51	19.50
Site Plan	204	0.39	0.25	0.90	5.43	2.00	3.43	243.51	19.50
Site Plan	205	0.48	0.25	0.90	6.69	2.00	4.69	295.83	24.00
Site Plan	206	0.54	0.25	0.90	7.52	2.00	5.52	330.71	27.00
Site Plan	207	0.93	0.25	0.90	11.96	2.00	9.96	565.81	46.50
Site Plan	208	0.92	0.25	0.90	11.82	2.00	9.82	560.00	46.00
Site Plan	209	0.58	0.25	0.90	8.08	2.00	6.08	353.96	29.00
Site Plan	210	0.84	0.25	0.90	11.70	2.00	9.70	505.10	42.00
Site Plan	211	0.86	0.50	0.90	118.45	2.00	116.45	199.82	43.00
Site Plan	212	0.20	0.50	0.90	27.55	2.00	25.55	48.18	10.00
Site Plan	213	0.40	0.50	0.90	55.09	2.00	53.09	94.10	20.00
Site Plan	214	0.34	0.50	0.90	46.83	2.00	44.83	80.31	17.00
Site Plan	215	0.82	0.50	0.90	112.94	2.00	110.94	190.63	41.00
Site Plan	216	0.19	0.50	0.90	26.17	2.00	24.17	45.89	9.50
Site Plan	217	0.36	0.50	0.90	49.58	2.00	47.58	84.90	18.00
Site Plan	218	0.58	0.50	0.90	79.88	2.00	77.88	135.47	29.00
Site Plan	219	0.57	0.50	0.90	78.51	2.00	76.51	133.17	28.50
Site Plan	220	1.00	0.50	0.90	137.73	2.00	135.73	232.00	50.00
Site Plan	221	1.30	0.50	0.90	179.05	2.00	177.05	300.95	65.00
Site Plan	222	0.74	0.50	0.90	101.92	2.00	99.92	172.24	37.00
Site Plan	223	0.82	0.50	0.90	112.94	2.00	110.94	190.63	41.00
Site Plan	224	0.46	0.50	0.90	63.36	2.00	61.36	107.89	23.00
Site Plan	225	0.38	0.50	0.90	52.34	2.00	50.34	89.50	19.00
Site Plan	226	0.61	0.50	0.90	84.02	2.00	82.02	142.36	30.50
Site Plan	227	0.32	0.50	0.90	44.07	2.00	42.07	75.72	16.00
Site Plan	228	0.35	0.50	0.90	48.21	2.00	46.21	82.61	17.50

\* Volumetric Requirement =Area x TIMP x 5mm x 10

\*\*2L/s is assumed as the groundwater pumping rate to storm sewers (a higher rate was selected based on feasibility and to be higher than the preliminary hydro-geotechnical investigation) and will be finalized through the SPA process (This discharge was subtracted from the allowable release rates)

Release Rates based on pre-development drainage to Lakshore Rd E.

## Storage Volume Calculation



Project: 4938 Catchment 201

### Modified Rational Method

Internal Area	Controlled Drainage Area (ha) =	0.520
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	5.24
	Actual Release Rate (l/s) =	5.24

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

#### 100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
15	140.69	203.38	0.00	0.00	203.38	183.04	4.72	178.32
16	135.41	195.75	0.00	0.00	195.75	187.92	5.03	182.89
17	130.56	188.74	0.00	0.00	188.74	192.52	5.35	187.17
18	126.09	182.28	0.00	0.00	182.28	196.86	5.66	191.20
19	121.96	176.31	0.00	0.00	176.31	200.99	5.98	195.01
20	118.12	170.76	0.00	0.00	170.76	204.91	6.29	198.62
21	114.55	165.59	0.00	0.00	165.59	208.65	6.61	202.04
22	111.21	160.77	0.00	0.00	160.77	212.22	6.92	205.30
23	108.09	156.26	0.00	0.00	156.26	215.64	7.24	208.40
24	105.16	152.03	0.00	0.00	152.03	218.92	7.55	211.36
25	102.41	148.04	0.00	0.00	148.04	222.07	7.87	214.20
26	99.82	144.29	0.00	0.00	144.29	225.10	8.18	216.92
27	97.37	140.75	0.00	0.00	140.75	228.02	8.50	219.53
85	43.39	62.73	0.00	0.00	62.73	319.93	26.75	293.18
90	41.60	60.14	0.00	0.00	60.14	324.74	28.32	296.43
100	38.47	55.62	0.00	0.00	55.62	333.70	31.47	302.24
105	37.10	53.63	0.00	0.00	53.63	337.89	33.04	304.85
110	35.84	51.80	0.00	0.00	51.80	341.91	34.61	307.30
115	34.66	50.11	0.00	0.00	50.11	345.77	36.18	309.58
120	33.58	48.54	0.00	0.00	48.54	349.49	37.76	311.73
125	32.57	47.08	0.00	0.00	47.08	353.07	39.33	313.74
130	31.62	45.71	0.00	0.00	45.71	356.53	40.90	315.63
135	30.73	44.43	0.00	0.00	44.43	359.88	42.48	317.41
140	29.90	43.23	0.00	0.00	43.23	363.13	44.05	319.08

Required Storage (m <sup>3</sup> ):	319.08
Provided Storage (m <sup>3</sup> ):	

## Storage Volume Calculation



Project: 4938 Catchment 202

### Modified Rational Method

Internal Area	Controlled Drainage Area (ha) =	0.760
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	8.59
	Actual Release Rate (l/s) =	8.59

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

#### 100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity	Total	Groundwater	External	Total			
	(mm/hr)	Runoff (l/s)	Flows (l/s)	Runoff (l/s)	Runoff (l/s)			
15	140.69	297.25	0.00	0.00	297.25	267.52	7.73	259.80
16	135.41	286.10	0.00	0.00	286.10	274.65	8.24	266.41
17	130.56	275.85	0.00	0.00	275.85	281.37	8.76	272.61
18	126.09	266.41	0.00	0.00	266.41	287.73	9.27	278.45
19	121.96	257.68	0.00	0.00	257.68	293.75	9.79	283.96
20	118.12	249.57	0.00	0.00	249.57	299.48	10.31	289.18
21	114.55	242.02	0.00	0.00	242.02	304.95	10.82	294.13
22	111.21	234.97	0.00	0.00	234.97	310.17	11.34	298.83
23	108.09	228.38	0.00	0.00	228.38	315.16	11.85	303.31
24	105.16	222.19	0.00	0.00	222.19	319.95	12.37	307.59
25	102.41	216.37	0.00	0.00	216.37	324.56	12.88	311.68
26	99.82	210.89	0.00	0.00	210.89	328.99	13.40	315.59
27	97.37	205.72	0.00	0.00	205.72	333.26	13.91	319.35
85	43.39	91.68	0.00	0.00	91.68	467.59	43.80	423.79
90	41.60	87.89	0.00	0.00	87.89	474.63	46.37	428.25
100	38.47	81.29	0.00	0.00	81.29	487.72	51.53	436.20
105	37.10	78.39	0.00	0.00	78.39	493.84	54.10	439.74
110	35.84	75.71	0.00	0.00	75.71	499.71	56.68	443.03
115	34.66	73.24	0.00	0.00	73.24	505.35	59.25	446.10
120	33.58	70.94	0.00	0.00	70.94	510.79	61.83	448.96
125	32.57	68.80	0.00	0.00	68.80	516.03	64.41	451.62
130	31.62	66.81	0.00	0.00	66.81	521.09	66.98	454.11
135	30.73	64.94	0.00	0.00	64.94	525.99	69.56	456.43
140	29.90	63.18	0.00	0.00	63.18	530.73	72.14	458.59

Required Storage (m <sup>3</sup> ):	458.59
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 203

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.390
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	3.43
	Actual Release Rate (l/s) =	3.43

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm	Design Storm =	Mississauga
	A =	1450
	B =	4.9
	C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	152.54	0.00	0.00			
16	135.41	146.81	0.00	0.00	146.81	140.94	3.30	137.64
17	130.56	141.56	0.00	0.00	141.56	144.39	3.50	140.89
18	126.09	136.71	0.00	0.00	136.71	147.65	3.71	143.94
19	121.96	132.23	0.00	0.00	132.23	150.74	3.91	146.83
20	118.12	128.07	0.00	0.00	128.07	153.68	4.12	149.56
21	114.55	124.19	0.00	0.00	124.19	156.49	4.33	152.16
22	111.21	120.58	0.00	0.00	120.58	159.16	4.53	154.63
23	108.09	117.19	0.00	0.00	117.19	161.73	4.74	156.99
24	105.16	114.02	0.00	0.00	114.02	164.19	4.94	159.24
25	102.41	111.03	0.00	0.00	111.03	166.55	5.15	161.40
26	99.82	108.22	0.00	0.00	108.22	168.82	5.36	163.47
27	97.37	105.57	0.00	0.00	105.57	171.02	5.56	165.45
85	43.39	47.05	0.00	0.00	47.05	239.95	17.51	222.44
90	41.60	45.10	0.00	0.00	45.10	243.56	18.54	225.02
100	38.47	41.71	0.00	0.00	41.71	250.28	20.60	229.68
105	37.10	40.23	0.00	0.00	40.23	253.42	21.63	231.79
110	35.84	38.85	0.00	0.00	38.85	256.43	22.66	233.77
115	34.66	37.58	0.00	0.00	37.58	259.33	23.69	235.64
120	33.58	36.40	0.00	0.00	36.40	262.11	24.72	237.40
125	32.57	35.31	0.00	0.00	35.31	264.80	25.75	239.05
130	31.62	34.28	0.00	0.00	34.28	267.40	26.78	240.62
135	30.73	33.32	0.00	0.00	33.32	269.91	27.81	242.11
140	29.90	32.42	0.00	0.00	32.42	272.35	28.84	243.51

Required Storage (m <sup>3</sup> ):	243.51
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 204

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.390
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	3.43
	Actual Release Rate (l/s) =	3.43

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	152.54	0.00	0.00			
16	135.41	146.81	0.00	0.00	146.81	140.94	137.64	
17	130.56	141.56	0.00	0.00	141.56	144.39	140.89	
18	126.09	136.71	0.00	0.00	136.71	147.65	143.94	
19	121.96	132.23	0.00	0.00	132.23	150.74	146.83	
20	118.12	128.07	0.00	0.00	128.07	153.68	149.56	
21	114.55	124.19	0.00	0.00	124.19	156.49	152.16	
22	111.21	120.58	0.00	0.00	120.58	159.16	154.63	
23	108.09	117.19	0.00	0.00	117.19	161.73	156.99	
24	105.16	114.02	0.00	0.00	114.02	164.19	159.24	
25	102.41	111.03	0.00	0.00	111.03	166.55	161.40	
26	99.82	108.22	0.00	0.00	108.22	168.82	163.47	
27	97.37	105.57	0.00	0.00	105.57	171.02	165.45	
85	43.39	47.05	0.00	0.00	47.05	239.95	222.44	
90	41.60	45.10	0.00	0.00	45.10	243.56	225.02	
100	38.47	41.71	0.00	0.00	41.71	250.28	229.68	
105	37.10	40.23	0.00	0.00	40.23	253.42	231.79	
110	35.84	38.85	0.00	0.00	38.85	256.43	233.77	
115	34.66	37.58	0.00	0.00	37.58	259.33	235.64	
120	33.58	36.40	0.00	0.00	36.40	262.11	237.40	
125	32.57	35.31	0.00	0.00	35.31	264.80	239.05	
130	31.62	34.28	0.00	0.00	34.28	267.40	240.62	
135	30.73	33.32	0.00	0.00	33.32	269.91	242.11	
140	29.90	32.42	0.00	0.00	32.42	272.35	243.51	

Required Storage (m <sup>3</sup> ):	243.51
Provided Storage (m <sup>3</sup> ):	



**Storage Volume Calculation**



Project: 4938 Catchment 205

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.480
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	4.69
	Actual Release Rate (l/s) =	4.69

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
15	140.69	187.74	0.00	0.00	187.74	168.96	4.22	164.74
16	135.41	180.69	0.00	0.00	180.69	173.46	4.50	168.97
17	130.56	174.22	0.00	0.00	174.22	177.71	4.78	172.93
18	126.09	168.26	0.00	0.00	168.26	181.72	5.06	176.66
19	121.96	162.74	0.00	0.00	162.74	185.53	5.34	180.18
20	118.12	157.62	0.00	0.00	157.62	189.15	5.62	183.52
21	114.55	152.86	0.00	0.00	152.86	192.60	5.91	186.69
22	111.21	148.40	0.00	0.00	148.40	195.89	6.19	189.71
23	108.09	144.24	0.00	0.00	144.24	199.05	6.47	192.58
24	105.16	140.33	0.00	0.00	140.33	202.08	6.75	195.33
25	102.41	136.66	0.00	0.00	136.66	204.98	7.03	197.95
26	99.82	133.19	0.00	0.00	133.19	207.78	7.31	200.47
27	97.37	129.93	0.00	0.00	129.93	210.48	7.59	202.89
85	43.39	57.91	0.00	0.00	57.91	295.32	23.90	271.42
90	41.60	55.51	0.00	0.00	55.51	299.76	25.31	274.46
100	38.47	51.34	0.00	0.00	51.34	308.04	28.12	279.91
105	37.10	49.51	0.00	0.00	49.51	311.90	29.53	282.37
110	35.84	47.82	0.00	0.00	47.82	315.61	30.93	284.67
115	34.66	46.26	0.00	0.00	46.26	319.17	32.34	286.83
120	33.58	44.81	0.00	0.00	44.81	322.60	33.75	288.86
125	32.57	43.45	0.00	0.00	43.45	325.91	35.15	290.76
130	31.62	42.19	0.00	0.00	42.19	329.11	36.56	292.55
135	30.73	41.01	0.00	0.00	41.01	332.20	37.96	294.24
140	29.90	39.90	0.00	0.00	39.90	335.20	39.37	295.83

Required Storage (m <sup>3</sup> ):	295.83
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 206

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.540
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	5.52
	Actual Release Rate (l/s) =	5.52

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	211.20	0.00	0.00			
16	135.41	203.28	0.00	0.00	203.28	195.15	189.85	
17	130.56	196.00	0.00	0.00	196.00	199.92	194.29	
18	126.09	189.29	0.00	0.00	189.29	204.44	198.47	
19	121.96	183.09	0.00	0.00	183.09	208.72	202.42	
20	118.12	177.33	0.00	0.00	177.33	212.79	206.16	
21	114.55	171.96	0.00	0.00	171.96	216.67	209.71	
22	111.21	166.96	0.00	0.00	166.96	220.38	213.09	
23	108.09	162.27	0.00	0.00	162.27	223.93	216.31	
24	105.16	157.87	0.00	0.00	157.87	227.34	219.38	
25	102.41	153.74	0.00	0.00	153.74	230.61	222.32	
26	99.82	149.84	0.00	0.00	149.84	233.76	225.14	
27	97.37	146.17	0.00	0.00	146.17	236.79	227.84	
85	43.39	65.14	0.00	0.00	65.14	332.23	304.07	
90	41.60	62.45	0.00	0.00	62.45	337.24	307.41	
100	38.47	57.76	0.00	0.00	57.76	346.54	313.40	
105	37.10	55.70	0.00	0.00	55.70	350.89	316.09	
110	35.84	53.80	0.00	0.00	53.80	355.06	318.61	
115	34.66	52.04	0.00	0.00	52.04	359.07	320.96	
120	33.58	50.41	0.00	0.00	50.41	362.93	323.16	
125	32.57	48.89	0.00	0.00	48.89	366.65	325.23	
130	31.62	47.47	0.00	0.00	47.47	370.25	327.17	
135	30.73	46.14	0.00	0.00	46.14	373.73	328.99	
140	29.90	44.89	0.00	0.00	44.89	377.10	330.71	

Required Storage (m <sup>3</sup> ):	330.71
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 207

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.930
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	9.96
	Actual Release Rate (l/s) =	9.96

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	363.74	0.00	0.00			
16	135.41	350.09	0.00	0.00	350.09	336.09	9.56	326.53
17	130.56	337.56	0.00	0.00	337.56	344.31	10.16	334.15
18	126.09	326.00	0.00	0.00	326.00	352.09	10.75	341.33
19	121.96	315.32	0.00	0.00	315.32	359.46	11.35	348.11
20	118.12	305.39	0.00	0.00	305.39	366.47	11.95	354.53
21	114.55	296.16	0.00	0.00	296.16	373.16	12.54	360.61
22	111.21	287.53	0.00	0.00	287.53	379.54	13.14	366.40
23	108.09	279.46	0.00	0.00	279.46	385.66	13.74	371.92
24	105.16	271.89	0.00	0.00	271.89	391.52	14.34	377.19
25	102.41	264.77	0.00	0.00	264.77	397.16	14.93	382.22
26	99.82	258.06	0.00	0.00	258.06	402.58	15.53	387.05
27	97.37	251.73	0.00	0.00	251.73	407.81	16.13	391.68
85	43.39	112.19	0.00	0.00	112.19	572.18	50.78	521.41
90	41.60	107.55	0.00	0.00	107.55	580.79	53.76	527.03
100	38.47	99.47	0.00	0.00	99.47	596.82	59.74	537.08
105	37.10	95.92	0.00	0.00	95.92	604.31	62.72	541.59
110	35.84	92.65	0.00	0.00	92.65	611.49	65.71	545.78
115	34.66	89.62	0.00	0.00	89.62	618.39	68.70	549.70
120	33.58	86.81	0.00	0.00	86.81	625.04	71.68	553.36
125	32.57	84.19	0.00	0.00	84.19	631.45	74.67	556.78
130	31.62	81.75	0.00	0.00	81.75	637.65	77.66	559.99
135	30.73	79.46	0.00	0.00	79.46	643.64	80.64	563.00
140	29.90	77.31	0.00	0.00	77.31	649.44	83.63	565.81

Required Storage (m <sup>3</sup> ):	565.81
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 208

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.920
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	9.82
	Actual Release Rate (l/s) =	9.82

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm	Design Storm =	Mississauga
	A =	1450
	B =	4.9
	C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	359.83	0.00	0.00			
16	135.41	346.33	0.00	0.00	346.33	332.47	9.42	323.05
17	130.56	333.93	0.00	0.00	333.93	340.61	10.01	330.59
18	126.09	322.50	0.00	0.00	322.50	348.30	10.60	337.70
19	121.96	311.93	0.00	0.00	311.93	355.59	11.19	344.40
20	118.12	302.11	0.00	0.00	302.11	362.53	11.78	350.75
21	114.55	292.97	0.00	0.00	292.97	369.15	12.37	356.78
22	111.21	284.44	0.00	0.00	284.44	375.46	12.96	362.51
23	108.09	276.46	0.00	0.00	276.46	381.51	13.55	367.97
24	105.16	268.97	0.00	0.00	268.97	387.31	14.14	373.18
25	102.41	261.93	0.00	0.00	261.93	392.89	14.72	378.16
26	99.82	255.29	0.00	0.00	255.29	398.25	15.31	382.94
27	97.37	249.03	0.00	0.00	249.03	403.42	15.90	387.52
85	43.39	110.99	0.00	0.00	110.99	566.03	50.06	515.96
90	41.60	106.40	0.00	0.00	106.40	574.55	53.01	521.54
100	38.47	98.40	0.00	0.00	98.40	590.40	58.90	531.50
105	37.10	94.89	0.00	0.00	94.89	597.81	61.84	535.97
110	35.84	91.65	0.00	0.00	91.65	604.92	64.79	540.13
115	34.66	88.66	0.00	0.00	88.66	611.75	67.73	544.01
120	33.58	85.88	0.00	0.00	85.88	618.32	70.68	547.64
125	32.57	83.29	0.00	0.00	83.29	624.66	73.62	551.04
130	31.62	80.87	0.00	0.00	80.87	630.79	76.57	554.22
135	30.73	78.61	0.00	0.00	78.61	636.72	79.51	557.20
140	29.90	76.48	0.00	0.00	76.48	642.46	82.46	560.00

Required Storage (m <sup>3</sup> ):	560.00
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 209

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.580
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	6.08
	Actual Release Rate (l/s) =	6.08

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	226.85	0.00	0.00			
16	135.41	218.34	0.00	0.00	218.34	209.60	203.77	
17	130.56	210.52	0.00	0.00	210.52	214.73	208.53	
18	126.09	203.31	0.00	0.00	203.31	219.58	213.01	
19	121.96	196.65	0.00	0.00	196.65	224.18	217.25	
20	118.12	190.46	0.00	0.00	190.46	228.55	221.26	
21	114.55	184.70	0.00	0.00	184.70	232.72	225.06	
22	111.21	179.32	0.00	0.00	179.32	236.71	228.68	
23	108.09	174.29	0.00	0.00	174.29	240.52	232.13	
24	105.16	169.57	0.00	0.00	169.57	244.18	235.42	
25	102.41	165.13	0.00	0.00	165.13	247.69	238.57	
26	99.82	160.94	0.00	0.00	160.94	251.07	241.59	
27	97.37	156.99	0.00	0.00	156.99	254.33	244.48	
85	43.39	69.97	0.00	0.00	69.97	356.84	325.84	
90	41.60	67.08	0.00	0.00	67.08	362.22	329.38	
100	38.47	62.03	0.00	0.00	62.03	372.21	335.73	
105	37.10	59.82	0.00	0.00	59.82	376.88	338.58	
110	35.84	57.78	0.00	0.00	57.78	381.36	341.23	
115	34.66	55.89	0.00	0.00	55.89	385.67	343.71	
120	33.58	54.14	0.00	0.00	54.14	389.81	346.04	
125	32.57	52.51	0.00	0.00	52.51	393.81	348.21	
130	31.62	50.98	0.00	0.00	50.98	397.67	350.25	
135	30.73	49.56	0.00	0.00	49.56	401.41	352.16	
140	29.90	48.22	0.00	0.00	48.22	405.03	353.96	

Required Storage (m <sup>3</sup> ):	353.96
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 210

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.840
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	9.70
	Actual Release Rate (l/s) =	9.70

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
15	140.69	328.54	0.00	0.00	328.54	295.68	8.73	286.95
16	135.41	316.21	0.00	0.00	316.21	303.56	9.31	294.25
17	130.56	304.89	0.00	0.00	304.89	310.99	9.90	301.09
18	126.09	294.46	0.00	0.00	294.46	318.01	10.48	307.53
19	121.96	284.80	0.00	0.00	284.80	324.67	11.06	313.61
20	118.12	275.84	0.00	0.00	275.84	331.01	11.64	319.36
21	114.55	267.50	0.00	0.00	267.50	337.05	12.22	324.82
22	111.21	259.71	0.00	0.00	259.71	342.81	12.81	330.01
23	108.09	252.42	0.00	0.00	252.42	348.34	13.39	334.95
24	105.16	245.58	0.00	0.00	245.58	353.63	13.97	339.66
25	102.41	239.15	0.00	0.00	239.15	358.72	14.55	344.17
26	99.82	233.09	0.00	0.00	233.09	363.62	15.14	348.49
27	97.37	227.37	0.00	0.00	227.37	368.34	15.72	352.62
85	43.39	101.34	0.00	0.00	101.34	516.81	49.48	467.33
90	41.60	97.15	0.00	0.00	97.15	524.59	52.39	472.20
100	38.47	89.84	0.00	0.00	89.84	539.06	58.21	480.85
105	37.10	86.64	0.00	0.00	86.64	545.83	61.12	484.70
110	35.84	83.68	0.00	0.00	83.68	552.31	64.03	488.28
115	34.66	80.95	0.00	0.00	80.95	558.55	66.94	491.61
120	33.58	78.41	0.00	0.00	78.41	564.55	69.86	494.70
125	32.57	76.05	0.00	0.00	76.05	570.35	72.77	497.58
130	31.62	73.84	0.00	0.00	73.84	575.94	75.68	500.26
135	30.73	71.77	0.00	0.00	71.77	581.35	78.59	502.76
140	29.90	69.83	0.00	0.00	69.83	586.59	81.50	505.10

Required Storage (m <sup>3</sup> ):	505.10
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 211

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.860
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	116.45
	Actual Release Rate (l/s) =	116.45

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
	A = 1450
	B = 4.9
	C = 0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	336.36	0.00	0.00			
16	135.41	323.74	0.00	0.00	323.74	310.79	199.00	
17	130.56	312.15	0.00	0.00	312.15	318.39	199.62	
18	126.09	301.47	0.00	0.00	301.47	325.58	199.82	
19	121.96	291.58	0.00	0.00	291.58	332.40	199.65	
20	118.12	282.41	0.00	0.00	282.41	338.89	199.15	
21	114.55	273.87	0.00	0.00	273.87	345.07	198.35	
22	111.21	265.89	0.00	0.00	265.89	350.98	197.27	
23	108.09	258.43	0.00	0.00	258.43	356.63	195.93	
24	105.16	251.43	0.00	0.00	251.43	362.05	194.37	
25	102.41	244.84	0.00	0.00	244.84	367.26	192.59	
26	99.82	238.64	0.00	0.00	238.64	372.28	190.62	
27	97.37	232.78	0.00	0.00	232.78	377.11	188.47	
85	43.39	103.75	0.00	0.00	103.75	529.11	0.00	
90	41.60	99.46	0.00	0.00	99.46	537.08	0.00	
100	38.47	91.98	0.00	0.00	91.98	551.90	0.00	
105	37.10	88.70	0.00	0.00	88.70	558.82	0.00	
110	35.84	85.68	0.00	0.00	85.68	565.46	0.00	
115	34.66	82.88	0.00	0.00	82.88	571.85	0.00	
120	33.58	80.28	0.00	0.00	80.28	578.00	0.00	
125	32.57	77.86	0.00	0.00	77.86	583.93	0.00	
130	31.62	75.60	0.00	0.00	75.60	589.65	0.00	
135	30.73	73.48	0.00	0.00	73.48	595.19	0.00	
140	29.90	71.50	0.00	0.00	71.50	600.56	0.00	

Required Storage (m <sup>3</sup> ):	199.82
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 212

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.200
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	25.55
	Actual Release Rate (l/s) =	25.55

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity	Total	Groundwater	External	Total			
	(mm/hr)	Runoff (l/s)	Flows (l/s)	Runoff (l/s)	Runoff (l/s)			
15	140.69	78.22	0.00	0.00	78.22	70.40	22.99	47.41
16	135.41	75.29	0.00	0.00	75.29	72.28	24.52	47.75
17	130.56	72.59	0.00	0.00	72.59	74.05	26.06	47.99
18	126.09	70.11	0.00	0.00	70.11	75.72	27.59	48.13
19	121.96	67.81	0.00	0.00	67.81	77.30	29.12	48.18
20	118.12	65.68	0.00	0.00	65.68	78.81	30.66	48.16
21	114.55	63.69	0.00	0.00	63.69	80.25	32.19	48.06
22	111.21	61.84	0.00	0.00	61.84	81.62	33.72	47.90
23	108.09	60.10	0.00	0.00	60.10	82.94	35.25	47.68
24	105.16	58.47	0.00	0.00	58.47	84.20	36.79	47.41
25	102.41	56.94	0.00	0.00	56.94	85.41	38.32	47.09
26	99.82	55.50	0.00	0.00	55.50	86.58	39.85	46.72
27	97.37	54.14	0.00	0.00	54.14	87.70	41.38	46.32
85	43.39	24.13	0.00	0.00	24.13	123.05	130.28	0.00
90	41.60	23.13	0.00	0.00	23.13	124.90	137.95	0.00
100	38.47	21.39	0.00	0.00	21.39	128.35	153.28	0.00
105	37.10	20.63	0.00	0.00	20.63	129.96	160.94	0.00
110	35.84	19.92	0.00	0.00	19.92	131.50	168.60	0.00
115	34.66	19.27	0.00	0.00	19.27	132.99	176.27	0.00
120	33.58	18.67	0.00	0.00	18.67	134.42	183.93	0.00
125	32.57	18.11	0.00	0.00	18.11	135.80	191.60	0.00
130	31.62	17.58	0.00	0.00	17.58	137.13	199.26	0.00
135	30.73	17.09	0.00	0.00	17.09	138.42	206.92	0.00
140	29.90	16.63	0.00	0.00	16.63	139.67	214.59	0.00

Required Storage (m <sup>3</sup> ):	48.18
Provided Storage (m <sup>3</sup> ):	



**Storage Volume Calculation**



Project: 4938 Catchment 213

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.400
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	53.09
	Actual Release Rate (l/s) =	53.09

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm	Design Storm =	Mississauga
	A =	1450
	B =	4.9
	C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	156.45	0.00	0.00			
16	135.41	150.58	0.00	0.00	150.58	144.55	50.97	93.59
17	130.56	145.19	0.00	0.00	145.19	148.09	54.15	93.94
18	126.09	140.22	0.00	0.00	140.22	151.43	57.34	94.10
19	121.96	135.62	0.00	0.00	135.62	154.61	60.52	94.08
20	118.12	131.35	0.00	0.00	131.35	157.62	63.71	93.91
21	114.55	127.38	0.00	0.00	127.38	160.50	66.90	93.60
22	111.21	123.67	0.00	0.00	123.67	163.25	70.08	93.16
23	108.09	120.20	0.00	0.00	120.20	165.87	73.27	92.61
24	105.16	116.94	0.00	0.00	116.94	168.40	76.45	91.94
25	102.41	113.88	0.00	0.00	113.88	170.82	79.64	91.18
26	99.82	111.00	0.00	0.00	111.00	173.15	82.82	90.33
27	97.37	108.27	0.00	0.00	108.27	175.40	86.01	89.39
85	43.39	48.25	0.00	0.00	48.25	246.10	270.77	0.00
90	41.60	46.26	0.00	0.00	46.26	249.80	286.70	0.00
100	38.47	42.78	0.00	0.00	42.78	256.70	318.55	0.00
105	37.10	41.26	0.00	0.00	41.26	259.92	334.48	0.00
110	35.84	39.85	0.00	0.00	39.85	263.01	350.41	0.00
115	34.66	38.55	0.00	0.00	38.55	265.98	366.34	0.00
120	33.58	37.34	0.00	0.00	37.34	268.84	382.26	0.00
125	32.57	36.21	0.00	0.00	36.21	271.59	398.19	0.00
130	31.62	35.16	0.00	0.00	35.16	274.26	414.12	0.00
135	30.73	34.18	0.00	0.00	34.18	276.83	430.05	0.00
140	29.90	33.25	0.00	0.00	33.25	279.33	445.97	0.00

Required Storage (m <sup>3</sup> ):	94.10
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 214

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.340
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	44.83
	Actual Release Rate (l/s) =	44.83

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	132.98	0.00	0.00			
16	135.41	127.99	0.00	0.00	127.99	122.87	43.04	79.84
17	130.56	123.41	0.00	0.00	123.41	125.88	45.72	80.15
18	126.09	119.18	0.00	0.00	119.18	128.72	48.41	80.30
19	121.96	115.28	0.00	0.00	115.28	131.42	51.10	80.31
20	118.12	111.65	0.00	0.00	111.65	133.98	53.79	80.19
21	114.55	108.27	0.00	0.00	108.27	136.42	56.48	79.94
22	111.21	105.12	0.00	0.00	105.12	138.76	59.17	79.58
23	108.09	102.17	0.00	0.00	102.17	140.99	61.86	79.13
24	105.16	99.40	0.00	0.00	99.40	143.14	64.55	78.58
25	102.41	96.80	0.00	0.00	96.80	145.20	67.24	77.96
26	99.82	94.35	0.00	0.00	94.35	147.18	69.93	77.25
27	97.37	92.03	0.00	0.00	92.03	149.09	72.62	76.47
85	43.39	41.02	0.00	0.00	41.02	209.18	228.62	0.00
90	41.60	39.32	0.00	0.00	39.32	212.33	242.07	0.00
100	38.47	36.37	0.00	0.00	36.37	218.19	268.97	0.00
105	37.10	35.07	0.00	0.00	35.07	220.93	282.42	0.00
110	35.84	33.87	0.00	0.00	33.87	223.56	295.87	0.00
115	34.66	32.77	0.00	0.00	32.77	226.08	309.32	0.00
120	33.58	31.74	0.00	0.00	31.74	228.51	322.76	0.00
125	32.57	30.78	0.00	0.00	30.78	230.85	336.21	0.00
130	31.62	29.89	0.00	0.00	29.89	233.12	349.66	0.00
135	30.73	29.05	0.00	0.00	29.05	235.31	363.11	0.00
140	29.90	28.27	0.00	0.00	28.27	237.43	376.56	0.00

Required Storage (m <sup>3</sup> ):	80.31
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 215

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.820
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	110.94
	Actual Release Rate (l/s) =	110.94

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
	A = 1450
	B = 4.9
	C = 0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	320.72	0.00	0.00			
16	135.41	308.68	0.00	0.00	308.68	296.34	106.50	189.83
17	130.56	297.63	0.00	0.00	297.63	303.59	113.16	190.43
18	126.09	287.45	0.00	0.00	287.45	310.44	119.81	190.63
19	121.96	278.02	0.00	0.00	278.02	316.94	126.47	190.47
20	118.12	269.27	0.00	0.00	269.27	323.13	133.13	190.00
21	114.55	261.13	0.00	0.00	261.13	329.02	139.78	189.24
22	111.21	253.52	0.00	0.00	253.52	334.65	146.44	188.21
23	108.09	246.41	0.00	0.00	246.41	340.04	153.10	186.95
24	105.16	239.73	0.00	0.00	239.73	345.21	159.75	185.46
25	102.41	233.45	0.00	0.00	233.45	350.18	166.41	183.77
26	99.82	227.54	0.00	0.00	227.54	354.96	173.06	181.90
27	97.37	221.96	0.00	0.00	221.96	359.57	179.72	179.85
85	43.39	98.92	0.00	0.00	98.92	504.50	565.79	0.00
90	41.60	94.83	0.00	0.00	94.83	512.10	599.07	0.00
100	38.47	87.70	0.00	0.00	87.70	526.23	665.63	0.00
105	37.10	84.58	0.00	0.00	84.58	532.83	698.91	0.00
110	35.84	81.69	0.00	0.00	81.69	539.16	732.20	0.00
115	34.66	79.02	0.00	0.00	79.02	545.25	765.48	0.00
120	33.58	76.54	0.00	0.00	76.54	551.11	798.76	0.00
125	32.57	74.24	0.00	0.00	74.24	556.77	832.04	0.00
130	31.62	72.08	0.00	0.00	72.08	562.23	865.32	0.00
135	30.73	70.06	0.00	0.00	70.06	567.51	898.60	0.00
140	29.90	68.17	0.00	0.00	68.17	572.63	931.89	0.00

Required Storage (m <sup>3</sup> ):	190.63
Provided Storage (m <sup>3</sup> ):	

## Storage Volume Calculation



Project: 4938 Catchment 216

### Modified Rational Method

Internal Area	Controlled Drainage Area (ha) =	0.190
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	24.17
	Actual Release Rate (l/s) =	24.17

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

### 100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity	Total	Groundwater	External	Total			
	(mm/hr)	Runoff (l/s)	Flows (l/s)	Runoff (l/s)	Runoff (l/s)			
15	140.69	74.31	0.00	0.00	74.31	66.88	21.75	45.13
16	135.41	71.52	0.00	0.00	71.52	68.66	23.20	45.46
17	130.56	68.96	0.00	0.00	68.96	70.34	24.65	45.69
18	126.09	66.60	0.00	0.00	66.60	71.93	26.10	45.83
19	121.96	64.42	0.00	0.00	64.42	73.44	27.55	45.89
20	118.12	62.39	0.00	0.00	62.39	74.87	29.00	45.87
21	114.55	60.51	0.00	0.00	60.51	76.24	30.45	45.78
22	111.21	58.74	0.00	0.00	58.74	77.54	31.90	45.64
23	108.09	57.09	0.00	0.00	57.09	78.79	33.35	45.44
24	105.16	55.55	0.00	0.00	55.55	79.99	34.80	45.19
25	102.41	54.09	0.00	0.00	54.09	81.14	36.25	44.89
26	99.82	52.72	0.00	0.00	52.72	82.25	37.70	44.54
27	97.37	51.43	0.00	0.00	51.43	83.32	39.15	44.16
85	43.39	22.92	0.00	0.00	22.92	116.90	123.26	0.00
90	41.60	21.97	0.00	0.00	21.97	118.66	130.51	0.00
100	38.47	20.32	0.00	0.00	20.32	121.93	145.01	0.00
105	37.10	19.60	0.00	0.00	19.60	123.46	152.26	0.00
110	35.84	18.93	0.00	0.00	18.93	124.93	159.51	0.00
115	34.66	18.31	0.00	0.00	18.31	126.34	166.76	0.00
120	33.58	17.74	0.00	0.00	17.74	127.70	174.01	0.00
125	32.57	17.20	0.00	0.00	17.20	129.01	181.27	0.00
130	31.62	16.70	0.00	0.00	16.70	130.27	188.52	0.00
135	30.73	16.23	0.00	0.00	16.23	131.50	195.77	0.00
140	29.90	15.80	0.00	0.00	15.80	132.68	203.02	0.00

Required Storage (m <sup>3</sup> ):	45.89
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 217

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.360
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	47.58
	Actual Release Rate (l/s) =	47.58

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	140.80	0.00	0.00			
16	135.41	135.52	0.00	0.00	135.52	130.10	45.68	84.42
17	130.56	130.67	0.00	0.00	130.67	133.28	48.53	84.75
18	126.09	126.20	0.00	0.00	126.20	136.29	51.39	84.90
19	121.96	122.06	0.00	0.00	122.06	139.15	54.24	84.90
20	118.12	118.22	0.00	0.00	118.22	141.86	57.10	84.76
21	114.55	114.64	0.00	0.00	114.64	144.45	59.95	84.49
22	111.21	111.30	0.00	0.00	111.30	146.92	62.81	84.11
23	108.09	108.18	0.00	0.00	108.18	149.29	65.66	83.62
24	105.16	105.25	0.00	0.00	105.25	151.56	68.52	83.04
25	102.41	102.49	0.00	0.00	102.49	153.74	71.37	82.36
26	99.82	99.90	0.00	0.00	99.90	155.84	74.23	81.61
27	97.37	97.44	0.00	0.00	97.44	157.86	77.08	80.78
85	43.39	43.43	0.00	0.00	43.43	221.49	242.67	0.00
90	41.60	41.63	0.00	0.00	41.63	224.82	256.95	0.00
100	38.47	38.50	0.00	0.00	38.50	231.03	285.50	0.00
105	37.10	37.13	0.00	0.00	37.13	233.93	299.77	0.00
110	35.84	35.86	0.00	0.00	35.86	236.71	314.05	0.00
115	34.66	34.69	0.00	0.00	34.69	239.38	328.32	0.00
120	33.58	33.60	0.00	0.00	33.60	241.95	342.60	0.00
125	32.57	32.59	0.00	0.00	32.59	244.43	356.87	0.00
130	31.62	31.65	0.00	0.00	31.65	246.83	371.15	0.00
135	30.73	30.76	0.00	0.00	30.76	249.15	385.42	0.00
140	29.90	29.93	0.00	0.00	29.93	251.40	399.70	0.00

Required Storage (m <sup>3</sup> ):	84.90
Provided Storage (m <sup>3</sup> ):	

## Storage Volume Calculation



Project: 4938 Catchment 218

### Modified Rational Method

Internal Area	Controlled Drainage Area (ha) =	0.580
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	77.88
	Actual Release Rate (l/s) =	77.88

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

### 100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity	Total	Groundwater	External	Total			
	(mm/hr)	Runoff (l/s)	Flows (l/s)	Runoff (l/s)	Runoff (l/s)			
15	140.69	226.85	0.00	0.00	226.85	204.16	70.10	134.07
16	135.41	218.34	0.00	0.00	218.34	209.60	74.77	134.84
17	130.56	210.52	0.00	0.00	210.52	214.73	79.44	135.29
18	126.09	203.31	0.00	0.00	203.31	219.58	84.11	135.47
19	121.96	196.65	0.00	0.00	196.65	224.18	88.79	135.39
20	118.12	190.46	0.00	0.00	190.46	228.55	93.46	135.09
21	114.55	184.70	0.00	0.00	184.70	232.72	98.13	134.59
22	111.21	179.32	0.00	0.00	179.32	236.71	102.81	133.90
23	108.09	174.29	0.00	0.00	174.29	240.52	107.48	133.04
24	105.16	169.57	0.00	0.00	169.57	244.18	112.15	132.02
25	102.41	165.13	0.00	0.00	165.13	247.69	116.83	130.86
26	99.82	160.94	0.00	0.00	160.94	251.07	121.50	129.57
27	97.37	156.99	0.00	0.00	156.99	254.33	126.17	128.16
85	43.39	69.97	0.00	0.00	69.97	356.84	397.21	0.00
90	41.60	67.08	0.00	0.00	67.08	362.22	420.57	0.00
100	38.47	62.03	0.00	0.00	62.03	372.21	467.30	0.00
105	37.10	59.82	0.00	0.00	59.82	376.88	490.67	0.00
110	35.84	57.78	0.00	0.00	57.78	381.36	514.03	0.00
115	34.66	55.89	0.00	0.00	55.89	385.67	537.40	0.00
120	33.58	54.14	0.00	0.00	54.14	389.81	560.76	0.00
125	32.57	52.51	0.00	0.00	52.51	393.81	584.13	0.00
130	31.62	50.98	0.00	0.00	50.98	397.67	607.49	0.00
135	30.73	49.56	0.00	0.00	49.56	401.41	630.86	0.00
140	29.90	48.22	0.00	0.00	48.22	405.03	654.22	0.00

Required Storage (m <sup>3</sup> ):	135.47
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 219

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.570
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	76.51
	Actual Release Rate (l/s) =	76.51

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
	A = 1450
	B = 4.9
	C = 0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	222.94	0.00	0.00			
16	135.41	214.57	0.00	0.00	214.57	205.99	73.45	132.54
17	130.56	206.89	0.00	0.00	206.89	211.03	78.04	132.99
18	126.09	199.81	0.00	0.00	199.81	215.79	82.63	133.17
19	121.96	193.26	0.00	0.00	193.26	220.31	87.22	133.10
20	118.12	187.18	0.00	0.00	187.18	224.61	91.81	132.80
21	114.55	181.52	0.00	0.00	181.52	228.71	96.40	132.31
22	111.21	176.23	0.00	0.00	176.23	232.62	100.99	131.64
23	108.09	171.28	0.00	0.00	171.28	236.37	105.58	130.79
24	105.16	166.64	0.00	0.00	166.64	239.97	110.17	129.80
25	102.41	162.28	0.00	0.00	162.28	243.42	114.76	128.66
26	99.82	158.17	0.00	0.00	158.17	246.74	119.35	127.39
27	97.37	154.29	0.00	0.00	154.29	249.95	123.94	126.01
85	43.39	68.76	0.00	0.00	68.76	350.69	390.18	0.00
90	41.60	65.92	0.00	0.00	65.92	355.97	413.13	0.00
100	38.47	60.97	0.00	0.00	60.97	365.79	459.04	0.00
105	37.10	58.79	0.00	0.00	58.79	370.38	481.99	0.00
110	35.84	56.79	0.00	0.00	56.79	374.78	504.94	0.00
115	34.66	54.93	0.00	0.00	54.93	379.02	527.89	0.00
120	33.58	53.21	0.00	0.00	53.21	383.09	550.84	0.00
125	32.57	51.60	0.00	0.00	51.60	387.02	573.80	0.00
130	31.62	50.10	0.00	0.00	50.10	390.82	596.75	0.00
135	30.73	48.70	0.00	0.00	48.70	394.49	619.70	0.00
140	29.90	47.39	0.00	0.00	47.39	398.05	642.65	0.00

Required Storage (m <sup>3</sup> ):	133.17
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 220

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	1.00
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	135.73
	Actual Release Rate (l/s) =	135.73

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	391.12	0.00	0.00			
16	135.41	376.44	0.00	0.00	376.44	361.38	130.30	231.08
17	130.56	362.97	0.00	0.00	362.97	370.23	138.44	231.78
18	126.09	350.54	0.00	0.00	350.54	378.59	146.59	232.00
19	121.96	339.05	0.00	0.00	339.05	386.52	154.73	231.78
20	118.12	328.38	0.00	0.00	328.38	394.06	162.88	231.18
21	114.55	318.45	0.00	0.00	318.45	401.24	171.02	230.22
22	111.21	309.18	0.00	0.00	309.18	408.11	179.16	228.95
23	108.09	300.50	0.00	0.00	300.50	414.69	187.31	227.38
24	105.16	292.36	0.00	0.00	292.36	420.99	195.45	225.54
25	102.41	284.70	0.00	0.00	284.70	427.05	203.60	223.46
26	99.82	277.49	0.00	0.00	277.49	432.88	211.74	221.14
27	97.37	270.68	0.00	0.00	270.68	438.50	219.88	218.62
85	43.39	120.64	0.00	0.00	120.64	615.25	692.22	0.00
90	41.60	115.65	0.00	0.00	115.65	624.51	732.94	0.00
100	38.47	106.96	0.00	0.00	106.96	641.74	814.38	0.00
105	37.10	103.14	0.00	0.00	103.14	649.79	855.10	0.00
110	35.84	99.62	0.00	0.00	99.62	657.52	895.82	0.00
115	34.66	96.37	0.00	0.00	96.37	664.94	936.54	0.00
120	33.58	93.35	0.00	0.00	93.35	672.09	977.26	0.00
125	32.57	90.53	0.00	0.00	90.53	678.98	1017.98	0.00
130	31.62	87.90	0.00	0.00	87.90	685.64	1058.70	0.00
135	30.73	85.44	0.00	0.00	85.44	692.09	1099.41	0.00
140	29.90	83.13	0.00	0.00	83.13	698.33	1140.13	0.00

Required Storage (m <sup>3</sup> ):	232.00
Provided Storage (m <sup>3</sup> ):	



**Storage Volume Calculation**



Project: 4938 Catchment 221

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	1.300
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	177.05
	Actual Release Rate (l/s) =	177.05

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm	Design Storm =	Mississauga
	A =	1450
	B =	4.9
	C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	508.45	0.00	0.00			
16	135.41	489.38	0.00	0.00	489.38	469.80	299.83	
17	130.56	471.86	0.00	0.00	471.86	481.29	300.70	
18	126.09	455.71	0.00	0.00	455.71	492.16	300.95	
19	121.96	440.76	0.00	0.00	440.76	502.47	300.63	
20	118.12	426.89	0.00	0.00	426.89	512.27	299.81	
21	114.55	413.98	0.00	0.00	413.98	521.62	298.54	
22	111.21	401.93	0.00	0.00	401.93	530.55	296.84	
23	108.09	390.65	0.00	0.00	390.65	539.09	294.77	
24	105.16	380.06	0.00	0.00	380.06	547.29	292.34	
25	102.41	370.11	0.00	0.00	370.11	555.17	289.59	
26	99.82	360.74	0.00	0.00	360.74	562.75	286.55	
27	97.37	351.88	0.00	0.00	351.88	570.05	283.23	
85	43.39	156.83	0.00	0.00	156.83	799.82	0.00	
90	41.60	150.34	0.00	0.00	150.34	811.86	0.00	
100	38.47	139.04	0.00	0.00	139.04	834.26	0.00	
105	37.10	134.08	0.00	0.00	134.08	844.73	0.00	
110	35.84	129.51	0.00	0.00	129.51	854.77	0.00	
115	34.66	125.28	0.00	0.00	125.28	864.42	0.00	
120	33.58	121.35	0.00	0.00	121.35	873.72	0.00	
125	32.57	117.69	0.00	0.00	117.69	882.68	0.00	
130	31.62	114.27	0.00	0.00	114.27	891.34	0.00	
135	30.73	111.08	0.00	0.00	111.08	899.71	0.00	
140	29.90	108.07	0.00	0.00	108.07	907.82	0.00	

Required Storage (m <sup>3</sup> ):	300.95
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 222

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.740
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	99.92
	Actual Release Rate (l/s) =	99.92

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	289.43	0.00	0.00			
16	135.41	278.57	0.00	0.00	278.57	267.42	95.92	171.50
17	130.56	268.60	0.00	0.00	268.60	273.97	101.92	172.05
18	126.09	259.40	0.00	0.00	259.40	280.15	107.91	172.24
19	121.96	250.90	0.00	0.00	250.90	286.02	113.91	172.11
20	118.12	243.00	0.00	0.00	243.00	291.60	119.90	171.70
21	114.55	235.65	0.00	0.00	235.65	296.92	125.90	171.02
22	111.21	228.79	0.00	0.00	228.79	302.00	131.89	170.11
23	108.09	222.37	0.00	0.00	222.37	306.87	137.89	168.98
24	105.16	216.34	0.00	0.00	216.34	311.53	143.89	167.65
25	102.41	210.68	0.00	0.00	210.68	316.02	149.88	166.14
26	99.82	205.34	0.00	0.00	205.34	320.33	155.88	164.46
27	97.37	200.30	0.00	0.00	200.30	324.49	161.87	162.62
85	43.39	89.27	0.00	0.00	89.27	455.28	509.59	0.00
90	41.60	85.58	0.00	0.00	85.58	462.14	539.57	0.00
100	38.47	79.15	0.00	0.00	79.15	474.89	599.52	0.00
105	37.10	76.32	0.00	0.00	76.32	480.85	629.50	0.00
110	35.84	73.72	0.00	0.00	73.72	486.56	659.47	0.00
115	34.66	71.31	0.00	0.00	71.31	492.06	689.45	0.00
120	33.58	69.08	0.00	0.00	69.08	497.35	719.43	0.00
125	32.57	66.99	0.00	0.00	66.99	502.45	749.40	0.00
130	31.62	65.05	0.00	0.00	65.05	507.38	779.38	0.00
135	30.73	63.23	0.00	0.00	63.23	512.14	809.35	0.00
140	29.90	61.52	0.00	0.00	61.52	516.76	839.33	0.00

Required Storage (m <sup>3</sup> ):	172.24
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 223

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.820
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	110.94
	Actual Release Rate (l/s) =	110.94

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	320.72	0.00	0.00			
16	135.41	308.68	0.00	0.00	308.68	296.34	189.83	
17	130.56	297.63	0.00	0.00	297.63	303.59	190.43	
18	126.09	287.45	0.00	0.00	287.45	310.44	190.63	
19	121.96	278.02	0.00	0.00	278.02	316.94	190.47	
20	118.12	269.27	0.00	0.00	269.27	323.13	190.00	
21	114.55	261.13	0.00	0.00	261.13	329.02	189.24	
22	111.21	253.52	0.00	0.00	253.52	334.65	188.21	
23	108.09	246.41	0.00	0.00	246.41	340.04	186.95	
24	105.16	239.73	0.00	0.00	239.73	345.21	185.46	
25	102.41	233.45	0.00	0.00	233.45	350.18	183.77	
26	99.82	227.54	0.00	0.00	227.54	354.96	181.90	
27	97.37	221.96	0.00	0.00	221.96	359.57	179.85	
85	43.39	98.92	0.00	0.00	98.92	504.50	0.00	
90	41.60	94.83	0.00	0.00	94.83	512.10	0.00	
100	38.47	87.70	0.00	0.00	87.70	526.23	0.00	
105	37.10	84.58	0.00	0.00	84.58	532.83	0.00	
110	35.84	81.69	0.00	0.00	81.69	539.16	0.00	
115	34.66	79.02	0.00	0.00	79.02	545.25	0.00	
120	33.58	76.54	0.00	0.00	76.54	551.11	0.00	
125	32.57	74.24	0.00	0.00	74.24	556.77	0.00	
130	31.62	72.08	0.00	0.00	72.08	562.23	0.00	
135	30.73	70.06	0.00	0.00	70.06	567.51	0.00	
140	29.90	68.17	0.00	0.00	68.17	572.63	0.00	

Required Storage (m <sup>3</sup> ):	190.63
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 224

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.460
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	61.36
	Actual Release Rate (l/s) =	61.36

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	179.91	0.00	0.00			
16	135.41	173.16	0.00	0.00	173.16	166.24	58.90	107.34
17	130.56	166.96	0.00	0.00	166.96	170.30	62.58	107.72
18	126.09	161.25	0.00	0.00	161.25	174.15	66.26	107.89
19	121.96	155.96	0.00	0.00	155.96	177.80	69.95	107.85
20	118.12	151.06	0.00	0.00	151.06	181.27	73.63	107.64
21	114.55	146.49	0.00	0.00	146.49	184.57	77.31	107.26
22	111.21	142.22	0.00	0.00	142.22	187.73	80.99	106.74
23	108.09	138.23	0.00	0.00	138.23	190.76	84.67	106.08
24	105.16	134.48	0.00	0.00	134.48	193.66	88.35	105.30
25	102.41	130.96	0.00	0.00	130.96	196.44	92.03	104.41
26	99.82	127.64	0.00	0.00	127.64	199.13	95.72	103.41
27	97.37	124.51	0.00	0.00	124.51	201.71	99.40	102.31
85	43.39	55.49	0.00	0.00	55.49	283.01	312.92	0.00
90	41.60	53.20	0.00	0.00	53.20	287.27	331.32	0.00
100	38.47	49.20	0.00	0.00	49.20	295.20	368.14	0.00
105	37.10	47.45	0.00	0.00	47.45	298.90	386.54	0.00
110	35.84	45.83	0.00	0.00	45.83	302.46	404.95	0.00
115	34.66	44.33	0.00	0.00	44.33	305.87	423.36	0.00
120	33.58	42.94	0.00	0.00	42.94	309.16	441.76	0.00
125	32.57	41.64	0.00	0.00	41.64	312.33	460.17	0.00
130	31.62	40.44	0.00	0.00	40.44	315.40	478.58	0.00
135	30.73	39.30	0.00	0.00	39.30	318.36	496.98	0.00
140	29.90	38.24	0.00	0.00	38.24	321.23	515.39	0.00

Required Storage (m <sup>3</sup> ):	107.89
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 225

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.380
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	50.34
	Actual Release Rate (l/s) =	50.34

External Area	Area (ha) =	0.00
	C =	0.00

External Flows	
----------------	--

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	148.62	0.00	0.00			
16	135.41	143.05	0.00	0.00	143.05	137.33	89.00	
17	130.56	137.93	0.00	0.00	137.93	140.69	89.34	
18	126.09	133.21	0.00	0.00	133.21	143.86	89.50	
19	121.96	128.84	0.00	0.00	128.84	146.88	89.49	
20	118.12	124.78	0.00	0.00	124.78	149.74	89.34	
21	114.55	121.01	0.00	0.00	121.01	152.47	89.05	
22	111.21	117.49	0.00	0.00	117.49	155.08	88.64	
23	108.09	114.19	0.00	0.00	114.19	157.58	88.12	
24	105.16	111.10	0.00	0.00	111.10	159.98	87.49	
25	102.41	108.19	0.00	0.00	108.19	162.28	86.77	
26	99.82	105.45	0.00	0.00	105.45	164.50	85.97	
27	97.37	102.86	0.00	0.00	102.86	166.63	85.08	
85	43.39	45.84	0.00	0.00	45.84	233.79	0.00	
90	41.60	43.95	0.00	0.00	43.95	237.31	0.00	
100	38.47	40.64	0.00	0.00	40.64	243.86	0.00	
105	37.10	39.19	0.00	0.00	39.19	246.92	0.00	
110	35.84	37.86	0.00	0.00	37.86	249.86	0.00	
115	34.66	36.62	0.00	0.00	36.62	252.68	0.00	
120	33.58	35.47	0.00	0.00	35.47	255.39	0.00	
125	32.57	34.40	0.00	0.00	34.40	258.01	0.00	
130	31.62	33.40	0.00	0.00	33.40	260.54	0.00	
135	30.73	32.47	0.00	0.00	32.47	262.99	0.00	
140	29.90	31.59	0.00	0.00	31.59	265.36	0.00	

Required Storage (m <sup>3</sup> ):	89.50
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 226

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.610
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	82.02
	Actual Release Rate (l/s) =	82.02

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
	A = 1450
	B = 4.9
	C = 0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
15	140.69	238.58	0.00	0.00	238.58	214.72	73.81	140.91
16	135.41	229.63	0.00	0.00	229.63	220.44	78.73	141.71
17	130.56	221.41	0.00	0.00	221.41	225.84	83.66	142.18
18	126.09	213.83	0.00	0.00	213.83	230.94	88.58	142.36
19	121.96	206.82	0.00	0.00	206.82	235.77	93.50	142.28
20	118.12	200.31	0.00	0.00	200.31	240.37	98.42	141.96
21	114.55	194.25	0.00	0.00	194.25	244.76	103.34	141.42
22	111.21	188.60	0.00	0.00	188.60	248.95	108.26	140.69
23	108.09	183.30	0.00	0.00	183.30	252.96	113.18	139.78
24	105.16	178.34	0.00	0.00	178.34	256.81	118.10	138.70
25	102.41	173.67	0.00	0.00	173.67	260.50	123.02	137.48
26	99.82	169.27	0.00	0.00	169.27	264.06	127.94	136.11
27	97.37	165.11	0.00	0.00	165.11	267.49	132.86	134.62
85	43.39	73.59	0.00	0.00	73.59	375.30	418.28	0.00
90	41.60	70.55	0.00	0.00	70.55	380.95	442.88	0.00
100	38.47	65.24	0.00	0.00	65.24	391.46	492.09	0.00
105	37.10	62.92	0.00	0.00	62.92	396.37	516.70	0.00
110	35.84	60.77	0.00	0.00	60.77	401.09	541.30	0.00
115	34.66	58.78	0.00	0.00	58.78	405.61	565.91	0.00
120	33.58	56.94	0.00	0.00	56.94	409.97	590.51	0.00
125	32.57	55.22	0.00	0.00	55.22	414.18	615.12	0.00
130	31.62	53.62	0.00	0.00	53.62	418.24	639.72	0.00
135	30.73	52.12	0.00	0.00	52.12	422.17	664.32	0.00
140	29.90	50.71	0.00	0.00	50.71	425.98	688.93	0.00

Required Storage (m <sup>3</sup> ):	142.36
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 227

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.320
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	42.07
	Actual Release Rate (l/s) =	42.07

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total Runoff Volume (m <sup>3</sup> )	Maximum Release Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
	Intensity (mm/hr)	Total Runoff (l/s)	Groundwater Flows (l/s)	External Runoff (l/s)	Total Runoff (l/s)			
	15	140.69	125.16	0.00	0.00			
16	135.41	120.46	0.00	0.00	120.46	115.64	40.39	75.25
17	130.56	116.15	0.00	0.00	116.15	118.47	42.92	75.56
18	126.09	112.17	0.00	0.00	112.17	121.15	45.44	75.71
19	121.96	108.50	0.00	0.00	108.50	123.69	47.96	75.72
20	118.12	105.08	0.00	0.00	105.08	126.10	50.49	75.61
21	114.55	101.90	0.00	0.00	101.90	128.40	53.01	75.39
22	111.21	98.94	0.00	0.00	98.94	130.60	55.54	75.06
23	108.09	96.16	0.00	0.00	96.16	132.70	58.06	74.64
24	105.16	93.55	0.00	0.00	93.55	134.72	60.59	74.13
25	102.41	91.10	0.00	0.00	91.10	136.66	63.11	73.55
26	99.82	88.80	0.00	0.00	88.80	138.52	65.63	72.89
27	97.37	86.62	0.00	0.00	86.62	140.32	68.16	72.16
85	43.39	38.60	0.00	0.00	38.60	196.88	214.58	0.00
90	41.60	37.01	0.00	0.00	37.01	199.84	227.20	0.00
100	38.47	34.23	0.00	0.00	34.23	205.36	252.44	0.00
105	37.10	33.01	0.00	0.00	33.01	207.93	265.06	0.00
110	35.84	31.88	0.00	0.00	31.88	210.41	277.69	0.00
115	34.66	30.84	0.00	0.00	30.84	212.78	290.31	0.00
120	33.58	29.87	0.00	0.00	29.87	215.07	302.93	0.00
125	32.57	28.97	0.00	0.00	28.97	217.27	315.55	0.00
130	31.62	28.13	0.00	0.00	28.13	219.41	328.17	0.00
135	30.73	27.34	0.00	0.00	27.34	221.47	340.80	0.00
140	29.90	26.60	0.00	0.00	26.60	223.46	353.42	0.00

Required Storage (m <sup>3</sup> ):	75.72
Provided Storage (m <sup>3</sup> ):	

**Storage Volume Calculation**



Project: 4938 Catchment 228

**Modified Rational Method**

Internal Area	Controlled Drainage Area (ha) =	0.350
	5-year C =	0.90
	100-year C =	1.00
	Allocated Release Rate (l/s) =	46.21
	Actual Release Rate (l/s) =	46.21

External Area	Area (ha) =	0.00
	C =	0.00

Groundwater	Groundwater pumping rate =	0.00 L/s
-------------	----------------------------	----------

100 Year Storm

Design Storm =	Mississauga
A =	1450
B =	4.9
C =	0.78

Time (min)	100 Year					Total	Maximum	Required
	Intensity	Total	Groundwater	External	Total	Runoff	Release	Storage
	(mm/hr)	Runoff (l/s)	Flows (l/s)	Runoff (l/s)	Runoff (l/s)	Volume (m <sup>3</sup> )	Volume (m <sup>3</sup> )	Volume (m <sup>3</sup> )
15	140.69	136.89	0.00	0.00	136.89	123.20	41.59	81.62
16	135.41	131.75	0.00	0.00	131.75	126.48	44.36	82.13
17	130.56	127.04	0.00	0.00	127.04	129.58	47.13	82.45
18	126.09	122.69	0.00	0.00	122.69	132.51	49.90	82.60
19	121.96	118.67	0.00	0.00	118.67	135.28	52.67	82.61
20	118.12	114.93	0.00	0.00	114.93	137.92	55.45	82.47
21	114.55	111.46	0.00	0.00	111.46	140.44	58.22	82.22
22	111.21	108.21	0.00	0.00	108.21	142.84	60.99	81.85
23	108.09	105.17	0.00	0.00	105.17	145.14	63.76	81.38
24	105.16	102.32	0.00	0.00	102.32	147.35	66.54	80.81
25	102.41	99.65	0.00	0.00	99.65	149.47	69.31	80.16
26	99.82	97.12	0.00	0.00	97.12	151.51	72.08	79.43
27	97.37	94.74	0.00	0.00	94.74	153.48	74.85	78.62
85	43.39	42.22	0.00	0.00	42.22	215.34	235.65	0.00
90	41.60	40.48	0.00	0.00	40.48	218.58	249.51	0.00
100	38.47	37.43	0.00	0.00	37.43	224.61	277.23	0.00
105	37.10	36.10	0.00	0.00	36.10	227.43	291.10	0.00
110	35.84	34.87	0.00	0.00	34.87	230.13	304.96	0.00
115	34.66	33.73	0.00	0.00	33.73	232.73	318.82	0.00
120	33.58	32.67	0.00	0.00	32.67	235.23	332.68	0.00
125	32.57	31.69	0.00	0.00	31.69	237.64	346.54	0.00
130	31.62	30.77	0.00	0.00	30.77	239.98	360.40	0.00
135	30.73	29.90	0.00	0.00	29.90	242.23	374.27	0.00
140	29.90	29.10	0.00	0.00	29.10	244.41	388.13	0.00

Required Storage (m <sup>3</sup> ):	82.61
Provided Storage (m <sup>3</sup> ):	



**Project 4938 Rangeview Estates Development  
Right of Way and Park SWM Requirements Summary**



Rainfall intensity  
Rainfall Intensity-City of Mississauga

Design Storm Event	A	B	C	I (mm/hr)
2-Year	610.0	4.6	0.78	59.9
5-Year	820.0	4.6	0.78	80.5
10-Year	1010.0	4.6	0.78	99.2
25-Year	1160.0	4.6	0.78	113.9
50-Year	1300.0	4.7	0.78	127.1
100-Year	1450.0	4.9	0.780	140.7

Tc= 15 minutes  
I=A/((T+B)^C)

Description	Catchment #	Area (ha)	Runoff coefficient	10-year minor flows (L/s)	100-year flows (L/s)	Volumetric Requirement (m3)*	LID Reference ID**
Park	300	0.29	0.30	23.97	34.00	-	-
Park	301	0.33	0.30	27.27	38.69	-	-
Park	302	0.34	0.30	28.10	39.86	-	-
Park	303	0.62	0.30	51.24	72.69	-	-
Park	304	0.16	0.30	13.22	18.76	-	-
Park	305	0.39	0.30	32.23	45.72	-	-
Park	306	0.16	0.30	13.22	18.76	-	-
Park	307	0.15	0.30	12.40	17.59	-	-
Park	308	0.26	0.30	21.49	30.48	-	-
Municipal ROW	401	0.20	0.90	49.58	70.34	10.00	-
Municipal ROW	402	0.19	0.90	47.10	66.83	9.50	1
Municipal ROW	403	0.18	0.90	44.62	63.31	9.00	-
Municipal ROW	404	0.71	0.90	176.02	249.72	35.50	2
Municipal ROW	405	0.82	0.90	203.29	288.41	41.00	3
Municipal ROW	406	0.23	0.90	57.02	80.90	11.50	4
Municipal ROW	407	0.27	0.90	66.94	94.97	13.50	5
Municipal ROW	408	0.29	0.90	71.90	102.00	14.50	6
Municipal ROW	409	0.52	0.90	128.92	182.90	26.00	7
Municipal ROW	410	0.61	0.90	151.23	214.55	30.50	8
Municipal ROW	411	0.18	0.90	44.62	63.31	9.00	9
Municipal ROW	412	0.16	0.90	39.67	56.28	8.00	10
Municipal ROW	413	0.32	0.90	79.33	112.55	16.00	11
Municipal ROW	414	0.44	0.90	109.08	154.76	22.00	12
Municipal ROW	415	0.50	0.90	123.96	175.86	25.00	13
Municipal ROW	416	0.21	0.90	52.06	73.86	10.50	-
Municipal ROW	417	0.21	0.90	52.06	73.86	10.50	-
Municipal ROW	418	0.34	0.90	84.29	119.59	17.00	-
Municipal ROW	419	0.15	0.90	37.19	52.76	7.50	14

\* Volumetric Requirement =Area x TIMP x 5mm x 10

\*\*Refer to LID Figure Location and Volume Requirements

Project# 4938



Rangeview Estates

**West of Lakefront Promenade Cumulative Requirements  
WATER QUALITY REQUIREMENT CALCULATIONS**

Table: Water Quality Storage Requirements Based on Receiving Waters

Protection Level	SWMP Type	Storage Volume (m <sup>3</sup> /ha) for Impervious Level					
		0%	35%	55%	70%	85%	100%
Level 3	Infiltration/Filtration	20	20	20	20	20	20

Input:
Estimated Imperviousness = 100%
Total ROW Area = 2.10 ha
Level of Protection: 3
SWMP Type : nfiltration/Filtration
Calculation:
Total Filter Volume Required = 20 m <sup>3</sup> /ha → 42

**5mm Retention Requirement= 105 m<sup>3</sup>**  
Use LID Sizing Greater of 5mm retention or  
volume required for 60% TSS removal filtration

Calculation are subject to change based on final grading, servicing and full capture points  
Given 5mm Retention requirement is higher than quality, quality control is satisfied (Tree Pits are sized for 5mm)

Project# 4938



Rangeview Estates

**East of Lakefront Promenade Treepit Cumulative Requirements  
WATER QUALITY REQUIREMENT CALCULATIONS**

Table: Water Quality Storage Requirements Based on Receiving Waters

Protection Level	SWMP Type	Storage Volume (m <sup>3</sup> /ha) for Impervious Level					
		0%	35%	55%	70%	85%	100%
Level 3	Infiltration/Filtration	20	20	20	20	20	20

Input: Estimated Imperviousness = 100% Total ROW Area = 3.49 ha Level of Protection: 3 SWMP Type : Infiltration/Filtration
Calculation: Total Filter Volume Required = 20 m <sup>3</sup> /ha → 70

**5mm Retention Requirement= 175 m<sup>3</sup>**  
Use LID Sizing Greater of 5mm retention or  
volume required for 60% TSS removal filtration

Calculation are subject to change based on final grading, servicing and full capture points  
Given 5mm Retention requirement is higher than quality, quality control is satisfied (Tree Pits are sized for 5mm)

Project# 4938



Rangeview Estates

### Lakefront Promenade Cumulative Tree Pit Requirements WATER QUALITY REQUIREMENT CALCULATIONS

Table: Water Quality Storage Requirements Based on Receiving Waters

Protection Level	SWMP Type	Storage Volume (m <sup>3</sup> /ha) for Impervious Level					
		0%	35%	55%	70%	85%	100%
Level 1	Infiltration/Filtration	53	25	30	35	40	45

Input: Estimated Imperviousness = 100% Total ROW Area = 0.79 ha Level of Protection: 1 SWMP Type : Infiltration/Filtration
Calculation: Total Filter Volume Required = 45 m <sup>3</sup> /ha → 36

**5mm Retention Requirement= 40 m<sup>3</sup>**  
Use LID Sizing Greater of 5mm retention or volume required for 80% TSS removal filtration

Calculations are subject to change based on final grading, servicing and full capture points  
Given 5mm Retention requirement is higher than quality, quality control is satisfied (Tree Pits are sized for 5mm)

Full Capture Flow Calculations

Street Name	Area ID	Capture MH	Trib. Area 10-Year Captured from Upstream CBs (ha)	Trib. Area 100-Year (ha)	R <sub>10</sub>	R <sub>100</sub>	AR <sub>10</sub>	AR <sub>100</sub>	Flow Length (m)	Flow Velocity (m/s)	Time of Conc. (min)	I <sub>10</sub> (mm/hr)	I <sub>100</sub> (mm/hr)	Q <sub>10</sub> (L/s)	Q <sub>100</sub> (L/s)	Q <sub>100</sub> -Q <sub>10</sub> (L/s)	Constant Flow (L/s)
Hydro Road / Rangeview (East)		5	0.34	1.25	0.9	1.00	0.31	1.25	200	1.5	20.0	83.1	118.1	70.6	410.2	339.6	339.6
Street L (East of Ogden)		15	0.16	0.72	0.9	1.00	0.14	0.72	215	1.5	20.4	82.1	116.8	32.8	233.5	200.7	200.7
East Ave / Rangeview (West)		31	1.11	1.20	0.9	1.00	1.00	1.20	370	1.5	24.3	73.4	104.5	203.6	348.2	144.7	144.7
Street L (West of Lakefront)		28	0.61	0.71	0.9	1.00	0.55	0.71	270	1.5	21.8	78.7	112.0	120.1	221.0	100.9	100.9
Ogden		7	0.48	0.97	0.9	1.00	0.43	0.97	210	1.5	20.3	82.4	117.2	98.9	315.8	216.9	216.9
Street L (West of Ogden)		23	0.35	0.51	0.9	1.00	0.32	0.51	260	1.5	21.5	79.3	112.9	69.4	159.9	90.5	90.5
Rangeview East		10	0.38	0.95	0.9	1.00	0.34	0.95	280	1.5	7	149.3	210.1	141.8	554.5	412.7	412.7
Lakeshore East (@ East)		Ex. F3-63	0.63	0.63	0.9	1.00	0.57	0.63	150	1.5	18.8	86.5	123.0	136.3	215.2	78.9	78.9
Lakeshore East (@ Lakefront)		Ex. 1	2.32	2.32	0.9	1.00	2.09	2.32	550	1.5	28.8	65.5	93.4	380.0	601.9	221.9	221.9
Hydro Road		4	0	0	0.9	1.00	0.00	0.00	90	1.5	17.3	91.1	129.4	0.0	0.0	0.0	0.0

IDF Parameters

	10-YR	100-YR
<b>A</b>	1010	1450
<b>b</b>	4.6	4.9
<b>c</b>	0.78	0.78

$I = A / (T.C. + b)^c$

T.C. = Time of Conc. (min)

I = Rainfall Intensity (mm/hr)

\*Calculations Assume 10-year Minor Flows are Captured

Run-off Coefficients

$R_{100} = R_{10} \times 1.25$


Max. R = 0.90

Time of Concentration

$T.C. (min) = \text{Flow Length (m)} \times \text{Flow Velocity (m/s)}$

Flow Velocity Overland = 1.5 m/s

Refer to Drawing GP-1 and GP-2 for manhole IDs and pipe information

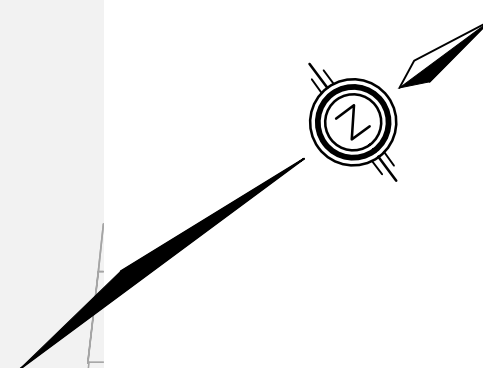


REFER TO TA-2

Ex. LAKEVIEW WATER TREATMENT PLANT

Ex. DOUGLAS KENNEDY PARK

EX.LAKEVIEW PARK

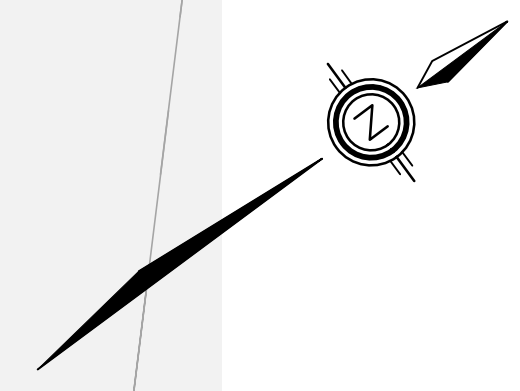

LAKESHORE RD. E  
(WIDENING)

LAKESHORE RD. E  
(WIDENING)



Caledon	
Rangeview	
Hydro Road / Rangeview (East)	
Job: 4938	Oct-22
<b>Input:</b>	
Design Specification (OPSD)	403.01
100-Year Overland Flow =	0.340 m <sup>3</sup> /s
Catchbasin Type =	2 *
Number of Catchbasins =	2
Allowable Depth of Ponding =	250 mm
Actual Depth of Ponding =	200 mm
<b>Output:</b>	
Flow Capacity per Inlet =	0.416 m <sup>3</sup> /s **
Flow Capacity per Inlet with 50% Blockage =	0.208 m <sup>3</sup> /s
Number of Inlet =	2
Total Flow Capacity with 50% Blockage =	0.416 m <sup>3</sup> /s
<p>Total flow capacity with 50% blockage is greater than the incoming 100-Year overland flow, therefore the inlet structure is sized adequately.</p>	
<b>Notes:</b>	
* Catchbasin Type (1 for single, 2 for twin)	
** Calculation based on MTO Design Chart 4.19: Inlet Capacity at Road Sag	
Allowable Depth of Ponding is based on Grading Plans	



Caledon	
Rangeview	
Street L (East of Ogden)	
Job: 4938	Oct-22
<b>Input:</b>	
Design Specification (OPSD)	403.01
100-Year Overland Flow =	0.201 m <sup>3</sup> /s
Catchbasin Type =	2 *
Number of Catchbasins =	2
Allowable Depth of Ponding =	250 mm
Actual Depth of Ponding =	150 mm
<b>Output:</b>	
Flow Capacity per Inlet =	0.289 m <sup>3</sup> /s **
Flow Capacity per Inlet with 50% Blockage =	0.144 m <sup>3</sup> /s
Number of Inlet =	2
Total Flow Capacity with 50% Blockage =	0.289 m <sup>3</sup> /s
<p>Total flow capacity with 50% blockage is greater than the incoming 100-Year overland flow, therefore the inlet structure is sized adequately.</p>	
<b>Notes:</b>	
* Catchbasin Type (1 for single, 2 for twin)	
** Calculation based on MTO Design Chart 4.19: Inlet Capacity at Road Sag	
Allowable Depth of Ponding is based on Grading Plans	

Caledon	
Rangeview	
East Ave / Rangeview (West)	
Job: 4938	Oct-22
<b>Input:</b>	
Design Specification (OPSD)	403.01
100-Year Overland Flow =	0.145 m <sup>3</sup> /s
Catchbasin Type =	2 *
Number of Catchbasins =	2
Allowable Depth of Ponding =	250 mm
Actual Depth of Ponding =	150 mm
<b>Output:</b>	
Flow Capacity per Inlet =	0.289 m <sup>3</sup> /s **
Flow Capacity per Inlet with 50% Blockage =	0.144 m <sup>3</sup> /s
Number of Inlet =	2
Total Flow Capacity with 50% Blockage =	0.289 m <sup>3</sup> /s
<p>Total flow capacity with 50% blockage is greater than the incoming 100-Year overland flow, therefore the inlet structure is sized adequately.</p>	
<b>Notes:</b>	
* Catchbasin Type (1 for single, 2 for twin)	
** Calculation based on MTO Design Chart 4.19: Inlet Capacity at Road Sag	
Allowable Depth of Ponding is based on Grading Plans	

Caledon	
Rangeview	
Street L (West of Lakefront)	
Job: 4938	Oct-22
<b>Input:</b>	
Design Specification (OPSD)	403.01
100-Year Overland Flow =	0.101 m <sup>3</sup> /s
Catchbasin Type =	1 *
Number of Catchbasins =	1
Allowable Depth of Ponding =	250 mm
Actual Depth of Ponding =	150 mm
<b>Output:</b>	
Flow Capacity per Inlet =	0.204 m <sup>3</sup> /s **
Flow Capacity per Inlet with 50% Blockage =	0.102 m <sup>3</sup> /s
Number of Inlet =	1
Total Flow Capacity with 50% Blockage =	0.102 m <sup>3</sup> /s
<p>Total flow capacity with 50% blockage is greater than the incoming 100-Year overland flow, therefore the inlet structure is sized adequately.</p>	
<b>Notes:</b>	
* Catchbasin Type (1 for single, 2 for twin)	
** Calculation based on MTO Design Chart 4.19: Inlet Capacity at Road Sag	
Allowable Depth of Ponding is based on Grading Plans	

Caledon	
Rangeview	
Ogden	
Job: 4938	Oct-22
<b>Input:</b>	
Design Specification (OPSD)	403.01
100-Year Overland Flow =	0.217 m <sup>3</sup> /s
Catchbasin Type =	2 *
Number of Catchbasins =	2
Allowable Depth of Ponding =	250 mm
Actual Depth of Ponding =	150 mm
<b>Output:</b>	
Flow Capacity per Inlet =	0.289 m <sup>3</sup> /s **
Flow Capacity per Inlet with 50% Blockage =	0.144 m <sup>3</sup> /s
Number of Inlet =	2
Total Flow Capacity with 50% Blockage =	0.289 m <sup>3</sup> /s
<p>Total flow capacity with 50% blockage is greater than the incoming 100-Year overland flow, therefore the inlet structure is sized adequately.</p>	
<b>Notes:</b>	
* Catchbasin Type (1 for single, 2 for twin)	
** Calculation based on MTO Design Chart 4.19: Inlet Capacity at Road Sag	
Allowable Depth of Ponding is based on Grading Plans	

Caledon	
Rangeview	
Street L (West of Ogden)	
Job: 4938	Oct-22
<b>Input:</b>	
Design Specification (OPSD)	403.01
100-Year Overland Flow =	0.090 m <sup>3</sup> /s
Catchbasin Type =	2 *
Number of Catchbasins =	1
Allowable Depth of Ponding =	250 mm
Actual Depth of Ponding =	150 mm
<b>Output:</b>	
Flow Capacity per Inlet =	0.289 m <sup>3</sup> /s **
Flow Capacity per Inlet with 50% Blockage =	0.144 m <sup>3</sup> /s
Number of Inlet =	1
Total Flow Capacity with 50% Blockage =	0.144 m <sup>3</sup> /s
<p>Total flow capacity with 50% blockage is greater than the incoming 100-Year overland flow, therefore the inlet structure is sized adequately.</p>	
<b>Notes:</b>	
* Catchbasin Type (1 for single, 2 for twin)	
** Calculation based on MTO Design Chart 4.19: Inlet Capacity at Road Sag	
Allowable Depth of Ponding is based on Grading Plans	

Caledon	
Rangeview	
Rangeview East	
Job: 4938	Oct-22
<b>Input:</b>	
Design Specification (OPSD)	403.01
100-Year Overland Flow =	0.413 m <sup>3</sup> /s
Catchbasin Type =	2 *
Number of Catchbasins =	2
Allowable Depth of Ponding =	250 mm
Actual Depth of Ponding =	200 mm
<b>Output:</b>	
Flow Capacity per Inlet =	0.416 m <sup>3</sup> /s **
Flow Capacity per Inlet with 50% Blockage =	0.208 m <sup>3</sup> /s
Number of Inlet =	2
Total Flow Capacity with 50% Blockage =	0.416 m <sup>3</sup> /s
<p>Total flow capacity with 50% blockage is greater than the incoming 100-Year overland flow, therefore the inlet structure is sized adequately.</p>	
<b>Notes:</b>	
* Catchbasin Type (1 for single, 2 for twin)	
** Calculation based on MTO Design Chart 4.19: Inlet Capacity at Road Sag	
Allowable Depth of Ponding is based on Grading Plans	










MTO Design Chart 4.19: Inlet Capacity (OPSD 400.01,400.03)

Depth	SINGLE										TWIN									
	400.01	400.03	400.02	400.02B	400.07	400.10	400.11	400.12	403.01		400.01	400.03	400.02	400.02B	400.07	400.10	400.11	400.12	403.01	
0.02	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.00	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
0.01	0.002	0.002	0.002	0.001	0.002	0.002	0.002	0.002	0.003	0.01	0.002	0.002	0.002	0.001	0.002	0.002	0.002	0.002	0.002	0.003
0.02	0.004	0.004	0.003	0.003	0.003	0.004	0.004	0.005	0.007	0.02	0.004	0.004	0.003	0.003	0.004	0.004	0.005	0.005	0.007	0.010
0.03	0.006	0.006	0.005	0.004	0.005	0.006	0.006	0.007	0.010	0.03	0.006	0.006	0.005	0.004	0.006	0.006	0.007	0.007	0.010	0.013
0.04	0.008	0.008	0.007	0.006	0.006	0.007	0.008	0.010	0.014	0.04	0.008	0.008	0.007	0.006	0.008	0.009	0.011	0.011	0.015	0.020
0.05	0.010	0.010	0.008	0.008	0.008	0.009	0.010	0.012	0.017	0.05	0.010	0.010	0.009	0.008	0.010	0.011	0.013	0.013	0.017	0.023
0.06	0.012	0.012	0.010	0.010	0.010	0.011	0.012	0.014	0.020	0.06	0.012	0.012	0.011	0.010	0.012	0.013	0.015	0.015	0.020	0.027
0.07	0.015	0.015	0.012	0.012	0.012	0.013	0.014	0.016	0.023	0.07	0.015	0.015	0.014	0.013	0.015	0.016	0.018	0.018	0.023	0.030
0.08	0.018	0.018	0.015	0.015	0.015	0.016	0.017	0.019	0.026	0.08	0.018	0.018	0.017	0.016	0.018	0.019	0.021	0.021	0.026	0.034
0.09	0.020	0.020	0.017	0.017	0.017	0.018	0.019	0.021	0.028	0.09	0.020	0.020	0.019	0.018	0.020	0.021	0.023	0.023	0.028	0.036
0.10	0.022	0.022	0.019	0.019	0.019	0.020	0.021	0.023	0.030	0.10	0.022	0.022	0.021	0.020	0.022	0.023	0.025	0.025	0.030	0.038
0.11	0.025	0.025	0.021	0.021	0.021	0.022	0.023	0.025	0.032	0.11	0.025	0.025	0.024	0.023	0.025	0.026	0.028	0.028	0.032	0.040
0.12	0.028	0.028	0.024	0.024	0.024	0.025	0.026	0.028	0.035	0.12	0.028	0.028	0.027	0.026	0.028	0.029	0.031	0.031	0.035	0.043
0.13	0.030	0.030	0.026	0.026	0.026	0.027	0.028	0.030	0.037	0.13	0.030	0.030	0.029	0.028	0.030	0.031	0.033	0.033	0.037	0.045
0.14	0.032	0.032	0.028	0.028	0.028	0.029	0.030	0.032	0.039	0.14	0.032	0.032	0.031	0.030	0.032	0.033	0.035	0.035	0.039	0.047
0.15	0.035	0.035	0.030	0.030	0.030	0.031	0.032	0.034	0.041	0.15	0.035	0.035	0.034	0.033	0.035	0.036	0.038	0.038	0.041	0.049
0.16	0.038	0.038	0.033	0.033	0.033	0.034	0.035	0.037	0.044	0.16	0.038	0.038	0.037	0.036	0.038	0.039	0.041	0.041	0.044	0.052
0.17	0.040	0.040	0.035	0.035	0.035	0.036	0.037	0.039	0.046	0.17	0.040	0.040	0.039	0.038	0.040	0.041	0.043	0.043	0.046	0.054
0.18	0.042	0.042	0.037	0.037	0.037	0.038	0.039	0.041	0.048	0.18	0.042	0.042	0.041	0.040	0.042	0.043	0.045	0.045	0.048	0.056
0.19	0.045	0.045	0.040	0.040	0.040	0.041	0.042	0.044	0.051	0.19	0.045	0.045	0.044	0.043	0.045	0.046	0.048	0.048	0.051	0.059
0.20	0.048	0.048	0.042	0.042	0.042	0.043	0.044	0.046	0.053	0.20	0.048	0.048	0.047	0.046	0.048	0.049	0.051	0.051	0.054	0.062
0.21	0.050	0.050	0.044	0.044	0.044	0.045	0.046	0.048	0.055	0.21	0.050	0.050	0.049	0.048	0.050	0.051	0.053	0.053	0.056	0.064
0.22	0.052	0.052	0.046	0.046	0.046	0.047	0.048	0.050	0.057	0.22	0.052	0.052	0.051	0.050	0.052	0.053	0.055	0.055	0.058	0.066
0.23	0.055	0.055	0.048	0.048	0.048	0.049	0.050	0.052	0.059	0.23	0.055	0.055	0.054	0.053	0.055	0.056	0.058	0.058	0.061	0.069
0.24	0.058	0.058	0.050	0.050	0.050	0.051	0.052	0.054	0.061	0.24	0.058	0.058	0.057	0.056	0.058	0.059	0.061	0.061	0.064	0.072
0.25	0.060	0.060	0.052	0.052	0.052	0.053	0.054	0.056	0.063	0.25	0.060	0.060	0.059	0.058	0.060	0.061	0.063	0.063	0.066	0.074
0.26	0.062	0.062	0.054	0.054	0.054	0.055	0.056	0.058	0.065	0.26	0.062	0.062	0.061	0.060	0.062	0.063	0.065	0.065	0.068	0.076
0.27	0.065	0.065	0.056	0.056	0.056	0.057	0.058	0.060	0.067	0.27	0.065	0.065	0.064	0.063	0.065	0.066	0.068	0.068	0.071	0.079
0.28	0.068	0.068	0.058	0.058	0.058	0.059	0.060	0.062	0.069	0.28	0.068	0.068	0.067	0.066	0.068	0.069	0.071	0.071	0.074	0.082
0.29	0.070	0.070	0.060	0.060	0.060	0.061	0.062	0.064	0.071	0.29	0.070	0.070	0.069	0.068	0.070	0.071	0.073	0.073	0.076	0.084
0.30	0.072	0.072	0.062	0.062	0.062	0.063	0.064	0.066	0.073	0.30	0.072	0.072	0.071	0.070	0.072	0.073	0.075	0.075	0.078	0.086

LEGEND



OPSD	Type	Open Area (sqm)	Open Area (sqft)
400.01	Fishbone w/overflow	242	0.156
400.03	Fishbone, V grate	203	0.131
400.02	Fishbone	203	0.131
400.02B	Beehive	155	0.100
400.07	Circular	182	0.117
400.10	Checkerboard	224	0.145
400.11	Checkerboard w/overflow	231	0.149
400.12	Birdcage	300	0.184
403.01	Honeycomb	411	0.265

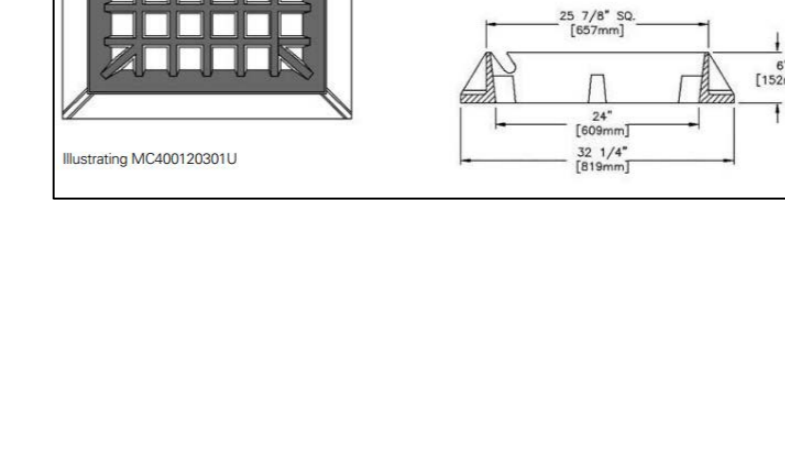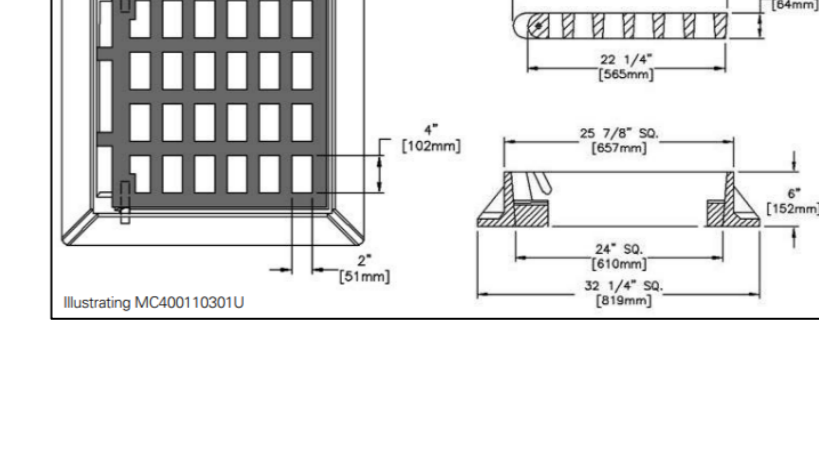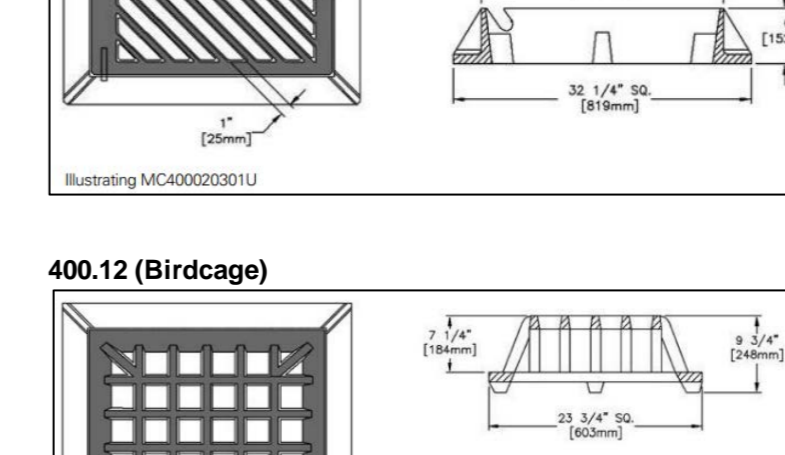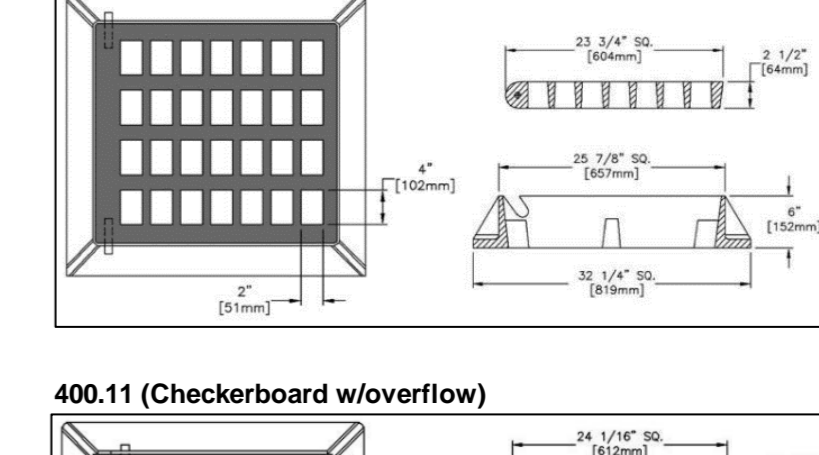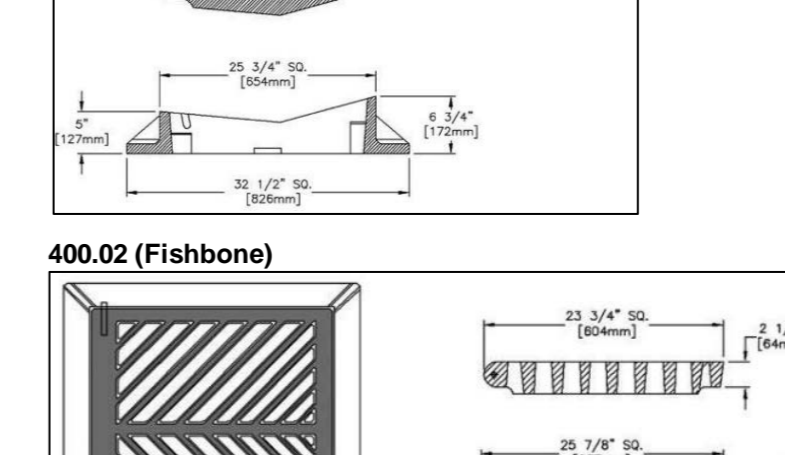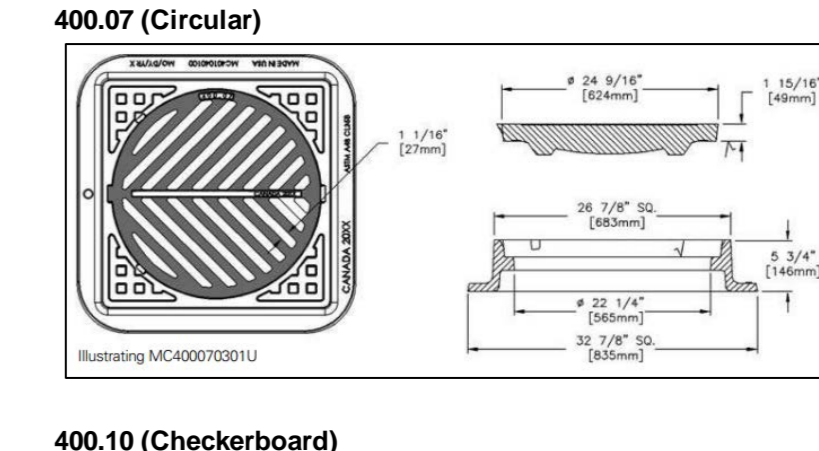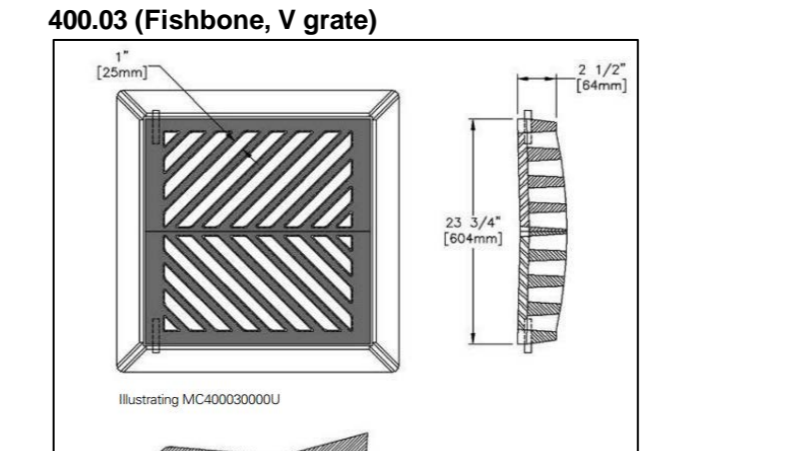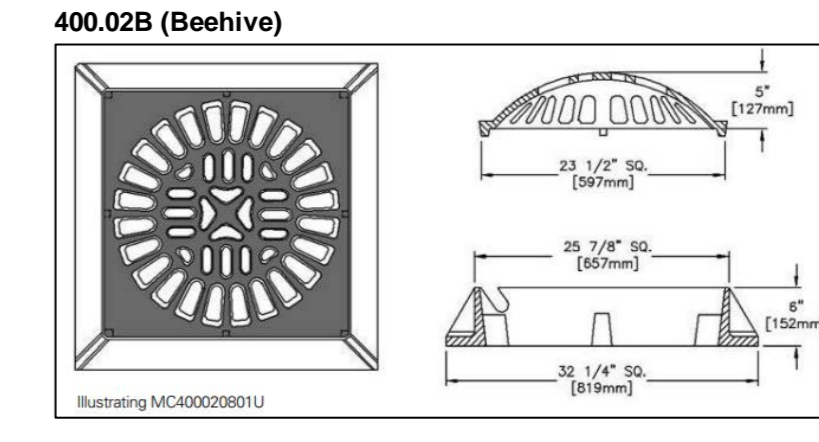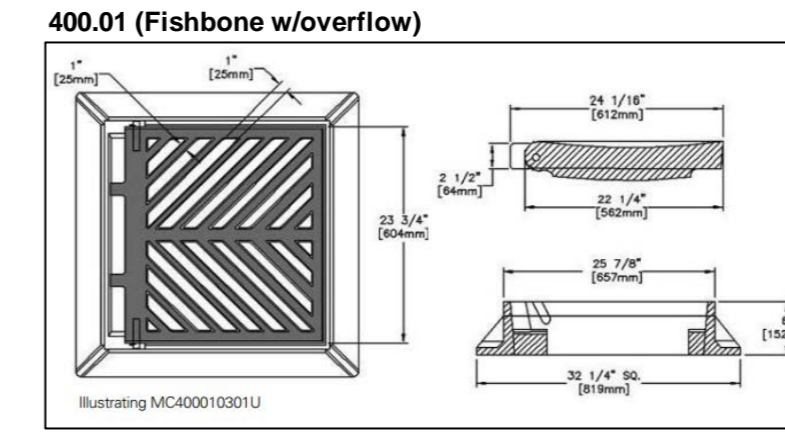
\*72% open area per Stappan, assumed total area = 400.01 type grate



RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA  
COMMUNITY COST SHARING

LEGEND

-  SUBJECT AREA
-  TREE PIT DRAINAGE AREA

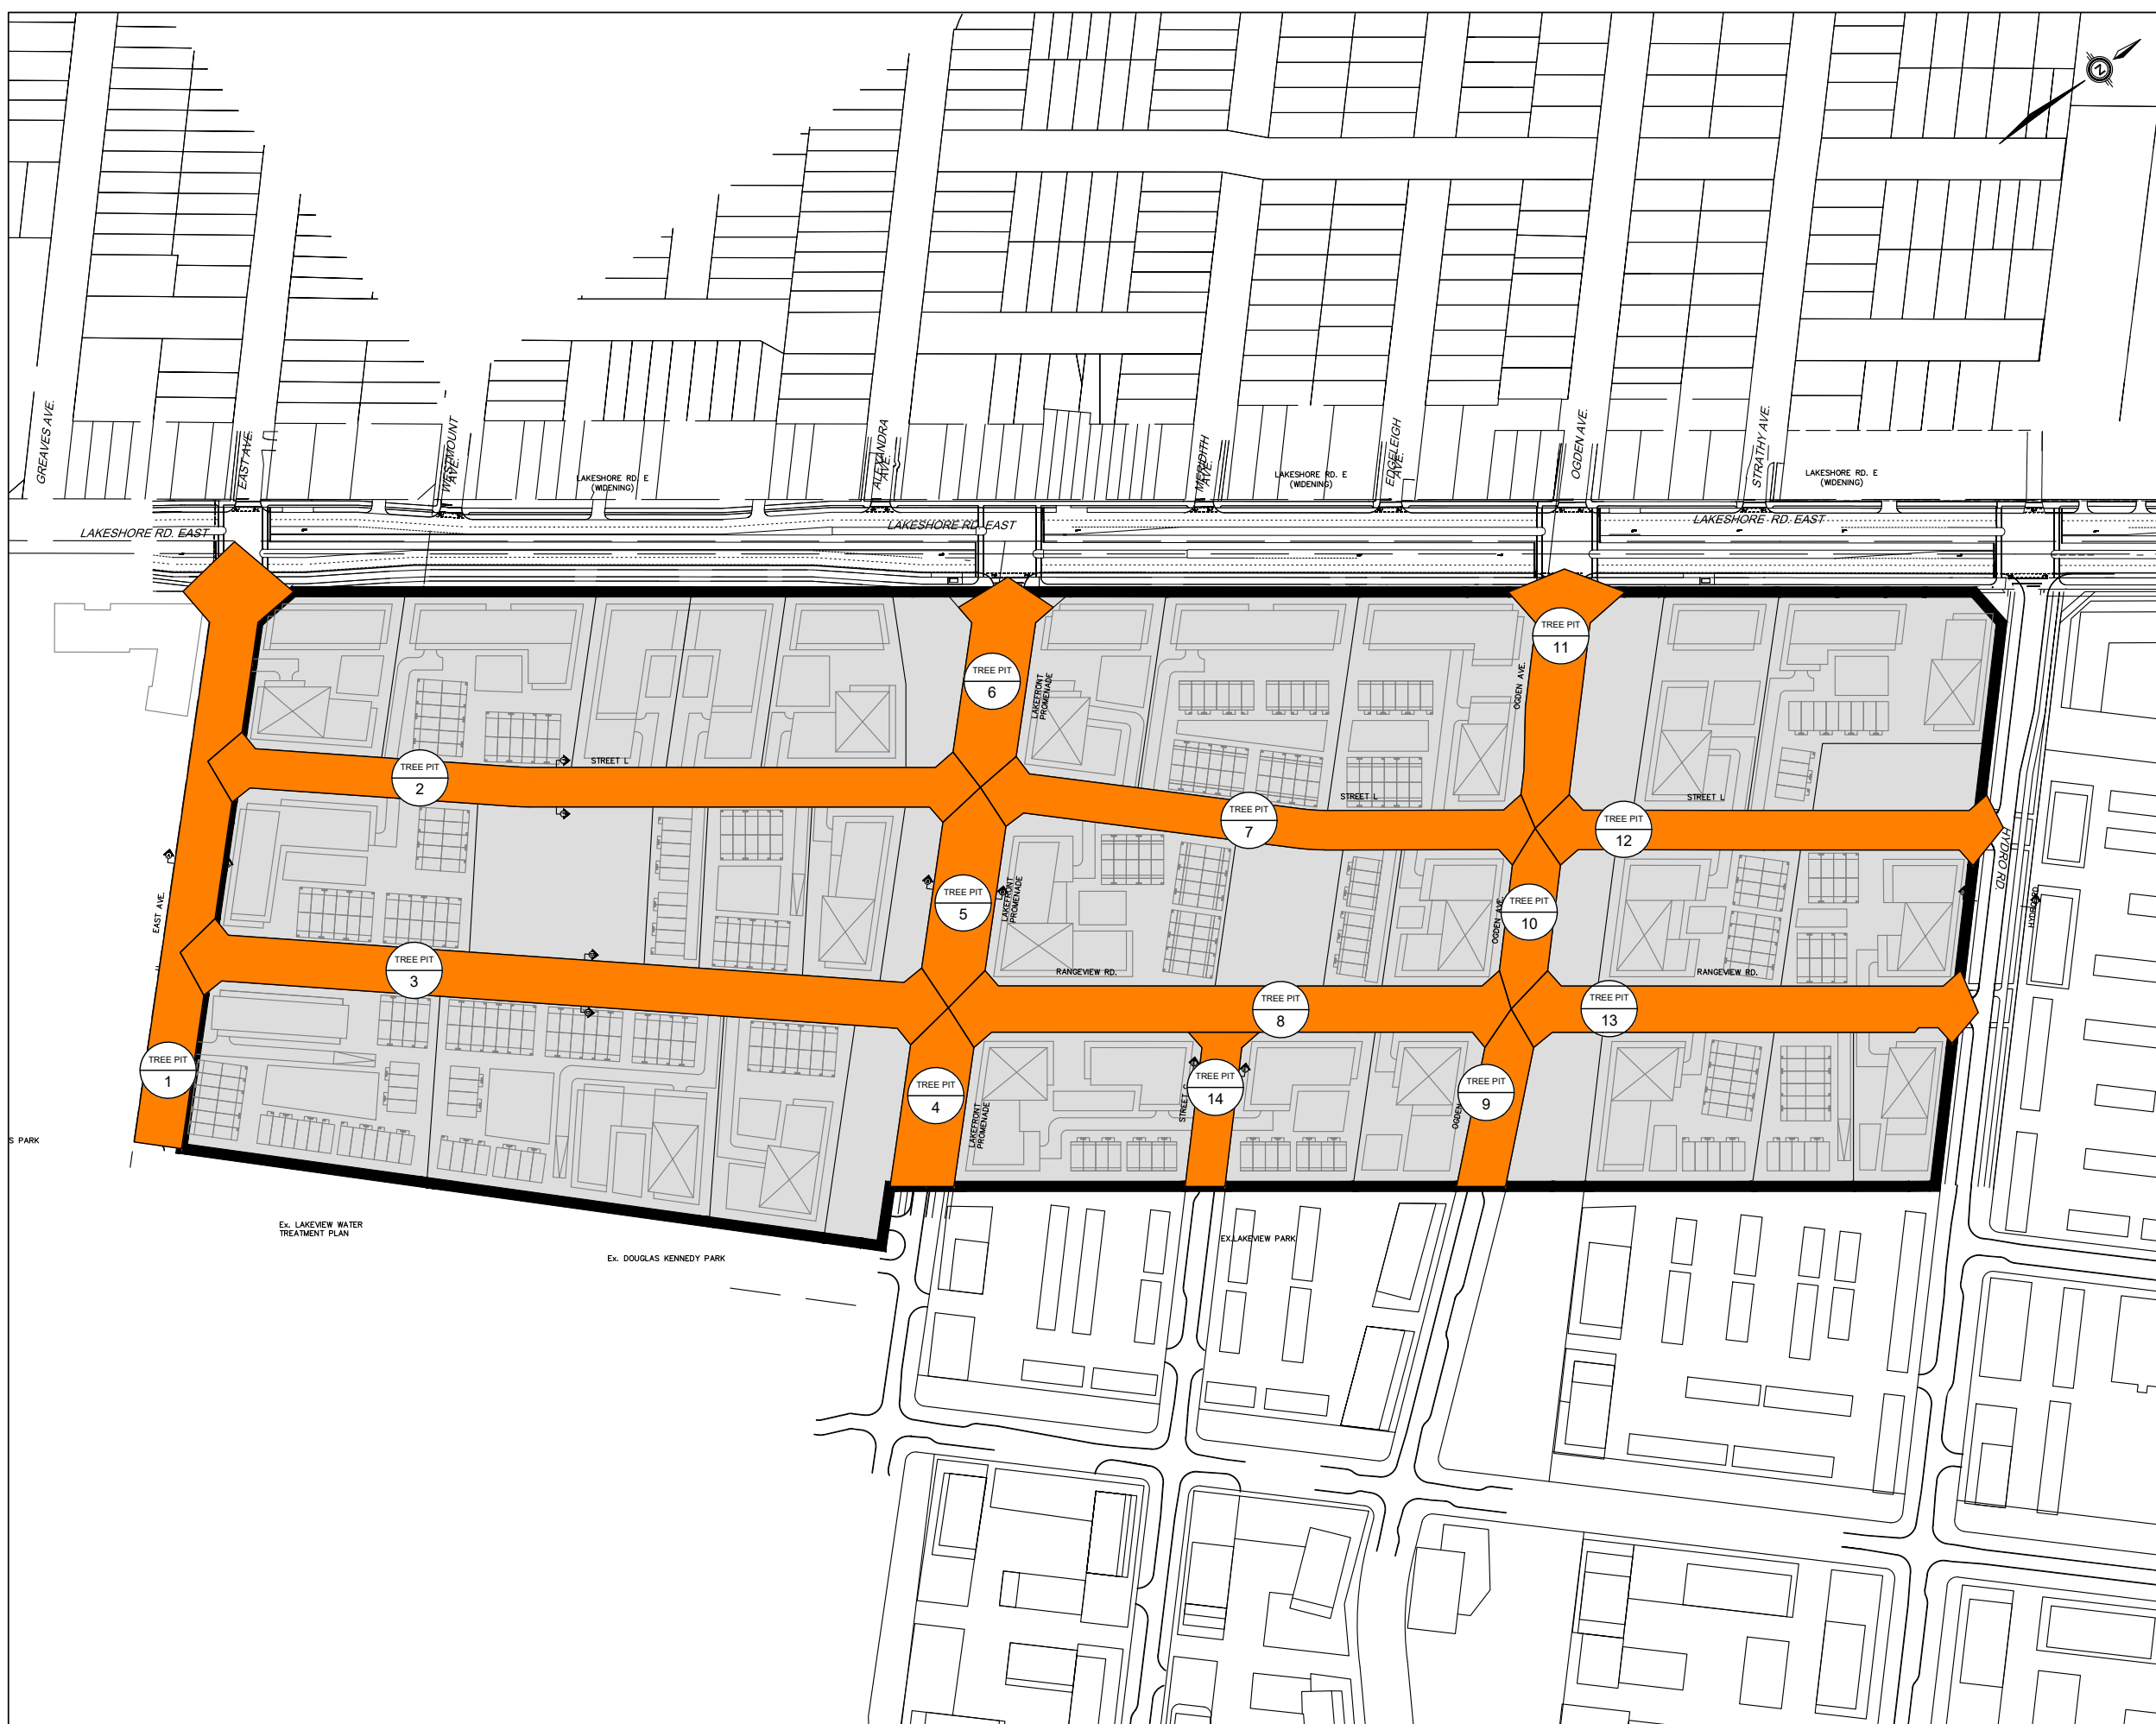


**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE D.2  
TREE PID LID LOCATIONS





# **SCHAEFFERS**

## **CONSULTING ENGINEERS**

6 Ronrose Drive  
Concord, Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-Mail: [general@schaeffers.com](mailto:general@schaeffers.com)  
T.O. Line: (416) 213-5590

### **MEMORANDUM**

**To: Rangeview Estates Development Land Owners Group  
C/O Delta Urban  
Mr. Myron Pestaluky, P.Eng.**

**From: Koryun Shahbikian, P.Eng.**

**Date: April 30, 2024**

**Our File: 2020-4938**

**Subject: Rangeview Development – Servicing Alternatives Memorandum**

---

#### **Introduction**

The following memorandum has been completed in support of the proposed Rangeview Development on Lakeshore Rd. East and Lakefront Promenade, in the City of Mississauga, Region of Peel (herein referred to as 'Rangeview Development').

The subject site is approximately 21.94 ha of developable area and is bound by Lakeshore Road to the northwest, Hydro Rd. to the northeast, East Avenue to the southwest, and Lakeview Park and Douglas Kennedy Park to the southeast. A location plan is provided in the enclosures. The majority of the site currently consists of employment land. The master plan development concept proposes future right-of-way (ROW), residential site plans, and park areas.

Currently, the proposed development consists of 33 parcels with 21 participating and 12 non-participating properties. The primary objective of this memorandum is to provide details regarding the available alternatives for water supply servicing, sanitary servicing, and stormwater management for the subject site in accordance with the applicable design criteria and standards. To ensure serviceability for the proposed development, alternative water supply, and sanitary and stormwater servicing were explored such that the serviceability for the Rangeview Development is independent of the development of Street 'L' and Ogden Avenue.

The latest development concept was presented in the report entitled “*Master Functional Servicing and Stormwater Management Report, Rangeview Master Plan*” (September

2023) by Schaeffers Consulting Engineers. The Master Functional Servicing Plan (MFSR) dated September 2023 presented servicing for interim and ultimate scenarios. Based on the Rangeview Development MFSR dated September 2023, both the interim and ultimate servicing (i.e. water supply, sanitary and stormwater management) conditions were dependent on the development of Street 'L', and Ogden Avenue. Given, that there are a few nonparticipating landowners who disrupt the ultimate construction of Street 'L', there was concern from the municipality on how the project will be developed. The proposed servicing for the development was revised to use a spine servicing approach through the existing ROW and eliminates the need for blocks to be serviced from the new proposed municipal road Street 'L' and Ogden Avenue. It is proposed to incorporate future infrastructure in the ROW of Rangeview Road, East Avenue, Hydro Road, Lakefront Promenade, and Lakeshore Road East to service all the blocks in the Rangeview Development.

### **Background Information (Sept. 2023 Submission – Servicing Concept)**

Based on the Rangeview Development MFSR dated September 2023, under the interim scenario, water supply, sanitary and storm infrastructure cannot be built along the entirety of Street 'L' due to the presence of non-participating landowners within the Rangeview site. As such, a partial buildout of Street 'L' was proposed with two cul-du sacs based on the non-participating landowners. Refer to the Drawings enclosed for the September 2023 Master Plan concept.

Two (2) alternatives were considered for water supply servicing under interim conditions. Option 1 involves servicing the parcels fronting Rangeview Road via the existing 250 mm diameter and 300 mm diameter water mains along Rangeview Road. Parcels fronting Lakeshore Road East were to be serviced directly from the existing 600 mm diameter water main along Lakeshore Road East. Option 2 involves servicing the parcels fronting Lakeshore Road East by proposed services on Street 'L' and Ogden Avenue. Temporary easements would be required to loop these water mains on Street 'L' back to Rangeview Road to limit dead-ends in the system. Parcels fronting Rangeview Road would be serviced via the existing 250 mm diameter and 300 mm diameter water mains along Rangeview Road.

For sanitary servicing in the interim scenario, the parcels fronting Rangeview Road were proposed to be serviced by Rangeview Road and parcels fronting Lakeshore Road East would be serviced by Street 'L' and Ogden Avenue. For the ultimate full buildout sanitary servicing, all future sanitary flows from the site were proposed to discharge only to the



proposed internal sewers located within the subject site, including proposed sanitary sewers on Street 'L' and Ogden Avenue.

Lastly, the stormwater management scheme for the subject site is proposed to ultimately discharge in Lake Ontario as per existing conditions. Within the interim conditions, temporary cul-du-sacs would be constructed, which requires a temporary easement for storm servicing through the proposed park block. This temporary easement would connect to the storm sewers on Rangeview Road. The proposed SWM scheme complies with the Lakeview servicing proposed to the south of the subject site. Quantity control, quality control, and volumetric controls are proposed at the site plan level. Quality control at the site plan level is proposed to be achieved via Jellyfish filters or equivalent measures. For the municipal right of way, quality control is proposed via a treatment train approach with tree pits in conjunction with OGS units to satisfy the required 80% TSS removal. Refer to the General plan enclosed for the September 2023 MFSR drawings.

### **Alternative Servicing Concept**

There was some concern from the municipality on how the Master Plan would be developed based on the large number of parcels and non-participating lands, interrupting the construction of Street 'L'. To address this concern, an alternate servicing concept was devised. The servicing for the development was revised to rely on the proposed spine services within the existing right of way (ROW) and eliminates the need for blocks to be serviced from the new proposed municipal road Street 'L' and Ogden Avenue.

It is proposed to incorporate future municipal infrastructures ( Water, sanitary, and storm) in the existing ROW of Rangeview Road, East Avenue, Hydro Road, Lakefront Promenade, and Lakeshore Road East to service all the blocks in the Rangeview Development. In order for the Rangeview Development to be independent of requiring Street 'L' and Ogden Avenue for servicing, it is proposed that the lots fronting Lakeshore Road East be serviced from Lakeshore Road. The other blocks are proposed to be serviced via the proposed infrastructure in the existing ROW (i.e.: Rangeview Road, East Avenue, and Hydro Road). Overall, the ROW for Lakefront Promenade, and Hydro Road is wide enough to incorporate the proposed infrastructure required to service the proposed development. Further details are presented in the sections below and the alternative servicing concept is illustrated in the drawings presented in the appendices.

### **Lakeshore Road East**



As part of the City of Mississauga road improvements, Lakeshore Road East is planned to be widened. As mentioned above, it is proposed for the lots fronting Lakeshore Road East to be serviced from Lakeshore Road. Currently, the existing parcels fronting Lakeshore Road East are serviced by the existing 600mm diameter water main along Lakeshore Road East in the south boulevard. The proposed servicing solution is to mimic the existing water supply servicing, in which parcels fronting Lakeshore Road East are serviced directly from the existing 600 mm diameter water main. If the Region does not prefer connecting to the existing 600mm diameter water main, a new local water main can be installed to service these parcels. The connection to the existing water main north of the ROW on Lakeshore Road East was investigated. However, this option will require long service connections crossing the Lakeshore Road ROW under the BRT configuration. Therefore, the latter option is deemed not preferable.

For sanitary servicing, the blocks fronting Lakeshore are proposed to collect sanitary flows via the proposed sanitary sewer. During the meeting with the City of Mississauga and the Region, it was proposed to run a sanitary sewer along Lakeshore Road East to collect the sanitary flows and discharge flows to the trunk sewers running west of Lakeshore Road East. However, there is a 2.4m water main that crosses Lakefront Promenade, and to run sanitary sewers across the length of Lakeshore Road East, it would require the sanitary sewers to be deepened. To avoid deep sanitary sewers along Lakeshore Road East, it was proposed that blocks East of Ogden Avenue will connect to the existing sewer and drain towards the east on Lakeshore Road. Based on a memorandum entitled “*Downstream Sanitary Sewer Analysis, Rangeview Road Proposed Development Lands*” by SCE, dated September 2023, there was residual capacity for the sanitary trunk sewer going east along Lakeshore Road East (defined as SAN-3 as part of the memorandum). According to the Downstream Sanitary Sewer Analysis, the sanitary trunk sewer running east of Lakeshore Road East has a residual capacity to accommodate 2300 people (under 80% of flow ratio). The proposed population to discharge to the east trunk sewer is 1358 people. It is to be noted, that based on the residual capacity of the sanitary trunk East of Lakeshore Road East, only blocks east of the proposed Ogden Avenue are proposed to discharge to the sanitary trunk. Therefore, sanitary constraints are not expected. Refer to the memorandum enclosed for further details.

Since there is a 2.4m diameter water main at the intersection of Lakefront Promenade and Lakeshore Road East, it is proposed that the block fronting Lakeshore Road East between Ogden Avenue and Lakefront Promenade will connect to a new sanitary sewer on Lakeshore Road East draining to the intersection of Lakefront Promenade. Ultimately, the



flow will drain towards Rangeview via a new sewer on the Lakefront Promenade draining towards the south.

The blocks fronting Lakeshore Road East, west of the Lakefront Promenade will connect to the new sewer on Lakeshore Road East draining towards the west where it will discharge to the newly proposed regional trunk system.

The concept is presented in the enclosed drawings.

Stormwater management for the blocks fronting Lakeshore Road East is proposed to discharge runoff to existing storm sewers to the allowable release rates of the area draining to the roadway. Quality control for the blocks is proposed to satisfy 80% TSS removal. As stipulated in the City of Mississauga stormwater management guidelines 5mm retention is proposed for the blocks as part of the volumetric requirements.

### **East Avenue**

In East Avenue, there are existing 1500mm CPP diameter watermain, 300mm PVC diameter watermain, and 900mm CPP diameter watermain. Additionally, on East Avenue, there is a future 900mm diameter CPP water main planned by the Region. To service the overall Rangeview Development, there are proposed sanitary and storm sewers on East Avenue. Overall, there is an array of existing, proposed, and future servicing planned for the roadway. Currently, it is proposed to install new sewers, and water mains within the 20.11m ROW. In the future, the East Avenue ROW will be widened when the widening blocks are conveyed. Refer to the road cross-section enclosed for East Avenue ROW details.

### **Rangeview Road**

Rangeview Road runs east-west of the Rangeview Development. To service the Rangeview Developments, currently, spine services including (local water mains, sanitary sewers, and storm sewers) are proposed within the existing ROW limit. Furthermore, there is a future 600mm diameter CPP water main planned by the Region. Currently, it is proposed to install infrastructure within the 20.11m ROW. This spine servicing solution, which relies on the existing ROW will provide flexibility for the development of each parcel. Each parcel will convey the widening blocks along Rangeview Road at the development application stage to create a 22.24m ROW.

Refer to the road cross-section enclosed for Rangeview Road ROW details.

### **Closing Remarks**



This memorandum illustrates the alternative servicing strategy for the Rangeview study area. The alternative municipal servicing strategy has been proposed to satisfy the City of Mississauga and Region standards. The proposed alternative servicing strategy provides flexibility for the development and eliminates the need for spine servicing on the proposed municipal ROW on Street 'L' and Ogden Avenue. The proposed spine servicing solution will provide the required services to all parcels independent of conveying future ROWs and widening blocks.

The conveyance of ROW blocks and future ROWs could be secured properly by legal instruments that can be discussed and finalized between the LOG and the City. The Trustee/Landowner Group will enter into an agreement with the City (the "Spine Services Agreement" or "SSA") to coordinate and provide for the timely delivery of the land required for the new spine roads (Street L, Ogden Avenue). This SSA (subject to discussions) will provide certainty that the lands required for the new spine roads will be conveyed to the City, which conveyances will be coordinated among the participating landowners by the Trustee. The lands can be conveyed directly to the City as part of individual owner's site plan applications. Alternatively, should the City prefer, these lands can be held in escrow by the Trustee as part of individual owner's site plan applications. The Trustee will hold these lands in escrow until they can be collectively delivered and conveyed to the City for the construction of Street L and Ogden Avenue. The obligations under the SSA would be addressed in the cost-sharing arrangements among the landowners, ensuring that the value of the conveyed lands is shared among all benefitting, participating owners.

We trust that you will find this material satisfactory, and we are looking forward to receiving your comments soon. Should you have any questions or comments, please contact the undersigned.

Respectfully Submitted,

**SCHAEFFER & ASSOCIATES LTD.**



**Ishraque Chandan, EIT.**  
Water Resources Analyst



**Koryun Shahbikian, P.Eng.**  
Partner



---

---

# ENCLOSURES

---


---

---


## LOCATION PLAN

---

---





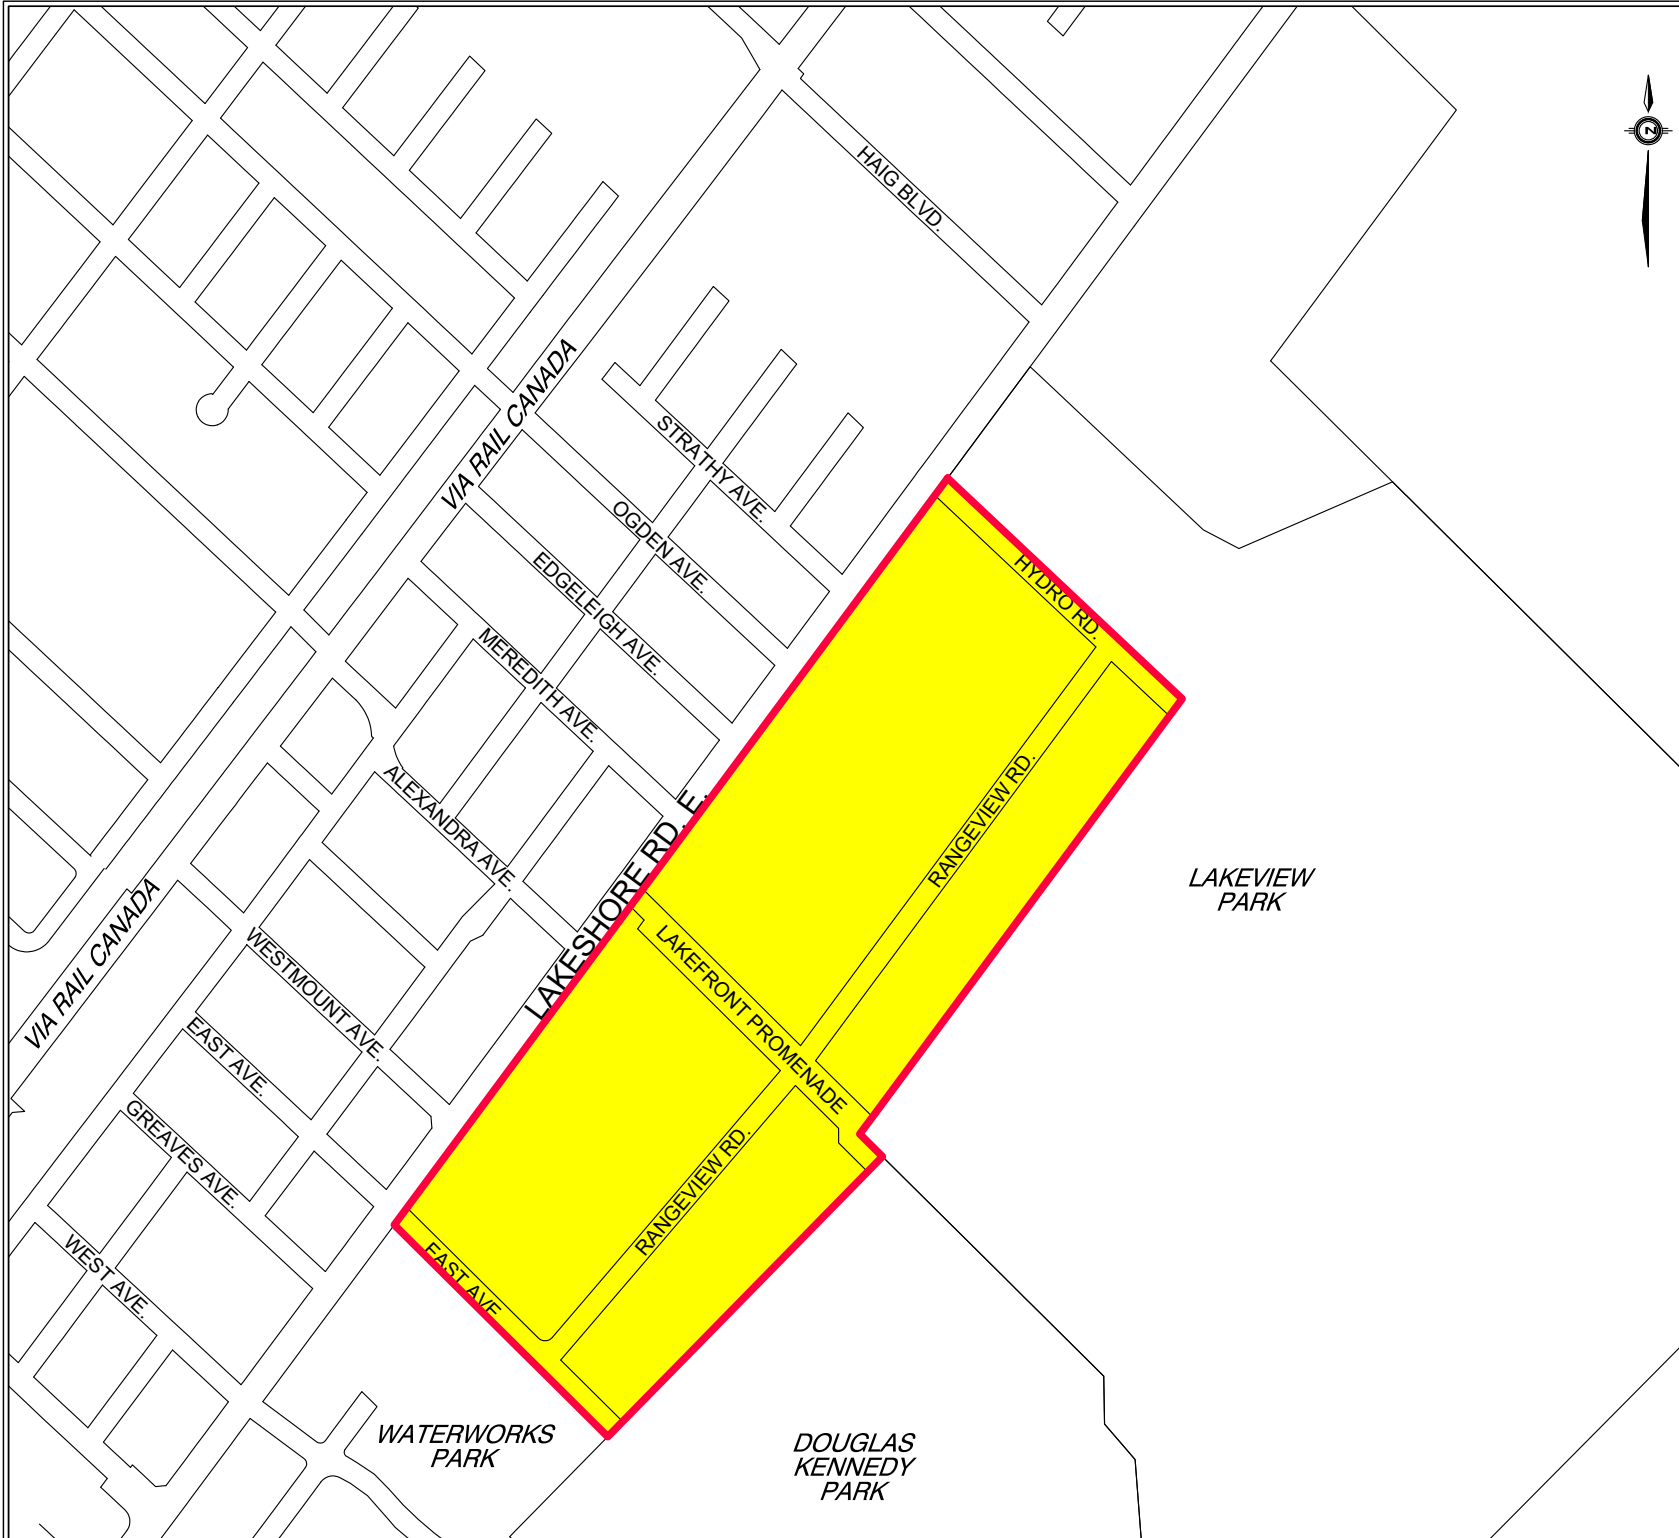

RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA

LEGEND

SUBJECT AREA

**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 1.1  
LOCATION PLAN

---

---

MASTER FUNCTIONAL SERVICING AND STORMWATER  
MANAGEMENT REPORT, RANGEVIEW MASTER PLAN  
SEPTEMBER 2023  
DRAWINGS


---

---





REFER TO INT.GP-2

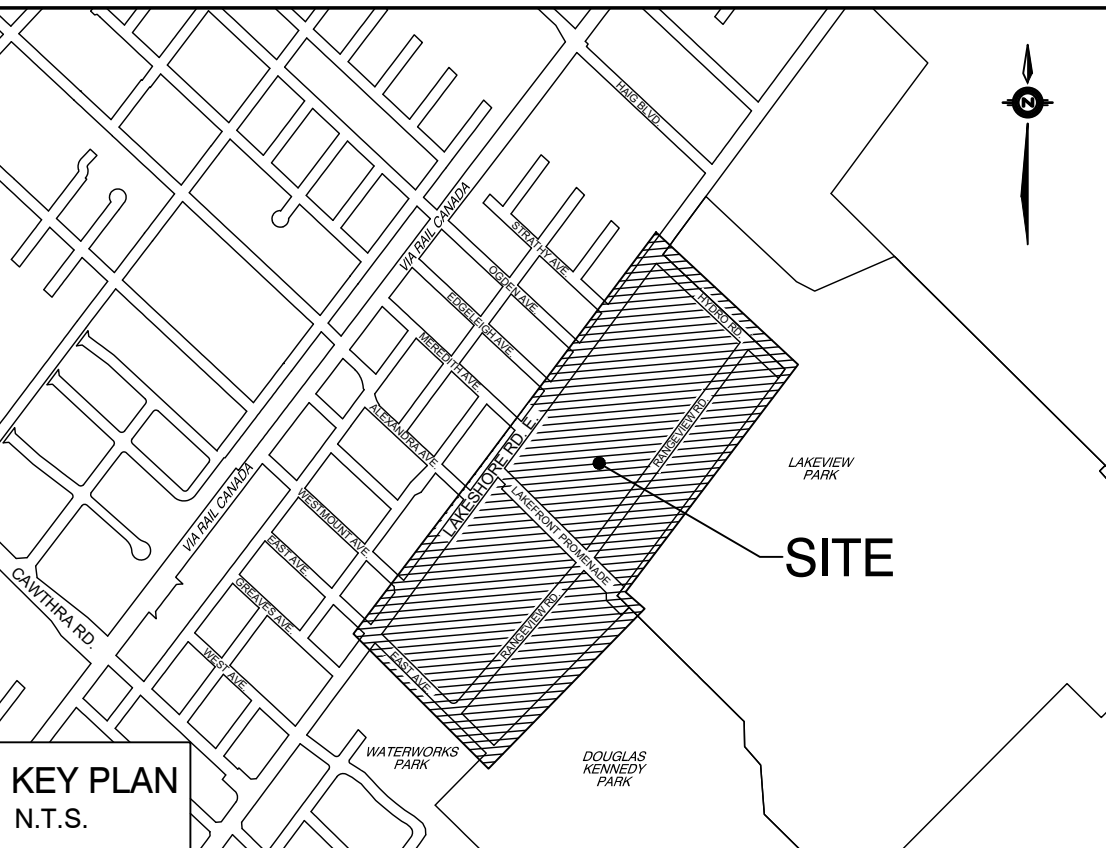

- LEGEND:**
- DENOTES PROPOSED SANITARY
  - DENOTES PROPOSED STORM
  - DENOTES PROPOSED WATERMAIN
  - DENOTES PROPOSED UTILITY CORRIDOR
  - - - DENOTES PROPOSED DISTRICT ENERGY
  - DENOTES FUTURE SANITARY
  - DENOTES FUTURE STORM
  - DENOTES FUTURE WATERMAIN
  - - - DENOTES EXISTING SANITARY
  - - - DENOTES EXISTING STORM
  - - - DENOTES EXISTING WATERMAIN
  - - - DENOTES EXISTING UTILITY CORRIDOR
  - DENOTES NON-PARTICIPATING LANDOWNERS
  - DENOTES EXTERNAL LANDS
  - T/G 84.73  
SW 80.20 DENOTES TOP OF GRATE (T/G) AND OVERTOP OF STM SEWER
  - T/G 84.75  
SW 80.95 DENOTES TOP OF GRATE (T/G) AND OVERTOP OF SAN SEWER

- NOTES:**
1. STORM SEWER SHOWN ON OGDEN RD. AND STREET 'G', SOUTH OF RANGEVIEW ROAD, ARE ONLY REQUIRED TO SUPPORT POTENTIAL ROAD CONSTRUCTION.
  2. PROPOSED STORM SEWER AND EASEMENT WITHIN PARK BLOCK TO BE DECOMMISSIONED UPON EXTENSION OF STREET L TO LAKEFRONT PROMENADE.

No.	Date	Issued for

**BENCHMARK NOTE**

**RANGEVIEW ESTATES PRECINCT AREA**  
CITY OF MISSISSAUGA

**SCHAEFFERS**  
CONSULTING ENGINEERS



6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-mail:  
design@schaeffers.com



**PRELIMINARY INTERIM GENERAL PLAN**

DRAWN BY: M.P.	DESIGNED BY: H.H.T.	CHECKED BY: H.H.T.
SCALE: 1:1000	DATE: SEPTEMBER 2023	
PROJECT No. 2022-4938	DRAWING No. INT.GP-1	

P:\4938\4938-GENERAL\4938-INT-GP-1-2.DWG | 2023-09-29, 8:22:05 AM | J.p.s

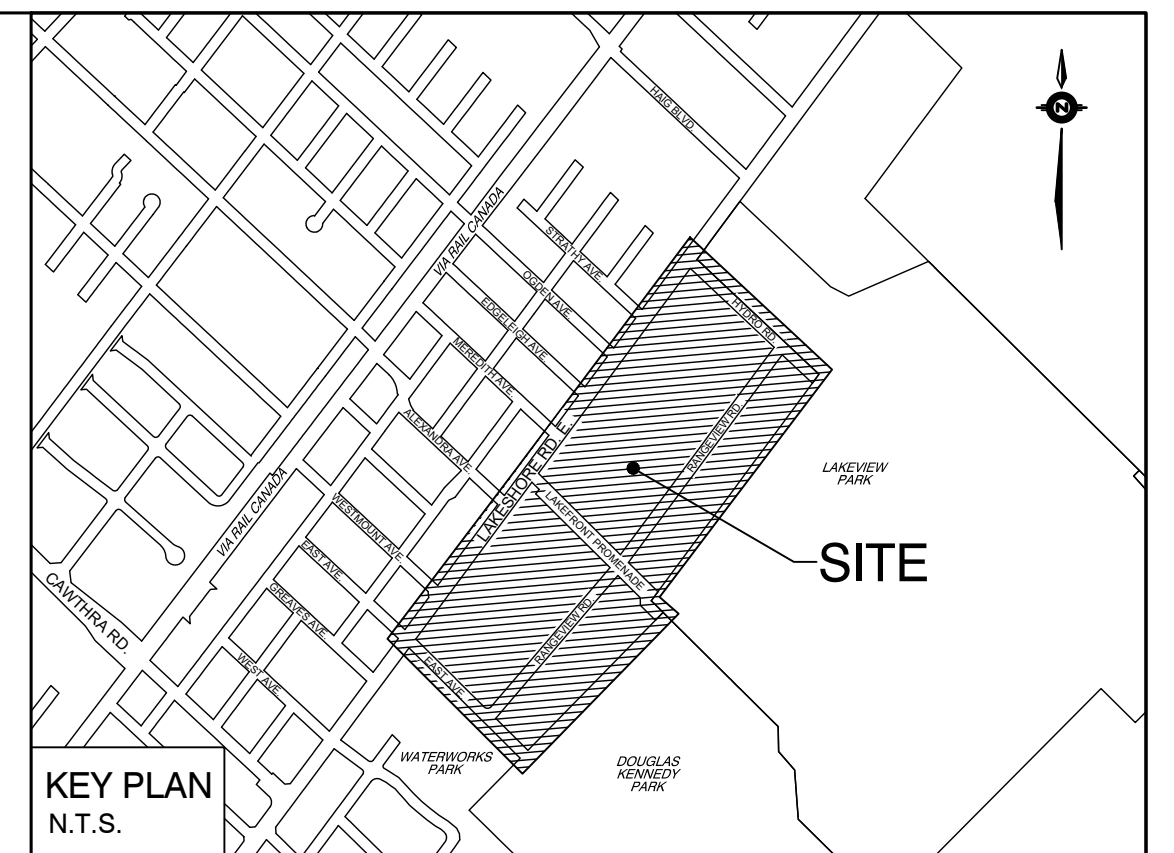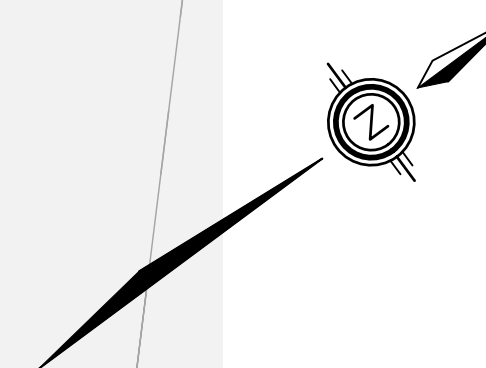

- LEGEND:**
- DENOTES PROPOSED SANITARY
  - DENOTES PROPOSED STORM
  - DENOTES PROPOSED WATERMAIN
  - DENOTES PROPOSED UTILITY CORRIDOR
  - - - DENOTES PROPOSED DISTRICT ENERGY
  - DENOTES FUTURE SANITARY
  - DENOTES FUTURE STORM
  - DENOTES FUTURE WATERMAIN
  - DENOTES EXISTING SANITARY
  - DENOTES EXISTING STORM
  - DENOTES EXISTING WATERMAIN
  - DENOTES NON-PARTICIPATING LANDOWNERS
  - DENOTES EXTERNAL LANDS
  - T/G 84.73  
SW 80.20 DENOTES TOP OF GRATE (T/G) AND INVERT OF STM SEWER
  - T/G 84.75  
SW 80.95 DENOTES TOP OF GRATE (T/G) AND INVERT OF SAN SEWER

- NOTES:**
- STORM SEWER SHOWN ON OGDEN RD. AND STREET 'G', SOUTH OF RANGEVIEW ROAD, ARE ONLY REQUIRED TO SUPPORT POTENTIAL ROAD CONSTRUCTION.

No.	Date	Issued for

**BENCHMARK NOTE**

**RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA**

**SCHAEFFERS**  
CONSULTING ENGINEERS

6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-mail:  
design@schaeffers.com






**PRELIMINARY INTERIM GENERAL PLAN**

DRAWN BY: M.P.	DESIGNED BY: H.H.T.	CHECKED BY: H.H.T.
SCALE: 1:1000	DATE: SEPTEMBER 2023	
PROJECT No. 2022-4938	DRAWING No. INT-GP-2	

F:\4938\4938-GENERAL\4938-INT-GP-1-2.DWG | 2023-09-25, 8:22:24 AM | J.yip

REFER TO INT-GP-1

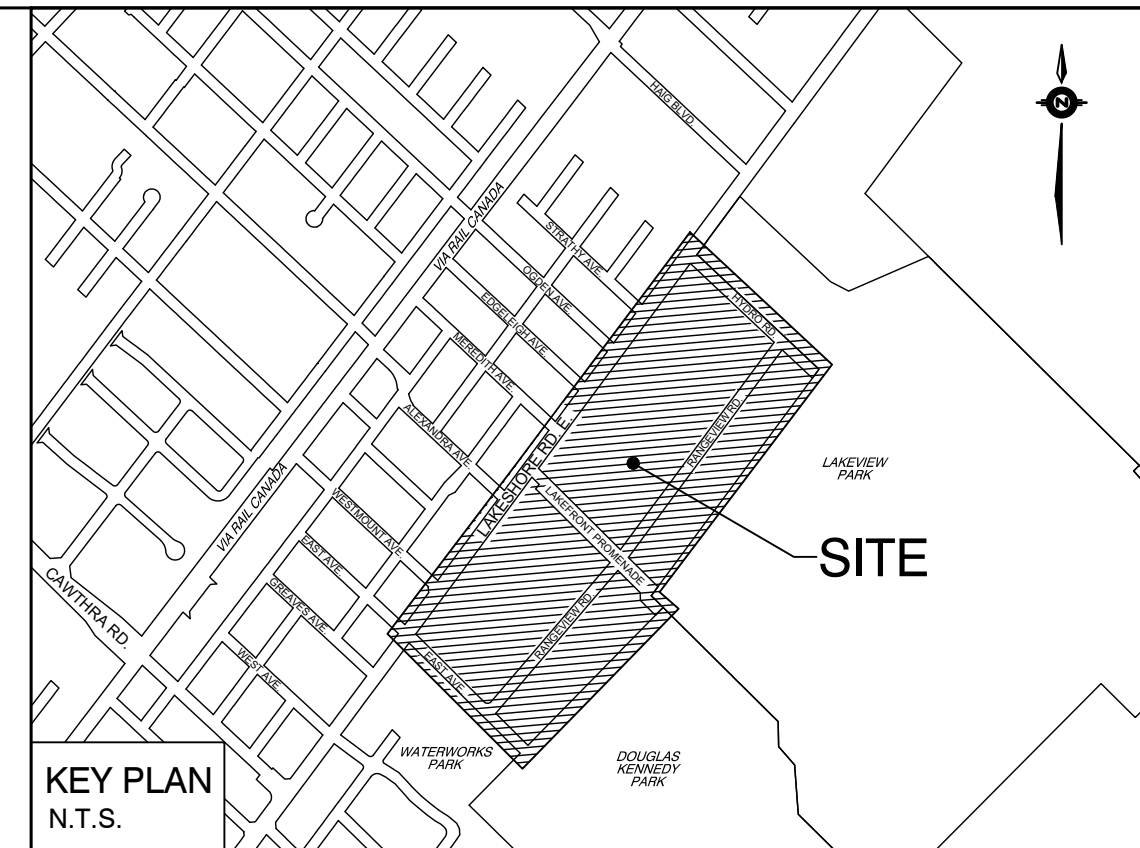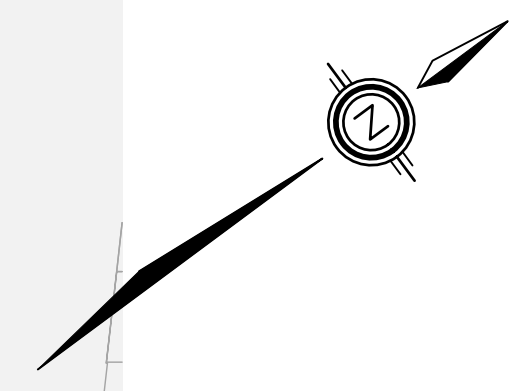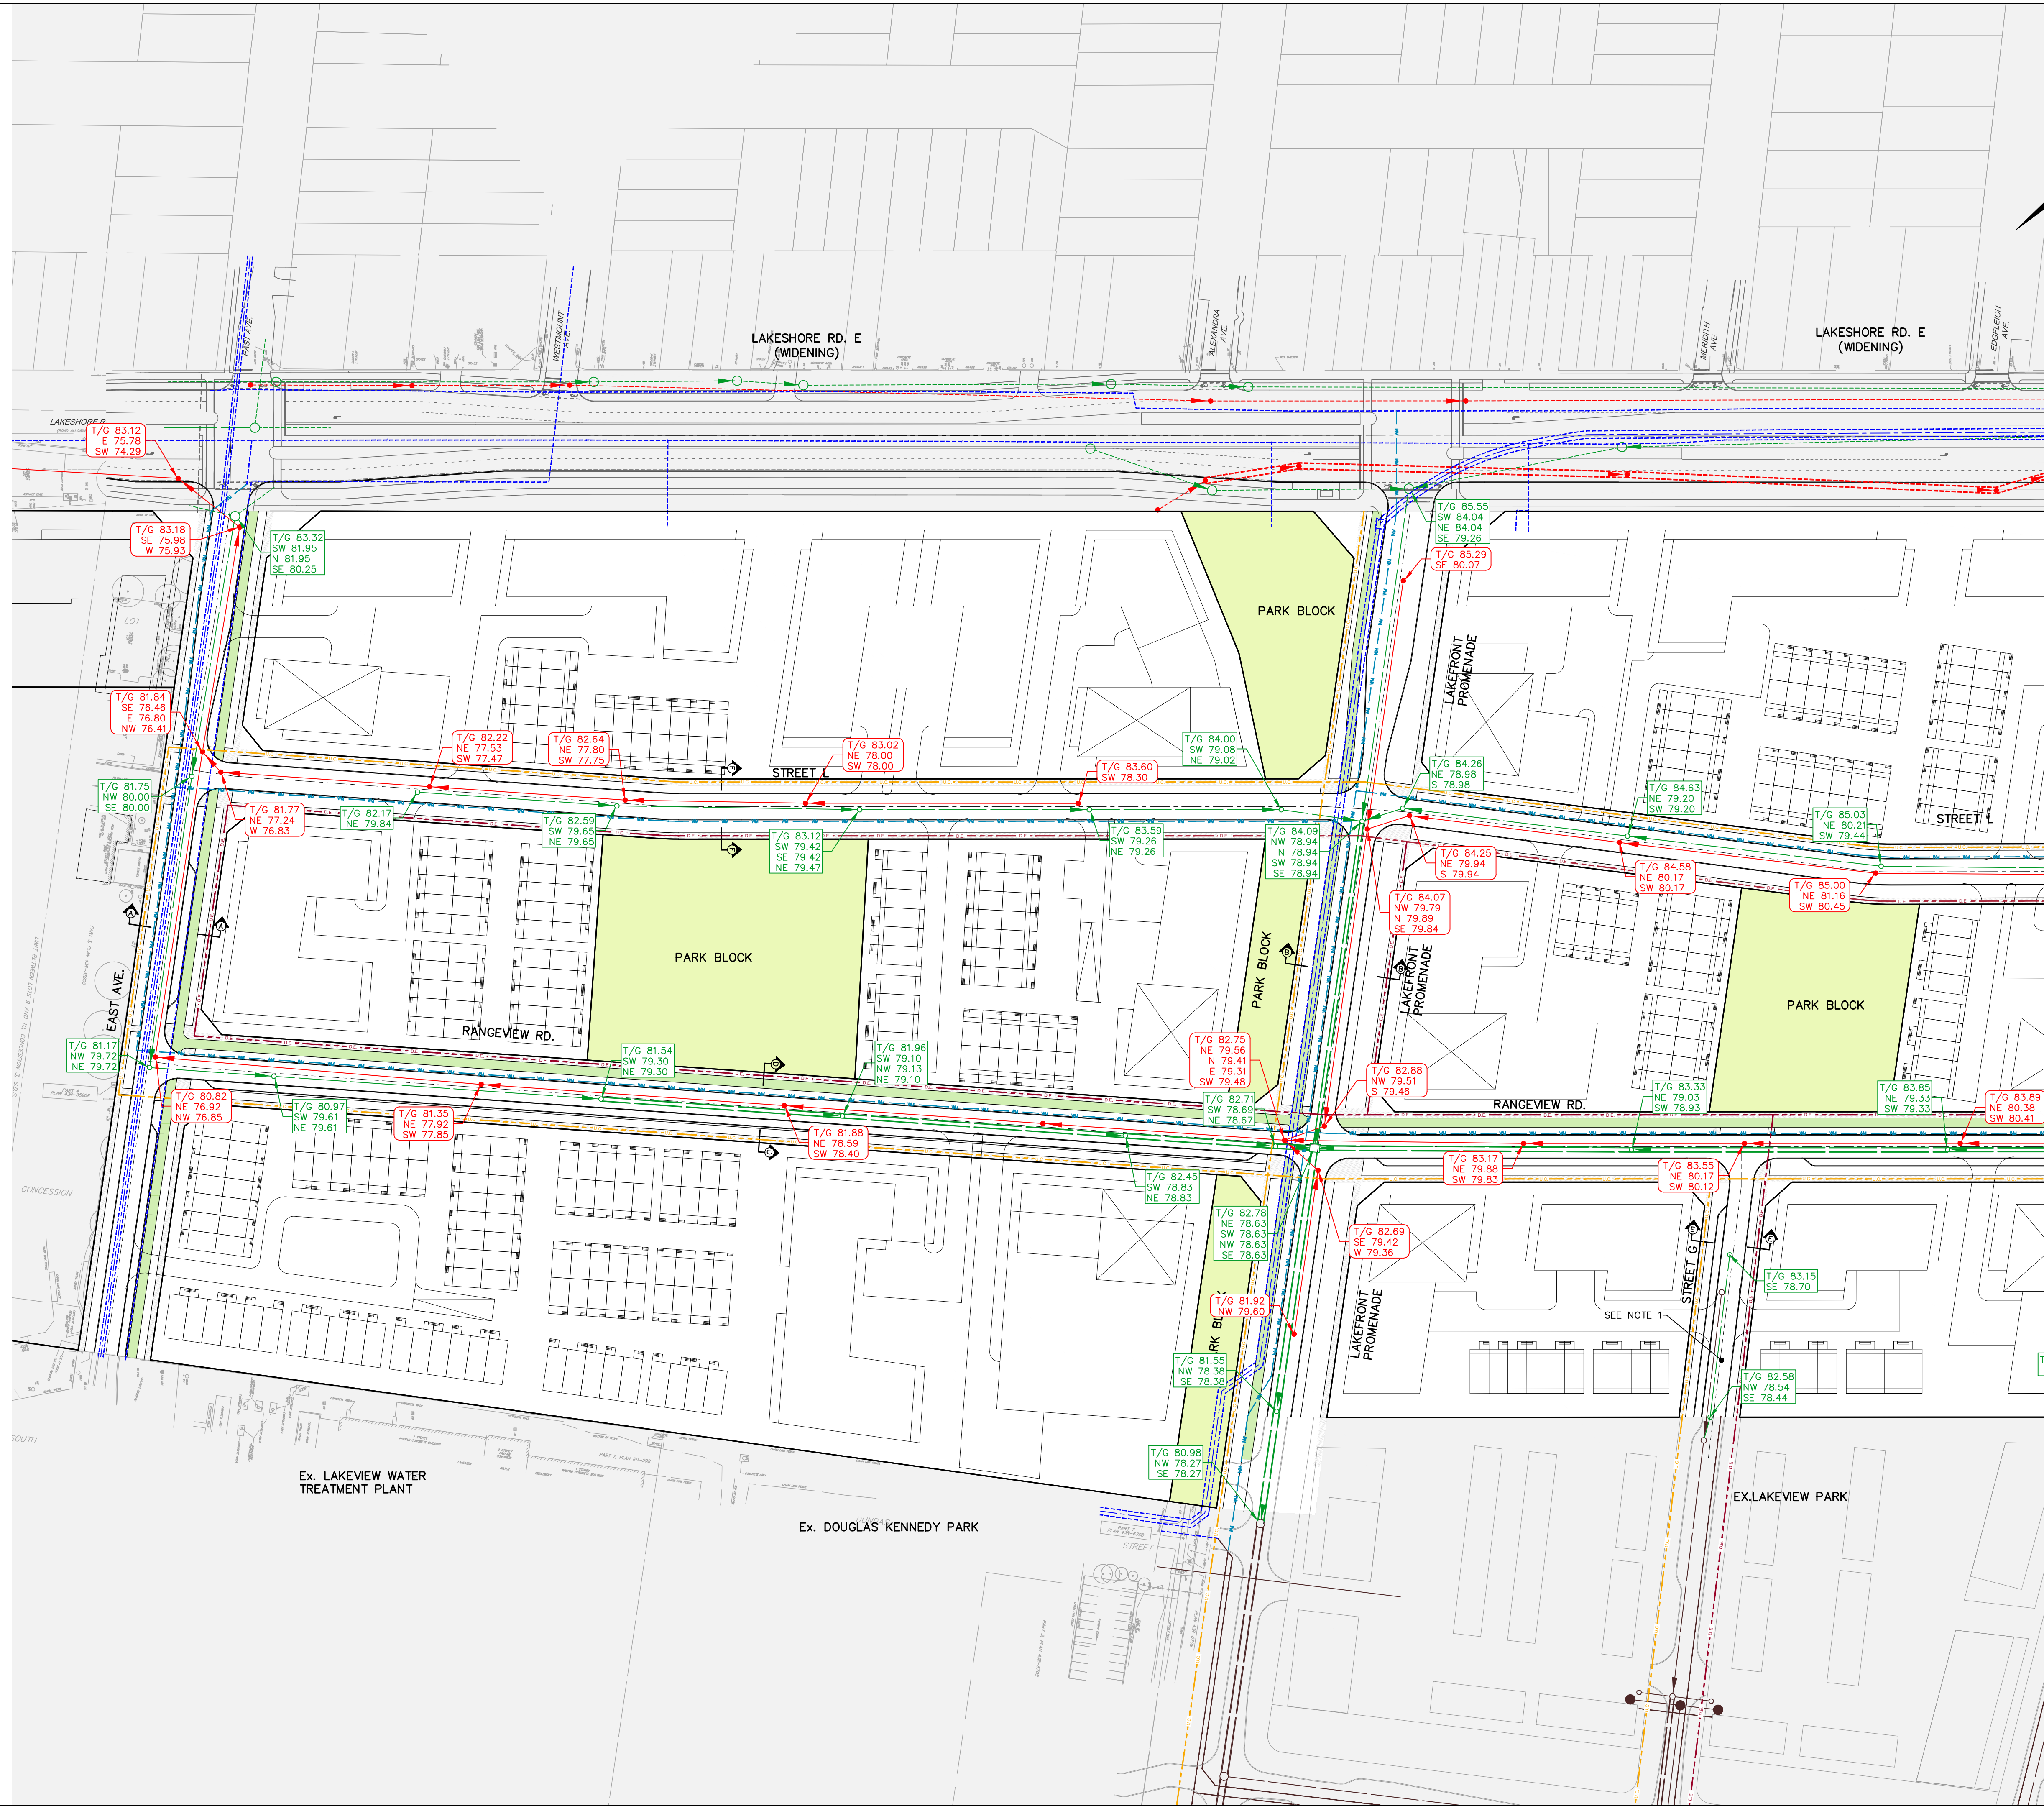

- LEGEND:**
- DENOTES PROPOSED SANITARY
  - DENOTES PROPOSED STORM
  - DENOTES PROPOSED WATERMAIN
  - - - DENOTES PROPOSED UTILITY CORRIDOR
  - - - DENOTES PROPOSED DISTRICT ENERGY
  - DENOTES FUTURE SANITARY
  - DENOTES FUTURE STORM
  - DENOTES FUTURE WATERMAIN
  - DENOTES EXISTING SANITARY
  - DENOTES EXISTING STORM
  - DENOTES EXISTING WATERMAIN
  - DENOTES EXTERNAL LANDS
  - T/G 84.73  
SW 80.20 DENOTES TOP OF GRATE (T/G) AND  
OVERTOP OF STM SEWER
  - T/G 84.75  
SW 80.95 DENOTES TOP OF GRATE (T/G) AND  
OVERTOP OF SAN SEWER

- NOTES:**
- STORM SEWER SHOWN ON OGDEN RD. AND STREET 'G', SOUTH OF RANGEVIEW ROAD, ARE ONLY REQUIRED TO SUPPORT POTENTIAL ROAD CONSTRUCTION.

No.	Date	Issued for

**BENCHMARK NOTE**

**RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA**

SCHAEFFERS  
CONSULTING ENGINEERS




6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-mail:  
design@schaeffers.com



**PRELIMINARY GENERAL PLAN**

DRAWN BY: M.P.	DESIGNED BY: H.H.T.	CHECKED BY: H.H.T.
SCALE: 1:1000	DATE: SEPTEMBER 2023	
PROJECT No. 2022-4938	DRAWING No. GP-1	

F:\4938\4938-GENERAL\4938-CP-1-2.DWG | 2023-09-25 8:15:41 AM | 1/10

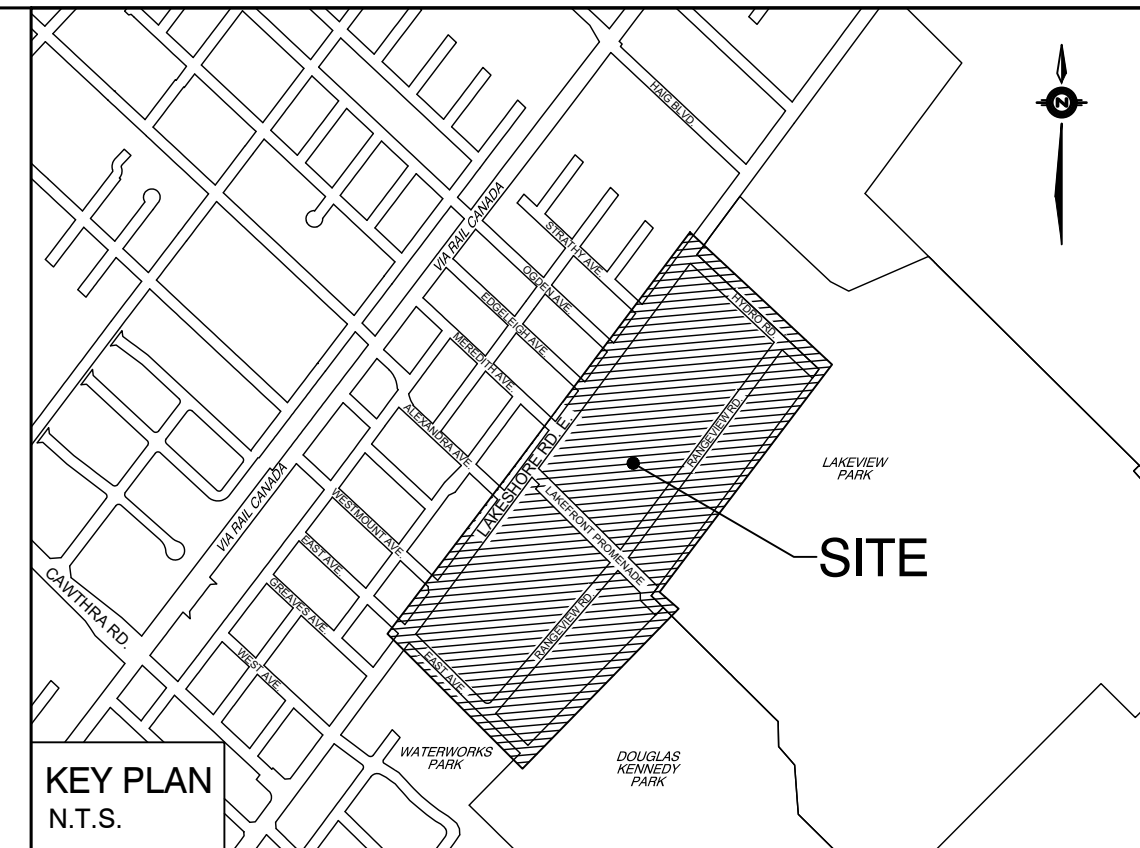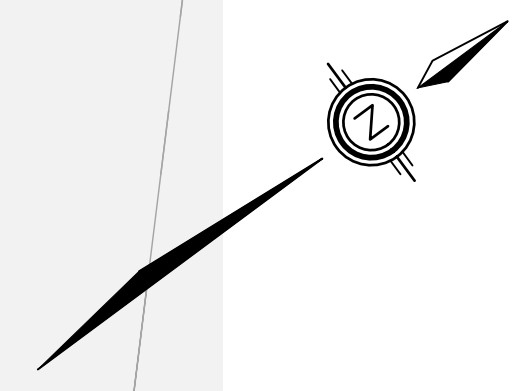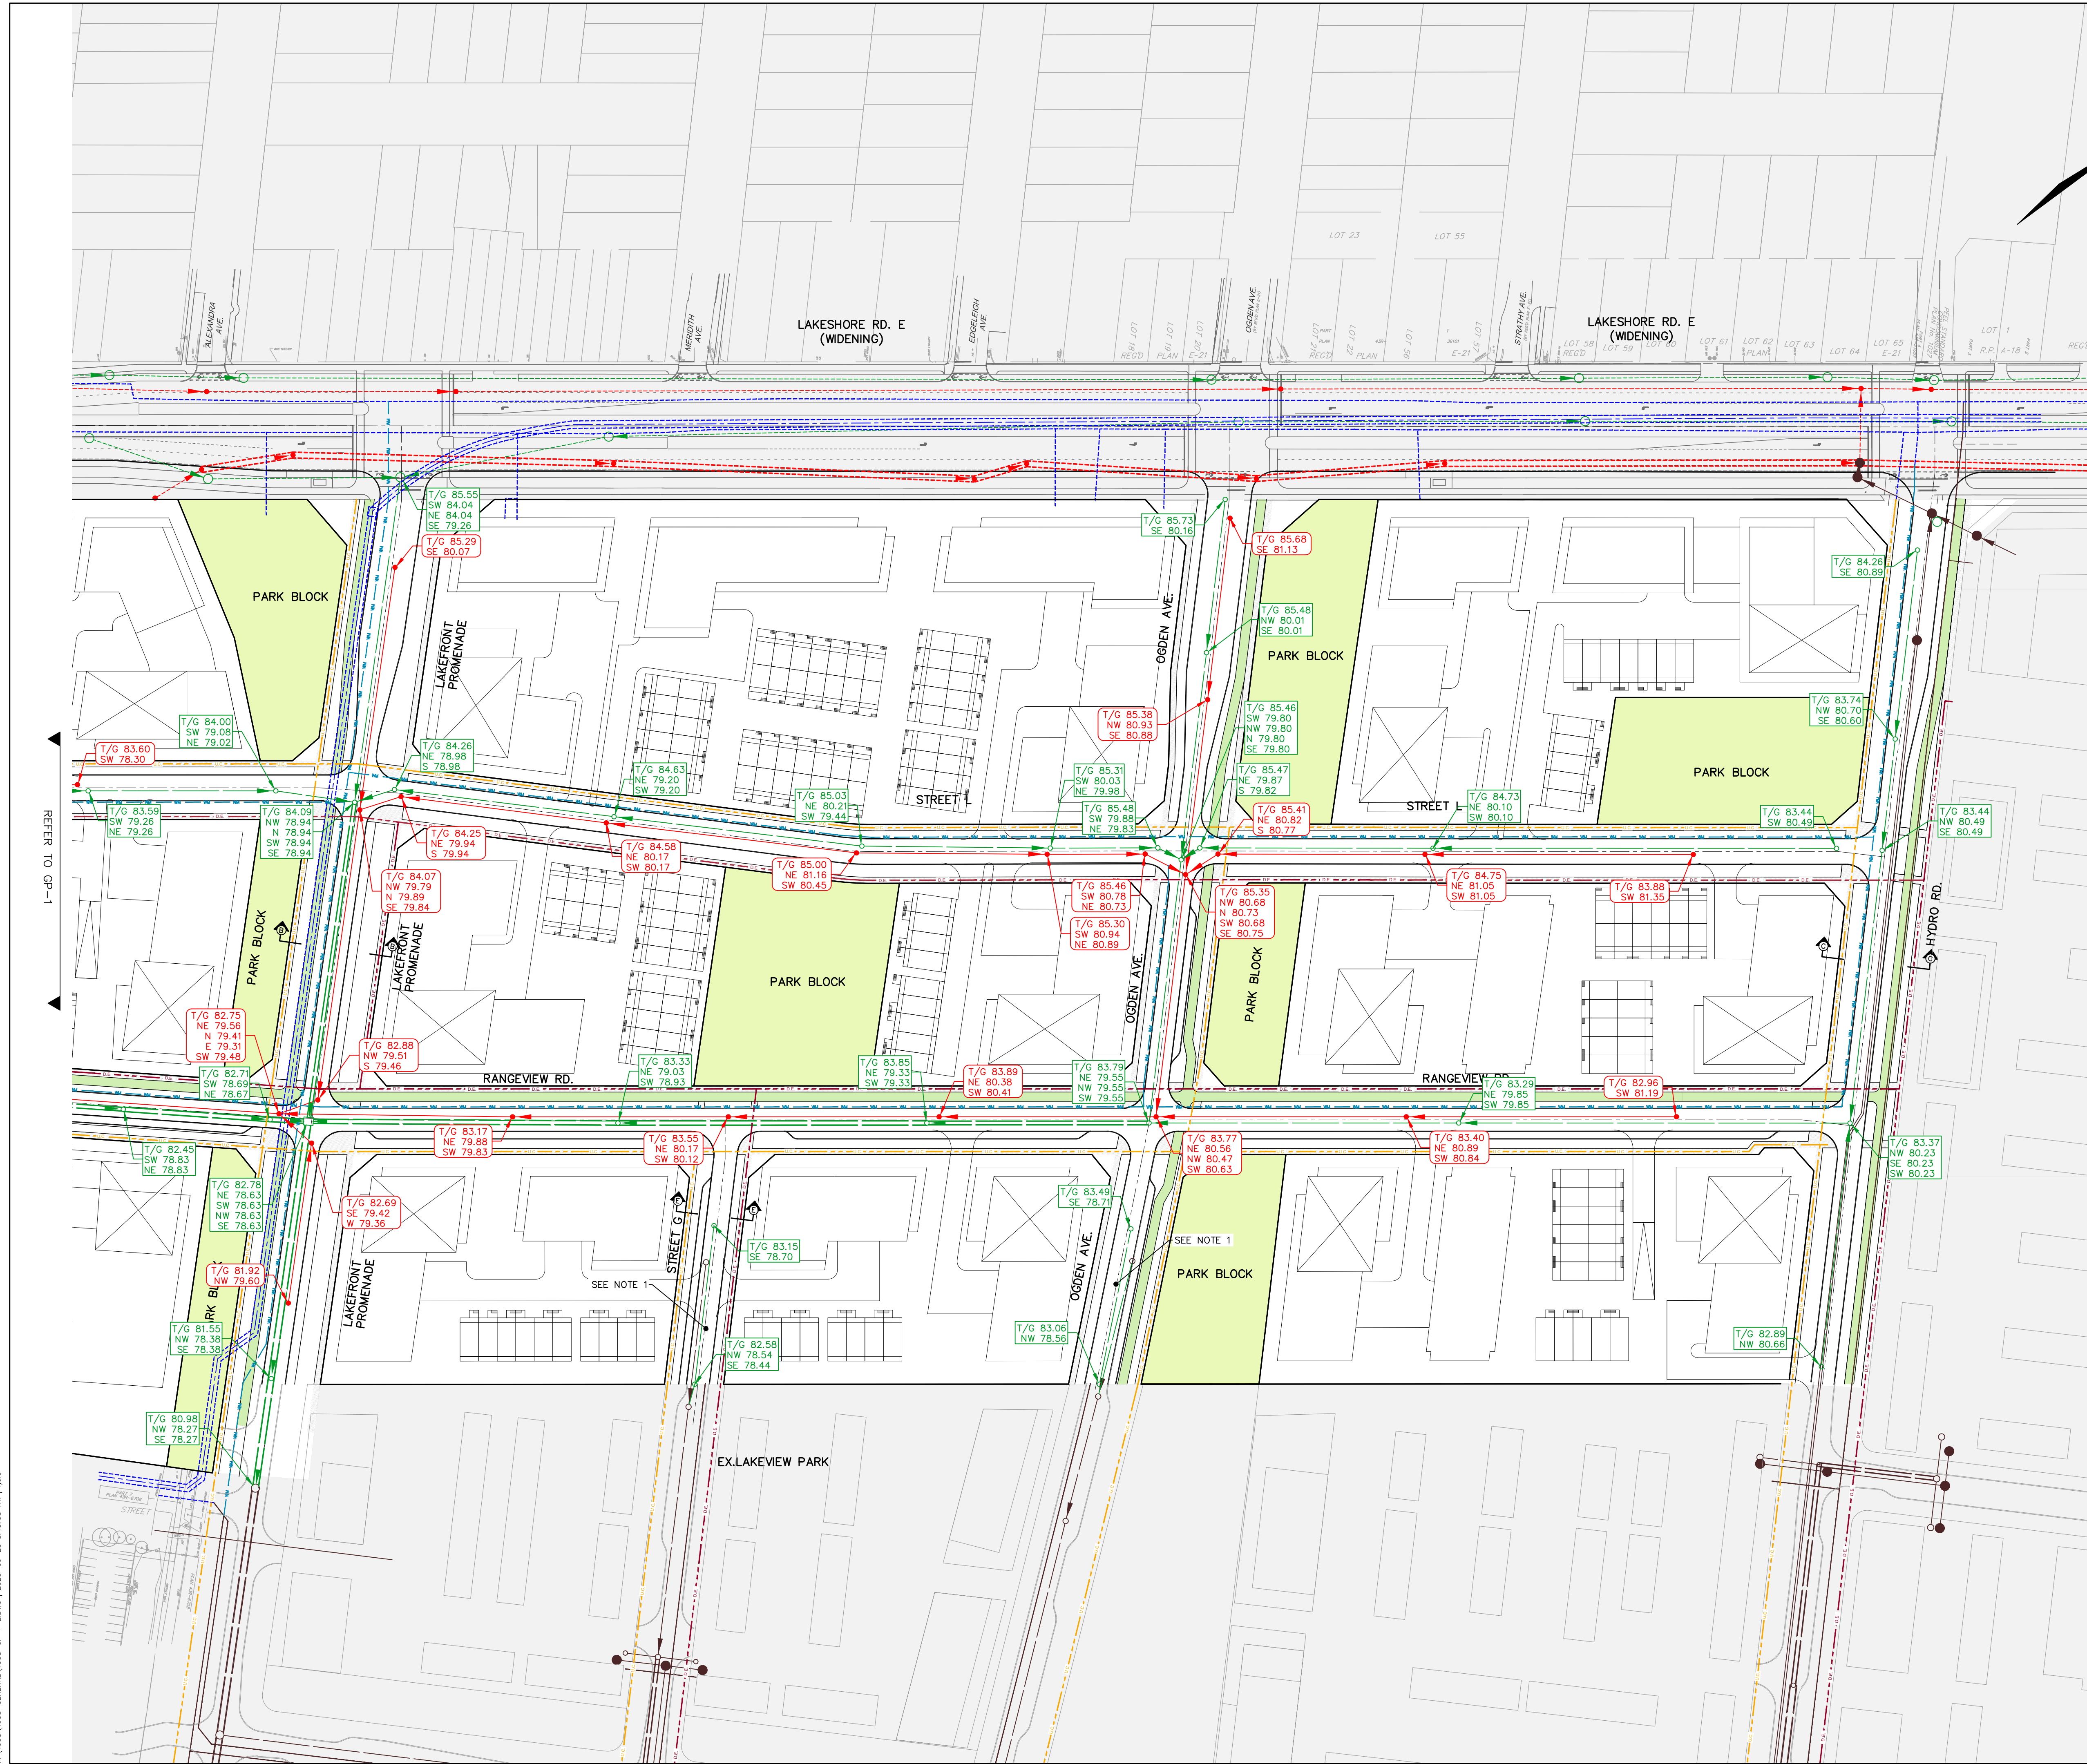

- LEGEND:**
- DENOTES PROPOSED SANITARY
  - DENOTES PROPOSED STORM
  - DENOTES PROPOSED WATERMAIN
  - DENOTES PROPOSED UTILITY CORRIDOR
  - - - DENOTES PROPOSED DISTRICT ENERGY
  - DENOTES FUTURE SANITARY
  - DENOTES FUTURE STORM
  - DENOTES FUTURE WATERMAIN
  - - - DENOTES EXISTING SANITARY
  - - - DENOTES EXISTING STORM
  - - - DENOTES EXISTING WATERMAIN
  - DENOTES EXTERNAL LANDS
  - T/G 84.73  
SW 80.20 DENOTES TOP OF GRATE (T/G) AND  
INVERT OF STM SEWER
  - T/G 84.75  
SW 80.95 DENOTES TOP OF GRATE (T/G) AND  
INVERT OF SAN SEWER

- NOTES:**
- STORM SEWER SHOWN ON OGDEN RD. AND STREET 'G', SOUTH OF RANGEVIEW ROAD, ARE ONLY REQUIRED TO SUPPORT POTENTIAL ROAD CONSTRUCTION.

No.	Date	Issued for

**BENCHMARK NOTE**

--	--	--

**RANGEVIEW ESTATES PRECINCT AREA  
CITY OF MISSISSAUGA**

**SCHAEFFERS**  
CONSULTING ENGINEERS







6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-mail:  
design@schaeffers.com



**PRELIMINARY GENERAL PLAN**

DRAWN BY: M.P.	DESIGNED BY: H.H.T.	CHECKED BY: H.H.T.
SCALE: 1:1000	DATE: SEPTEMBER 2023	
PROJECT No. 2022-4938	DRAWING No. GP-2	

F:\4938\4938-GENERAL\4938-CP-1-2.DWG | 2023-09-25 8:15:58 AM | 1/44

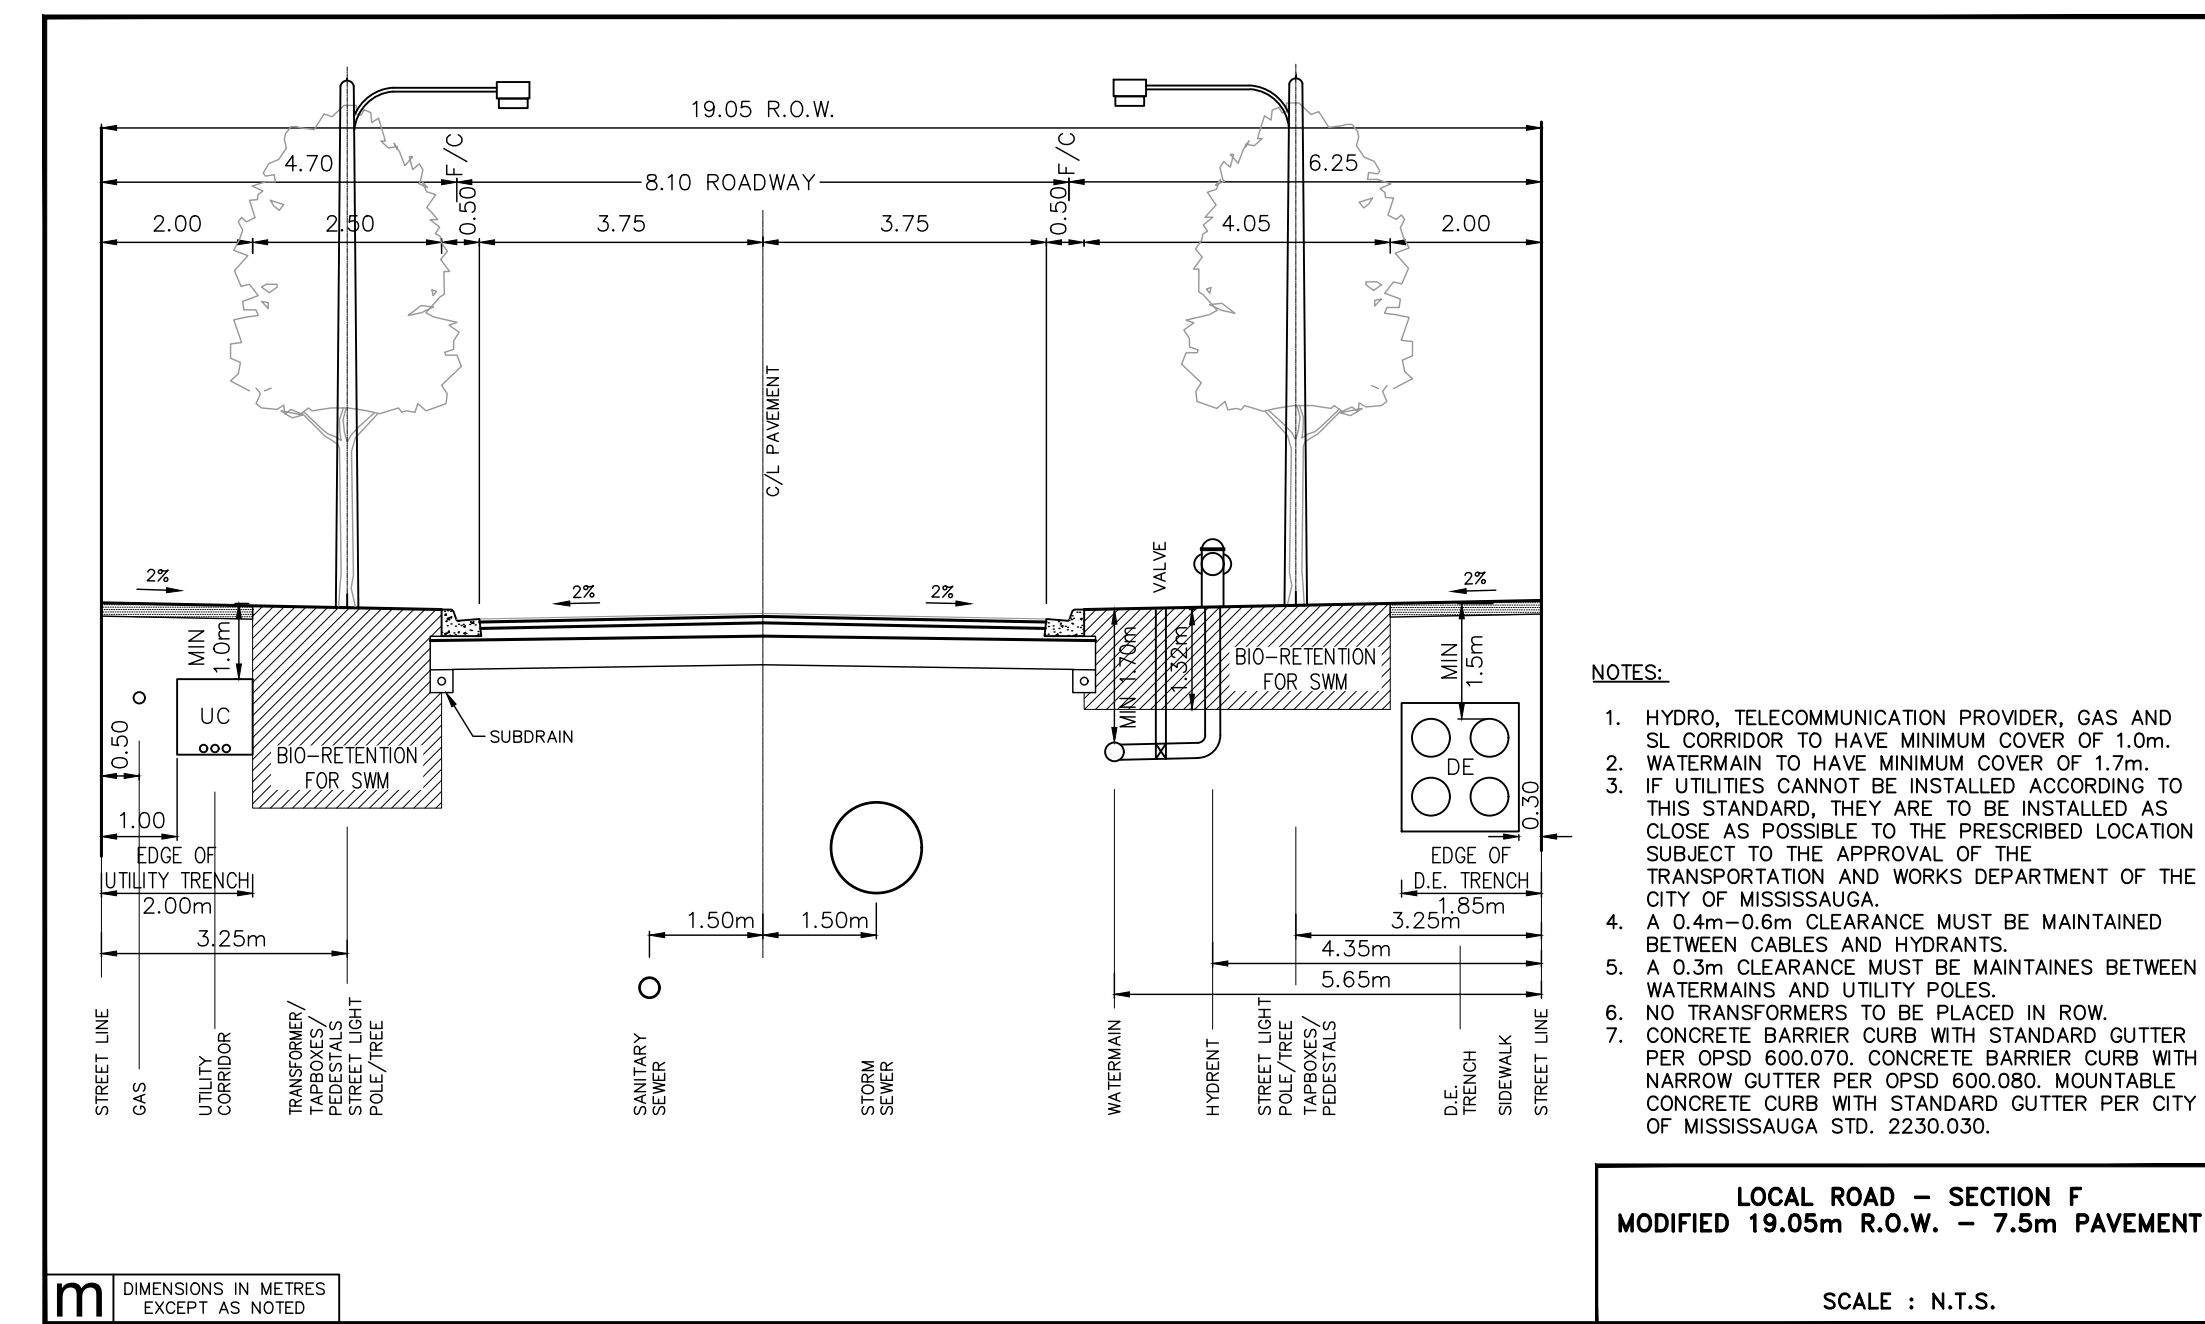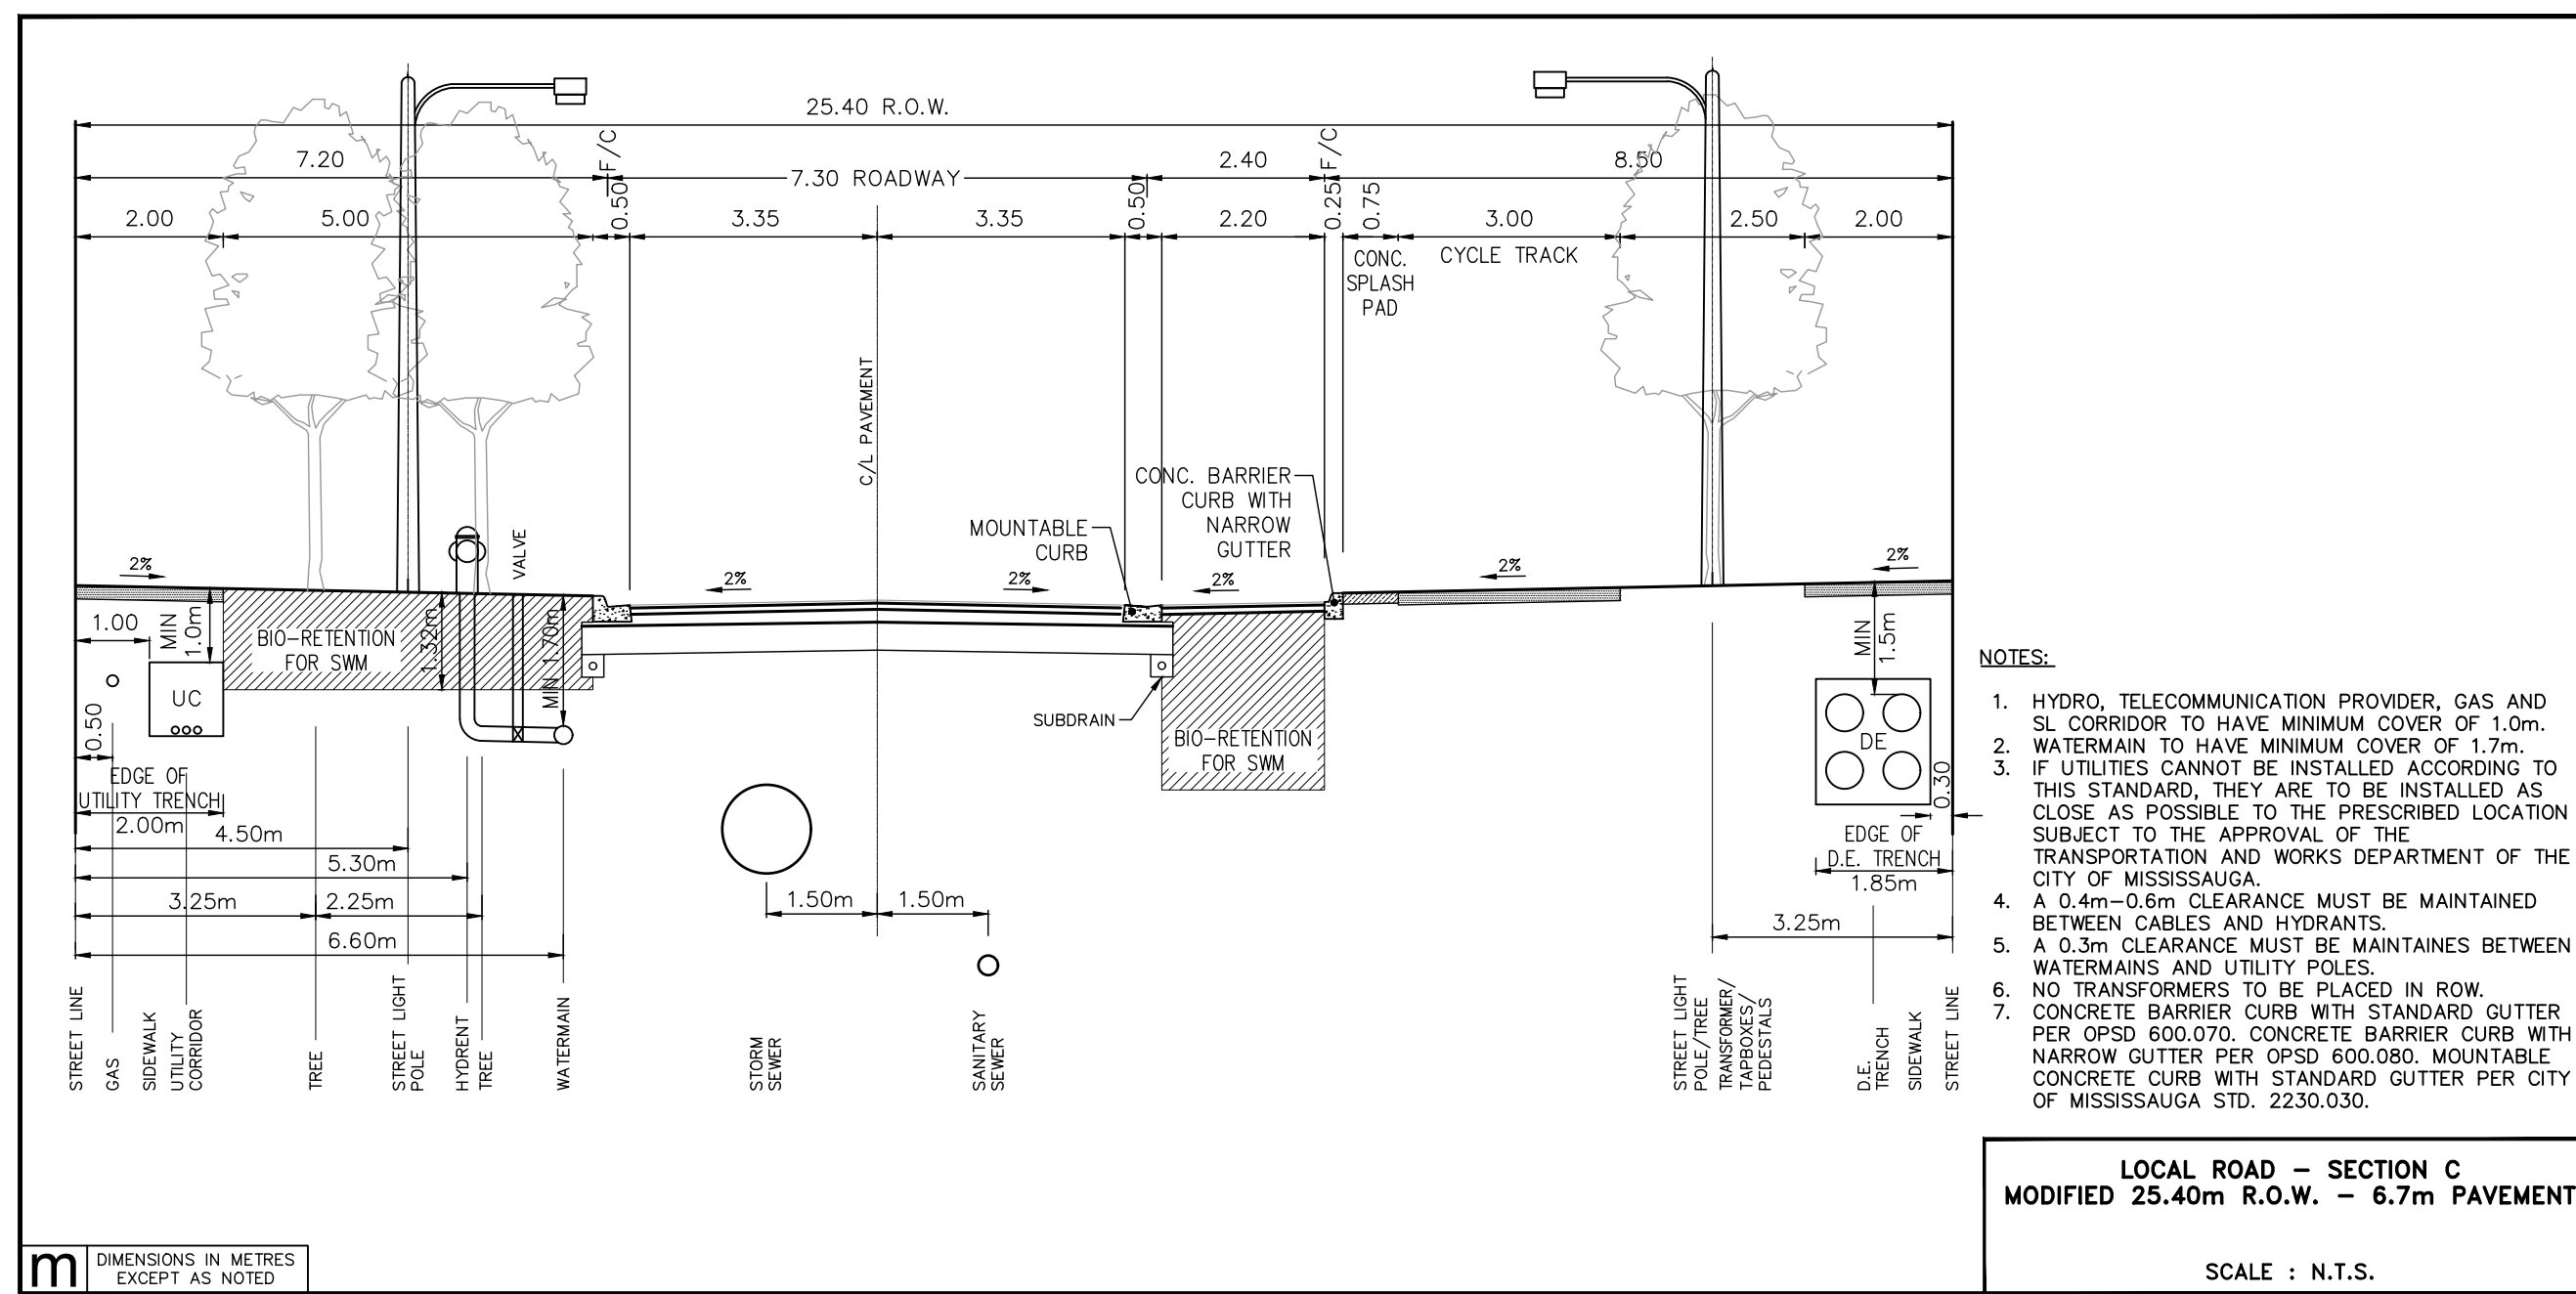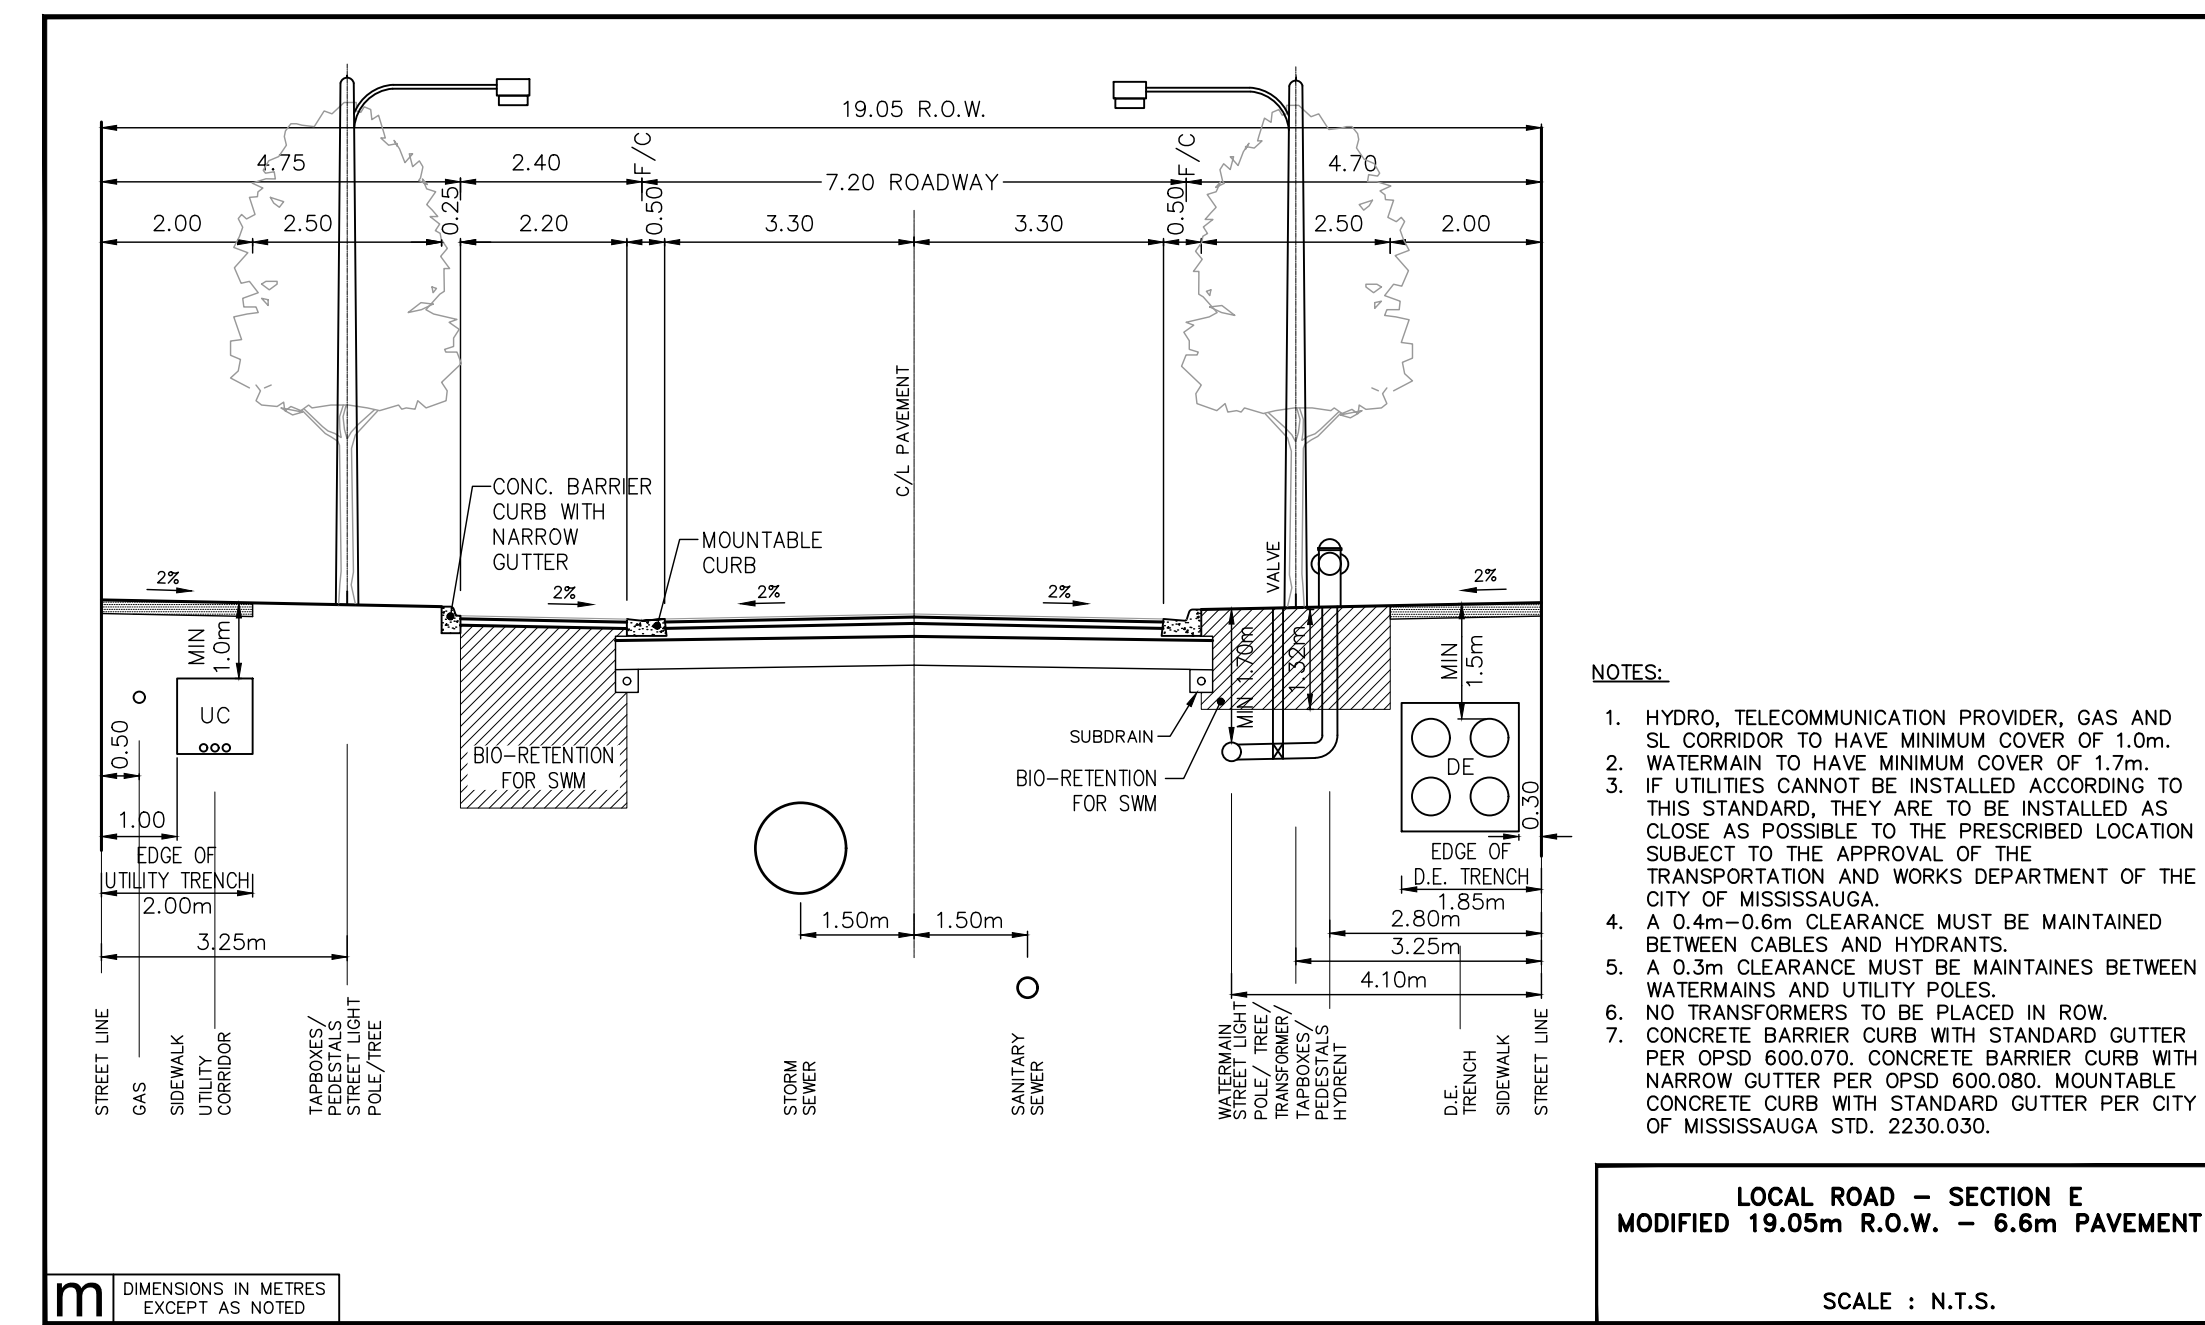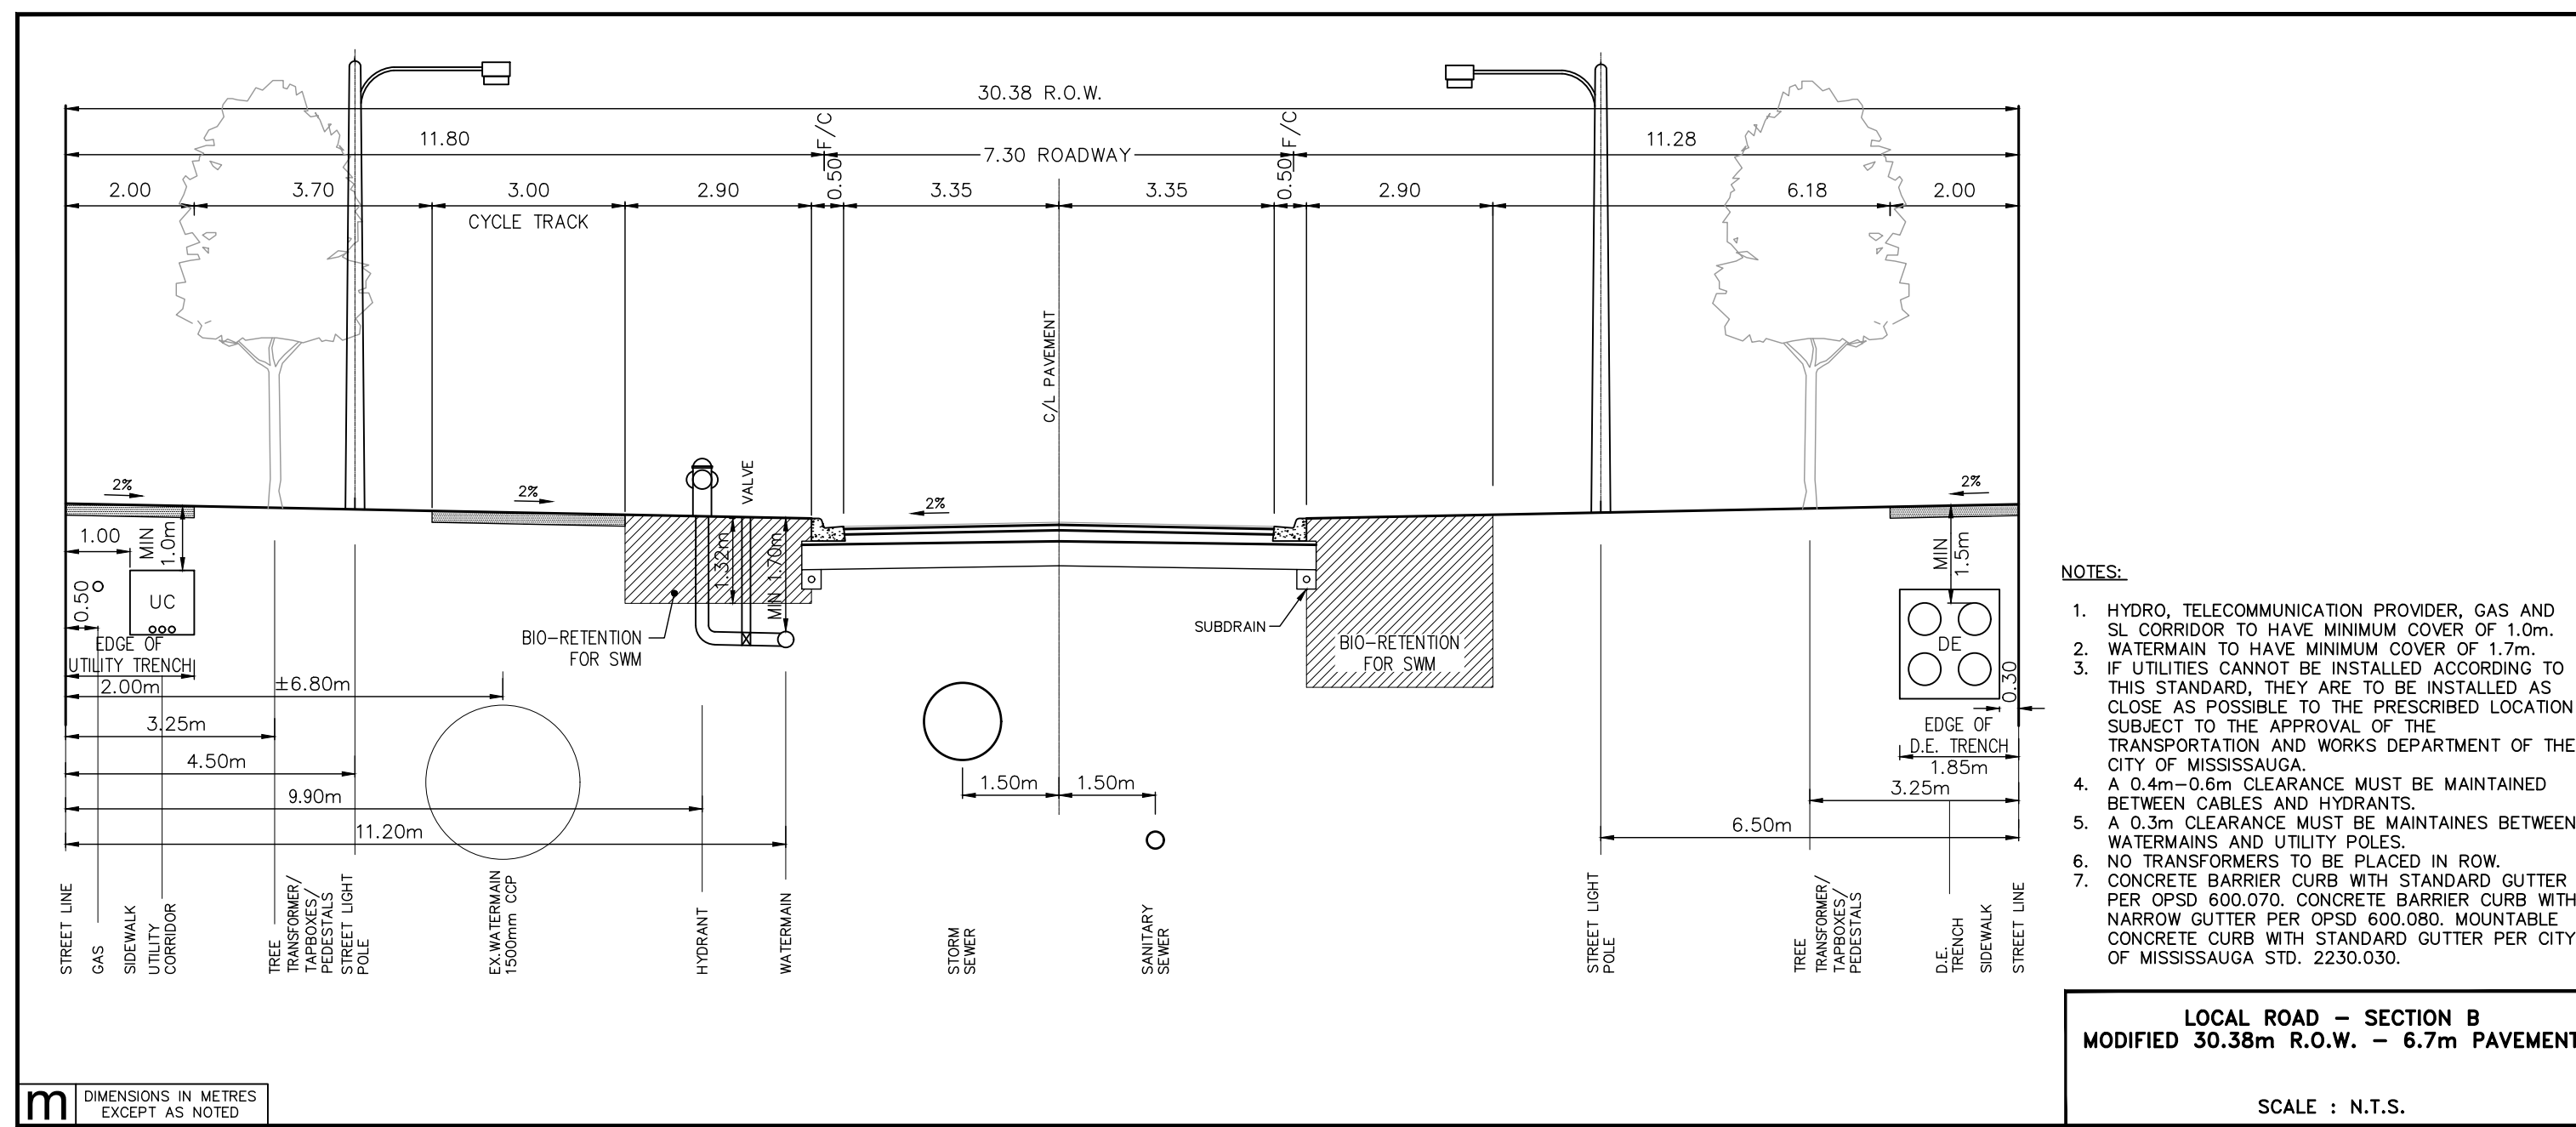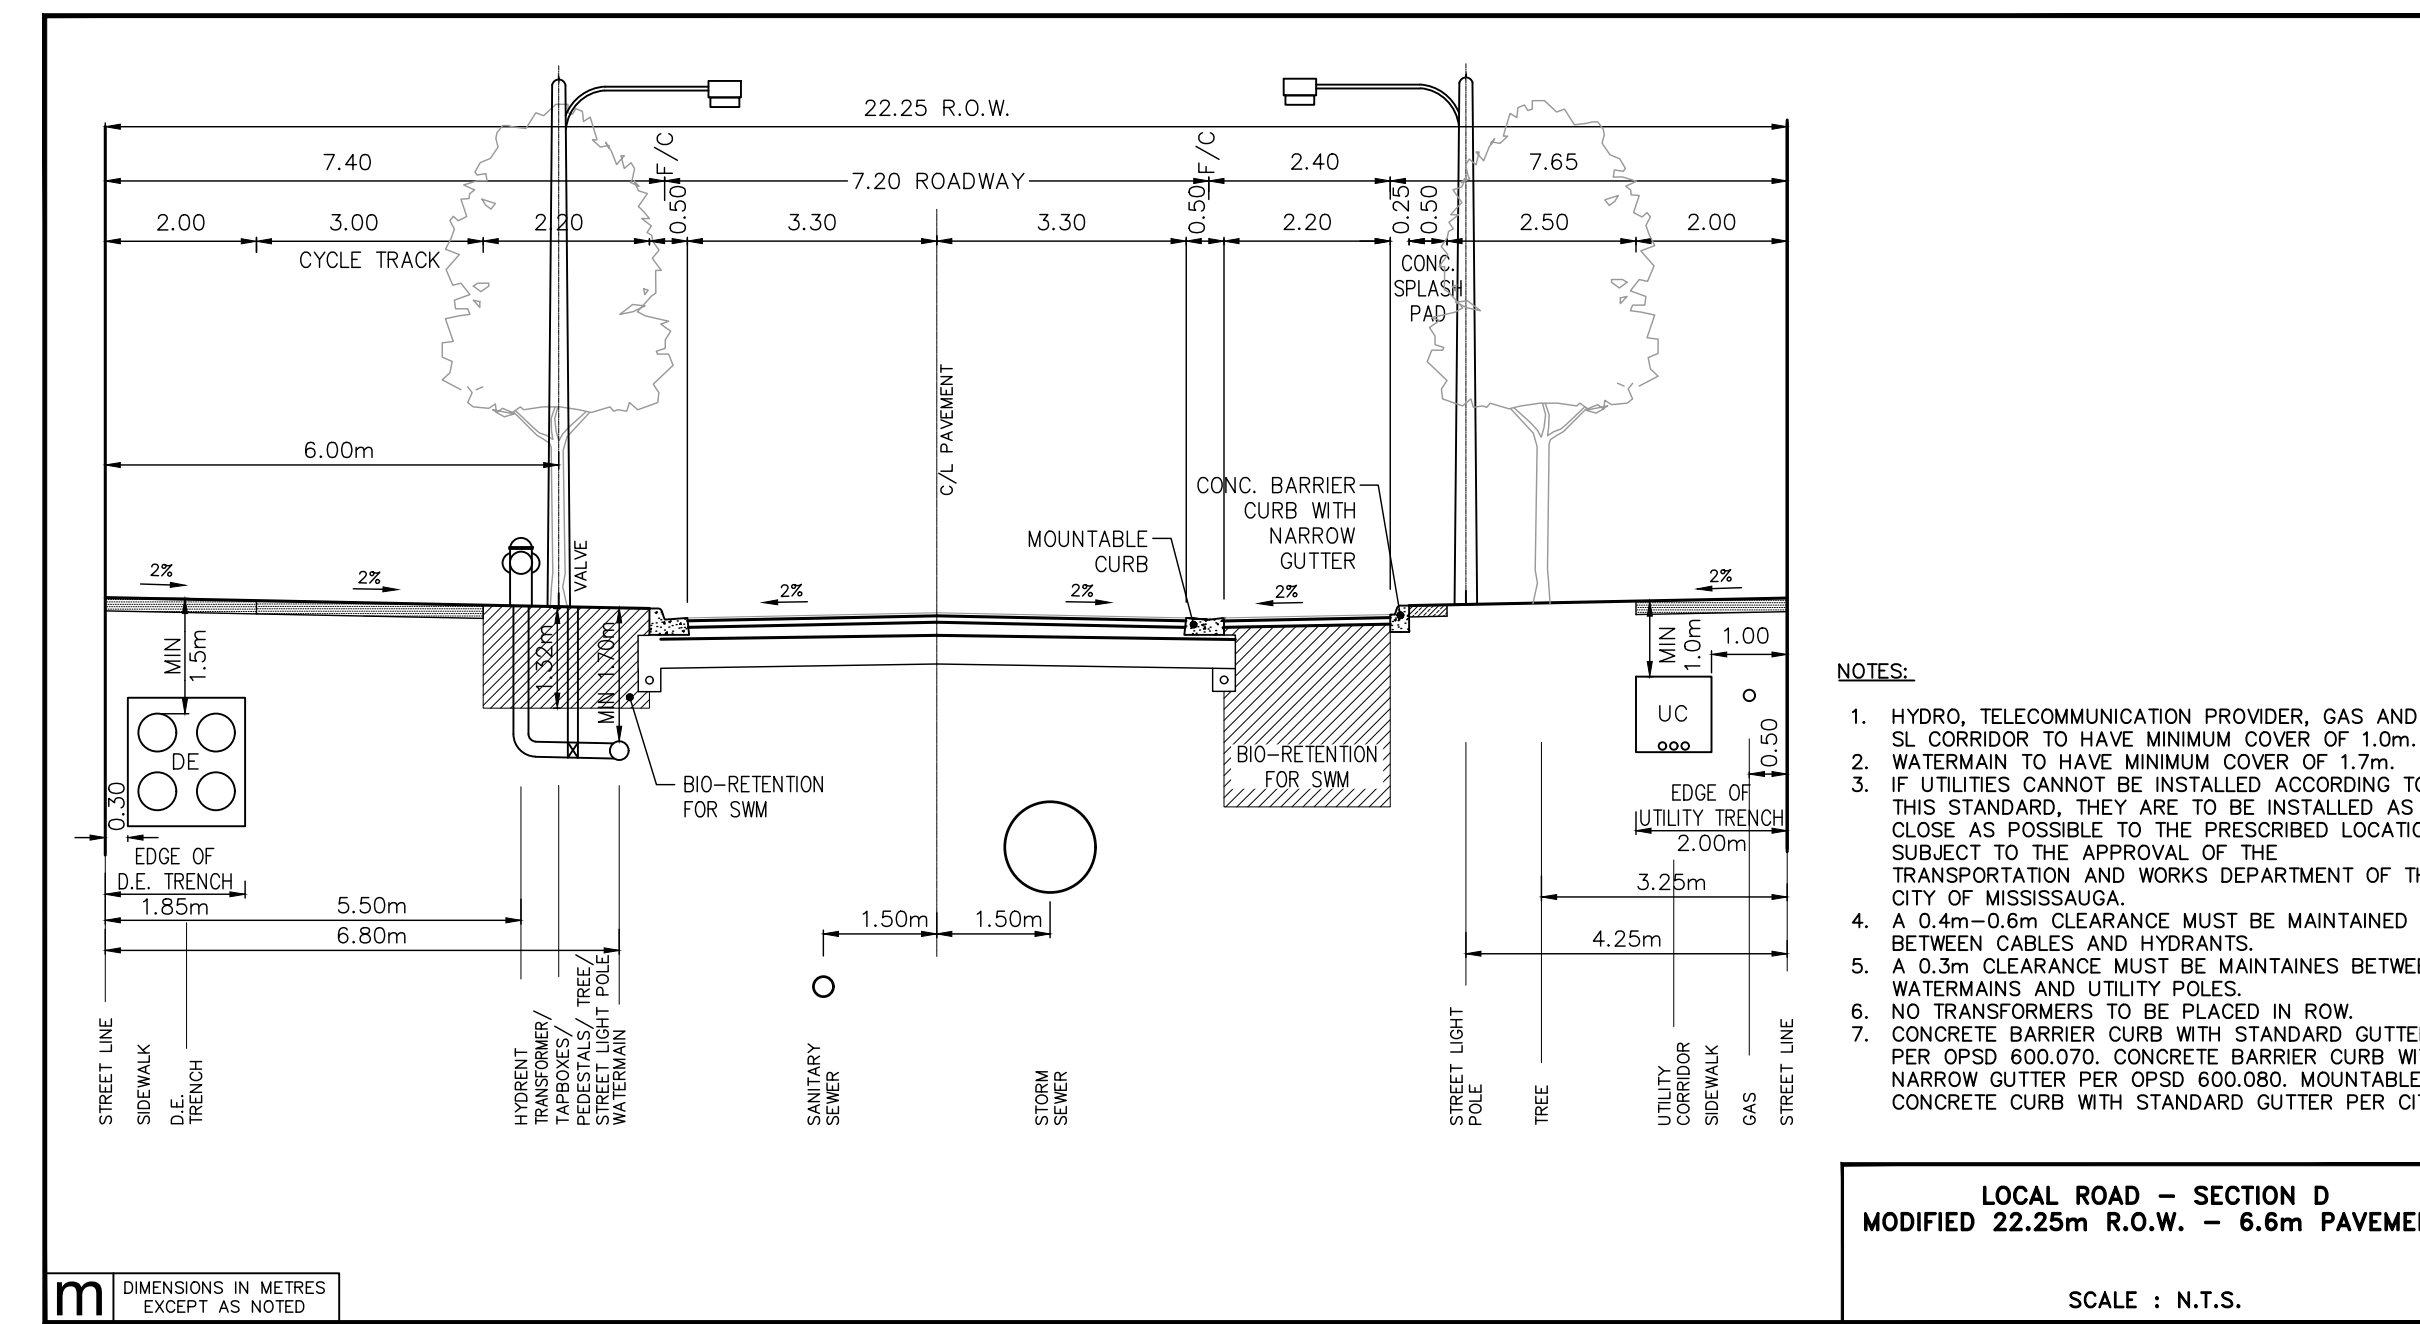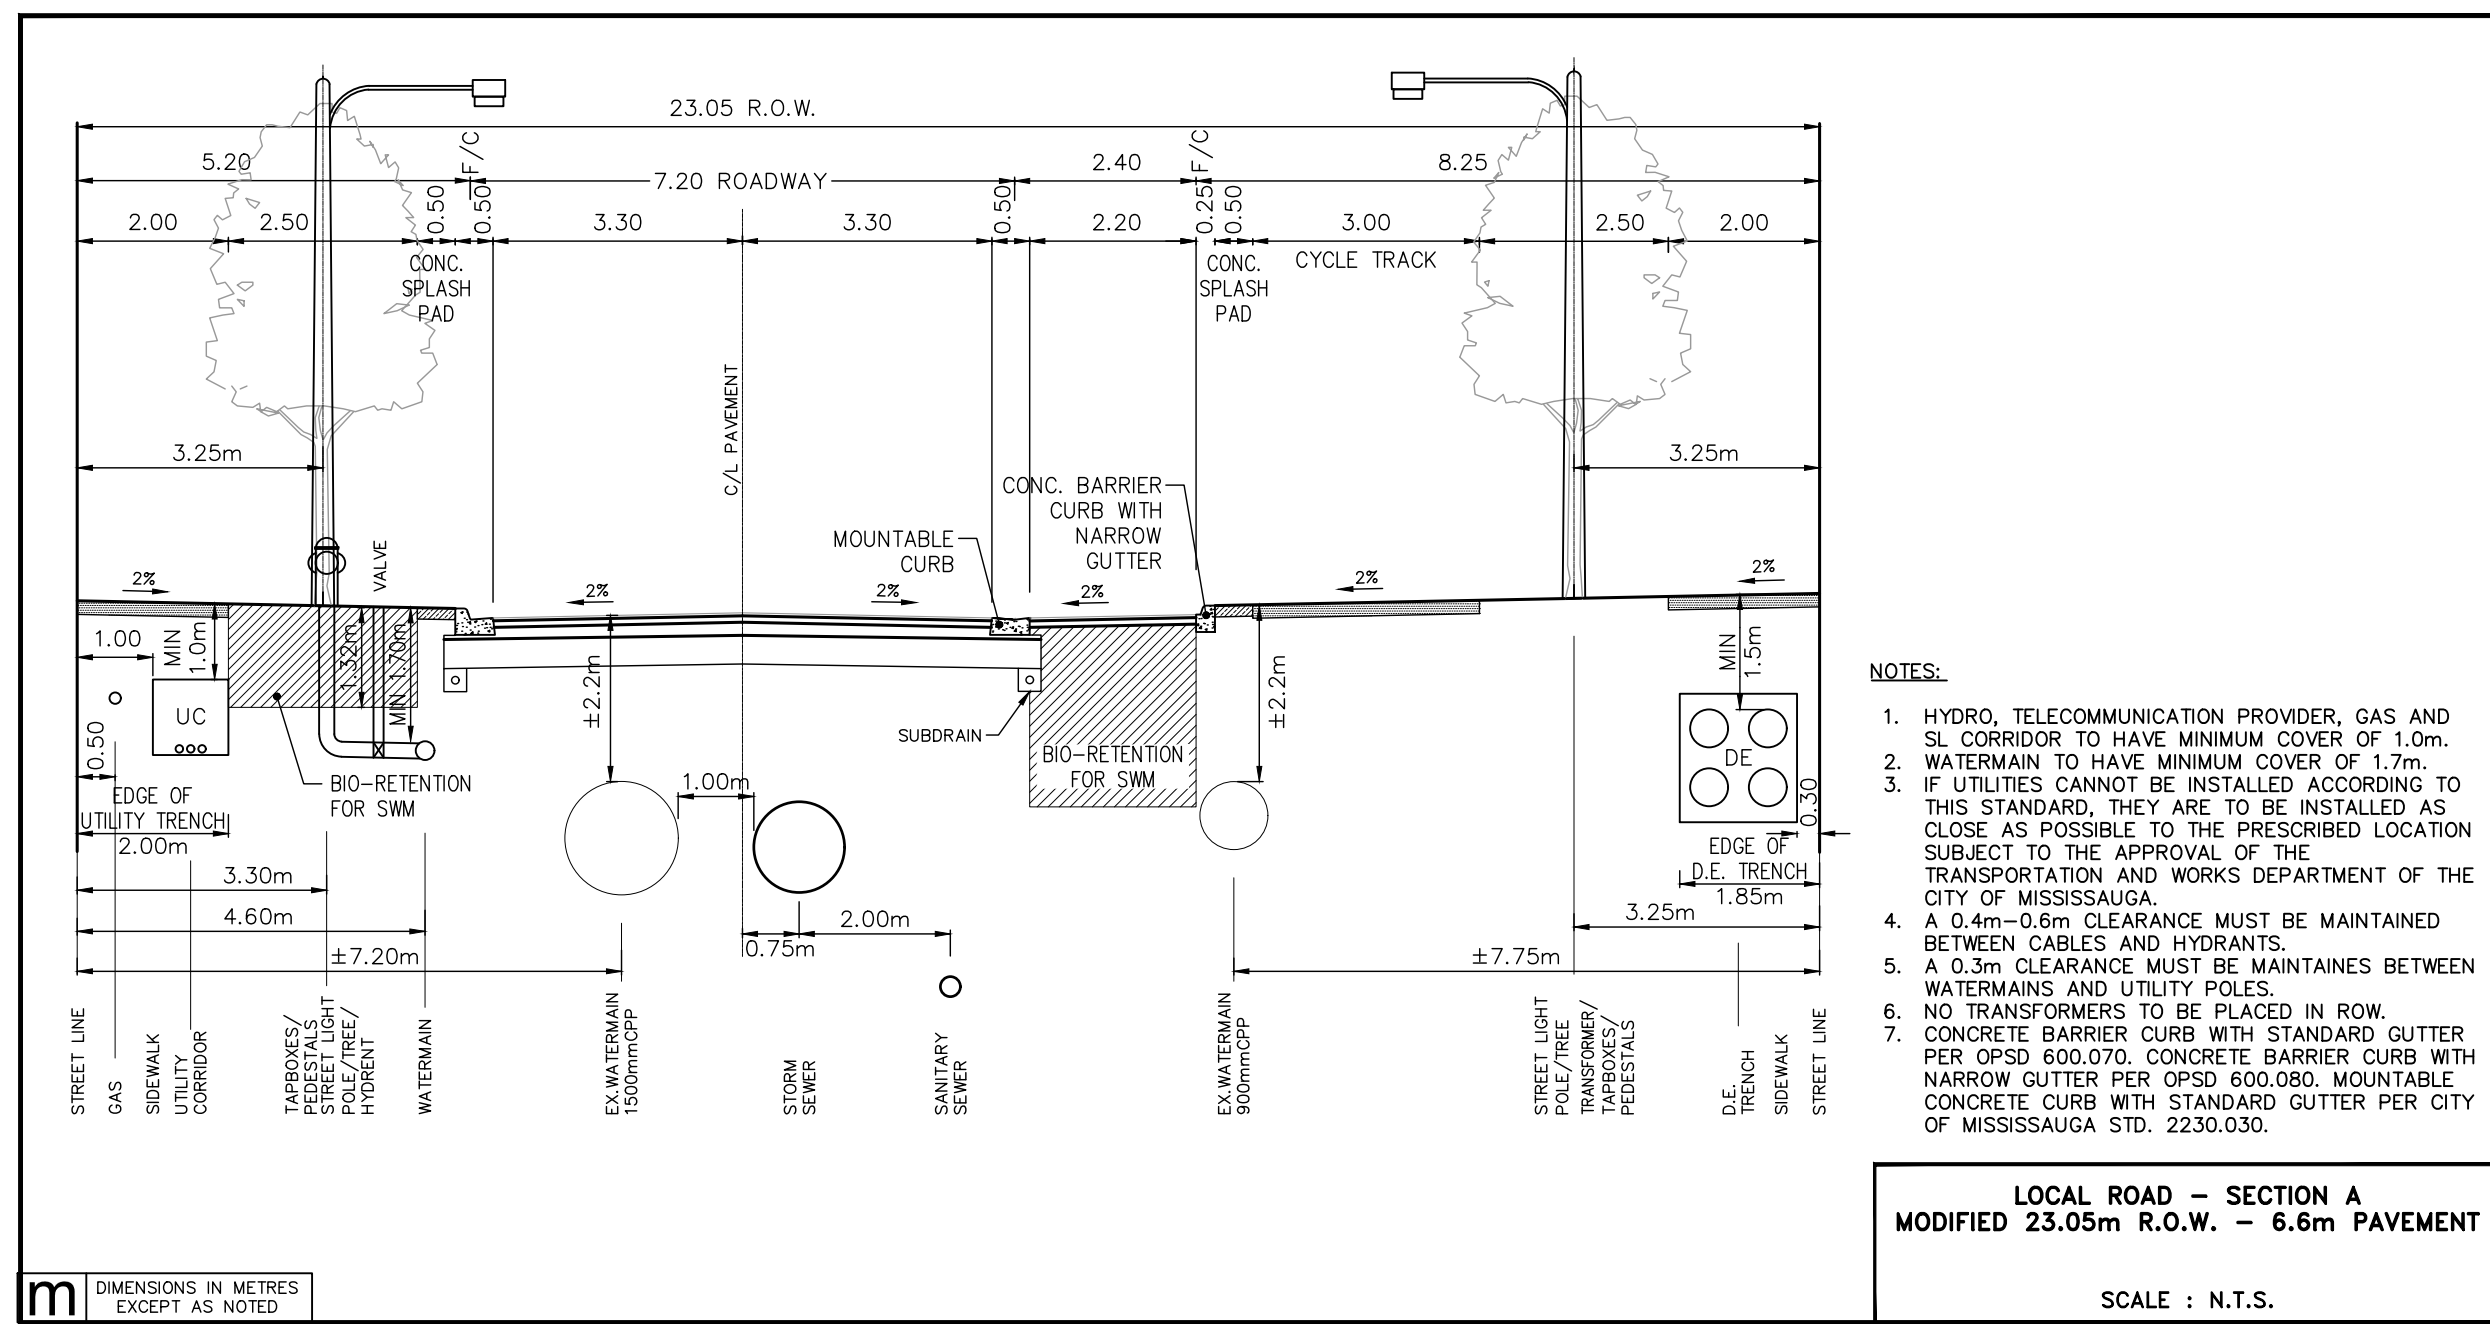

No.	Date	Issued for

**BENCHMARK NOTE**

**RANGEVIEW ESTATES PRECINCT AREA**  
CITY OF MISSISSAUGA

**SCHAEFFERS**  
CONSULTING ENGINEERS

6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-mail:  
design@schaeffers.com




**PUBLIC RIGHT-OF-WAY SECTIONS**

DRAWN BY: M.P.	DESIGNED BY: H.H.T.	CHECKED BY: H.H.T.
SCALE: AS SHOWN	DATE: SEPTEMBER 2023	
PROJECT No. 2022-4938	DRAWING No. D-2	



---

ALTERNATIVE SERVICING CONCEPT  
DRAWINGS

---





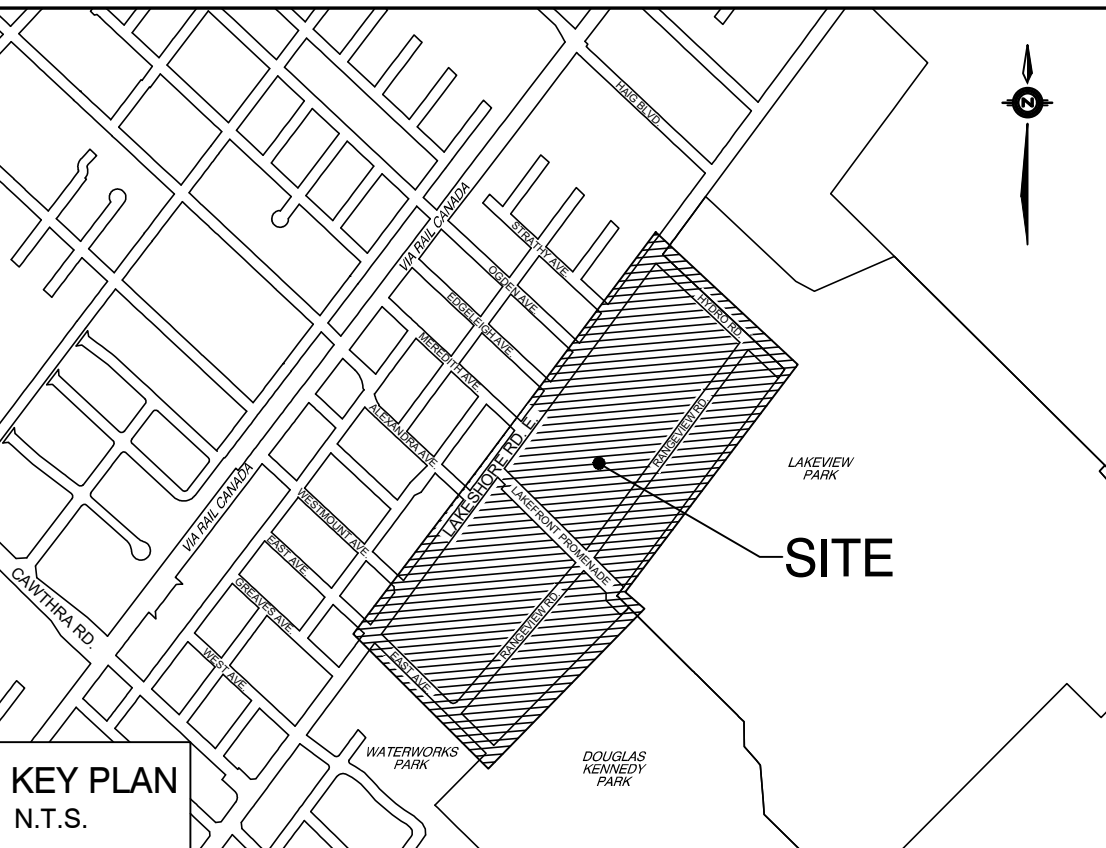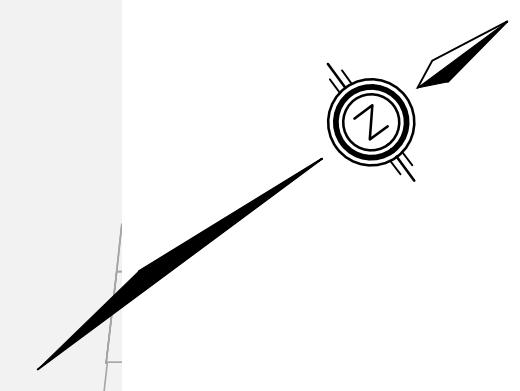

- LEGEND:**
- DENOTES PROPOSED SANITARY
  - DENOTES PROPOSED STORM
  - DENOTES PROPOSED WATERMAIN
  - DENOTES PROPOSED UTILITY CORRIDOR
  - - - DENOTES PROPOSED DISTRICT ENERGY
  - DENOTES FUTURE SANITARY
  - DENOTES FUTURE STORM
  - DENOTES FUTURE WATERMAIN
  - DENOTES EXISTING SANITARY
  - DENOTES EXISTING STORM
  - DENOTES EXISTING WATERMAIN
  - DENOTES EXTERNAL LANDS
  - MH1 DENOTES MH NUMBER  
T/G 84.73  
SW 80.20
  - MH1A DENOTES MH NUMBER  
T/G 84.75  
SW 80.95

**NOTES:**

- STORM SEWER SHOWN ON OGDEN RD. AND STREET 'G', SOUTH OF RANGEVIEW ROAD, ARE ONLY REQUIRED TO SUPPORT POTENTIAL ROAD CONSTRUCTION.

No.	Date	ISSUED FOR DRAFT MASTER PLAN SUBMISSION	Issued for

**BENCHMARK NOTE**


**RANGEVIEW ESTATES PRECINCT AREA**  
CITY OF MISSISSAUGA

**SCHAEFFERS**  
CONSULTING ENGINEERS

SCHAEFFER & ASSOCIATES LTD.



6 Rontrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-mail:  
design@schaeffers.com



**PRELIMINARY GENERAL PLAN**

DRAWN BY: M.P.	DESIGNED BY: H.H.T.	CHECKED BY: H.H.T.
SCALE: 1:1000	DATE: SEPTEMBER 2023	
PROJECT No. 2022-4938	DRAWING No. GP-1	

F:\4938\4938-DMP\4938-CIVIL SET\4938-GENERAL\4938-GP-1-2.DWG | 2024-04-29 2:59:47 PM | JHR

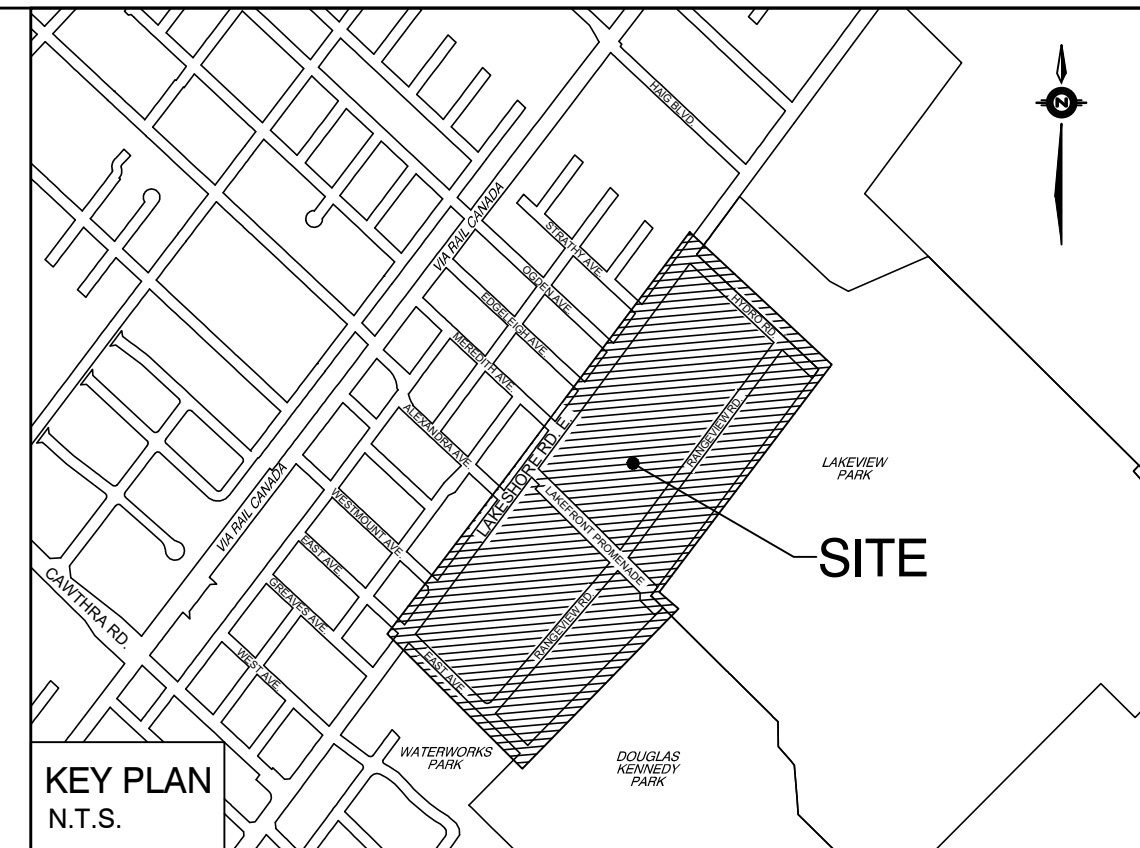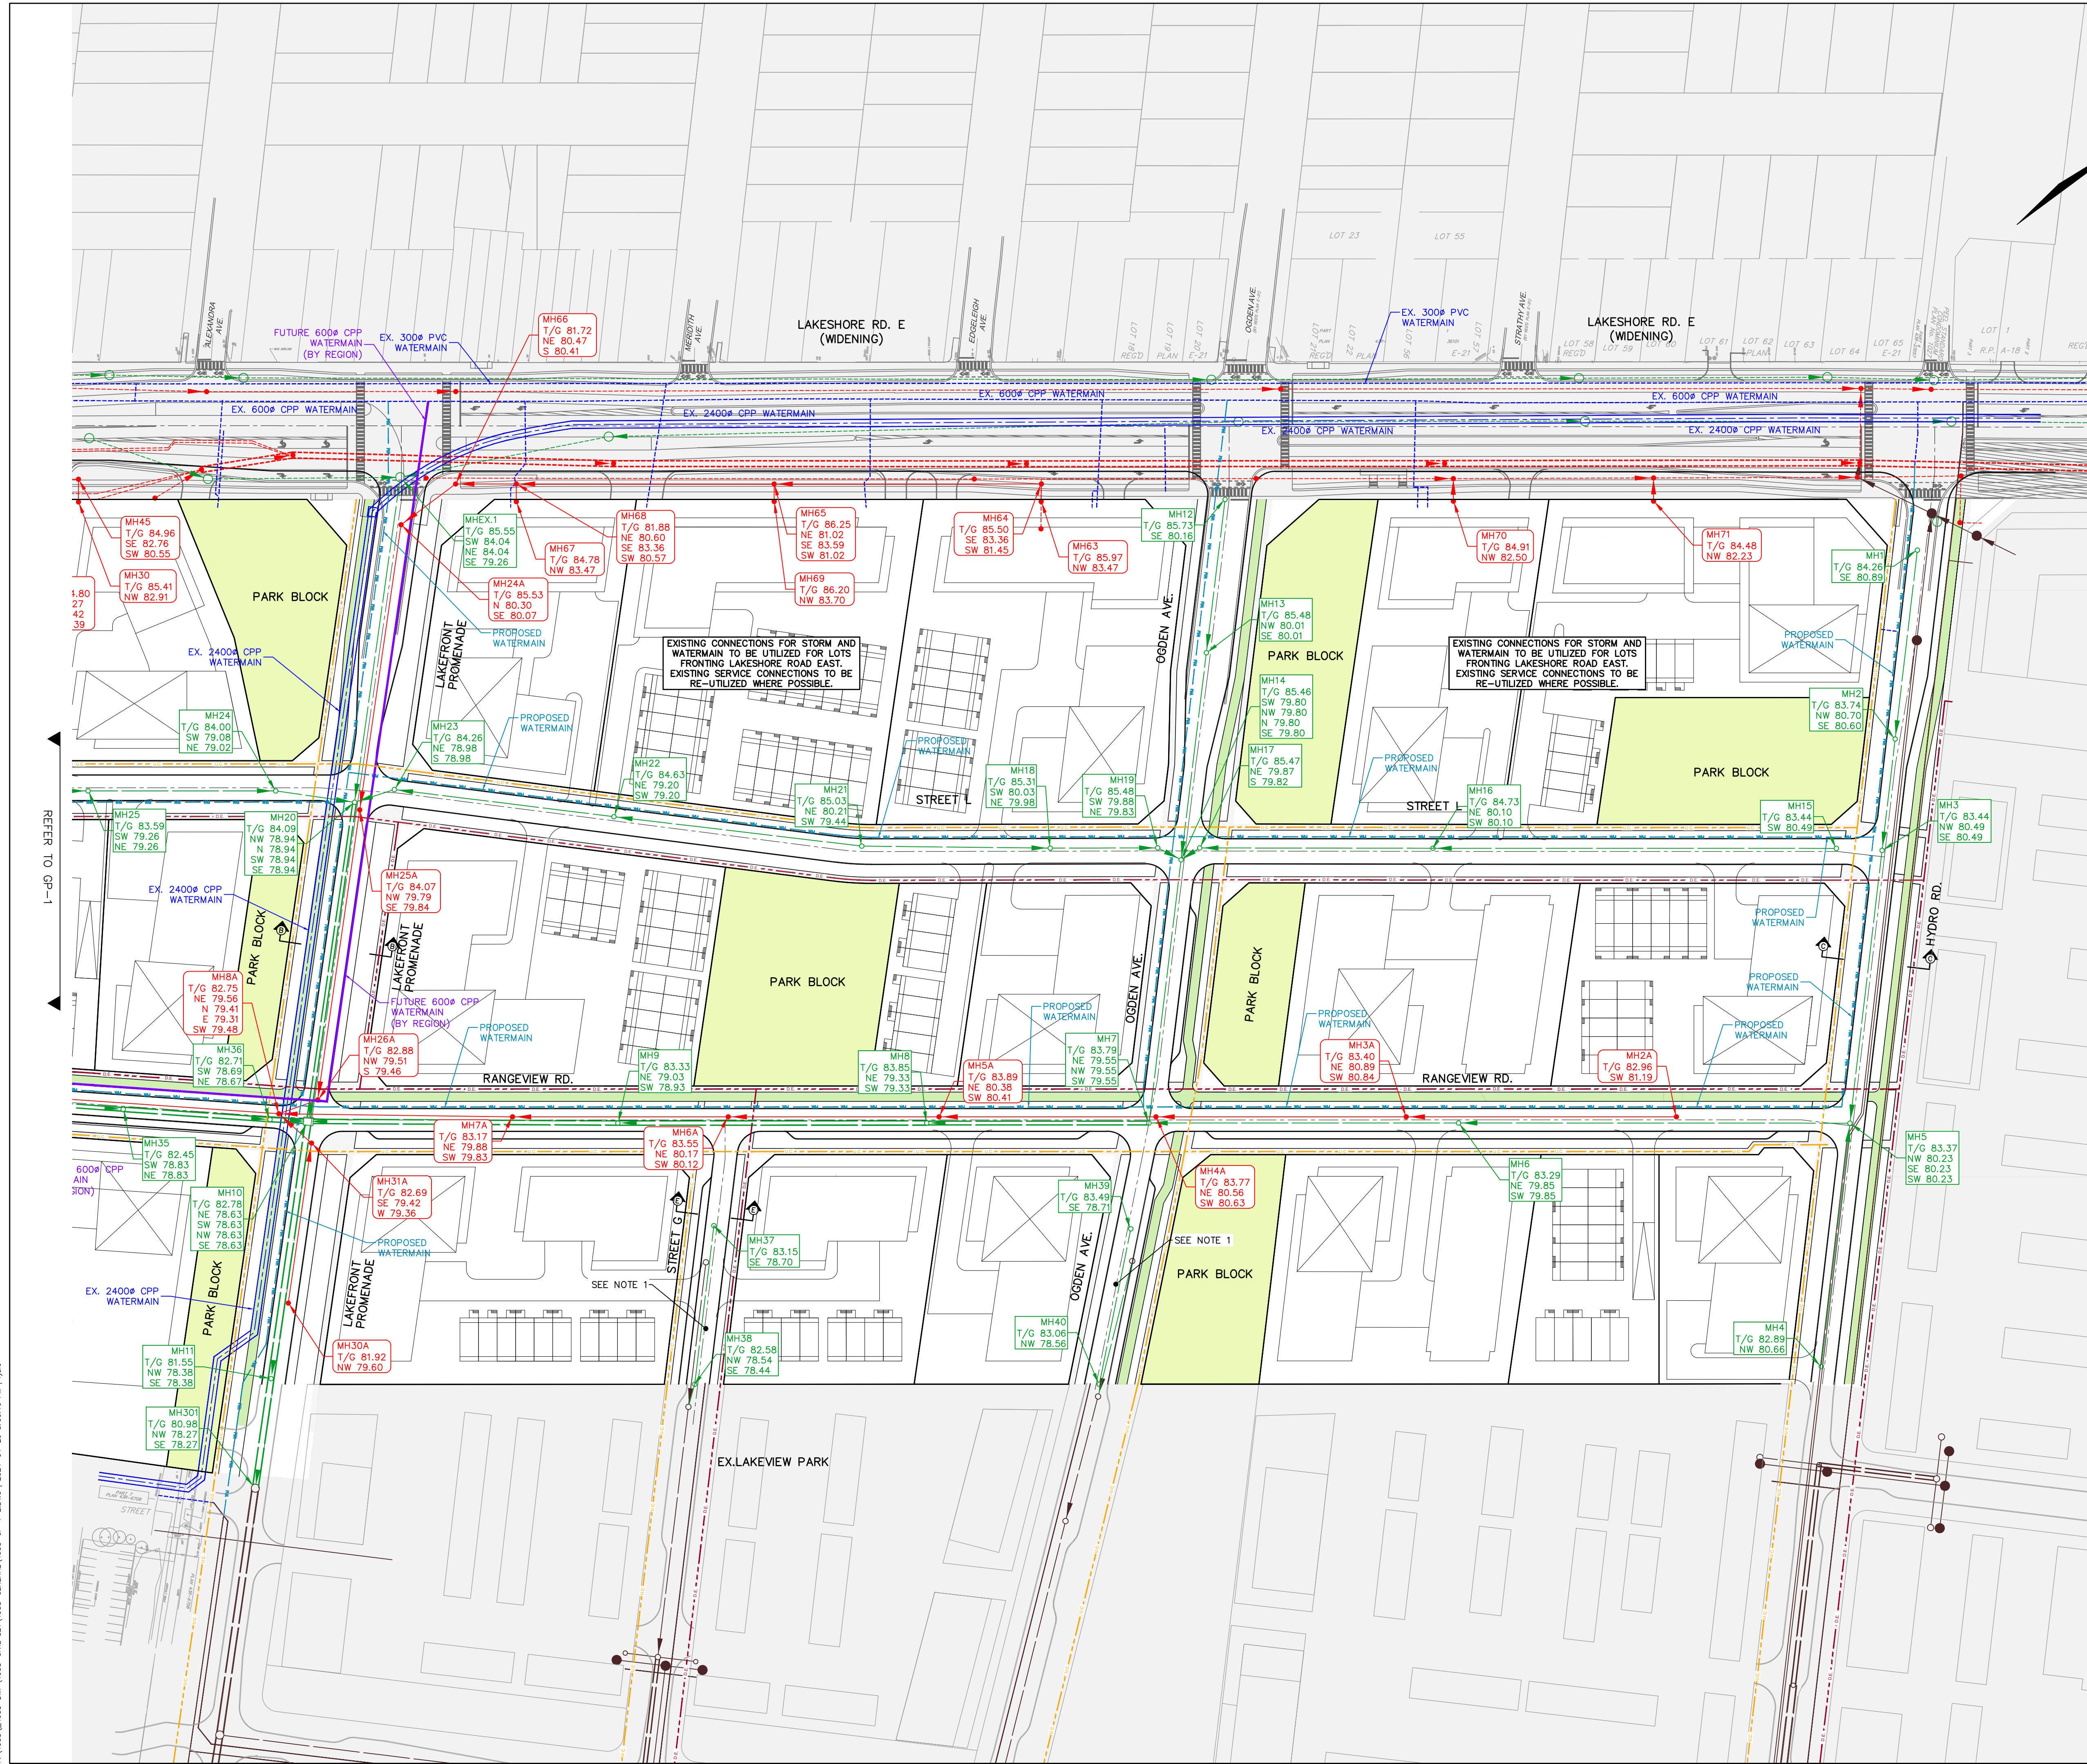

**LEGEND:**

	DENOTES PROPOSED SANITARY
	DENOTES PROPOSED STORM
	DENOTES PROPOSED WATERMAIN
	DENOTES PROPOSED UTILITY CORRIDOR
	DENOTES PROPOSED DISTRICT ENERGY
	DENOTES FUTURE SANITARY
	DENOTES FUTURE STORM
	DENOTES FUTURE WATERMAIN
	DENOTES EXISTING SANITARY
	DENOTES EXISTING STORM
	DENOTES EXISTING WATERMAIN
	DENOTES EXTERNAL LANDS
	DENOTES MH NUMBER TOP OF GRATE (T/G) SW 80.20
	DENOTES MH NUMBER TOP OF GRATE (T/G) SW 80.95

**NOTES:**

- STORM SEWER SHOWN ON ODGEN RD. AND STREET 'G', SOUTH OF RANGEVIEW ROAD, ARE ONLY REQUIRED TO SUPPORT POTENTIAL ROAD CONSTRUCTION.

1.	04/26/2024	ISSUED FOR DRAFT MASTER PLAN SUBMISSION
No.	Date	Issued for

**BENCHMARK NOTE**

**RANGEVIEW ESTATES PRECINCT AREA**  
CITY OF MISSISSAUGA

**SCHAEFFERS**  
CONSULTING ENGINEERS

6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
E-mail:  
design@schaeffers.com



**PRELIMINARY GENERAL PLAN**

DRAWN BY: M.P.	DESIGNED BY: H.H.T.	CHECKED BY: H.H.T.
SCALE: 1:1000	DATE: SEPTEMBER 2023	
PROJECT No. 2022-4938	DRAWING No. GP-2	

F:\4938\4938-DMP\4938-CIVIL SET\4938-GENERAL\4938-PP-1-2.DWG | 2024-04-29 5:00:10 PM | JMK




---

ALTERNATIVE SERVICING CONCEPT

O I I O IO

---



**Equivalent Population Calculations**

Project Title: 4938 - Rangeview  
 Last Edited: 2024-04-26  
 Municipality: Region of Peel

Project: 4938 Rangeview Mississauga  
 2024-04-26

**Design Criteria**

Unit Type	Population Density	Unit	Source
Rowhouses/Other Multiples	3.5	ppu	Per correspondence with Region of Peel (Oct 3, 2022)
Apartment	2.7	ppu	Per correspondence with Region of Peel (Oct 3, 2022)

Land Use	Population Density	Unit	Source
Single Family (>10m frontage)	50	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Single Family (<10m frontage)	70	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Semi-detached	70	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Row dwellings	175	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Apartments	475	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)
Commercial	50	ppha	Per Region of Peel Sanitary Sewer Design Criteria (July 2009)

Parcel	Landowners	Parcel Area (Gross)		Net Developable		Parcel Area (Townhouse)		Parcel Area (Apartments)		Low-rise Units		Mid-rise Units	Tall Building Units	Commercial	Equivalent Population											
		sq.m.	ha	sq.m.	ha	ha	ha	(Up to 4-Storeys)					(5- to 8-Storeys)	(9- to 15-Storeys)	Floor Area	Unit Type Method					Land Use Method					
								units	units	units	units	units	units	units	sq. m.	Townhouses	Apartments	Commercial	Institutional	Total	Townhouses	Apartments	Commercial	Institutional	Total	
1	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	6,198.99	0.62	5,211.39	0.52	0	0	0	0	0	0	98	160	363.67					699					248	2	250
2	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	8,451.90	0.85	7,632.77	0.76	0.38	0.38	0	0	52	0	162	0	594.63	182	438	3		623	67			182	3	252	
3	1127792 ONTARIO LIMITED (Dino Collini)	4,339.04	0.43	3,868.37	0.39		0.39	0	0	0	0	148	0	550.55		400	3		403				184	3	187	
4	896 Lakeshore Road East	4,338.68	0.43	3,868.33	0.39		0.39	0	0	0	0	151	0	562.90		408	3		411				184	3	187	
5	910 - 920 Lakeshore Road East	8,686.81	0.87	4,755.51	0.48		0.48	0	0	0	0	0	204	1,731.60		551	9		560				226	9	235	
6	946 Lakeshore Road East	7,040.36	0.70	5,723.87	0.57		0.57	0	0	0	0	83	144	1,207.11		613	7		620				272	7	279	
7	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	10,735.57	1.07	9,334.79	0.93	0.65	0.28	0	0	80	0	162	0	578.31	280	438	3		721	115			134	3	252	
8	447111 ONTARIO LIMITED (Norstar)	7,833.20	0.78	7,133.15	0.71	0.21	0.50	0	0	36	0	136	0	487.48	126	368	3		497	38			238	3	279	
9	RANGEVIEW 1035 HOLDING INC./RANGEVIEW 1045 HOLDING INC./1207238 ONTARIO INC. (Oasis Banquet Hall)	8,590.92	0.86	2,089.15	0.21		0.21	0	0	0	0	0	172	443.49		465	3		468				100	3	103	
10	ILSCO OF CANADA LIMITED (Thomas Quinn)	6,980.11	0.70	5,820.65	0.58		0.58	0	0	0	0	85	170	750.14		689	4		693				277	4	281	
11	1076 Lakeshore Road East	13,573.97	1.36	8,378.98	0.84	0.34	0.50	9	0	0	0	0	230	2,277.43	32	621	12		665	59			239	12	310	
12	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	15,357.62	1.54	8,586.32	0.86	0.43	0.43	0	0	40	0	199	0	0.00	140	538			678	76			204		280	
13	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	4,189.30	0.42	2,036.86	0.20	0.20	0.20	0	22	0	0	0	0	0.00	77				77				36		36	
14	895 Rangeview Road	4,465.52	0.45	3,975.17	0.40	0.40	0.40	0	0	48	0	0	0	0.00	168				168	70					70	
15	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	5,653.29	0.57	3,747.11	0.37		0.37	0	0	0	0	0	199	0.00		538			538				178		178	
16	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	7,259.45	0.73	7,109.98	0.71	0.28	0.43	0	0	56	0	0	253	0.00	196	684			880	50			203		253	
17	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	3,627.10	0.36	775.00	0.08	0.08	0.19	0	0	0	0	0	0	0.00					63						33	
18	2547046 ONTARIO INC./2545488 ONTARIO INC. (Vittorio Torchia)	3,627.76	0.36	1,856.79	0.19		0.19	0	18	0	0	0	0	0.00					63	33					33	
19	DORSAY (LAKESHORE) INC./DORSAY (LAKEFRONT PROMENADE) INC./DORSAY (RANGEVIEW) INC.	5,075.55	0.51	3,554.25	0.36		0.36	0	0	0	0	0	190	0.00		513			513				169		169	
20	RANGEVIEW 1035 HOLDING INC./RANGEVIEW 1045 HOLDING INC./1207238 ONTARIO INC. (Oasis Banquet Hall)	4,587.89	0.46	1,612.07	0.16		0.16	0	0	0	0	0	182	0.00		492			492				77		77	
21	RANGEVIEW 1035 HOLDING INC./RANGEVIEW 1045 HOLDING INC./1207238 ONTARIO INC. (Oasis Banquet Hall)	4,829.66	0.48	4,205.37	0.42		0.42	0	0	0	54	0	0	0.00		146			146				200		200	
22	2547046 ONTARIO INC./2545488 ONTARIO INC. (Vittorio Torchia)	6,054.50	0.61	5,655.26	0.57	0.28	0.28	0	0	20	0	0	177	0.00		478			548	50			135		185	
23	850 Rangeview Road	10,354.01	1.04	9,964.00	1.00	1.00	1.00	24	0	28	0	0	0	0.00	182			182		175					175	
24	WHITEROCK 880 RANGEVIEW INC. (Dream)	13,146.95	1.31	12,996.05	1.30	0.71	0.58	9	0	36	0	240	0	0.00	158	648			806	126			278		404	
25	890 Rangeview Road (Canada Post)	8,627.44	0.86	7,383.00	0.74		0.15	0	0	0	47	0	168	0.00		581		450	1031				71	450	521	
26	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	7,258.96	0.73	7,128.44	0.71	0.14	0.57	0	20	0	0	83	186	0.00	70	727			797	25			271		296	
27	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	3,621.46	0.36	2,087.67	0.21	0.06	0.15	0	0	0	0	0	0	0.00					0							
28	ELGROUP HOLDINGS INC./ELIAS BROS. CONSTRUCTION LIMITED (Elias Brothers Construction)	3,625.21	0.36	3,573.99	0.36	0.11	0.25	0	16	0	0	86	0	0.00	56	233			289	19			119		138	
29	1008 Rangeview Road	3,621.63	0.36	3,569.56	0.36		0.36	0	0	0	0	0	177	0.00		478			478				170		170	
30	1024 Rangeview Road	3,623.21	0.36	276.43	0.03		0.03	0	0	0	0	0	0	0.00					0							
31	2120412 ONTARIO INC. (Xtreme Tire)	7,248.77	0.72	6,069.04	0.61		0.61	0	0	0	58	0	180	0.00		643			643				289		289	
32	1062 Rangeview Road	3,273.04	0.33	3,232.41	0.32	0.32	0.32	4	0	12	0	0	0	0.00	56			56		57					57	
33	KOTYCK INVESTMENTS LTD. (Laurie McPherson)	3,491.56	0.35	3,437.21	0.34		0.34	0	0	0	0	0	186	0.00		503			503				164		164	
<b>TOTALS</b>		<b>219,389.43</b>	<b>21.94</b>	<b>166,648.93</b>	<b>16.66</b>	<b>5.79</b>	<b>10.25</b>	<b>46</b>	<b>76</b>	<b>136</b>	<b>272</b>	<b>159</b>	<b>1,633</b>	<b>2,978</b>	<b>9,547</b>	<b>1,856</b>	<b>12,890</b>	<b>52</b>	<b>15,248</b>	<b>996</b>	<b>4,812</b>	<b>52</b>	<b>450</b>	<b>6,310</b>		

**LEGEND**  
 Non-participating Landowners

Notes:  
 Parcel area for breakdown between townhouses and apartments was based on spatial estimates  
 Parcel 25 was assumed to include a senior public school with 900 students (minimum per Region's standards)

September 21, 2023

Our File: 2020-4938

Rangeview Landowners Group Inc.  
C/O Delta Urban Inc.  
8800 Dufferin Street, Suite 104  
Vaughan, ON  
L4K 0C5



---

6 Ronrose Drive, Vaughan, Ontario L4K 4R3  
Tel: (905) 738-6100 Fax: (905) 738-6875  
Tor. Line: (416) 213-5590 E-mail:  
general@schaeffers.com

**RE: Downstream Sanitary Sewer Analysis  
Rangeview Road Proposed Development Lands  
City of Mississauga**

---

## **1. Introduction**

Schaeffer and Associates Ltd. (SCE) has been retained to analyze sanitary servicing options for the Rangeview Road proposed development lands (herein referred to as “the site”) in the City of Mississauga. The proposed lands are bound by Lakeshore Road East to the north, Hydro Road to the east, Waterfront Trail to the south and East Avenue to the west. Lakefront Promenade runs in the north-south direction in the middle of the proposed lands. The majority of the lands currently consist of employment land uses and are proposed to be developed into mixed-use high-rise buildings.

This memo is written to present the residual capacity of the existing sewers and the population and units that could be developed within the residual capacity during the interim condition.

## **2. Existing Condition**

The existing sewer network is presented in **Figure 1**. There are three existing sanitary systems that could be utilized to service the site listed as follows:

- Sewers routing west on Rangeview Road, south on East Avenue, west on Easement and Montbeck Crescent, south on Goodwin Road and further discharging to Beach Street Pumping Station (SAN-1)
- Sewers routing west on Lakeshore Road East, south on Montbeck Crescent, west on Byngmount Avenue and south connecting the aforementioned sewer on Goodwin Road (SAN-2)
- Sewers routing east on Lakeshore Road East and further connecting to the Lakeview Pumping Station (SAN-3)

It is to be noted that the last sewer on Aviation Road connecting to the Beach Street Pumping Station was identified to be surcharged under pre-development condition in the previous submitted sanitary analysis. This leg is required to be upgraded from 300mm to 450mm in order to utilize the existing sewers connecting to the Beach Street Pumping Station (SAN-1 & SAN-2) as servicing the site during interim condition.

### 3. Scenarios

As previously discussed, the last sewer is required to be upgraded in order to service the site. The following scenarios consider the upgrade of the last sewer has already been implemented:

#### Scenario A

Existing sewers are analysed without any upgrade except the last sewer on Aviation Road.

#### Scenario B

Existing sewers are analysed based on Scenario A but with an additional upgrade on one sewer on East Avenue (83.5m) from 250mm to 300mm diameter. This sewer was identified as the most critical sewer of the existing sanitary system along Rangeview Road and Montbeck Crescent (SAN-1) under Scenario A. As a result, it is proposed to upgrade this sewer to provide more capacity for the existing sewers. However, upgrades on other sanitary systems (SAN-2 & SAN-3) are not suggested since the downstream sewer would need to be upsized as the upstream if the sewer upstream is proposed to be upgraded. It might not be economically reasonable to upgrade few downstream sewers for an interim servicing solution.

The sanitary tributary areas and sanitary sewer network of Scenario A and B are shown in **Figures 2 and 3** respectively.

### 4. Result

#### Scenario A

The following table summarises the residual capacity of the most critical sewer in different existing systems and the allowable population and units that could be developed under Scenario A. The allowable population is presented with reaching 80% and 90% of the pipe capacity since the Region may accept 90% utilization of the sewers as an interim solution. It is to be noted that, in the estimation of the equivalent unit, 2.7 persons per unit are assumed as the design criteria of the apartment since the unit breakdown of the site during interim condition has not been decided.

**Table 1 – Result of Scenario A**

Existing Sanitary System	Residual Capacity (L/s)	80% of Pipe Capacity		90% of Pipe Capacity	
		Allowable Population	Equivalent Unit	Allowable Population	Equivalent Unit
SAN-1	16.93	790	292	1000	370
SAN-2	14.59	510	188	850	314
SAN-3	37.78	2300	851	2700	1000

#### Scenario B

The following table summarises the residual capacity of the most critical sewer in different existing systems and the allowable population and units that could be developed under Scenario

B. Similar to Scenario A, the population is presented with reaching 80% and 90% of the pipe capacity and 2.7 persons per unit are assumed in the estimation of the equivalent unit.

**Table 2 – Result of Scenario B**

Existing Sanitary System	Residual Capacity (L/s)	80% of Pipe Capacity		90% of Pipe Capacity	
		Allowable Population	Equivalent Unit	Allowable Population	Equivalent Unit
SAN-1	22.84	1000	370	1450	537
SAN-2	14.59	510	188	850	314
SAN-3	37.78	2300	851	2700	1000

The detail of the capacity analysis for Scenario A and B is provided in **Attachment A**.

## 5. Flow Monitoring

The above mentioned calculation is based on the theoretical calculation using design guideline. Flow monitoring can be utilized to estimate the actual flow and assess the residual capacity in the system. To conduct flow monitoring, the Region’s acceptance and permit is required. Having said that considering the edge of sewers in this neighbourhood and being at the vicinity of Lake Ontario, there might be a chance that monitoring exercise observes higher I/I from groundwater. Thus, the monitoring exercise might weaken our argument with respect to using residual capacity. Should the landowners willing to conduct monitoring, we can approach the Region and start the conversation.



## 6. Conclusion

This memo has been prepared to present the residual capacity of the existing sewers and the population and units that could be developed within the residual capacity during the interim condition.

Three existing sewer systems were identified that could accommodate the site. It is to be noted that the last sewer on Aviation Road is required to be upgraded in order to utilize the existing sewers connecting to the Beach Street Pumping Station (SAN-2 & SAN-3) as servicing the site during interim condition. Two scenarios with different upgrading options and the residual capacity in different scenarios are presented. Furthermore, allowable population and unit are estimated based on the residual capacity in different scenarios.

We trust that you will find the contents of this memo satisfactory. Should you have any questions or comments, please do not hesitate to contact the undersigned.

Respectfully,

**SCHAEFFER & ASSOCIATES LTD.**



**Paul Wong, E.I.T**  
Water Resources Analyst



**Koryun Shahbikian, M.Eng., P.Eng., PMP**  
Partner



---

---


## *Figures*

---

---

Sheet 1 of 2

W:\00004838 - Rangeview - Main\00004838\Drawings\01\01-01-2021-04-13-2021-Rev1.dwg

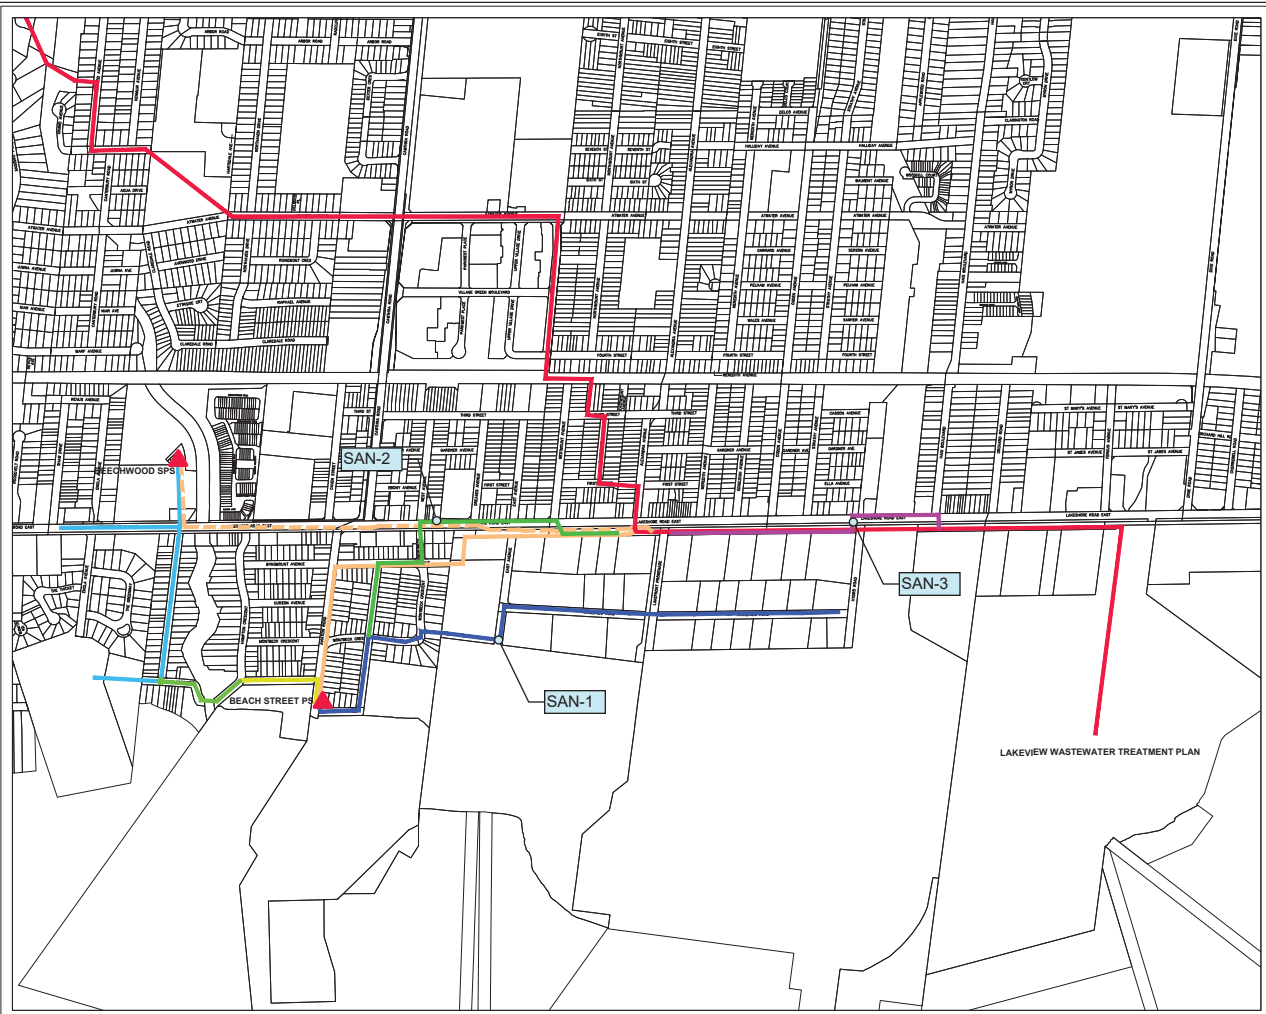

RANGEVIEW DEVELOPMENT

LEGEND

- TRUNK SEWER
- PREVIOUS TRUNK SEWER
- BEACH STREET SPS FORCEMAIN
- BEECHWOOD SPS FORCEMAIN
- DOWNSTREAM OF RANGEVIEW
- DOWNSTREAM LAKESHORE EAST
- DOWNSTREAM LAKESHORE WEST
- DIVERTED TRUNK SEWER
- TRUNK SEWER TO BEECHWOOD

**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Ronrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100 Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 1- SANITARY SERVICING ROUTES




RANCEVIEW RD  
CITY OF MISSISSAUGA

- LEGEND
- SEWERSHED AREA
  - SITE BOUNDARY
  - SANITARY SEWER
  - MANHOLE
  - SEWERSHED ID

**SCHAEFFERS**  
CONSULTING ENGINEERS  
6 Rotrose Drive, Concord, Ontario L4K 4R3  
Tel: (905) 738-6100    Email: general@schaeffers.com  
[www.schaeffers.com](http://www.schaeffers.com)

FIGURE 2 - EXISTING SANITARY TRIBUTARY AREAS  
( Scenario A - One Upgrade Upstream of Beach Street SP5)

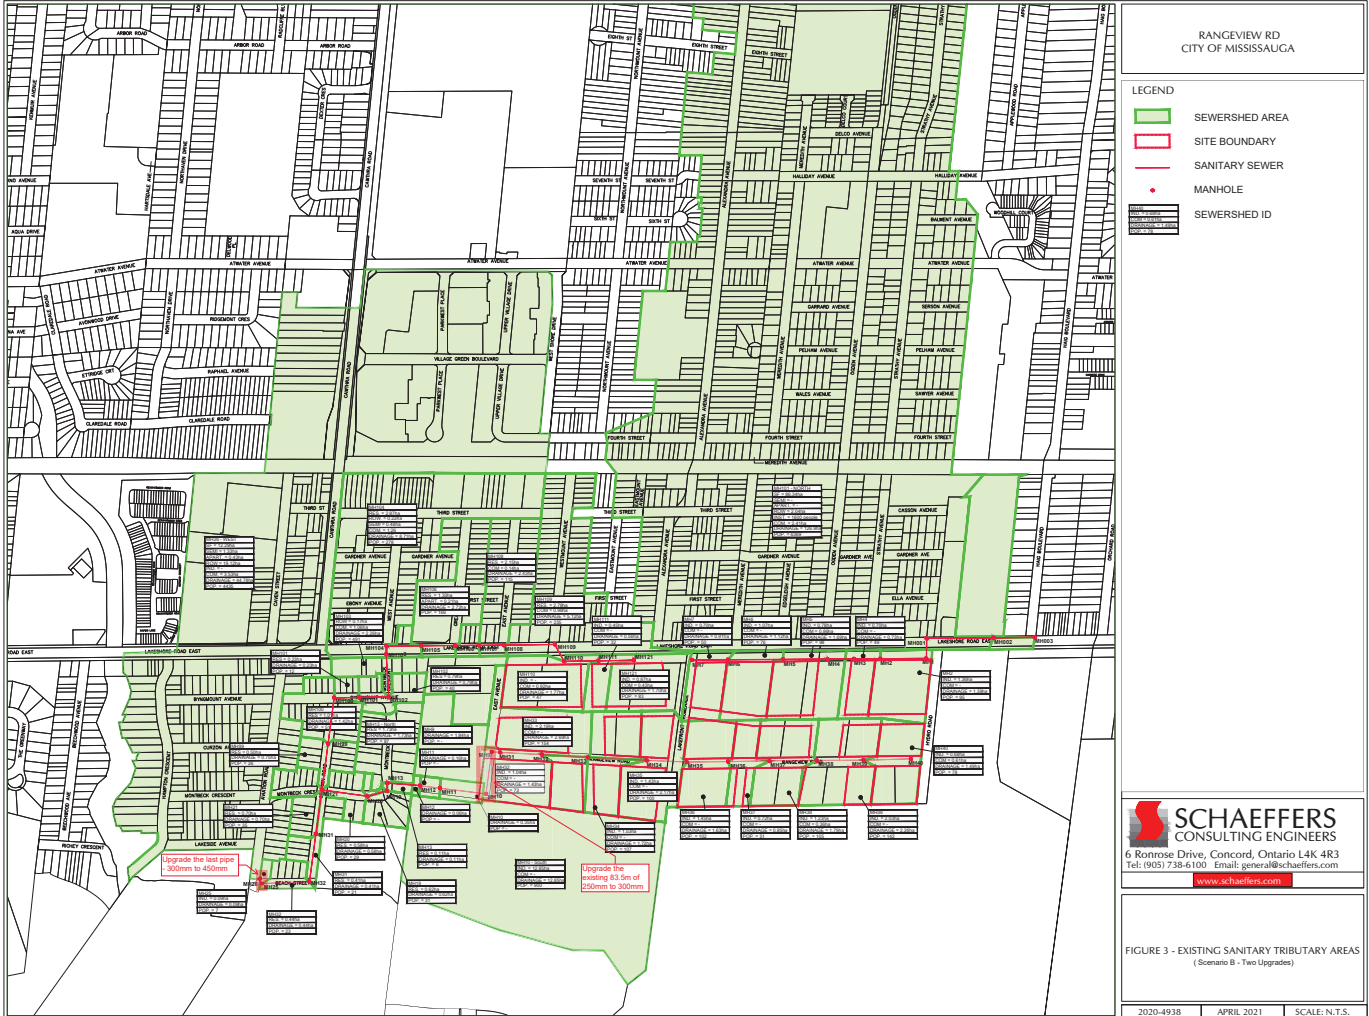

---

---

*Attachment A*

---

---

## Summary of Population & Units for Rangeview Development

Scenario A:

Location	Minimum Available Capacity (l/s)	Current populatoin	No Surcharge Conditions				80%
			Population	Equivalent Unit	Equivalent Area (ha)	Total Peak Flow (L/s)	
D/S Rangeview Rd (to Montbeck Cres & Goodwin Rd)*	16.93	912	790	292	1.10	10.29	80%
D/S Lakeshore Rd E (Western System to Montbeck Cres & Goodwin Rd)*	14.59	1513	510	188	0.71	6.54	80%
D/S of Montbeck Cres & Goodwin Rd to Beach St PS							
D/S Lakeshore Rd E (Eastern System to Lakeview PS)**	37.78	273	2300	851	3.19	28.84	80%

\* last pipe to PS should be upgraded

\*\*Equivalent Area for Lakeshore Eastern System is greater than Proposed Development Area

\*\*\*The surcharge conditions downstream of Montbeck Cres & Goodwin Rd are due to the constraints from the upstream sewers in the Rangeview and Lakeshore Rd E Western locations. In the event these two systems do not have surcharge conditions, there will be no surcharge conditions downstream of Montbeck Cres & Goodwin Rd

Population	Equivalent Unit	
1000	370	90%
850	314	90%
2700	1000	90%

Ex.Flow at critical location	Full pipe Capacity at critical location	
15.8	32.73	
24.86	39.45	
4.94	42.42	

Scenario B:

Location	Minimum Available Capacity (l/s)	Current populatoin	No Surcharge Conditions				80%
			Population	Equivalent Unit	Equivalent Area (ha)	Total Peak Flow (L/s)	
D/S Rangeview Rd (to Montbeck Cres & Goodwin Rd)*	22.84	1812	1000	370	1.39	12.43	80%
D/S Lakeshore Rd E (Western System to Montbeck Cres & Goodwin Rd)**	14.59	1513	510	188	0.71	6.54	80%
D/S of Montbeck Cres & Goodwin Rd to Beach St PS							
D/S Lakeshore Rd E (Eastern System to Lakeview PS)**	37.78	273	2300	851	3.19	28.84	80%

\* last pipe to PS as well as 83.5m of 250mm should be upgraded

\*\* last pipe to PS should be upgraded

\*\*\*Equivalent Area for Lakeshore Eastern System is greater than Proposed Development Area

\*\*\*\*The surcharge conditions downstream of Montbeck Cres & Goodwin Rd are due to the constraints from the upstream sewers in the Rangeview and Lakeshore Rd E Western locations. In the event these two systems do not have surcharge conditions, there will be no surcharge conditions downstream of Montbeck Cres & Goodwin Rd

Population	Equivalent Unit	
1450	537	90%
850	314	90%
2700	1000	90%

Ex.Flow at critical location	Full pipe Capacity at critical location	
29.19	52.04	
24.86	39.45	
4.94	42.42	

---

---

*Storm Design Sheets*

---

---



# STORM SEWER DESIGN SHEET

CITY OF MISSISSAGUA  
4938 - RANGEVIEW ESTATES PRECINCT  
(10-YR. RAINFALL INTENSITY)

Designed By: H.H.T.  
Checked By: H.H.T.  
Date: 02-Jul-24  
File No.: 2020-4938

F:\4938\4938-DESIGN-SHEETS\4938-STM Design.xls\10YR

LOCATION			CONTRIBUTING AREA				FLOW					SEWER DESIGN							(22)	
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)		(21)
STREET	FROM	TO	AREA "A" (ha.)	RATIONAL METHOD RUNOFF FACTOR "R"	SECTION AR (ha.)	ACCUMULATED AR (ha.)	RAINFALL INTENSITY "I" (mm/hr)	FLOW Q=RAIN=(7)(8)x0.0028 (L/s)	CONSTANT FLOW (L/s)	ACCUM. CONST. FLOW (L/s)	ACCUMULATED FLOW (L/s)	LENGTH (m)	SLOPE %	DIAMETER (mm)	FULL FLOW CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW TO SECTION (min)	TIME OF FLOW IN PIPE	TIME OF CONCENTRATION (min)	COMMENTS
HYDRO ROAD	1	2	0.24	0.90	0.2160	0.2160	99.2	59.5	0.00	0.0	59.5	61.6	0.30	375	96.0	0.87	15.00	1.18	16.18	62.0% Full
	2	3	0.09	0.90	0.0810	0.2970	94.7	78.2	0.00	0.0	78.2	36.3	0.30	375	96.0	0.87	16.18	0.70	16.88	81.4% Full
	3	5	0.21	0.90	0.1890	0.4860	92.3	124.7	0.00	0.0	124.7	89.3	0.30	450	155.8	0.98	16.88	1.52	18.40	80.0% Full
						<b>0.4860</b>				<b>0.0</b>	<b>124.7</b>						<b>18.40</b>			
HYDRO ROAD	4	5	0.21	0.90	0.1890	0.1890	99.2	52.1	27.66	27.7	79.7	79.0	0.55	375	130.4	1.18	15.00	1.12	16.12	61.2% Full
						<b>0.1890</b>				<b>27.7</b>	<b>79.7</b>						<b>16.12</b>			
CATCHMENT 219		5	0.56	0.90	0.5040	0.5040	99.2			78.51	78.5						15.00			Const. flow per SWM Req.
CATCHMENT 228		5	0.34	0.90	0.3060	0.3060	99.2			48.21	48.2						15.00			Const. flow per SWM Req.
CATCHMENT 227		5	0.32	0.90	0.2880	0.2880	99.2			44.07	44.1						15.00			Const. flow per SWM Req.
RANGEVIEW ROAD	5	6	0.28	0.90	0.2520	0.9270	87.5	225.4	150.60	321.4	546.8	126.2	0.30	825	786.1	1.47	18.40	1.43	19.83	69.6% Full
CATCHMENT 218		6	0.57	0.90	0.5130	0.5130	99.2			79.88	79.9						15.00			Const. flow per SWM Req.
CATCHMENT 226		6	0.61	0.90	0.5490	0.5490	99.2			84.02	84.0						15.00			Const. flow per SWM Req.
PARK BLOCK		6	0.18	0.30	0.0540	0.0540	99.2			14.88							15.00			Const. flow per SWM Req.
PARK BLOCK 306		6	0.16	0.30	0.0480	0.0480	99.2			13.22							15.00			Const. flow per SWM Req.
	6	7	0.22	0.90	0.1980	0.3000	83.5	69.6	0.00	485.3	554.9	100.8	0.30	825	786.2	1.47	19.83	1.14	20.97	70.6% Full
						<b>0.3000</b>				<b>485.3</b>	<b>554.9</b>						<b>20.97</b>			
PARK BLOCK 301		12	0.34	0.30	0.1020	0.1020	99.2			28.10							15.00			Const. flow per SWM Req.
OGDEN AVENUE	12	13	0.18	0.90	0.1620	0.2640	99.2	72.7	0.00	0.0	72.7	50.0	0.30	375	96.0	0.87	15.00	0.96	15.96	75.7% Full
	13	14	0.14	0.90	0.1260	0.3900	95.5	103.5	0.00	0.0	103.5	68.3	0.30	450	156.2	0.98	15.96	1.16	17.12	66.3% Full
						<b>0.3900</b>				<b>0.0</b>	<b>103.5</b>						<b>17.12</b>			
PARK BLOCK 302		15	0.34	0.30	0.1020	0.1020	99.2			28.10							15.00			Const. flow per SWM Req.
STREET L	15	16	0.28	0.90	0.2520	0.3540	99.2	97.5	52.41	80.5	178.0	130.6	0.30	525	235.6	1.09	15.00	2.00	17.00	75.6% Full
STREET L	16	17	0.16	0.90	0.1440	0.4980	91.9	127.2	0.00	80.5	207.7	75.5	0.30	600	336.3	1.19	17.00	1.06	18.06	61.8% Full
LAKEFRONT PROMENADE	17	14	0.00	0.90	0.0000	0.4980	88.6	122.5	0.00	80.5	203.0	7.8	0.30	600	336.3	1.19	18.06	0.11	18.17	60.4% Full
						<b>0.4980</b>				<b>80.5</b>	<b>203.0</b>						<b>18.17</b>			
STREET L	21	18	0.11	0.90	0.0990	0.0990	99.2	27.3	0.00	0.0	27.3	61.0	0.30	300	53.0	0.75	15.00	1.36	16.36	51.5% Full
STREET L	18	19	0.09	0.90	0.0810	0.1800	94.1	47.1	0.00	0.0	47.1	34.8	0.30	375	96.0	0.87	16.36	0.67	17.02	49.0% Full
LAKEFRONT PROMENADE	19	14	0.00	0.90	0.0000	0.1800	91.8	45.9	0.00	0.0	45.9	8.1	0.30	375	96.0	0.87	17.02	0.16	17.18	47.8% Full
						<b>0.1800</b>				<b>0.0</b>	<b>45.9</b>						<b>17.18</b>			
OGDEN AVENUE	14	7	0.16	0.90	0.1440	1.2120	88.2	297.1	0.00	80.5	377.6	85.7	0.30	750	609.8	1.38	18.17	1.03	19.20	61.9% Full
						<b>1.2120</b>				<b>80.5</b>	<b>377.6</b>						<b>19.20</b>			
CATCHMENT 217		7	0.35	0.90	0.3150	0.3150	99.2			49.58	49.6						15.00			Const. flow per SWM Req.
RANGEVIEW ROAD	7	8	0.16	0.90	0.1440	1.6560	80.6	370.8	57.39	672.8	1043.5	71.4	0.30	1050	1495.7	1.73	20.97	0.69	21.66	69.8% Full
CATCHMENT 216		8	0.18	0.90	0.1620	0.1620	99.2			26.17	26.2						15.00			Const. flow per SWM Req.
PARK BLOCK 305		8	0.37	0.30	0.1110	0.1110	99.2			30.58							15.00			Const. flow per SWM Req.
	8	9	0.22	0.90	0.1980	1.9650	78.9	430.9	0.00	698.9	1129.8	100.0	0.30	1200	2135.4	1.89	21.66	0.88	22.54	52.9% Full
CATCHMENT 215		9	0.79	0.90	0.7110	0.7110	99.2			118.45	118.5						15.00			Const. flow per SWM Req.
	9	10	0.22	0.90	0.1980	2.1630	76.9	462.3		943.6	1405.9	100.9	0.30	1200	2135.4	1.89	22.54	0.89	23.43	65.8% Full

NOTES:

N=2.778 GIVEN AREA (ha) AND RAINFALL INTENSITY (mm/hr)  
n=1.0 GIVEN AREA (m<sup>2</sup>) AND RAINFALL INTENSITY (mm/hr)

$$I=929.6 (T+4.0)^{-0.798} \text{ mm/hr}$$

# STORM SEWER DESIGN SHEET

CITY OF MISSISSAGUA  
4938 - RANGEVIEW ESTATES PRECINCT  
(10-YR. RAINFALL INTENSITY)

Designed By: H.H.T.  
Checked By: H.H.T.  
Date: 02-Jul-24  
File No.: 2020-4938

F:\4938\4938-DESIGN-SHEETS\4938-STM Design.xls\10YR

LOCATION			CONTRIBUTING AREA				FLOW					SEWER DESIGN							(22)		
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)		(21)	
STREET	FROM	TO	AREA "A" (ha.)	RATIONAL METHOD RUNOFF FACTOR "R"	SECTION AR (ha.)	ACCUMULATED AR (ha.)	RAINFALL INTENSITY "I" (mm/hr)	FLOW Q=RAIN = (7)(8)x0.0028 (L/s)	CONSTANT FLOW (L/s)	ACCUM. CONST. FLOW (L/s)	ACCUMULATED FLOW (L/s)	LENGTH (m)	SLOPE %	DIAMETER (mm)	FULL FLOW CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW TO SECTION (min)	TIME OF FLOW IN PIPE	TIME OF CONCENTRATION (min)	COMMENTS	
						<b>2.1630</b>				<b>943.6</b>	<b>1405.9</b>						<b>23.43</b>				
<b>LAKESHORE ROAD EAST</b>		5000	2.32	0.90	2.0880	2.0880	307.2	1781.7	0.00	0.0	1781.7									28.80	
						<b>2.0880</b>				<b>0.0</b>	<b>1781.7</b>						<b>28.80</b>				
<b>LAKEFRONT PROMENADE</b>	EX.1	20	0.29	0.90	0.2610	2.3490	65.4	427.0	221.93	16.6	443.6	106.3	0.70	1050	2284.7	2.64	28.80	0.67	29.47		19.4% Full
						<b>2.3490</b>				<b>16.6</b>	<b>443.6</b>						<b>29.47</b>				
	21	22	0.16	0.90	0.1440	0.1440	99.2	39.7	0.00	0.0	39.7	81.1	0.30	300	53.0	0.75	15.00	1.80	16.80		74.9% Full
	22	23	0.16	0.90	0.1440	0.2880	92.6	74.1		0.0	74.1	71.6	0.30	375	96.0	0.87	16.80	1.37	18.18		77.1% Full
	23	20	0.00	0.90	0.0000	0.2880	88.2	70.6	58.76	58.8	129.3	13.5	0.30	525	235.6	1.09	18.18	0.21	18.38		54.9% Full
						<b>0.2880</b>				<b>58.8</b>	<b>129.3</b>						<b>18.38</b>				
	28	27	0.12	0.90	0.1080	0.1080	99.2	29.8	81.2	81.2	111.0	63.2	0.30	450	156.2	0.98	15.00	1.07	16.07		71.1% Full
	27	26	0.15	0.90	0.1350	0.2430	95.1	64.2	0.00	81.2	145.4	76.8	0.30	525	235.6	1.09	16.07	1.18	17.25		61.7% Full
						<b>0.2430</b>				<b>81.2</b>	<b>145.4</b>						<b>17.25</b>				
	26	25	0.14	0.90	0.1260	0.3690	91.1	93.4	0.00	81.2	174.6	72.7	0.30	525	235.6	1.09	17.25	1.11	18.36		74.1% Full
<b>STREET A</b>	25	24	0.17	0.90	0.1530	0.5220	87.6	127.1	0.00	81.2	208.3	60.8	0.30	600	336.3	1.19	18.36	0.85	19.21		61.9% Full
<b>STREET A</b>	24	20	0.17	0.90	0.1530	0.6750	85.2	159.7	0.00	81.2	241.0	25.1	0.30	600	336.3	1.19	19.21	0.35	19.57		71.6% Full
						<b>0.6750</b>				<b>81.2</b>	<b>241.0</b>						<b>19.57</b>				
<b>LAKEFRONT PROMENADE</b>	20	10	0.27	0.90	0.2430	3.5550	64.4	636.3	0.00	156.6	792.9	105.4	0.70	1050	2284.7	2.64	29.47	0.67	30.14		34.7% Full (Pipe size designed per fut. Conn. From Street L W)
						<b>3.5550</b>				<b>156.6</b>	<b>792.9</b>						<b>30.14</b>				
<b>LAKESHORE ROAD EAST</b>	Ex. CB	Ex. F3-63	0.63	0.90	0.5670	0.5670	307.2	483.8	0.00	0.0	483.8									18.80	
						<b>0.5670</b>				<b>0.0</b>	<b>483.8</b>						<b>18.80</b>				
<b>CATCHMENT 203</b>	42	43	0.40	0.90	0.3600	0.3600	99.2	99.2	5.43	5.4	5.4	63.1	0.30	375	96.0	0.87	15.00	1.21	16.21		5.7% Full
<b>CATCHMENT 202</b>	43	44	0.75	0.90	0.6750	1.2420	94.6	326.5	10.59	16.0	16.0	60.9	0.30	375	96.0	0.87	16.21	1.17	17.38		16.7% Full
<b>CATCHMENT 201</b>	44	45	0.53	0.90	0.4770	1.0440	90.7	263.0	7.24	23.3	23.3	58.0	0.30	375	96.0	0.87	17.38	1.11	18.49		24.2% Full
										<b>23.3</b>	<b>23.3</b>						<b>18.49</b>				
<b>EAST AVENUE</b>	Ex. F3-63	29	0.32	0.90	0.2880	0.8550	86.4	205.1	78.94	78.9	284.1	83.4	0.50	600	434.2	1.54	18.80	0.91	19.71		65.4% Full
<b>EAST AVENUE</b>	29	31	0.19	0.90	0.1710	1.0260	83.8	239.0	0.00	78.9	317.9	93.7	1.10	600	644.0	2.28	19.71	0.69	20.39		49.4% Full
<b>RANGEVIEW ROAD</b>	31	32	0.09	0.90	0.0810	1.1070	82.0	252.3	128.16	207.1	459.4	39.4	0.30	1050	1495.7	1.73	20.39	0.38	20.77		30.7% Full
<b>CATCHMENT 220</b>		32	1.01	0.90	0.9090	0.9090	99.2		137.73	137.7							15.00				Const. flow per SWM Req.
<b>CATCHMENT 211</b>		32	0.88	0.90	0.7920	0.7920	99.2		118.45	118.5							15.00				Const. flow per SWM Req.
	32	33	0.23	0.90	0.2070	0.2070	81.1	46.6	0.00	463.3	509.9	103.8	0.30	1050	1495.7	1.73	20.77	1.00	21.77		34.1% Full
						<b>0.2070</b>				<b>463.3</b>	<b>509.9</b>						<b>21.77</b>				
<b>PARK BLOCK 303</b>		33	0.62	0.30	0.1860	0.1860	99.2		51.24	514.5							15.00				Const. flow per SWM Req.
	33	41	0.17	0.90	0.1530	0.1530	78.7	33.4	0.00	514.5	548.0	76.6	0.30	1050	1495.7	1.73	21.77	0.74	22.51		36.6% Full
<b>RANGEVIEW ROAD</b>	41	35	0.20	0.90	0.1800	0.1800	78.7	39.3	0.00	514.5	553.9	89.7	0.30	1050	1495.7	1.73	21.77	0.87	22.64		37.0% Full
<b>CATCHMENT 221</b>		35	1.30	0.90	1.1700	1.1700	99.2		179.05	179.1		89.3	0.30	450			15.00				Const. flow per SWM Req.

NOTES:

N=2.778 GIVEN AREA (ha) AND RAINFALL INTENSITY (mm/hr)  
n=1.0 GIVEN AREA (m<sup>2</sup>) AND RAINFALL INTENSITY (mm/hr)

$$I=929.6 (T+4.0)^{-0.798} \text{ mm/hr}$$



**SCHAEFFERS**  
Consulting Engineers  
6 Ronrose Drive, Concord,  
Ontario L4K 4R3  
Tel: (905) 738-6100  
Fax: (905) 738-6875  
SCHAEFFER & ASSOCIATES LTD. design@schaeffers.com

# STORM SEWER DESIGN SHEET

CITY OF MISSISSAGUA  
4938 - RANGEVIEW ESTATES PRECINCT  
(10-YR. RAINFALL INTENSITY)

Designed By: H.H.T.  
Checked By: H.H.T.  
Date: 02-Jul-24  
File No.: 2020-4938

F:\4938\4938-DESIGN-SHEETS\4938-STM Design.xls\10YR

LOCATION			CONTRIBUTING AREA				FLOW					SEWER DESIGN						(22)		
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)		(20)	(21)
STREET	FROM	TO	AREA "A" (ha.)	RATIONAL METHOD RUNOFF FACTOR "R"	SECTION AR (ha.)	ACCUMULATED AR (ha.)	RAINFALL INTENSITY "I" (mm/hr)	FLOW Q=RAIN = (7)(8)x0.0028 (L/s)	CONSTANT FLOW (L/s)	ACCUM. CONST. FLOW (L/s)	ACCUMULATED FLOW (L/s)	LENGTH (m)	SLOPE %	DIAMETER (mm)	FULL FLOW CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW TO SECTION (min)	TIME OF FLOW IN PIPE	TIME OF CONCENTRATION (min)	COMMENTS
CATCHMENT 212		35	0.20	0.90	0.1800	0.1800	99.2		27.55	27.6		89.3	0.30	450			15.00			Const. flow per SWM Req.
CATCHMENT 213		35	0.39	0.90	0.3510	0.3510	99.2		55.09	55.1		89.3	0.30	450			15.00			Const. flow per SWM Req.
	35	36	0.13	0.90	0.1170	0.2970	76.7	63.3	0.00	776.2	839.5	47.6	0.30	1200	2135.4	1.89	22.64	0.42	23.06	39.3% Full
CATCHMENT 222		36	0.74	0.90	0.6660	0.6660	99.2		82.64	82.6							15.00			Const. flow per SWM Req.
CATCHMENT 214		36	0.34	0.90	0.3060	0.3060	99.2		46.83	46.8							15.00			Const. flow per SWM Req.
	35	36	0.13	0.90	0.1170	0.4140	75.8	87.2	0.00	905.7	992.9	47.6	0.30	1200	2135.4	1.89	23.06	0.42	23.48	46.5% Full
	36	10	0.00	0.90	0.0000	0.4140	74.9	86.2	0.00	905.7	991.8	11.8	0.30	1200	2136.8	1.89	23.48	0.10	23.58	46.4% Full
						<b>0.4140</b>				<b>905.7</b>	<b>991.8</b>						<b>23.58</b>			
CATCHMENT 223		10	0.82	0.90	0.7380	0.7380	99.2		112.94	112.9							15.00			
PARK BLOCK		10	0.15	0.30	0.0450	0.0450	99.2		12.40	12.4							15.00			Const. flow per SWM Req.
LAKEFRONT PROMENADE	10	11	0.23	0.90	0.2070	6.3390	63.5	1117.5	126.25	2257.5	3375.0	83.2	0.30	1650	5021.7	2.35	30.14	0.59	30.73	67.2% Full
	11	301	0.00	0.90	0.0000	6.3390	62.6	1102.9	0.00	2257.5	3360.4	35.8	0.30	1650	4992.2	2.33	30.73	0.26	30.98	67.3% Full
						<b>6.3390</b>				<b>2257.5</b>	<b>3360.4</b>						<b>30.98</b>			
CATCHMENT 225		39	0.39	0.90	0.3510	0.3510	99.2		52.34	52.3							15.00			
OGDEN AVENUE	39	40	0.18	0.90	0.1620	0.1620	99.2	44.6	0.00	52.3	97.0	51.4	0.30	450	156.0	0.98	15.00	0.87	15.87	62.1% Full
						<b>0.1620</b>				<b>52.3</b>	<b>97.0</b>						<b>15.87</b>			
CATCHMENT 224		37	0.46	0.90	0.4140	0.4140	99.2		63.36	63.4							15.00			
STREET G	37	38	0.15	0.90	0.1350	0.1350	99.2	37.2	0.00	63.4	100.6	51.7	0.30	450	156.2	0.98	15.00	0.88	15.88	64.4% Full
						<b>0.1350</b>				<b>63.4</b>	<b>100.6</b>						<b>15.88</b>			

2750.00 l/s

NOTES:

N=2.778 GIVEN AREA (ha) AND RAINFALL INTENSITY (mm/hr)  
n=1.0 GIVEN AREA (m<sup>2</sup>) AND RAINFALL INTENSITY (mm/hr)

$$I=929.6 (T+4.0)^{-0.798} \text{ mm/hr}$$

Street Name	Area ID	Capture MH	Trib. Area (ha)	R <sub>10</sub>	R <sub>100</sub>	AR <sub>10</sub>	AR <sub>100</sub>	Flow Length (m)	Flow Velocity (m/s)	Time of Conc. (min)	I <sub>10</sub> (mm/hr)	I <sub>100</sub> (mm/hr)	Q <sub>10</sub> (m <sup>3</sup> /s)	Q <sub>100</sub> (m <sup>3</sup> /s)	Q <sub>100</sub> -Q <sub>10</sub> (m <sup>3</sup> /s)	Constant Flow (m <sup>3</sup> /s)
Hydro Road / Rangeview (East)		5	1.25	0.9	1.00	1.13	1.25	200	1.5	20.0	83.1	118.1	259.6	410.2	150.6	150.6
Street L (East of Ogden)		15	0.44	0.9	1.00	0.40	0.44	215	1.5	20.4	82.1	116.8	90.3	142.7	52.4	52.4
East Ave / Rangeview (West)		31	1.20	0.9	1.00	1.08	1.20	370	1.5	24.3	73.4	104.5	220.1	348.2	128.2	128.2
Street L (West of Lakeview)		28	0.71	0.9	1.00	0.64	0.71	270	1.5	21.8	78.7	112.0	139.7	221.0	81.2	81.2
Ogden		7	0.48	0.9	1.00	0.43	0.48	210	1.5	20.3	82.4	117.2	98.9	156.3	57.4	57.4
Street L (West of Ogden)		23	0.51	0.9	1.00	0.46	0.51	260	1.5	21.5	79.3	112.9	101.1	159.9	58.8	58.8
Rangeview East		10	0.6	0.9	1.00	0.54	0.60	280	1.5	7	149.3	210.1	224.0	350.2	126.2	126.2
Lakeshore East (@ East)		Ex. F3-63	0.63	0.9	1.00	0.57	0.63	150	1.5	18.8	86.5	123.0	136.3	215.2	78.9	78.9
Lakeshore East (@ Lakefront)		Ex. 1	2.32	0.9	1.00	2.09	2.32	550	1.5	28.8	65.5	93.4	380.0	601.9	221.9	221.9
Hydro Road		4	0.21	0.9	1.00	0.19	0.21	90	1.5	17.3	91.1	129.4	47.8	75.5	27.7	27.7

**IDF Parameters**

	10-YR	100-YR
<b>A</b>	1010	1450
<b>b</b>	4.6	4.9
<b>c</b>	0.78	0.78

$I = A / (T.C.+b)^c$   
 T.C. = Time of Conc. (min)  
 I = Rainfall Intensity (mm/hr)

**Run-off Coefficients**

$R_{100} = R_{10} \times 1.25$   
 Max. R = 0.90

**Time of Concentration**

$T.C. (min) = \text{Flow Length (m)} \times \text{Flow Velocity (m/s)}$   
 Flow Velocity Overland = 1.5 m/s

---

Appendix E  
Engineering Drawings  
Refer to Submission  
Package

---