


Hydrogeological Investigation

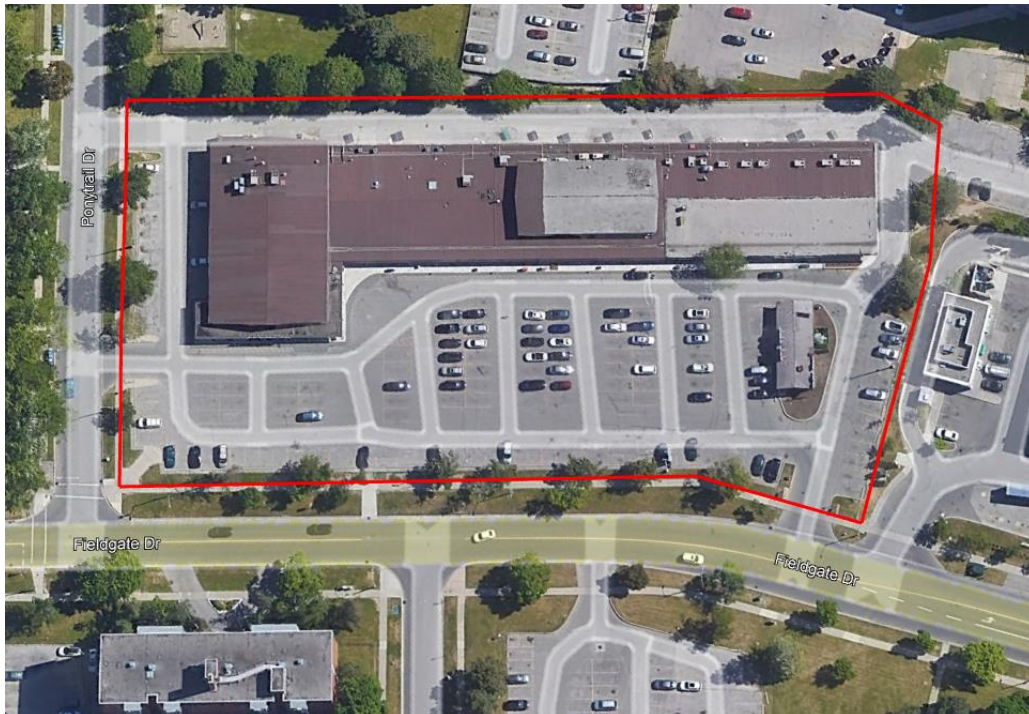

3403-3455 Fieldgate Drive, Mississauga, Ontario
G2S24018D

Sajecki Planning Inc.
227 Pape Avenue
Mississauga, ON
M4M 2W3

Executive Summary

G2S Consulting Inc. (G2S) was retained by Sajecki Planning Inc. (the Client) to complete a Hydrogeological Investigation for the property located at 3403-3455 Fieldgate Drive in Mississauga, Ontario (referred to herein as the 'Site').

The irregular-shaped Site is located on the north side of Fieldgate drive, at the northeast corner of the intersection with Ponytrail drive. The Site covers an approximate plan area of 15,840 m² (3.91 acres) with approximately 150 m of frontage on Fieldgate Drive, 80 m of frontage on Ponytrail Drive, and 25 m of frontage on Bloor Street. The 'Study Area', which is defined as being the area including the Site and lands within approximately 250 m of the Site, consists of residential, commercial, institutional, and recreational land use. Etobicoke Creek is located approximately 530 m northeast of the Site. The Site location is illustrated on Drawing 1 in Appendix A.

The Site is currently developed with an existing commercial plaza and smaller secondary commercial dwelling along with its access roads and parking areas. It is understood that development plan includes the demolition of the existing commercial plaza, and the construction of a high rise building which will comprise three towers (13, 18, and 22 storeys) and two levels of underground parking. Based on a pre-design statistics report provided to G2S by the Client, the proposed underground parking level will have an approximate footprint of 12,679 m² and the underside of footing (USF) is expected to be approximately 7 m below ground surface (bgs).

The purpose of this assignment was to prepare a hydrogeological investigation report for the proposed development at the Site and to assess the stratigraphic and hydrogeological conditions for the purpose of estimating construction dewatering flow rates (short-term) and post-construction dewatering flow rates (long-term). This report was prepared to present the study findings for supporting an application for a Permit to Take Water (PTTW) or Environmental Activity and Sector Registry (EASR).

G2S is completing a Geotechnical Investigation and a Phase Two Environmental Site Assessment for the Site and the boreholes and monitoring wells from these assignments were utilized for this hydrogeological investigation. Refer to Drawing 2 in Appendix A for the Borehole and Monitoring Well Location Plan.

To meet these objectives, the following tasks were undertaken:

1. Completion of an elevation survey for the boreholes and monitoring wells at the Site;
2. Completion of a minimum of three groundwater level monitoring events over a three-month period;
3. Sampling groundwater from one monitoring well for chemical testing to the City of Mississauga and Region of Peel Sewer Use By-Laws (filtered and unfiltered samples for metals and total suspended solids (TSS));
4. Completion of in-situ hydraulic conductivity testing in three monitoring wells;
5. Completion of a water well search for properties located within 250 m of the Site;

6. Completion of a hydrogeologic analysis, including review of grain size analyses data from the Geotechnical Investigation completed by G2S;
7. Estimation of construction dewatering flow rates (short-term) and estimate postconstruction dewatering flow rates (long-term) based on current proposed plans and monitoring well data; and
8. Preparation of a hydrogeological investigation report to summarize the background review information, field work and laboratory results, subsurface conditions, construction dewatering needs, and assessment of the potential impacts of the dewatering, including conclusions and recommendations together with illustrative tables, figures, drawings and back-up data in appendices.

Based on the proposed development features and our findings of the Site setting, subsurface conditions, results of field work, and laboratory analyses, the hydrogeological site assessment salient points for the dewatering needs are summarized in the following paragraphs.

1. It is understood that development plan includes the demolition of the existing commercial plaza, and the construction of a high rise building which will consist of three towers (13, 18, and 20 storeys) and two levels of underground parking.
2. The subsurface conditions generally consist of fill materials overlying deposits of silt, sand/silty sand/sandy silt, silty sand/sandy silt till, clayey silt till and shale bedrock. Bedrock was encountered and/or inferred by auger/sampler refusal at boreholes BH105, BH107, BH108 and BH110 and coring in boreholes BH102, BH106 and BH109 at elevations ranging between approximately 121.9 and 130.2 m asl.
3. The measured hydrostatic groundwater levels ranged from 134.3 to 130.6 m asl in the monitoring wells during the most recent round of groundwater level measurements (June 11, 2024).
4. The water-bearing units that will be exposed in the excavations during construction include fill, silt, sand/silty sand/sandy silt, silty sand/sandy silt till, clayey silt till, and shale bedrock, with calculated K values between 1.2×10^{-5} and 5.9×10^{-8} m/sec.
5. The required groundwater lowering (drawdown) is recommended 1 m below the base of the excavation to maintain dry working conditions.
6. The construction dewatering flow rate (short-term) is summarized in the following table:

Calculated Maximum Total Dewatering Rate Including Factors of Safety

Excavation	Steady State Dewatering (L/day)	Initial Drawdown Surcharge (L/day)	Precipitation and Runoff (L/day)	Maximum Total Dewatering Requirement (L/day)	Maximum Total Dewatering Requirement with 1.5x Safety Factor (L/day)
2-Levels of Underground Parking	219,997	109,998	332,822	662,818	994,227

7. The permanent dewatering flow rate (long-term) is summarized in the following table:

Long Term (Permanent) Dewatering Requirements

Excavation	Long Term Daily Dewatering Rate (L/day)	Long Term Daily Dewatering Rate with 1.5x Safety Factor (L/day)
2-Levels of Underground Parking	224,630	336,994

8. Construction dewatering will require maximum daily dewatering rates of up to 994,227 L/day; therefore, a PTTW would be required for the proposed temporary construction dewatering.
9. Long-term dewatering will require maximum daily dewatering rates of up to 336,994 L/day; therefore, a PTTW would be required for the proposed temporary long-term dewatering.
10. Based on the groundwater chemical testing results, it was found that for discharge to City of Mississauga storm and sanitary sewers, the groundwater quality in the unfiltered groundwater sample did not comply with the City of Mississauga storm sewer discharge by-law criteria for total suspended solids (TSS) and aluminium. It is important to note that the elevated levels were measured in an unfiltered sample which is not representative of the dewatering discharge from a decantation tank or equivalent treatment system to remove the suspended solids and phosphorous. Treatment and/or removal of suspended solids and phosphorous prior to discharge will be a key component of dewatering mitigation. Additional confirmatory sampling and analyses of the construction dewatering discharge are recommended to confirm compliance with the criteria of the receiving system to be used.
11. All monitoring wells and dewatering wells should be abandoned in accordance with the Ontario Regulation 903, as amended. The Site owner is considered to be the well owner of the monitoring wells installed at the Site (“well owner” Section 1.0, Regulation 903). When the monitoring wells are no longer required, it is the owner’s responsibility to arrange for abandonment in accordance with Ontario Water Resources Act–R.R.O. 1990, Regulation 903 – Amended to O. Reg. 128/03.

Table of Contents

Executive Summary	i
1. Introduction	1
1.1 Site Description	1
1.2 Proposed Site Development	2
2. Terms of Reference	3
3. Scope of Work.....	4
4. Previous Reports	5
5. Site Setting and Water Well Survey	6
5.1 Site Topography and Drainage	6
5.2 Site Physiographic, Geologic and Hydrogeologic Setting	6
5.3 MECP Water Well Records and Site Observations	6
6. Field Work and Laboratory Analysis.....	7
6.1 Borehole Drilling and Monitoring Well Installation.....	7
6.2 Groundwater Monitoring, Sampling and Borehole Permeability Testing.....	7
6.2.1 Groundwater Monitoring.....	7
6.2.2 Groundwater Sampling	7
6.2.3 Borehole Permeability Testing	8
6.3 Laboratory Testing	8
6.3.1 Water Sample Chemical Analysis	8
6.3.2 Soil Particle Size Distribution Analyses.....	9
7. Findings.....	10
7.1 Summarized Subsurface Conditions.....	10
7.1.1 Pavement Structure	10
7.1.2 Fill.....	10
7.1.3 Silt	10
7.1.4 Sand/Silty Sand/Sandy Silt	10
7.1.5 Silty Sand/Sandy Silt Till	10
7.1.6 Clayey Silt Sill	11
7.1.7 Shale Bedrock.....	11
7.2 Groundwater Conditions	12
7.3 Estimated Hydraulic Conductivity.....	13
7.3.1 In-Situ Hydraulic Conductivity Testing	13
7.3.2 Grain Size Analysis	13
7.4 Groundwater Quality	13
8. Construction Dewatering Analysis	15
8.1 Excavation Requirements and Temporary Construction Dewatering Assumptions.....	15

8.1.1 Excavation.....	16
8.1.2 Dewatering Assumptions	16
8.2 Dewatering Calculations	16
8.2.1 Calculated Dewatering Rates, With Factors of Safety	17
8.3 Long-Term (Permanent) Dewatering Requirements	18
9. Permit Requirements and Dewatering Discharge.....	20
9.1 Dewatering Discharge.....	20
9.1.1 City of Mississauga Storm Sewer Use By-Law	20
9.1.2 Region of Peel Sanitary Sewer Use By-Law.....	21
9.2 Evaluation of Potential Impacts.....	21
9.2.1 Local Groundwater Sources.....	21
9.2.2 Baseflow Reduction in Waterbodies	21
9.2.3 Induced Movement of Contaminant Plumes	21
9.2.4 Confined Groundwater Conditions and Excavation Bottom Heave.....	22
9.2.5 Potential Ground Subsidence in Adjacent Structures (Settlement).....	22
9.2.6 Proposed Mitigation Measures for Potential Ground Subsidence.....	23
9.2.7 Dewatering Discharge Quantity and Quality	24
9.2.8 Monitoring Well Decommissioning	24
10. Summary and Conclusions.....	25
11. References and Supporting Documentation	27
12. Limitations.....	28
13. Closing Remarks.....	29

Appendices

- Appendix A: Drawings
- Appendix B: Summary of Water Well Records
- Appendix C: Borehole Logs
- Appendix D: Hydraulic Testing
- Appendix E: Grain Size Analyses
- Appendix F: Laboratory Certificates of Analysis

List of Tables

- Table 1: General Site Details
- Table 2: Samples Submitted for Analytical Testing
- Table 3: Approximate Depth and Elevation of Shale Bedrock Surface
- Table 4: Summary of Groundwater Levels
- Table 5: Hydraulic Conductivity Estimates – Slug Testing
- Table 6: Exceedances of the City of Mississauga Sewer Discharge Criteria
- Table 7: Preliminary Excavation Requirements
- Table 8: Steady-State Dewatering Requirements
- Table 9: Calculated Maximum Total Dewatering Rate Including Factors of Safety
- Table 10: Long-Term (Permanent) Dewatering Requirements

Drawings (in Appendix A)

- Drawing 1: MECP Water Well Record Location Plan
- Drawing 2: Borehole and Monitoring Well Location Plan
- Drawing 3: Groundwater Contour Plan – May 13, 2024

1. Introduction

G2S Consulting Inc. (G2S) was retained by Sajecki Planning Inc. (the Client) to complete a Hydrogeological Investigation for the property located at 3403-3445 Fieldgate Avenue in Mississauga, Ontario (referred to herein as the 'Site').

1.1 Site Description

Table 1: General Site Details

Municipal Address	3403-3445 Fieldgate Avenue, Mississauga, Ontario
UTM Coordinates	17T 613850 m E, 4831119 m N
General Site Location	Located on the north side of Fieldgate drive, at the northeast corner of the intersection with Ponytrail drive. The 'Study Area', which is defined as being the area including the Site and lands within approximately 250 m of the Site, consists of residential, commercial, institutional, and recreational land use. Etobicoke Creek is located approximately 530 m northeast of the Site.
Approximate Plan Area	15,840 m ² (3.91 acres) with approximately 150 m of frontage on Fieldgate Drive, 80 m of frontage on Ponytail Drive, and 25 m of frontage on Bloor Street.
Legal Description	BLK J PL 719 TORONTO; S/T RIGHT IN TT175194; S/T TT172757 MISSISSAUGA
Current Wastewater and Potable Water Servicing	Municipal (Lake Ontario)
Proposed Development Plan	A high rise building which will comprise three towers (13, 18, and 20 storeys) and two levels of underground parking.
Current Site Occupant	<p>Site Building 1:</p> <ul style="list-style-type: none"> • 3407 Fieldgate Drive: Computer and Printing • 3409 Fieldgate Drive Forest Glen Deli and Appetizer • 3411 Fieldgate Drive: Dollarcade • 3415 Fieldgate Drive: Maxwell Physiotherapy and Rehab • 3417 Fieldgate Drive: Dixie Bloor Neighbourhood Centre (LINC English Classes) • 3419 Fieldgate Drive: Coin Laundry, Suya Express • 3421 Fieldgate Drive: The Hairspot, Pizza Wings and More • 3423 Fieldgate Drive: Subway • 3425 Fieldgate Drive: Karachi Grill • 3427 Fieldgate Drive: Fieldgate Pharmacy • 3429 Fieldgate Drive: Vacant (formerly medical offices) • 3431 Fieldgate Drive: Dixie Bloor Neighbourhood Centre (English Classes) • 3433 Fieldgate Drive: The Bun Man • 3435 Fieldgate Drive: Dixie Bloor Neighbourhood Centre (LINC English Classes) • 3437 Fieldgate Drive: Optic Chiasma, Vacant (formerly Fairway Cleaners) • 3439 Fieldgate Drive: Dixie Bloor Neighbourhood Centre

	<ul style="list-style-type: none"> • 3441 Fieldgate Drive: Hasty Market and Vape Store • 3443 Fieldgate Drive: Vacant (formerly Balkan Grill) • 3445 Fieldgate Drive: IC Food World <p>Site Building 2: 3403 Fieldgate Drive: Fieldgate Dental</p>
Surrounding Land Uses	<p>North: Residential apartment buildings at 811 Ponytrail Drive and 1745 Bloor Street.</p>
	<p>South: Fieldgate Drive followed by residential buildings located at 1665 Bloor Street and 3450 Fieldgate Drive.</p>
	<p>East: Bloor Street followed by a mixed use residential and commercial building 3315 Fieldgate Drive. Commercial dwelling at 1715 Bloor Street.</p>
	<p>West: Ponytrail Drive followed by a residential building at 3320 Ponytrail Drive.</p>

The Site location is illustrated on Drawing 1 in Appendix A.

1.2 Proposed Site Development

It is understood that development plan includes the demolition of the existing commercial plaza, and the construction of a high rise building which will consist of three towers (13, 18, and 22 storeys) and two levels of underground parking.

Based on a pre-design statistics report provided to G2S by the Client, the proposed underground parking level will have an approximate footprint of 12,679 m² and the underside of footing (USF) is expected to be approximately 7 m below ground surface (bgs).

2. Terms of Reference

The purpose of this assignment was to prepare a hydrogeological investigation report for the proposed development at the Site and to assess the stratigraphic and hydrogeological conditions for the purpose of evaluating short-term (temporary) dewatering requirements during Site development as well as estimated post-construction dewatering flow rates (long-term) after the Site has been developed. This report was prepared to present the study findings for supporting an application for a Permit to Take Water (PTTW) or Environmental Activity and Sector Registry (EASR).

3. Scope of Work

The scope of work for the investigation included the following tasks:

1. Completion of an elevation survey for the boreholes and monitoring wells at the Site;
2. Completion of a minimum of three groundwater level monitoring events over a three-month period;
3. Sampling groundwater from one monitoring well for chemical testing to the City of Mississauga and Region of Peel Sewer Use By-Laws (filtered and unfiltered samples for metals and total suspended solids (TSS));
4. Completion of in-situ hydraulic conductivity testing in three monitoring wells;
5. Completion of a water well search for properties located within 250 m of the Site;
6. Completion of a hydrogeologic analysis, including review of grain size analyses data from the Geotechnical Investigation completed by G2S;
7. Estimation of construction dewatering flow rates (short-term) and estimate postconstruction dewatering flow rates (long-term) based on current proposed plans and monitoring well data; and
8. Preparation of a hydrogeological investigation report to summarize the background review information, field work and laboratory results, subsurface conditions, construction dewatering needs, and assessment of the potential impacts of the dewatering, including conclusions and recommendations together with illustrative tables, figures, drawings and back-up data in appendices.

4. Previous Reports

G2S was provided the following reports for the Site:

1. Phase One Environmental Site Assessment, 3403-3445 Fieldgate Drive, Mississauga, Ontario, prepared by Pinchin, Pinchin File. 315068, dated October 3, 2022
2. Phase Two Environmental Site Assessment, 3403-3445 Fieldgate Drive, Mississauga, Ontario, prepared by Pinchin, Pinchin File. 315068.001, dated December 22, 2022

G2S has completed the following reports for the Site:

1. Phase One Environmental Site Assessment Update, 3403-3445 Fieldgate Drive, Mississauga, Ontario, Reference G2S24018A, dated May 2024.
2. Phase Two Environmental Site Assessment Update, 3403-3445 Fieldgate Drive, Mississauga, Ontario, Reference G2S24018B, dated May 2024.
3. Geotechnical Investigation, Proposed Mixed Use Development, 3403-3445 Fieldgate Drive, Mississauga, Ontario, Reference G2S24018C, dated July 2024.

As part of the G2S Geotechnical Investigation, ten boreholes, three of which were completed as a groundwater monitoring wells, were advanced on-Site and were utilized for this Hydrogeological Investigation. Grain size distribution testing for three samples was undertaken, included in Appendix E.

As part of the Phase Two Environmental Site Assessment, six boreholes, three of which were completed as groundwater monitoring wells, were advance on-Site and were utilized for this Hydrogeological Investigation.

5. Site Setting and Water Well Survey

5.1 Site Topography and Drainage

The Site is generally flat sloping slightly down toward the southwest. There are no drainage features (i.e., open ditches or swales) present on-Site, and surface water is inferred to follow topography and flow southeast over the developed ground surface toward Fieldgate Drive. The nearest surface water body is Etobicoke Creek, located approximately 530 m northeast of the Site.

5.2 Site Physiographic, Geologic and Hydrogeologic Setting

The subsurface conditions generally consist of fill materials overlying deposits of silt, sand/silty sand/sandy silt, silty sand/sandy silt till, clayey silt till and shale bedrock. Bedrock was encountered and/or inferred by the auger/sampler refusal at BH105, BH107, BH108 and BH110 and coring in BH102, BH106 and BH109 at depths ranging between approximately 121.9 and 130.2 m asl.

Based on elevations interpolated from topographic survey plan titled "Surveyor's Real Property Report and Topography of Block J Registered Plan 719, City of Mississauga, Regional Municipality of Peel", dated April 26, 2023, by Genesis Land Surveying Inc, elevations at the Site range from approximately 136.2 m asl at the northwest corner of the Site to 133.95 m asl on the east portion of the Site. The regional direction of shallow groundwater flow in the vicinity of the Site is expected to be southeast toward Lake Ontario located approximately 5.6 km from the Site.

5.3 MECP Water Well Records and Site Observations

The Site and properties within an approximate 250 m radius of the Site were searched within the current MECP Water Well Information System (WWIS) database. A total of 18 water well records were located within the search radius, none of which were located on-Site. The locations of the water well records are shown on Drawing 1 in Appendix A and a copy of the well record summary is included in Appendix B.

The use of the water wells within the 250 m radius include two monitoring (MO), five monitoring testhole (MT), one not used (NU) and ten wells that did not identify their use. Although ten wells did not identify their use, since the City of Mississauga supplies drinking and potable water via Lake Ontario, and the Site is located within a developed urban area, it is unlikely any of the wells within the search radius are for drinking water purposes.

A reconnaissance of the Site was conducted during the field work to identify existing structures, land uses, and potential sources of groundwater contamination, if any, which may be located within the potential dewatering zone of influence (approximately 47.1 m).

The major features surrounding the Site included:

- a) Major arterial roads, including Fieldgate Drive and Bloor Street.
- b) Properties comprise primarily residential, commercial, institutional, and recreational land use.
- c) Etobicoke Creek is located approximately 530 m northeast of the Site.

6. Field Work and Laboratory Analysis

6.1 Borehole Drilling and Monitoring Well Installation

As part of the Geotechnical Investigation completed for the Site, ten boreholes were advanced between March 12 and 15, 2024, three of which were completed as groundwater monitoring wells. As a part of the Phase Two Environmental Site Assessment completed for the Site, six boreholes were advanced at the Site on April 29, 2024, three of which were completed as groundwater monitoring wells. The newly installed monitoring wells were utilized for the Hydrogeological Investigation. The monitoring wells installed by G2S as a part of the Geotechnical Investigation and the Phase Two ESA are identified as BH/MW101, BH/MW102, BH/MW106, BH/MW210, BH/MW202, BH/MW203. In addition, seven existing monitoring wells installed at the Site (MW1 through MW7) in 2022 were utilized for the Hydrogeological Investigation.

Field work for this assignment included collection of groundwater levels, groundwater sampling, and borehole permeability testing. The borehole and monitoring well locations are shown on Drawing 2 included in Appendix A. Geodetic Elevations at the ground surface of the borehole locations were Interpolated from the provided topographic survey plan titled “Surveyor’s Real Property Report and Topography of Block J Registered Plan 719, City of Mississauga, Regional Municipality of Peel”, dated April 26, 2023, by Genesis Land Surveying Inc.

The details of the monitoring well construction used in this assignment are shown on the Borehole Logs in Appendix C.

6.2 Groundwater Monitoring, Sampling and Borehole Permeability Testing

6.2.1 Groundwater Monitoring

Groundwater was not encountered in the boreholes during drilling. Groundwater levels were measured in each of the monitoring wells between April and June 2024, using a Solinst™ groundwater level reader, which was cleaned between uses at each monitoring well location.

6.2.2 Groundwater Sampling

Development/purging of one monitoring well for sanitary and storm sewer analysis was completed on May 13, 2024, and involved removal of a minimum of three to five well volumes or until the well was dry, in accordance with fixed volume and well evacuation purging procedures as outlined in ASTM D6452-99 (2005).

In an effort to minimize potential cross-contamination, dedicated sampling equipment was used in the groundwater well. The equipment was used with new nitrile gloves.

Groundwater samples were collected from the monitoring well identified as BH/MW106 (screened in shale bedrock), on May 13, 2024. The groundwater samples were field logged and placed in clean, laboratory provided bottles, stored in an insulated cooler on ice, and delivered directly to Paracel Laboratories Ltd. (Paracel) for analysis of the City of Mississauga storm sewer discharge parameters and the Peel Region sanitary sewer discharge parameters. Particular attention was applied to visual and olfactory evidence of potential contamination such as odours and sheens during the course of the field work.

6.2.3 Borehole Permeability Testing

In situ borehole permeability was determined through falling head (slug) testing, performed in monitoring wells identified as BH/MW101, BH/MW106 and MW2 on June 11, 2024. The falling head testing was completed according to ASTM procedure D4044 “Standard Test Method for (Field Procedure) for Instantaneous Change in Head (Slug) Tests for Determining Hydraulic Properties of Aquifers”.

Prior to conducting the tests, the monitoring wells were developed to remove any fines introduced into the screen following construction. The wells were then left to recharge to static water level. The test was carried out by inserting a data logger into the bottom of the well, then filling the monitoring well with water until the water level reached the approximate top of the casing. The loggers were then used to record the change in head over time. Once the well had returned to 63% of its static water level or the logger had recorded a sufficient amount of data, the logger was removed. The results were then calculated using the Hvorslev Method.

Groundwater levels were monitored before and during falling head testing using both manual readings with a Solinst™ groundwater level reader and automatic readings with a Solinst™ water level logger.

6.3 Laboratory Testing

6.3.1 Water Sample Chemical Analysis

To address the potential in-construction groundwater dewatering discharge quality issues, groundwater samples (collected from BH/MW106) were submitted to Parcel for chemical analyses. Parcel is accredited by The Standards Council of Canada (SCC) and The Canadian Association for Laboratory Accreditation (CALA).

The unfiltered groundwater sample collected from BH/MW106 (identified as sample BH/MW106-UF) was analyzed for the parameters contained within the City of Mississauga storm sewer discharge parameters and the Peel Region sanitary sewer discharge parameters, which includes selected organic, inorganic, and microbiological parameters. A filtered sample was also collected from BH/MW106 (identified as sample BHMW106-F) and analyzed for metals and total suspended solids (TSS).

The following is a summary of the groundwater samples submitted for analysis.

Table 2: Samples Submitted for Analytical Testing

Sample Location	Sample I.D.	Screened Interval Elevation (m) and Depth (m bgs)	Description	Type of Chemical Analysis
BH/MW106	BH/MW106-UF	127.32 – 124.22 (7.68 – 10.78)	Clear, no odour or sheen	City of Mississauga Storm Sewer By-law No. 0046-2022 (March 23, 2022) Discharge parameters. Peel Region Sanitary Sewer By-law No. 53-2010 (2010) Discharge parameters.
	BH/MW106-F			Metals, TSS

6.3.2 Soil Particle Size Distribution Analyses

The following three representative soil samples obtained from the Site were submitted to the G2S laboratory for particle size distribution analyses:

- BH101 S5 (clayey silt till)
- BH105 S8 (clayey silt till)
- BH109 S10 (silty clay till)

7. Findings

7.1 Summarized Subsurface Conditions

Reference is made to Drawing 2 in Appendix A and the Borehole Logs in Appendix C for details of the field work including sampling locations, visual soil classification, standard penetration test N values (where applicable), inferred stratigraphy, groundwater observations, and monitoring well installation details. It is noted that the subsurface conditions described below include boreholes and monitoring wells advanced as part of the Geotechnical Investigation completed by G2S.

The boundaries indicated on the borehole logs are intended to reflect transition zones for the purpose of hydrogeological assessment and should not be interpreted as exact planes of geological change.

7.1.1 Pavement Structure

In BH101 and BH103 to BH110, a surficial asphaltic concrete layer with a thickness ranging between approximately 90 to 150 mm was encountered over approximately 80 to 175 mm thick granular material. A surficial granular layer with a thickness of approximately 150 mm was encountered at BH102 location.

7.1.2 Fill

In all investigated boreholes, fill material was encountered below the pavement structure/granular. The fill consisted generally of clayey silt or silty sand/sand and gravel. Organic material was indicated within the fill layer at the locations of BH101, BH104, BH106 to BH108, and BH110. The fill material extended to depths ranging between 0.8 and 1.5 metres below the existing grade (m bgs). The moisture content for the fill ranged between 7 and 37%, indicating moist to wet conditions.

7.1.3 Silt

Silt material was encountered beneath the fill in BH102 and extended to a depth of approximately 2.3 m bgs. The SPT "N" values of this silt deposit ranged from 11 blows per 300 millimetres of penetration, indicating compact condition. The moisture content for the silt was in the order of 17%, indicating moist conditions.

7.1.4 Sand/Silty Sand/Sandy Silt

Sand/silty sand/sandy silt material was encountered beneath the fill in BH103 to BH105 and BH107 to BH110 and extended to depths ranging from approximately 3.8 and 6.1 m bgs. The SPT "N" values of this sand/silty sand/sandy silt deposit ranged between 10 and 30 blows per 300 millimetres of penetration, indicating compact to dense compactness. The moisture content of the silty sand/sandy silt till ranged between 3% and 21%, indicating moist to wet conditions.

7.1.5 Silty Sand/Sandy Silt Till

Silty sand/sandy silt till material was encountered beneath the fill in BH101 and BH106, beneath the silt in BH102, and beneath the sand/silty sand/sandy silt in BH103, BH104, BH109, and BH110, and extended to depths ranging from approximately 3.0 and 9.1 m bgs.

The SPT “N” values of this silty sand/sandy silt till deposit ranged between 12 to in excess of 50 blows per 300 millimetres of penetration, indicating compact to very dense compactness. The moisture content for the silty sand/sandy silt till ranged between 7% and 22%, indicating moist to wet conditions.

7.1.6 Clayey Silt Sill

Clayey silt till was encountered beneath the sand/silty sand/sandy silt in BH104, BH105, BH107 and BH108, beneath the silty sand/sandy silt till in the remaining investigated boreholes. The clayey silt till deposit extended to the depths ranged between approximately 4.0 and 12.2 m bgs. This clayey silt till. Boreholes BH101, BH103, and BH104 were terminated in this deposit. With “N” values ranging from 20 to in excess of 50 blows per 300 millimetres of penetration indicating the clayey sandy silt till deposit was classified as very stiff to hard in consistency. The moisture content for the clayey silt till ranged between 7% and 16%, indicating moist conditions. Boreholes BH101, and BH103 to BH104 were terminated in this deposit. Based on three (3) grain size analyses, the clayey silt till contained between 40 to 54% gravel, 17 to 19% sand, 21 to 34% silt, and 89 to 10% clay sized particles. Based on the laboratory results for two (2) selected samples of this deposit, the liquid limit ranged between 26% and 27%, and the plastic limit ranged between 18% and 19%, indicating low to moderate plasticity.

7.1.7 Shale Bedrock

Weathered to unweathered shale bedrock was encountered and/or inferred by the auger/sampler refusal at BH105, BH107, BH108 and BH110 and coring in BH102, BH106 and BH109 at elevations ranging between approximately 121.9 and 130.2 m asl. The approximate depth and elevation of the shale bedrock surface/probable shale bedrock surface at the borehole locations are presented in Table 3 below:

Table 3: Approximate Depth and Elevation of Shale Bedrock surface

Borehole ID	Depth of Shale Bedrock Surface Below Existing Grade (m)	Approximate Relative Elevation of Bedrock Surface (m asl)	Remarks
BH102	6.1	129.0	Proven by coring. (~Elev. 129.0 to 122.7 m)
BH105	9.1	126.2	Inferred by auger and sampler refusal
BH106	5.0	130.0	Proven coring. (~Elev. 129.8 to 124.2 m)
BH107	4.8	130.2	Inferred by auger and sampler refusal
BH108	9.1	125.4	Inferred by auger and sampler refusal
BH109	10.7	123.8	Proven coring. (~Elev. 123.6 to 119.2 m)
BH110	12.2	121.9	Inferred by auger and sampler refusal

Due to the method of drilling and sampling, the surface elevation of the bedrock can be different than indicated on the borehole logs. Typically, the till overlying the shale contains slabs of limestone that may give a false indication of the bedrock level. Based on our experience and the available published information, the upper portion of the bedrock is typically weathered and becomes more sound with depth.

The shale was typically grey of the Georgian Bay formation and contained increasing limestone/siltstone content. Based on the Ministry of Northern Development and Mines Map 2544, *Bedrock Geology of Ontario, Southern Sheet*, the bedrock in the Site vicinity consists of Georgian Bay Shale of the Upper Ordovician period. Sandstone, shale, dolostone, and siltstone (Lockport formation) lenses may also be encountered within the shale.

7.2 Groundwater Conditions

Groundwater was not encountered in the boreholes during drilling. The measured hydrostatic groundwater levels ranged from 134.3 to 130.6 m asl in the monitoring wells during the most recent round of groundwater level measurements (June 11, 2024). Groundwater levels are subject to seasonal fluctuations and variations in precipitation. A summary of groundwater data is included in the following table.

Table 4: Summary of Groundwater Levels

Monitoring Well I.D.	Ground Surface Elevation	Well Depth from Ground Surface (m)	Screened Interval Elevation (m) and Depth (m bgs)	Groundwater Elevation (m) (Depth mbgs)			
				Apr 12, 2024	May 6, 2024	May 13, 2024	Jun 11, 2024
BH/MW101	136.15	3.84	133.81-132.31 (2.34-3.84)	134.3 (1.83)	-	134.6 (1.60)	134.3 (1.90)
BH/MW106	135.00	10.78	127-32-124.22 (7.68-10.78)	132.1 (2.90)	-	132.2 (2.80)	132.3 (2.74)
MW1	134.03	5.94	131.19-128.09 (2.84-5.94)	130.6 (3.44)	130.6 (3.43)	130.6 (3.44)	130.6 (3.42)
MW2	134.54	6.17	131.47-128-37 (3.07-6.17)	130.8 (3.78)	130.8 (3.71)	130.9 (3.68)	130.9 (3.68)
MW3	133.95	4.31	132.74-129.64 (1.21-4.31)	-	130.7 (3.23)	130.7 (3.25)	130.7 (3.27)
MW4	135.38	5.05	133.43-130.33 (1.95-5.05)	131.9 (3.52)	131.9 (3.45)	131.0 (4.42)	131.7 (3.67)
MW201	135.53	4.55	134.08-130.98 (1.45-4.55)	-	134.0 (1.58)	133.9 (1.60)	-
MW202	135.39	4.57	133.92-130.82 (1.47-4.57)	-	133.8 (1.63)	133.7 (1.65)	133.6 (1.77)
MW203	135.13	4.80	133.44-130.34 (1.70-4.80)	-	133.1 (2.08)	-	133.0 (2.11)

Drawing 2 in Appendix A shows the monitoring well locations, measured groundwater levels and surface elevations.

Based on G2S' Site observations and short-term water level measurements, the groundwater table in the shallow aquifer underlying the Site appeared to be flowing to the southeast. The expected direction of groundwater flow in the Study Area is to the southeast, following surface topography towards Lake Ontario, located approximately 5.6 km southeast of the Site.

7.3 Estimated Hydraulic Conductivity

7.3.1 In-Situ Hydraulic Conductivity Testing

Falling head tests were carried out in three monitoring wells (BH/MW101, BH/MW106 and MW2) on June 11, 2024. The results of the analyses are presented in Appendix D. The hydraulic conductivities of the subsurface strata at the Site are as shown in the following table.

Table 5: Hydraulic Conductivity Estimates – Slug Testing

Monitoring Well I.D.	Ground Surface Elevation (m)	Elevation of Well Screen (m)	Stratum Captured by Well Screen	Hydraulic Conductivity (Rising Head Test, m/s)
BH/MW101	136.15	133.81-132.31 (2.34-3.84)	Silty sand till/silty clay till	7.5×10^{-7} m/sec
BH/MW106	135.00	127.32-124.22 (7.68-10.78)	Grey shale	5.9×10^{-8} m/sec
MW2	134.54	131.47-128.37 (3.07-6.17)	Sand	1.2×10^{-5} m/sec

7.3.2 Grain Size Analysis

Typical rates of hydraulic conductivity for the soil types found at this Site during the investigation are as follows (Freeze and Cherry, 1979):

- Silty sand till/silty clay till - 10^{-6} m/s 10^{-12} m/s
- Shale - 10^{-9} m/s 10^{-12} m/s
- Fine sand - 10^{-2} m/s 10^{-6} m/s

The grain size analysis curves confirming the soil classifications and hydraulic conductivity ranges are presented in Appendix E.

7.4 Groundwater Quality

The laboratory certificate of analysis, including chain-of-custody record, compared to the City of Mississauga storm sewer discharge parameters and the Peel Region sanitary sewer discharge parameters are included in Appendix F.

Based on the results of chemical analysis on samples tested, the quality of the groundwater samples complied with the applicable guidelines with the following exception below.

Table 6: Exceedances of the City of Mississauga Sewer Discharge Criteria

Sample Location	Parameter	Region of Peel Sanitary Sewer Discharge Criteria (mg/L)	Region of Peel Storm Sewer Discharge Criteria (mg/L)	Concentration (mg/L)		
				Sample I.D.		
				BH/MW106-UF (sample 1)	BH/MW106-UF (sample 1)	BH/MW106-F
BH/MW106	Total Suspended Solids	350	15	153	205	9
	Aluminium	50	1.0	4.04	4.47	<0.01

Notes: UF – Unfiltered; F – Filtered; NT – Not tested, NC – No criteria
Italics – Concentration exceeds City of Hamilton Sanitary Sewer Discharge Criteria
Bold – Concentration exceeds City of Hamilton Storm Sewer Discharge Criteria

8. Construction Dewatering Analysis

Based on excavation locations, dimensions, and depths provided for this report, the soil excavation and subsequent construction of the 2-level underground parking structure will require dewatering to lower the groundwater table within the excavation to maintain a dry excavation base and sidewalls.

Temporary dewatering requirements are dependent on factors such as excavation parameters (excavation dimensions, infrastructure invert elevations, the number of concurrent excavations, etc.), hydrogeological conditions at the Site (groundwater levels, soil/bedrock hydrogeological parameters, etc.), construction and dewatering methodologies (open cuts, dewatering pits, sumps, wellpoints, etc.), and the amount of groundwater drawdown required to achieve and maintain dry working conditions and stable excavations.

Additionally, factors such as the use of shoring would be expected to influence the rate of groundwater inflow into the excavation. The calculations provided below assume an open excavation as a conservative factor of safety.

It is important to note that the dewatering contractor retained to perform construction dewatering is solely responsible for achieving and maintaining dry working conditions at the Site at all times. The calculations and dewatering rates/volumes provided below are not directives for a dewatering contractor, and the dewatering contractor must review the information, calculations, and recommendations provided as part of their own assessment of dewatering requirements to determine appropriate methodologies and designs for their construction dewatering project.

8.1 Excavation Requirements and Temporary Construction Dewatering Assumptions

During the construction project dewatering, operations are expected to take place twenty-four hours per day to maintain a dry excavation. Dewatering calculations include a number of variables such as the static groundwater level, soil hydraulic conductivity, aquifer thickness, confined aquifer conditions, etc., that can be adjusted to provide conservative buffers to account for conditions beyond those encountered in the available monitoring wells.

Table 7 below summarizes the preliminary excavation requirements for the proposed bulk excavation of the Site. Additionally, the table below includes the following buffers as factors of safety:

- A buffer of 1 m for the excavation invert elevation to ensure groundwater is drawn down 1 m below the base of the excavation to maintain a dry work surface. The excavation invert is taken as Elev. 128.0 m asl (7 m bgs), which is understood to be the lowest excavation depth for the construction of the underground parking (two levels).
- A buffer of approximately 5% for the proposed underground parking excavation area (12,679 m²) to account for an excavation large enough to accommodate working around the excavation perimeter.
- A “squared off” excavation shape to account for excavation dimension adjustments during the construction process.

- An initial groundwater elevation in the area of the underground parking excavation corresponding to the highest measured groundwater level from the on-Site monitoring wells (Elev. 134.60 m asl measured at BH/MW101 on May 13, 2024).

Table 7: Preliminary Excavation Requirements

Excavation	Excavation Area (m ²) (+5%)	Excavation Depth (m asl and m bgs) (-1 m)	Groundwater Elevation (m asl)
2-Level of Underground Parking	13,313 m ²	127.0 (7)	134.60

It is very important to consider that all construction dewatering calculations provided in this report are based on the draft development concept design provided by the client. If design changes or other site plan modifications result in changes to the information listed above, the dewatering calculations below will need to be revised accordingly.

8.1.1 Excavation

It is understood the following concurrent tasks should be contemplated for construction dewatering:

- Concurrent excavation of the full footprint for the underground parking structure.

It is very important to consider that if modifications to the concurrent construction tasks are desired, the calculated dewatering requirements would need to be reassessed.

8.1.2 Dewatering Assumptions

Dewatering calculations have been prepared for the concurrent tasks noted above based on the following assumptions to account for variability in soil and groundwater conditions:

- Aquifer hydraulic conductivity of 4.27×10^{-6} m/s (the average measured hydraulic conductivity from slug test analysis completed by G2S in June 2024).
- An aquifer depth of Elev. 124.00 m asl.
- An initial groundwater elevation in the area of the underground parking excavation corresponding to the highest measured groundwater level from the on-Site monitoring wells (Elev. 134.60 m asl measured at BH/MW101 on May 13, 2024).

8.2 Dewatering Calculations

To estimate the steady-state dewatering flow rate needed to maintain dry conditions for the excavations at the Site, the following equation (for radial flow to an unconfined aquifer) from Powers (2007) was used:

$$Q = \frac{\pi K(H^2 - h_w^2)}{\ln\left(\frac{R_o}{r_e}\right)}$$

Where:

Q = Flow Rate (m³/sec)

H = Initial Saturated Thickness (Piezometric Head) of Aquifer (m)

h_w = Dewatered Saturated Thickness (Piezometric Head) of Aquifer (m)

K = Soil Hydraulic Conductivity (m/sec)

r_e = Effective radius, $r_e = \sqrt{(excavation\ area/\pi)}$ (m)

R_o = Radius of influence, $R_o = 3000*(H-h_w)*\sqrt{K}$ (m)

Using the assumptions listed in Section 8.1 and its subsections, the steady-state inflow rates and radii of influence listed in the table below were estimated.

Table 8: Steady-State Dewatering Requirements

Excavation	Daily Dewatering Rate (L/day)	Radius of Influence (m)
2-Levels of Underground Parking	219,997	~47.1

8.2.1 Calculated Dewatering Rates, With Factors of Safety

It is important to consider that dewatering requirements will be highest at the start of the dewatering process when the volume of water stored within the pore spaces of the overburden deposits must be extracted. This storage must be accounted for to allow for rapid achievement of drawdown targets.

Initial drawdown of the overburden soils within a short period of time would be expected to require additional pumping capacity. An initial drawdown requirement has been calculated assuming a surcharge of 50% of the estimated steady state dewatering rate.

Additionally, it is important to consider that during and after precipitation events significantly higher dewatering flow rates may be required to account for direct precipitation and surficial runoff falling into an excavation. For the purpose of assessing precipitation/runoff dewatering requirements, a 25 mm storm event within 24 hours has been assumed.

The table below provides a summary of the calculated dewatering rates and factors of safety for the bulk excavation of the Site.

Table 9: Calculated Maximum Total Dewatering Rate Including Factors of Safety

Excavation	Steady State Dewatering (L/day)	Initial Drawdown Surcharge (L/day)	Precipitation and Runoff (L/day)	Maximum Total Dewatering Requirement (L/day)	Maximum Total Dewatering Requirement with 1.5x Safety Factor (L/day)
2-Levels of Underground Parking	219,997	109,998	332,822	662,818	994,227

The totals shown in the table above indicate a potential maximum dewatering requirement of up to 994,227 L/day for simultaneous dewatering of the entire Site. As the calculated dewatering requirements are more than 400,000 L/day, a Permit to Take Water (PTTW) will be required.

While the conservative assumptions and factors of safety discussed in the preceding sections combine to create very conservative dewatering calculations, it is important to consider the variable nature of the overburden soils and aquifer and the potential for groundwater ingress from upper and lower stratigraphic units.

The potential maximum dewatering requirements outlined above are reasonable based on the information available; however, performing one or several pumping tests of the shallow overburden aquifer in advance of designing and installing mitigation systems would provide empirical data that could be used to refine maximum daily pumping requirements. Additionally, deep test pits can be excavated to monitor the short-term groundwater conditions. The client, the construction contractor, and the dewatering contractor shall review the dewatering calculations provided above and make their own determinations regarding the potential maximum daily dewatering requirements for the project.

8.3 Long-Term (Permanent) Dewatering Requirements

It is understood that long term (permanent) dewatering is being considered for the project. Designing the underground levels to be waterproof and resist hydrostatic uplift is always recommended over perpetual dewatering due to the risk of pump failure or piping infrastructure failure over time.

Long-term dewatering calculations (based on the formula provided in Section 8.2 above) were prepared to evaluate permanent dewatering requirements using the following assumptions:

- Aquifer hydraulic conductivity of 4.27×10^{-6} m/s (the average measured hydraulic conductivity from slug test analysis completed by G2S in June 2024).
- An aquifer depth of Elev. 124.00 m asl.
- An initial groundwater elevation in the area of the underground parking excavation corresponding to the highest measured groundwater level from the on-Site monitoring wells (Elev. 134.60 m asl measured at BH/MW101 on May 13, 2024).
- An assumed foundation footprint of 12,679 m² for the underground parking, and an underslab drainage elevation of 7 m bgs (elevation 128.00 m asl).

The table below provides the conservatively estimated long term maximum dewatering requirement for the underground parking garage.

Table 10: Long Term (Permanent) Dewatering Requirements

Excavation	Long Term Daily Dewatering Rate (L/day)	Long Term Daily Dewatering Rate with 1.5x Safety Factor (L/day)
2-Levels of Underground Parking	224,630	336,994

As the calculated long-term dewatering requirements are more than 50,000 L/day, a PTTW would be required for long-term permanent dewatering.

9. Permit Requirements and Dewatering Discharge

Ontario Regulation 387/04 requires authorization from the Ministry of the Environment, Conservation, and Parks (MECP) for all water takings over 50,000 L/day. Ontario Regulation 63/16 specifies that for temporary construction dewatering at rates between 50,000 and 400,000 L/day an Environmental Activity and Sector Registry (EASR) may be obtained in lieu of a Permit to Take Water (PTTW). Dewatering at rates of more than 400,000 L/day require a PTTW to authorize groundwater withdrawal.

As shown in Section 8.2.1, construction dewatering will have a potential maximum dewatering requirement of up to 994,227 L/day; therefore, an PTTW would be required for the proposed temporary construction dewatering.

As shown in Section 8.3, permanent dewatering will have a potential maximum dewatering requirement of up to 336,994 L/day; therefore, a PTTW would be required for the long-term permanent dewatering.

9.1 Dewatering Discharge

On May 13, 2024, water chemistry samples were obtained from one monitoring well (BH/MW106), identified as sample BH/MW106-UF (unfiltered) and BH/MW106-F (filtered). The laboratory Certificates of Analysis are included in Appendix F for reference.

The water chemistry samples were obtained using low flow pumps, helping to minimize the inclusion of sediments into the water samples.

Water chemistry analysis results were compared to the City of Mississauga storm sewer discharge parameters and the Peel Region sanitary sewer discharge parameters

9.1.1 City of Mississauga Storm Sewer Use By-Law

Groundwater chemistry samples collected from monitoring well BH/MW105 exhibited exceedances of the following City of Mississauga Storm Sewer Use By-Law criteria limits:

- Total Suspended Solids (TSS) in the unfiltered groundwater sample (262 and 153 mg/L versus criteria of 15 mg/L).
- Aluminum in the unfiltered groundwater sample (4.04 and 4.47 mg/L versus criteria of 0.4 mg/L).

Based on the analysis results, discharge to municipal storm sewers would require treatment such as settling tanks with flocculation and/or mechanical filtration (using filter bags) to reduce TSS and aluminium concentrations to acceptable levels. The filtered sample collected from BH/MW106 met the applicable criteria for discharge to municipal storm sewers; therefore, the above noted treatment options would be viable dewatering solutions.

During construction dewatering operations, regular sampling and analysis of discharge would be required to confirm continued compliance with the City of Mississauga Storm Sewer Use By-Law. In the event parameter exceedances were measured, treatment of discharge would need to be adjusted/modified/supplemented to City of Mississauga Storm Use By-Law criteria limits.

9.1.2 Region of Peel Sanitary Sewer Use By-Law

Groundwater chemistry samples did not exhibit any exceedances of the Region of Peel Sanitary Sewer Use By-Law criteria limits.

Based on the analysis results, discharge to municipal sanitary sewers would not require treatment prior to discharge. During construction dewatering operations, regular sampling and analysis of discharge would be required to confirm continued compliance with the Region of Peel Sewer Use By-Law. In the event parameter exceedances are measured, treatment such as settling tanks with flocculation and/or mechanical filtration (using filter bags), or additional specialized treatment for specific parameters, may be required to achieve Region of Peel Sanitary Sewer Use By-Law criteria limits.

9.2 Evaluation of Potential Impacts

9.2.1 Local Groundwater Sources

The Site and properties within an approximate 250 m radius of the Site were searched within the current MECP Water Well Information System (WWIS) database. A total of 18 water well records were located within the search radius. The locations of the water well records are shown on Drawing 1 in Appendix A and a copy of the well record summary is included in Appendix B.

The use of the water wells within the 250 m radius include two monitoring (MO), five monitoring testhole (MT), one not used (NU) and ten wells that did not identify their use. Although ten wells did not identify their use, since the City of Mississauga supplies drinking and potable water via Lake Ontario, and the Site is located within a developed urban area, it is unlikely any of the wells within the search radius are for drinking water purposes.

9.2.2 Baseflow Reduction in Waterbodies

Etobicoke Creek is located approximately 530 m northeast of the Site. The water body is located outside the radius of influence (47.1 m) and as such no reduction in baseflow is anticipated.

9.2.3 Induced Movement of Contaminant Plumes

Based on the subsurface investigations completed for the Site, an isolated area in the northwest portion of the property has VOCs in groundwater at concentrations above the Table 3 Site Condition Standards. A remedial action plan has not yet been initiated to remove the VOC impacts, but it is expected that action will be taken prior to the start of construction. VOC analysis should be added to the dewatering discharge monitoring program.

The radius of influence has been calculated to be approximately 47.1 m during construction dewatering. There is potential for groundwater contamination from off-Site sources within these distances to be drawn toward the Site, depending on conditions at the time of pumping. Should this be the case, treatment of groundwater contamination may be required prior to discharge to the sewer. Additional confirmatory sampling and analyses of the construction dewatering discharge are recommended to confirm compliance with the criteria of the receiving system to be used.

9.2.4 Confined Groundwater Conditions and Excavation Bottom Heave

While confined aquifer conditions were not observed in the monitoring wells installed on-Site, bottom heave occurring in excavations due to unweighting of the soil/bedrock as a result of excavations removing soil/bedrock weight overlying pressurized aquifer conditions should still be considered a possibility as a conservative factor of safety. Diligent observation of conditions in the excavation is recommended to monitor for potential bottom heaving. In the unlikely event bottom heaving or other issues due to pressurized aquifer conditions occur, the construction and dewatering strategies for the project would need to be revised.

9.2.5 Potential Ground Subsidence in Adjacent Structures (Settlement)

The potential ground subsidence (settlement) of the soil within the zone of influence due the lowering of the groundwater level during construction dewatering was assessed considering the maximum drawdown to be achieved. The ground settlement results from the increase in effective stresses, which could be estimated as 10 kPa per each one metre of drawdown, caused by the lowering of the groundwater level and subsequent decrease in pore pressure. In addition, settlement associated with dewatering may occur due to the loss of fine particles (migration of fines) within the dewatering system as a result of pumping. Therefore, adequate filtration at the system ingress points should be maintained all times to reduce the potential of soils migration through the system.

9.2.5.1 Potential Settlement due to Increase in Effective Pore Water Space

The maximum amount of settlement is expected to occur in the area adjacent to maximum drawdown points, and the potential of settlement will decrease substantially towards the radius of influence limit. The total drawdown required is 8 metres, which includes the depth of excavation (7.0 mbgs) plus the additional 1.0 metre drawdown to maintain dry working conditions. For our investigation, we reference the highest groundwater level estimated at ~Elev. 134.60 masl. Therefore, the drawdown will be within the native sand, silty sand/sandy silt, silty sand/sandy silt till and the cohesive clayey silt till deposit. The maximum thickness of the cohesionless deposit is 4.6 m and the thickness of the cohesive clayey silt till deposit ranged between 0.5 to 4.5 m. Given the presence of shale bedrock at depths of approximately 4.3 to 10.7 mbgs below this cohesive deposit, the thickness considered for deformation analysis would be approximated to 4.5 metres.

The anticipated settlement during construction is primarily due to consolidation within the underlying native clayey silt till. Assuming the soil is normally consolidated and that both the increase in effective vertical stress and the coefficient of compressibility remain constant with depth, a simplified one-dimensional calculation can be employed to estimate settlement:

$$S_c = m_v \Delta\delta H$$

Where:

S_c : Total consolidation of the clay deposit

$\Delta\delta$: The effective vertical stress increment

m_v : The coefficient of the volume compressibility

H: The thickness of the clay deposit

Using approximate parameters, the potential settlement at the area adjacent to the shoring (the area of maximum drawdown) was estimated to be in the order of 9 mm.

9.2.5.2 *Potential Settlement due to Fine Particles Migration*

The other potential cause for settlement during construction dewatering is the loss of fine soil particles into the dewatering system, which in turn may trigger the creation of voids/cavities within the subsurface stratum and lead to further settlement. High-speed pumping can create steep hydraulic gradients around the dewatering wells or trenches. This increased hydraulic gradient can lead to a higher velocity of groundwater flow, which can cause soil particles to be mobilized and carried away, particularly fines. This process can lead to additional settlement and potentially create voids or loose zones in the soil structure. As such, mitigation measures are recommended to reduce/eliminate the risk of settlement during temporary dewatering.

9.2.6 Proposed Mitigation Measures for Potential Ground Subsidence

Considering the ZOI (approximately 47.1 m), as well as the temporary nature of the operation, the potential settlement under these conditions on the surrounding structures/utilities is expected to be relatively insignificant. The following monitoring and mitigative measures are recommended for buildings/structures considered sensitive to ground settlement and located within the radius of influence:

- A pre-construction condition survey of buildings/structures located within the estimated Zone of Influence as the baseline condition prior to dewatering.
- Installation of settlement monitoring monuments for buildings/structures and underground utilities geotechnically considered susceptible to potential settlement.
- Surveying of the above-noted settlement monuments prior to dewatering and during dewatering twice a week and provide the collected data to the geotechnical engineer of record (G2S) for evaluation. The estimated potential and actual settlements should also be reviewed by a structural engineer to assess the potential damage to existing structures.

If the above-noted evaluation indicates an undesirable deformation, the dewatering scope will require modification. If the surveying records indicated no significant deformation after a period of 30 days, the settlement monitoring can be terminated.

In addition, the following mitigation measures should be put in place to reduce/eliminate the risk of settlement due to fine particles migration during temporary dewatering:

- The dewatering system should be designed to better control the pumping discharge rate, the discharged water velocity, and to provide adequate filtration for the pumping equipment.
- Drawdown should be monitored and be assessed regularly during the different stages of dewatering to make sure that the assumed soil property and the estimated drawdown rates are consistent with the field results.

- The TSS and aluminum levels in the discharged water should be monitored and analyzed on regular basis during construction.
- The fine particles accumulation in the sedimentation tanks must be monitored during construction.

If soldier piles and lagging shoring system was used, geotextile filter fabric should be installed behind the lagging boards to prevent the migration of fine through the spaces between the boards.

9.2.7 Dewatering Discharge Quantity and Quality

The construction dewatering discharge receptor was not known at the time of the issuance of this report; however, discharge to local storm or sanitary sewers is the most likely receptor in the urban setting of the Site.

Based on the limited chemical test results of the unfiltered groundwater samples analyzed, the quality of the water did not comply with the City of Mississauga storm sewer discharge by-law criteria for TSS or aluminum.

It is important to note that the elevated levels were measured in an unfiltered sample which is not representative of the dewatering discharge from a decantation tank or equivalent treatment system to remove the parameters exceeding the criteria. Treatment and/or removal of the parameters exceeding the criteria prior to discharge will be a key component of dewatering mitigation. Additional confirmatory sampling and analyses of the construction dewatering discharge are recommended to confirm compliance with the criteria of the receiving system to be used.

The VOC impacts in groundwater in the northwest section of the property should be remediated prior to construction or treated prior to discharge. VOC analysis should be added to the discharge monitoring program.

Discharge permits are required from the City of Mississauga for short-term groundwater discharge to the municipal sewers.

9.2.8 Monitoring Well Decommissioning

The Site owner is considered to be the well owner of the monitoring wells installed at the Site ("well owner" Section 1.0, Regulation 903). When the monitoring wells are no longer required, it is the owner's responsibility to arrange for abandonment in accordance with the Ontario Water Resources Act, O. Reg. 903/90, amended to O. Reg. 372/07.

10. Summary and Conclusions

Based on the proposed development features and our findings of the Site setting, subsurface conditions, results of field work, and laboratory analyses, the hydrogeological site assessment salient points for the dewatering needs are summarized in the following paragraphs.

1. It is understood that development plan includes the demolition of the existing commercial plaza, and the construction of a high rise building which will consist of three towers (13, 18, and 20 storeys) and two levels of underground parking.
2. The subsurface conditions generally consist of fill materials overlying deposits of silt, sand/silty sand/sandy silt, silty sand/sandy silt till, clayey silt till and shale bedrock. Bedrock was encountered and/or inferred by auger/sampler refusal at boreholes BH105, BH107, BH108 and BH110 and coring in boreholes BH102, BH106 and BH109 at depths ranging between approximately 121.9 and 130.2 m asl.
3. The measured hydrostatic groundwater levels ranged from 134.3 to 130.6 m asl in the monitoring wells during the most recent round of groundwater level measurements (June 11, 2024).
4. The water-bearing units that will be exposed in the excavations during construction include fill, silt, sand/silty sand/sandy silt, silty sand/sandy silt till, clayey silt till, and shale bedrock, with calculated K values between 1.2×10^{-5} and 5.9×10^{-8} m/sec.
5. The required groundwater lowering (drawdown) is recommended 1 m below the base of the excavation to maintain dry working conditions.
6. The construction dewatering flow rate (short-term) is summarized in the following table:

Calculated Maximum Total Dewatering Rate Including Factors of Safety

Excavation	Steady State Dewatering (L/day)	Initial Drawdown Surcharge (L/day)	Precipitation and Runoff (L/day)	Maximum Total Dewatering Requirement (L/day)	Maximum Total Dewatering Requirement with 1.5x Safety Factor (L/day)
2-Levels of Underground Parking	219,997	109,998	332,822	662,818	994,227

7. The permanent dewatering flow rate (long-term) is summarized in the following table:

Long Term (Permanent) Dewatering Requirements

Excavation	Long Term Daily Dewatering Rate (L/day)	Long Term Daily Dewatering Rate with 1.5x Safety Factor (L/day)
2-Levels of Underground Parking	224,630	336,994

8. Construction dewatering will require maximum daily dewatering rates of up to 994,227 L/day; therefore, a PTTW would be required for the proposed temporary construction dewatering.
9. Long-term dewatering will require maximum daily dewatering rates of up to 336,994 L/day; therefore, a PTTW would be required for the proposed temporary long-term dewatering.
10. Based on the groundwater chemical testing results, it was found that for discharge to City of Mississauga storm and sanitary sewers, the groundwater quality in the unfiltered groundwater sample did not comply with the Region of Peel storm sewer discharge by-law criteria for total suspended solids (TSS) and aluminium. It is important to note that the elevated levels were measured in an unfiltered sample which is not representative of the dewatering discharge from a decantation tank or equivalent treatment system to remove the suspended solids and phosphorous. Treatment and/or removal of suspended solids and phosphorous prior to discharge will be a key component of dewatering mitigation. Additional confirmatory sampling and analyses of the construction dewatering discharge are recommended to confirm compliance with the criteria of the receiving system to be used.
11. All monitoring wells and dewatering wells should be abandoned in accordance with the Ontario Regulation 903, as amended. The Site owner is considered to be the well owner of the monitoring wells installed at the Site (“well owner” Section 1.0, Regulation 903). When the monitoring wells are no longer required, it is the owner’s responsibility to arrange for abandonment in accordance with Ontario Water Resources Act–R.R.O. 1990, Regulation 903 – Amended to O. Reg. 128/03.

11. References and Supporting Documentation

- a) Freeze, R.A. and Cherry, J.A. (1979) Groundwater. Prentice-Hall, Inc., Englewood Cliffs.
- b) *“Guidance on Sampling and Analytical Methods for Use at Contaminated Sites in Ontario”* Ministry of the Environment of Ontario, December 1996.
- c) Singer SN, Cheng CK, Scafe MG. (2003). *The Hydrogeology of Southern Ontario, Second Edition*, Report from the Ontario Ministry of the Environment.
- d) *The Ontario Water Resources Act – R.R.O. 1990, Regulation 903 – Amended to O. Reg. 128/03, August 2003.0.8*
- e) *“Protocol for Analytical Methods Used in the Assessment of Properties Under Part XV.1 of the Environmental Protection Act”, March 2004.*
- f) *Ontario Regulation 153/04 (made under the Environmental Protection Act), May 2004, as amended.*
- g) *Environmental Protection Act, R.S.O. 1990, Chapter E.19, as amended, September 2004.*
- h) *“Phase One Environmental Site Assessment, 3403-3445 Fieldgate Drive, Mississauga, Ontario”,* prepared by Pinchin, Pinchin File. 315068, dated October 3, 2022
- i) *“Phase Two Environmental Site Assessment, 3403-3445 Fieldgate Drive, Mississauga, Ontario”,* prepared by Pinchin, Pinchin File. 315068.001, dated December 22, 2022
- j) *“Phase One Environmental Site Assessment Update, 3403-3445 Fieldgate Drive, Mississauga, Ontario”,* prepared by G2S, Reference G2S24018A, dated May 2024.
- k) *“Phase Two Environmental Site Assessment Update, 3403-3445 Fieldgate Drive, Mississauga, Ontario”,* prepared by G2S, Reference G2S24018B, dated May 2024.
- l) *“Geotechnical Investigation, Proposed Mixed Use Development, 3403-3445 Fieldgate Drive, Mississauga, Ontario”,* prepared by G2S, Reference G2S24018C, dated July 2024.

12. Limitations

The hydrogeological advice and recommendations provided in this report are based on the information obtained during this investigation. It may be possible that the subsurface conditions vary between and beyond the investigated borehole and monitoring well locations. For the purpose of this report, it is assumed that the conditions outside of and between the exact borehole locations are similar to the conditions observed in the boreholes. The change in subsurface stratigraphy reported on the borehole logs has also been interpreted based on non-continuous sampling, therefore, changes in stratigraphy as shown on the borehole logs and as discussed in this report should not be regarded as exact lines of geological change. The subsurface conditions at the Site may change with the passage of time and/or by human intervention.

The findings along with the hydrogeological advice and recommendations provided in this report are limited to the conditions at the Site at the time of this investigation as described herein. Conclusions presented in this report should not be construed as legal advice. If Site conditions or applicable standards change or if any additional information becomes available at a future date, changes to the findings, conclusions and recommendations in this report may be necessary.

Through any subsurface investigation by boreholes and/or monitoring wells, it may not be possible to identify all aspects of the subsurface conditions at the Site that could affect construction costs, techniques, equipment, and scheduling. Contractors bidding on or undertaking work on the project must be directed to draw their own conclusions as to how the subsurface conditions may affect them, based on their interpretation of the subsurface conditions and/or their own investigations.

This report has been prepared for the sole benefit of Sajecki Planning Inc. and is intended to provide hydrogeological advice and recommendations based on the subsurface conditions investigated in the monitoring wells on-Site. This report is the copyright of G2S Consulting Inc. (G2S) and may not be used by any other person or entity without the expressed written consent of Sajecki Planning Inc and G2S. Any use which a third party makes of this report, or any reliance on decisions made based on it, is the responsibility of such third parties. G2S accepts no responsibility for damages, if any suffered by any third party as a result of decisions made or actions based on this report. It is recognized that City of Mississauga in their capacity as the planning and building authority under Provincial statues, may make use of and rely upon this report cognizant of the limitations thereof, both as are expressed and implied.

13. Closing Remarks

We trust this report is satisfactory for your purposes. Should you have any questions, please do not hesitate to contact this office.

Yours truly,

G2S Consulting Inc.



Geoff Bell, P. Geo (limited)
Principal, Senior Geoscientist



Steve Campbell, P. Geo
Principal, Senior Geoscientist

**Appendix A:
Drawings**



- LEGEND**
- APPROXIMATE SITE BOUNDARY
 - APPROXIMATE 250 m RADIUS STUDY AREA
 - APPROXIMATE WATER WELL LOCATION BASED ON MECP WELL RECORD MAP

REFERENCE:
DRAWING REPRODUCED USING CITY OF MISSISSAUGA AND MECP WELL RECORD MAP


TITLE:
MECP WATER WELL RECORD LOCATION PLAN

CLIENT:
SAJECKI PLANNING INC.

LOCATION:
3403 - 3445 FIELDGATE DRIVE,
MISSISSAUGA, ONTARIO

PROJECT NO.: G2S24018D

DRAWING:	1
SCALE:	AS SHOWN
DATE:	JULY 2024
DRAWN BY:	RL
FILE NAME:	G2S24018D.dwg





LEGEND

- APPROXIMATE SITE BOUNDARY
- BOREHOLE ADVANCED BY G2S (APRIL 2024)
- BOREHOLE / MONITORING WELL ADVANCED BY G2S (APRIL 2024)
- BOREHOLE ADVANCED BY G2S (MARCH 2024)
- BOREHOLE/GROUNDWATER MONITORING WELL ADVANCED BY G2S (MARCH 2024)
- BOREHOLE/GROUNDWATER MONITORING WELL ADVANCED BY OTHERS (NOVEMBER 2022)
- DAMAGED BOREHOLE/GROUNDWATER MONITORING WELL ADVANCED BY OTHERS (NOVEMBER 2022)
- 88.88 GROUND SURFACE ELEVATION (m)
- 88.88 MEASURED GROUNDWATER ELEVATION (m) (MAY 13, 2024)

REFERENCE:

DRAWING REPRODUCED USING THE CITY OF MISSISSAUGA INTERACTIVE MAPPING WEBSITE

TITLE:

BOREHOLE AND MONITORING WELL LOCATION PLAN

CLIENT:

SAJECKI PLANNING INC.

LOCATION:

3403 - 3445 FIELDGATE DRIVE
MISSISSAUGA, ONTARIO

PROJECT NO.: G2S24018D

DRAWING:

2

SCALE:

AS SHOWN

DATE:



JULY 2024

DRAWN BY:

RL

FILE NAME:

G2S24018D.dwg

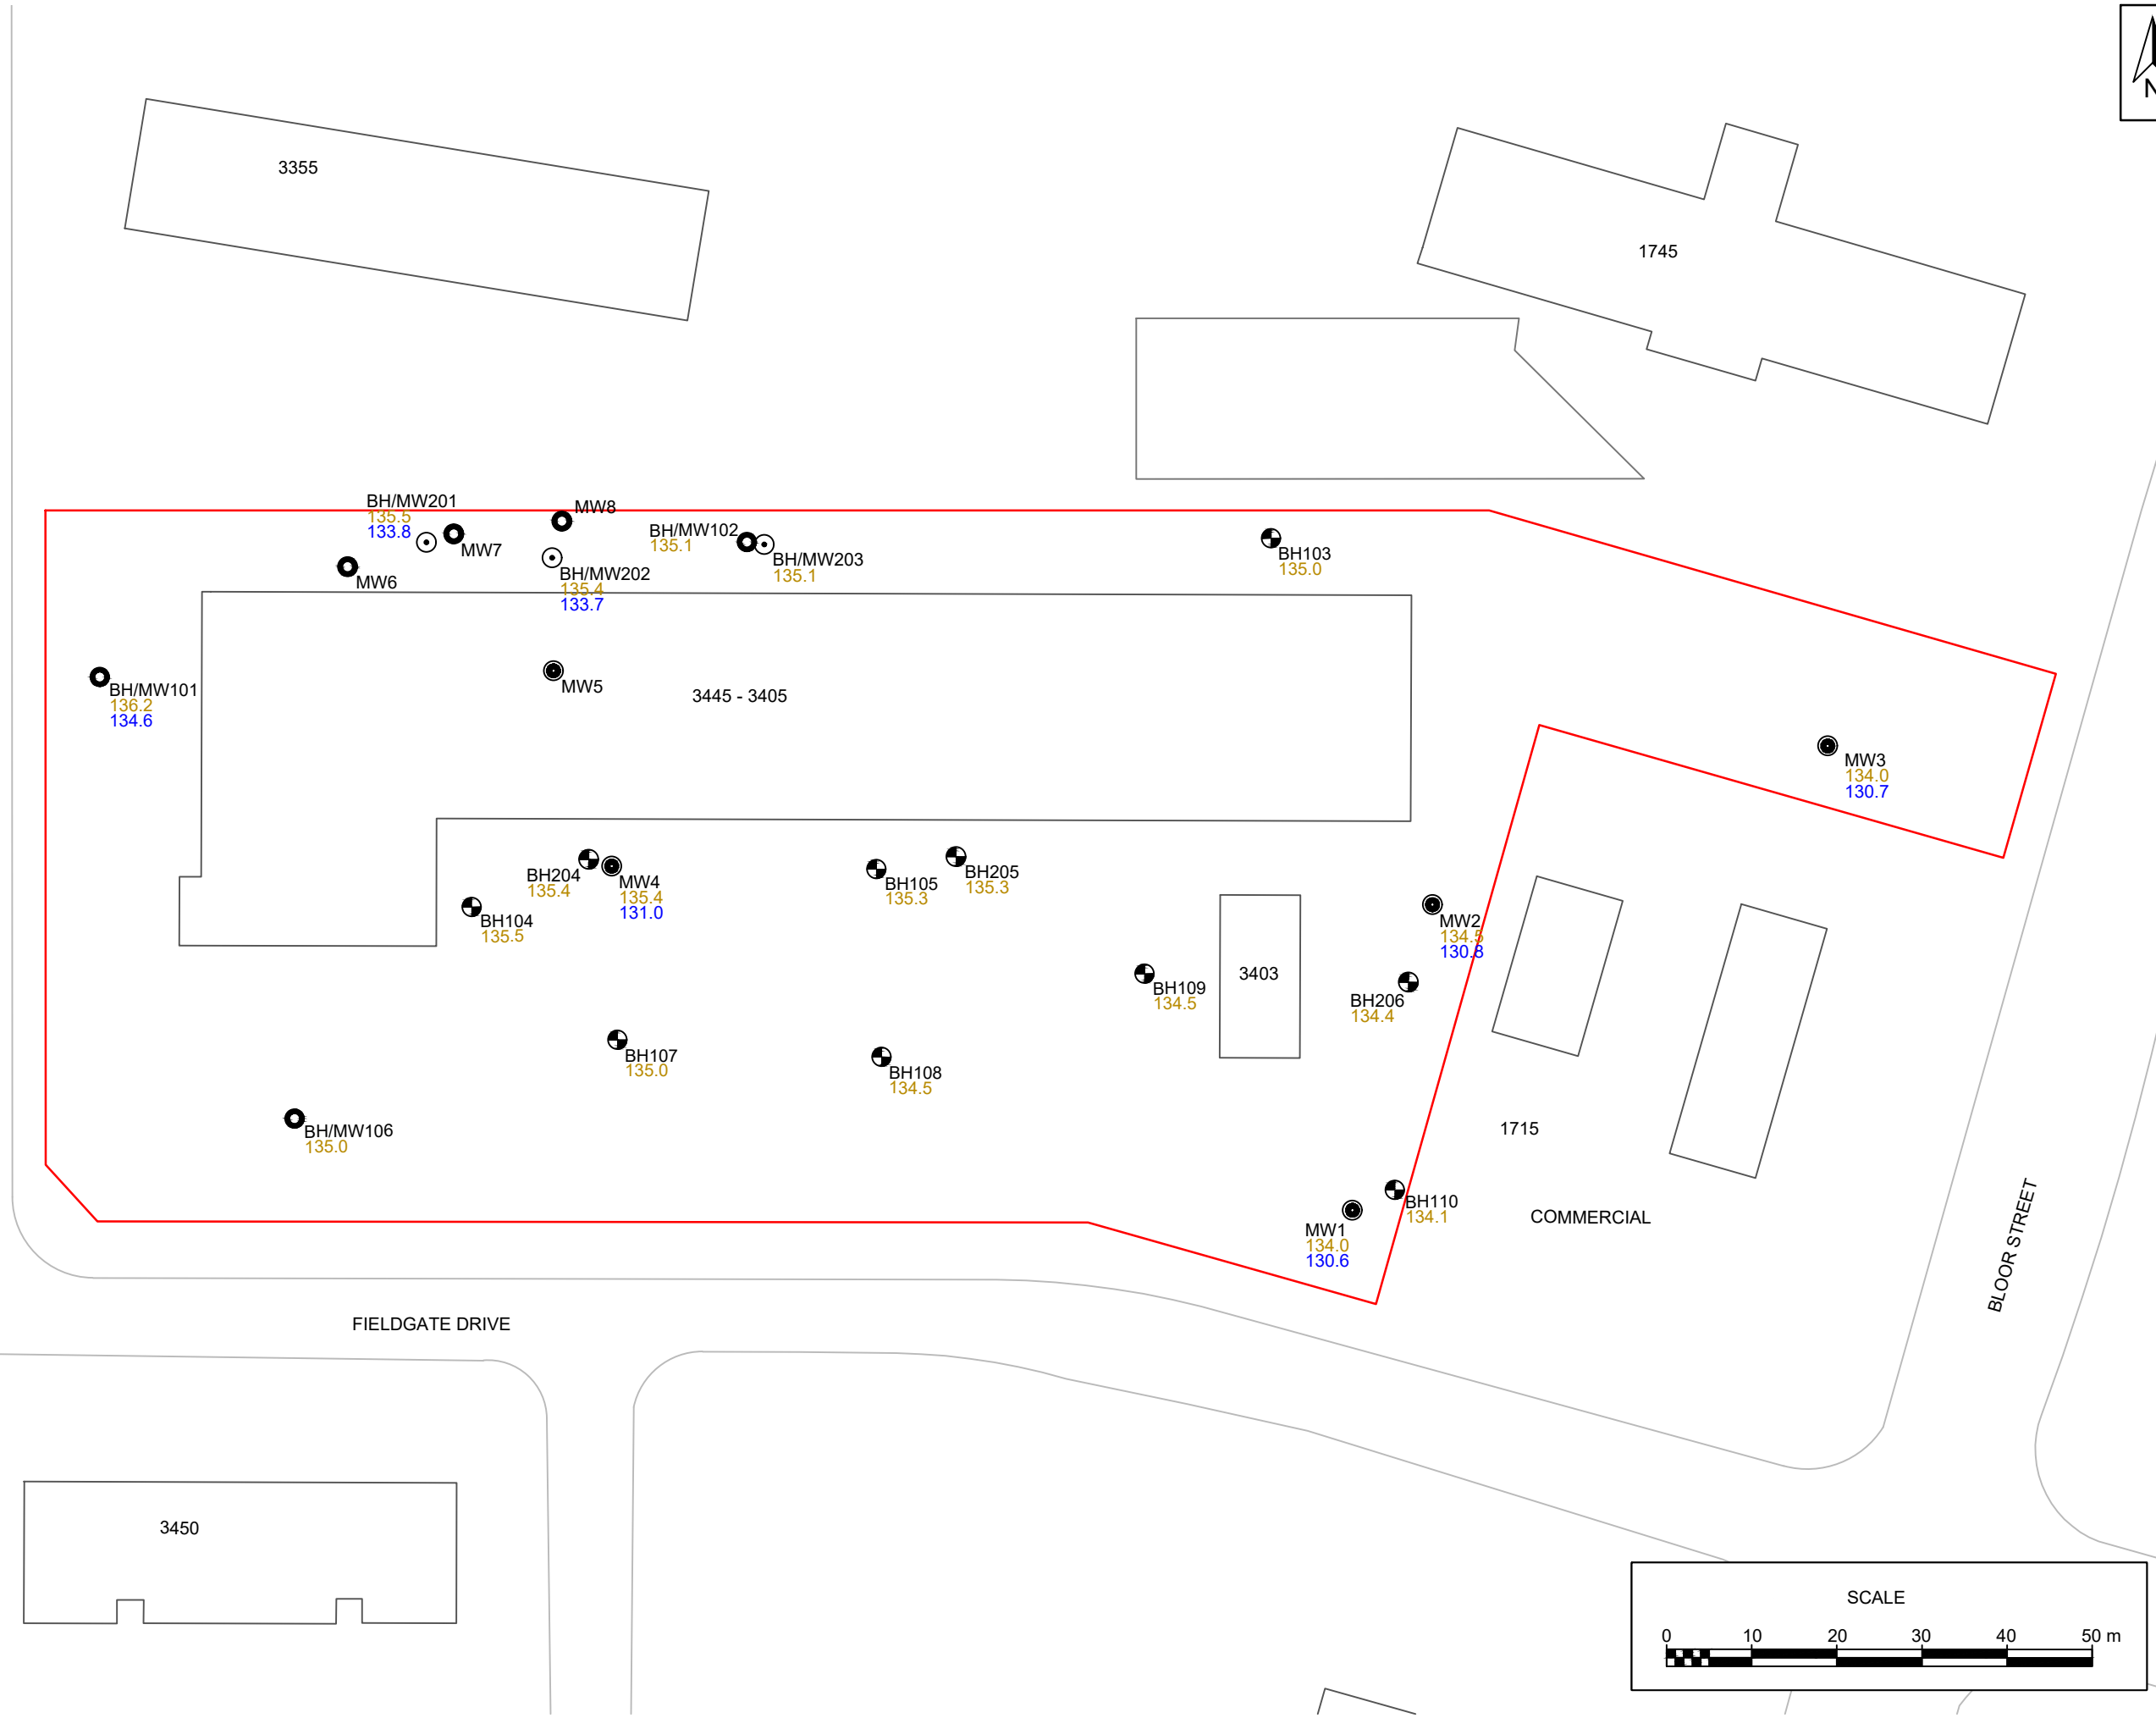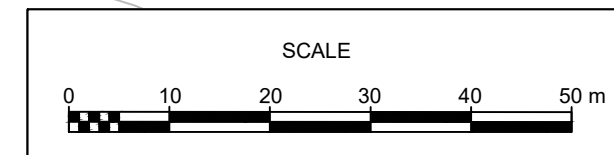



- LEGEND**
- APPROXIMATE SITE BOUNDARY
 - BOREHOLE ADVANCED BY G2S (APRIL 2024)
 - BOREHOLE / MONITORING WELL ADVANCED BY G2S (APRIL 2024)
 - BOREHOLE ADVANCED BY G2S (MARCH 2024)
 - BOREHOLE/GROUNDWATER MONITORING WELL ADVANCED BY G2S (MARCH 2024)
 - BOREHOLE/GROUNDWATER MONITORING WELL ADVANCED BY OTHERS (NOVEMBER 2022)
 - DAMAGED BOREHOLE/GROUNDWATER MONITORING WELL ADVANCED BY OTHERS (NOVEMBER 2022)
 - 88.88 GROUND SURFACE ELEVATION (m)
 - 88.88 MEASURED GROUNDWATER ELEVATION (m) (MAY 13, 2024)*
 - INFERRED GROUNDWATER DIRECTION

NOTE:
*GROUNDWATER CONTOURS PRODUCED USING MW1, MW2, MW3, MW4, BH/MW101, BH/MW201, AND BH/MW202.

REFERENCE:
DRAWING REPRODUCED USING THE CITY OF MISSISSAUGA INTERACTIVE MAPPING WEBSITE



TITLE:
GROUNDWATER CONTOUR PLAN - MAY 13, 2024

CLIENT:
SAJECKI PLANNING INC.

LOCATION:
3403 - 3445 FIELDGATE DRIVE
MISSISSAUGA, ONTARIO

PROJECT NO.: G2S24018D

DRAWING:	3
SCALE:	AS SHOWN
DATE:	JULY 2024
DRAWN BY:	RL
FILE NAME:	G2S24018D.dwg

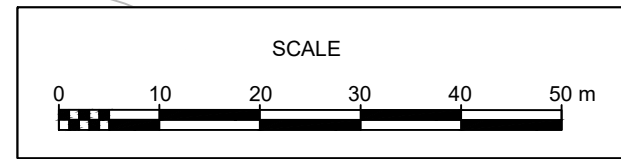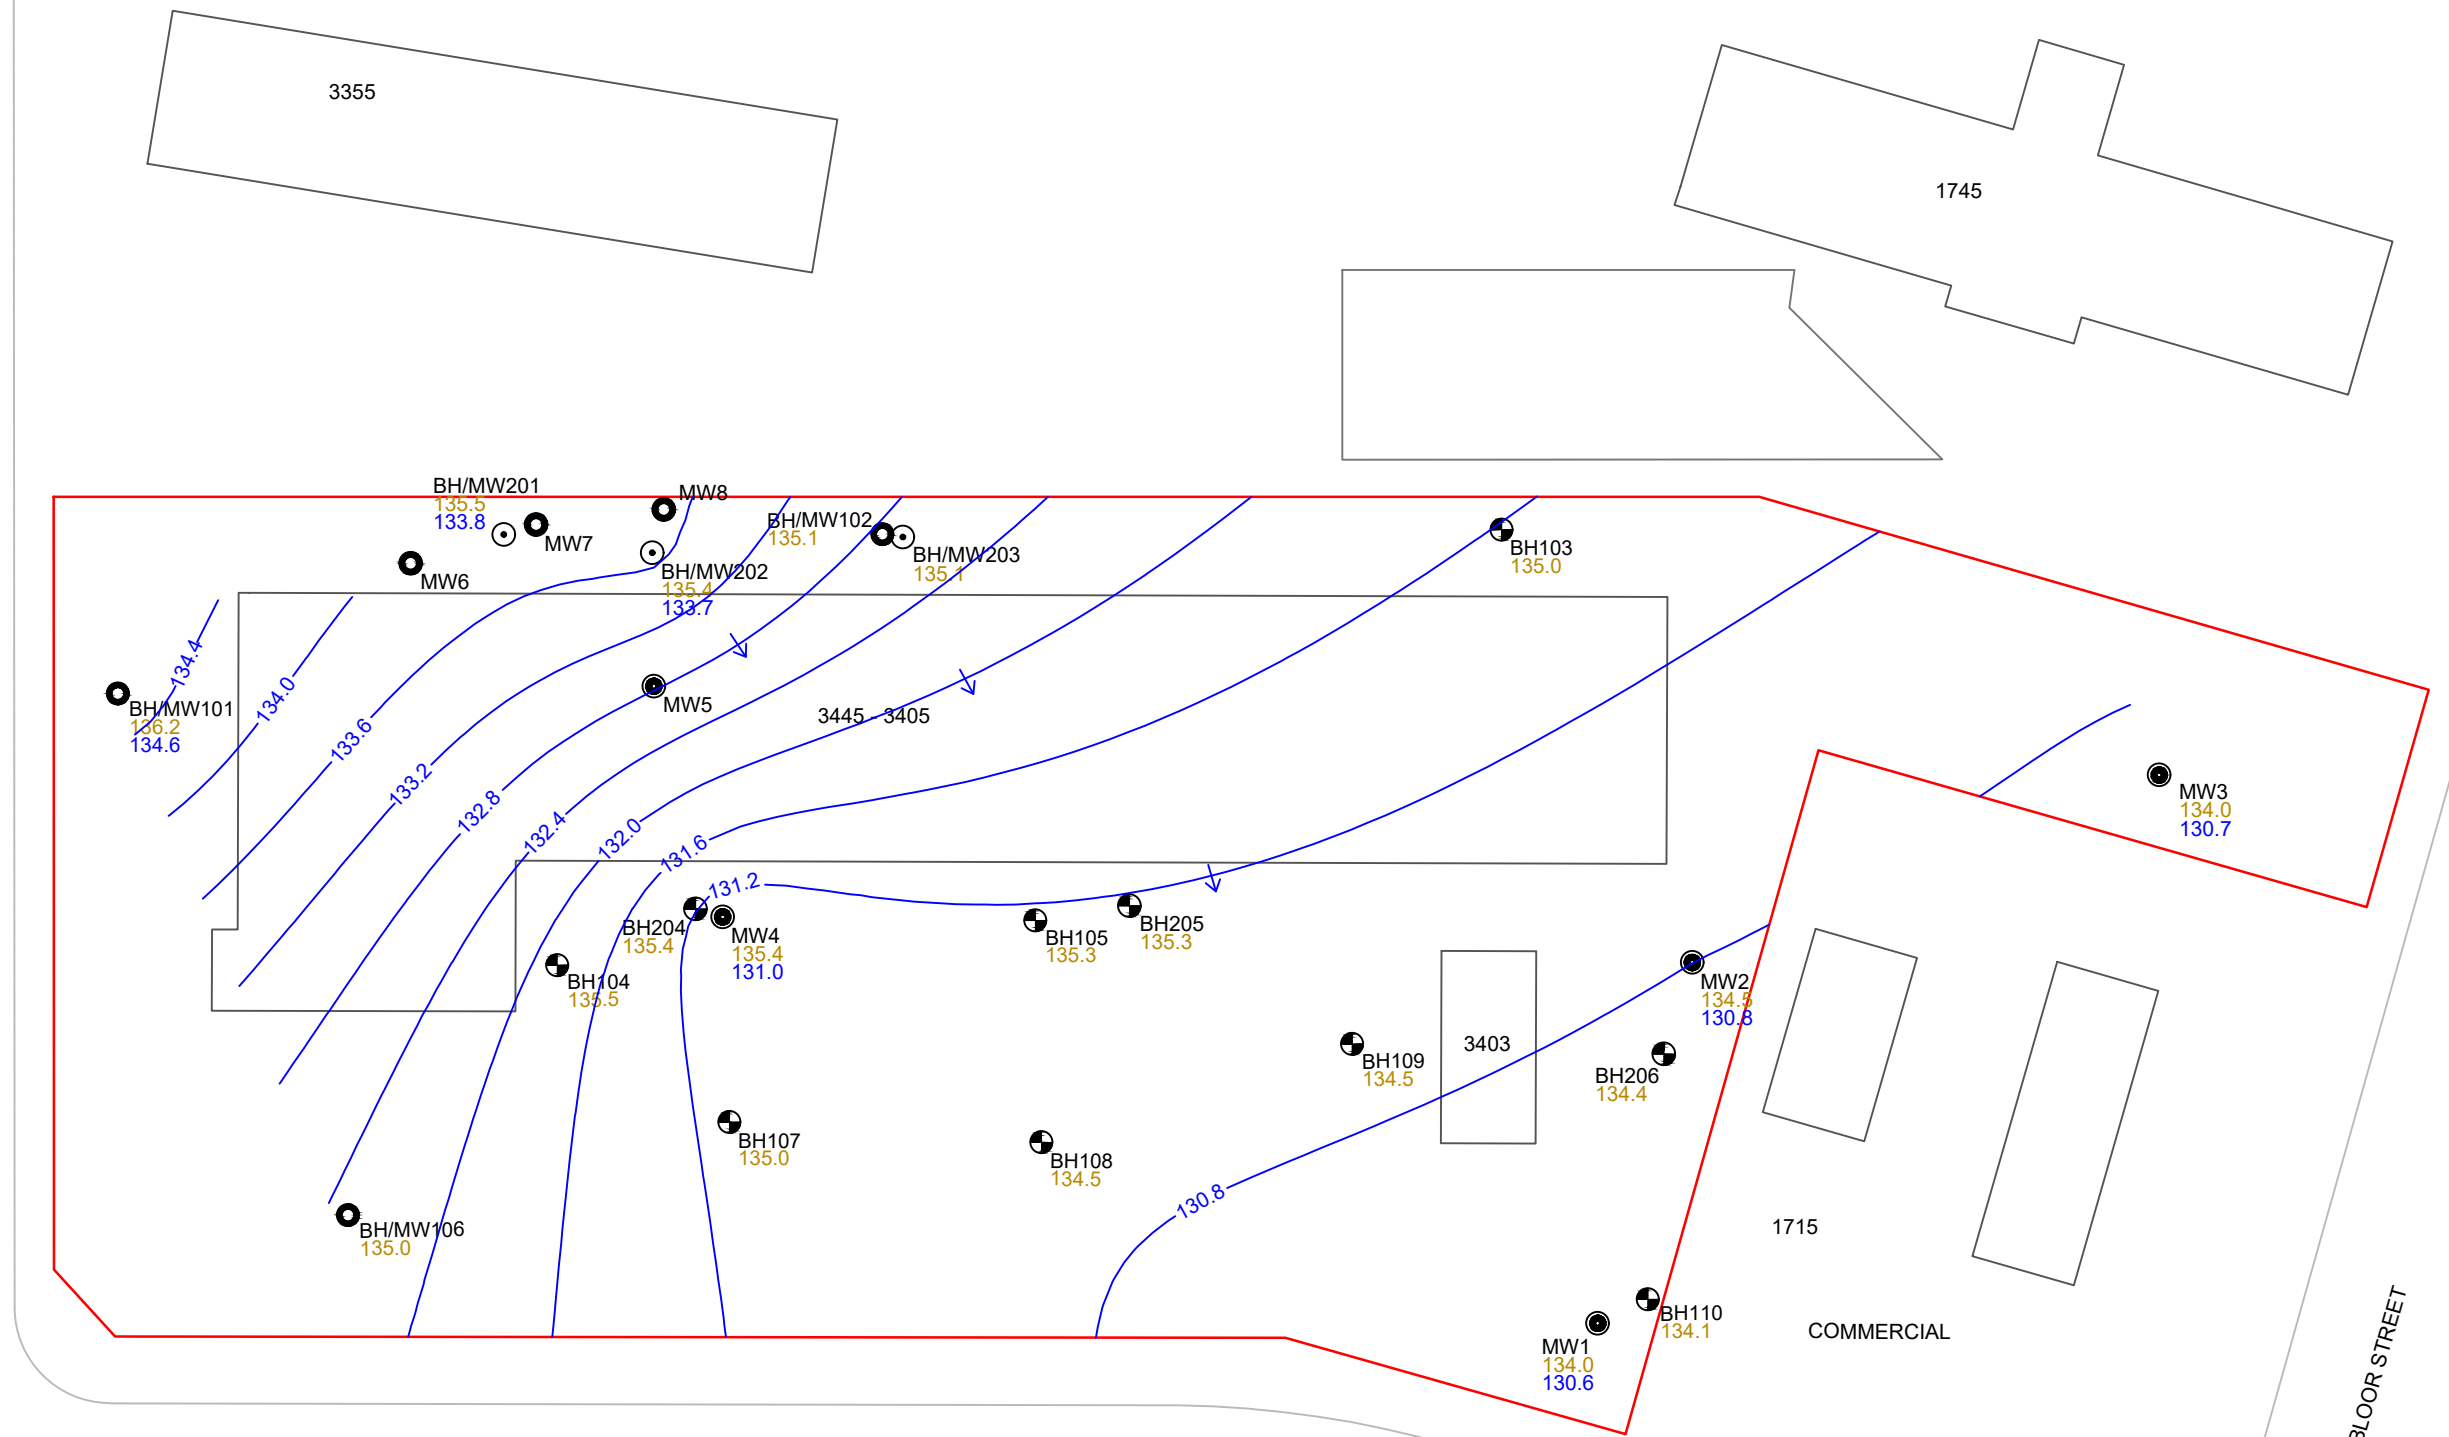

**Appendix B:
Summary of Water Well Records**



Water Well Records

May 31, 2024

4:29:26 PM

TOWNSHIP CON L	UTM	DATE CN	CASING DIA	WATER	PUMP TEST	WELL USE	SCREEN	WELL	FORMATION
MISSISSAUGA CITY	17 613979 4831215 W	2016-10 7295	1.79			MO	0010 10	7276722 (Z230893) A203433	BRWN FILL DRY 0007 GREY SAND SILT DRY 0010 SAND WBRG 0020
MISSISSAUGA CITY	17 613981 4830934 W	2006-03 7215	2				0004 10	4910100 (Z43667) A034903	
MISSISSAUGA CITY	17 613939 4831004 W	2006-01 7215	0.79			NU	0020 49	4910102 (Z43652) A031384	
MISSISSAUGA CITY	17 613920 4831000 W	2006-07 6607		FR 0015				4910290 (Z52268) A	
MISSISSAUGA CITY	17 613940 4831030 W	2006-12 6607	1.97	FR 0013			0010 10	7039277 (Z59625) A048423	BRWN SILT CLAY SAND 0010 GREY SAND SILT 0015 GREY SAND 0020
MISSISSAUGA CITY	17 614044 4831097 W	2008-09 7241	1.59			MT	0012 10	7112119 (Z88785) A078047	BRWN SAND LOOS 0005 GREY SILT SAND SOFT 0017 GREY FSND SILT HARD 0022
MISSISSAUGA CITY	17 614062 4830935 W	2008-09 7241	1.59			MT	0009 10	7112120 (Z88783) A078048	BRWN SAND LOOS 0005 GREY SILT SAND SOFT 0015 GREY FSND SILT WBRG 0019
MISSISSAUGA CITY	17 613920 4831020 W	2005-12 6607	2.00	0012			0020 10	4910055 (Z42187) A036840	BRWN FSND 0020 GREY FSND 0030
MISSISSAUGA CITY	17 613985 4830999 W	2008-09 7241	1.59			MT	0006 10	7112127 (Z88786) A077945	BRWN SAND LOOS 0008 GREY SILT SAND SOFT 0013 GREY FSND SILT HARD 0016
MISSISSAUGA CITY	17 613976 4831128 W	2017-03 7437	2	0007		MO	0007 10	7285463 (Z239291) A218172	BRWN SAND WBRG 0002 BRWN SAND WBRG 0005 GREY SAND WBRG 0010 BLCK SAND WBRG 0017
MISSISSAUGA CITY	17 614100 4830958 W	2017-06 7247	2	UT 0015		TH MO	0015 10	7316005 (Z272470) A223268	---- 0001 BRWN CLAY SILT SAND 0025
MISSISSAUGA CITY	17 613985 4830999 W	2020-11 7241						7375546 (Z342773) A077945 P	
MISSISSAUGA CITY	17 613997 4831010 W	2020-11 7241						7375547 (Z342772) A077944 P	
MISSISSAUGA CITY	17 613997 4831010 W	2008-09 7241	1.59			MT	0008 10	7112126 (Z88784) A077944	BRWN SAND LOOS 0005 GREY SILT SAND SOFT 0012 GREY FSND SAND SOFT 0018

TOWNSHIP CON L	UTM	DATE CN	CASING DIA	WATER	PUMP TEST	WELL USE	SCREEN	WELL	FORMATION
MISSISSAUGA CITY DS N 01 003	17 614056 4831244 W	2021-10 7241						7404588 (Z374670) A334111 P	
MISSISSAUGA CITY DS N 01 003	17 614023 4831266 W	2021-10 7241						7404585 (Z372060) A320458 P	
MISSISSAUGA CITY DS N 01 003	17 613998 4831268 W	2021-10 7241						7404586 (Z372061) A320459 P	
MISSISSAUGA CITY DS N 01 003	17 614055 4831301 W	2021-10 7241						7404587 (Z372062) A320460 P	

Notes:

UTM: UTM in Zone, Easting, Northing and Datum is NAD83; L: UTM estimated from Centroid of Lot; W: UTM not from Lot Centroid
DATE CNTR: Date Work Completed and Well Contractor Licence Number
CASING DIA: .Casing diameter in inches
WATER: Unit of Depth in Fee. See Table 4 for Meaning of Code

PUMP TEST: Static Water Level in Feet / Water Level After Pumping in Feet / Pump Test Rate in GPM / Pump Test Duration in Hour : Minutes
WELL USE: See Table 3 for Meaning of Code
SCREEN: Screen Depth and Length in feet
WELL: WEL (AUDIT #) Well Tag . A: Abandonment; P: Partial Data Entry Only

1. Core Material and Descriptive te

Code	Description	Code	Description	Code	Description	Code	Description	Code	Description
BLDR	BOULDERS	FCRD	FRACTURED	IRFM	IRON FORMATION	PORS	POROUS	SOFT	SOFT
BSLT	BASALT	FGRD	FINE-GRAINED	LIMY	LIMY	PRDG	PREVIOUSLY DUG	SPST	SOAPSTONE
CGRD	COARSE-GRAINED	FGVL	FINE GRAVEL	LMSN	LIMESTONE	PRDR	PREV. DRILLED	STKY	STICKY
CGVL	COARSE GRAVEL	FILL	FILL	LOAM	TOPSOIL	QRTZ	QUARTZITE	STNS	STONES
CHRT	CHERT	FLDS	FELDSPAR	LOOS	LOOSE	QSND	QUICKSAND	STNY	STONEY
CLAY	CLAY	FLNT	FLINT	LTCL	LIGHT-COLOURED	QTZ	QUARTZ	THIK	THICK
CLN	CLEAN	FOSS	FOSILIFEROUS	LYRD	LAYERED	ROCK	ROCK	THIN	THIN
CLYY	CLAYEY	FSND	FINE SAND	MARL	MARL	SAND	SAND	TILL	TILL
CMTD	CEMENTED	GNIS	GNEISS	MGRD	MEDIUM-GRAINED	SHLE	SHALE	UNKN	UNKNOWN TYPE
CONG	CONGLOMERATE	GRNT	GRANITE	MGVL	MEDIUM GRAVEL	SHLY	SHALY	VERY	VERY
CRYS	CRYSTALLINE	GRSN	GREENSTONE	MRBL	MARBLE	SHRP	SHARP	WBRG	WATER-BEARING
CSND	COARSE SAND	GRVL	GRAVEL	MSND	MEDIUM SAND	SHST	SCHIST	WDFR	WOOD FRAGMENTS
DKCL	DARK-COLOURED	GRWK	GREYWACKE	MUCK	MUCK	SILT	SILT	WTHD	WEATHERED
DLMT	DOLOMITE	GVLV	GRAVELLY	OBND	OVERBURDEN	SLTE	SLATE		
DNSE	DENSE	GYPS	GYPSUM	PCKD	PACKED	SLTY	SILTY		
DRTY	DIRTY	HARD	HARD	PEAT	PEAT	SNDS	SANDSTONE		
DRY	DRY	HPAN	HARDPAN	PGVL	PEA GRAVEL	SNDY	SANDYOAPSTONE		

2. Core Color

Code	Description
WHIT	WHITE
GREY	GREY
BLUE	BLUE
GRN	GREEN
YLLW	YELLOW
BRWN	BROWN
RED	RED
BLCK	BLACK
BLGY	BLUE-GREY

3. Well Use

Code	Description	Code	Description
DO	Domestic	OT	Other
ST	Livestock	TH	Test Hole
IR	Irrigation	DE	Dewatering
IN	Industrial	MO	Monitoring
CO	Commercial	MT	Monitoring TestHole
MN	Municipal		
PS	Public		
AC	Cooling And A/C		
NU	Not Used		

4. Water Detail

Code	Description	Code	Description
FR	Fresh	GS	Gas
SA	Salty	IR	Iron
SU	Sulphur		
MN	Mineral		
UK	Unknown		

**Appendix C:
Borehole Logs**

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-15 **COMPLETED** 24-3-15 **GROUND ELEVATION** 99.7 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
0.12	ASPHALT: ~120 mm	99.58		S1A	SPT	9	▲					
0.27	GRANULAR: ~150 mm	99.43		S1B	SPT	9	▲					
1.5	FILL: Silty sand, brown, organics, moist			S2A	SPT	9	▲					
		98.20		S2B	SPT	9	▲					
2	SILTY SAND TILL: Brown, some gravel, moist, dense			S3	SPT	35	▲					
3				S4	SPT	47	▲					
3.0		96.70		S5	SPT	50	▲					
4	SILTY CLAY TILL: Grey, some sand, some gravel, moist, hard			S6	SPT	50	▲					
4.0		95.70										

Borehole terminated at 4.0 m.

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-15 **COMPLETED** 24-3-15 **GROUND ELEVATION** 98.6 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger+ Rock Coring **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
							Undrained Shear Strength (kPa)					
							Pocket Penetrometer X	Vane +	PL MC LL			
							40 80 120 160	10 20 30 40	10 20 30			
0.18	GRANULAR: ~175 mm FILL: Sand, brown, some silt, moist	98.43	[Pattern]	S1A S1B	SPT	11	▲	△	●			Flushmount protective casing set in concrete
1				S2	SPT	13	▲	△	●			
1.5		97.10		S3	SPT	11	▲	△	●			
2	SILT: Brown, some sand, moist, compact			S4	SPT	30	▲	△	●			
2.3		96.30		S5	SPT	34	▲	△	●			
3	SANDY SILT TILL: Grey, some clay, some gravel, moist, dense	95.60		S6	SPT	38	▲	△	●			Bentonite seal
4	SILTY CLAY TILL: Grey, some sand, some gravel, shale fragments, moist, hard			S7	SPT	50	▲	△	●			
5				S8	RC							
6	Weathered Shale: Georgian Bay Formation, Grey	92.50 92.40	[Pattern]	S9	RC							
6.1				S10	RC							
6.2				S11	RC							Filter sand
7	BEDROCK: Grey shale. Refer to Log of Rock Core for details of bedrock coring		[Pattern]	S12	RC							Slotted screen
8												
9												
10												
11												
12												
12.3		86.26										

Borehole terminated at 12.3 m.

2021 G2S GEOTECH BOREHOLE LOG G2S24018 BOREHOLE LOGS.GPJ G2S 2021 BH DATA TEMPLATE.GDT 24-4-16

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-14 **COMPLETED** 24-3-14 **GROUND ELEVATION** 98.5 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
0.09	ASPHALT: ~90 mm	98.41		S1A	SPT	31						
0.23	GRANULAR: ~140 mm	98.27		S1B								
1.5	FILL: Silty sand, dark brown, moist to very moist			S2	SPT	5	▲					
2.0	SAND: Light brown, some silt, occasional silt zones, moist, compact	97.00		S3	SPT	22	▲					
3.0				S4	SPT	30						
3.4		95.10		S5A	SPT	25						
3.8	occasional silt zone	94.70		S5B								
4.0	SILTY SAND TILL: Grey, some gravel to gravelly, moist, compact to dense			S6	SPT	38	▲					
5.0				S7	SPT	43						
6.1	SILTY CLAY TILL: Grey, some sand, some gravel, shale fragments, moist, hard	92.40		S8	SPT	50						
7.0												
8.0				S9	SPT	50						
9.0												
10.0				S10	SPT	50						
10.1		88.40		S11	SPT	50						

No further progress due to auger and sampler refusal on possible bedrock
Borehole terminated at 10.1 m.

Upon completion of drilling
Cave at 6.7 m
Free water at 5.5 m

2021 G2S GEOTECH BOREHOLE LOG G2S24018 BOREHOLE LOGS.GPJ G2S 2021 BH DATA TEMPLATE.GDT 24-4-16

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-12 **COMPLETED** 24-3-12 **GROUND ELEVATION** 99.0 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
0.15	ASPHALT: ~150 mm	98.85										
0.26	GRANULAR: ~110 mm	98.74										
1.00	FILL: Silty sand, brown to dark brown, trace gravel, wood pieces, organics, moist becoming brown, no organics, moist	98.00		S1	SPT	13	▲		●			
1.50		97.50		S2A S2B	SPT	7	▲		●			
2.00	SILTY SAND/SANDY SILT: Brownish grey, trace gravel, moist, compact			S3	SPT	13	▲		●			
3.00				S4A S4B	SPT	21	▲		●			
3.80		95.20		S5	SPT	24	▲		●			
4.30	CLAYEY SILT TILL: Grey, some sand, some gravel, shale fragments, moist, hard	94.70		S6 S7	SPT	50	▲		●			

No further progress due to auger and sampler refusal on possible bedrock
Borehole terminated at 4.3 m.

Upon completion of drilling
Cave at 2.1 m
No free water

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-13 **COMPLETED** 24-3-13 **GROUND ELEVATION** 98.8 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL		
							N values ▲	CPT values △						
							Undrained Shear Strength (kPa)							
							Pocket Penetrometer X	Vane +	PL	MC	LL			
							40	80	120	160	10	20	30	
0.11 0.26	ASPHALT: ~110 mm GRANULAR: ~150 mm FILL: Sand, brown, some silt, moist to very moist	98.69 98.54		S1	SPT	12	▲		●					
1.5		97.30		S2	SPT	5	▲		●					
2	SANDY SILT: Brown, very moist, compact			S3	SPT	10	▲		●					
3				S4	SPT	10	▲		●					
3.8		95.00		S5	SPT	18	▲		●					
4.6	SAND: Brown, some silt, moist, compact	94.20		S6	SPT	21	▲		●					
5	SILTY CLAY TILL: Grey, some sand, some gravel, shale fragments, moist, hard			S7	SPT	30	▲		●					
6				S8	SPT	49	▲		●					
7				S9	SPT	45	▲		●					
8				S10	SPT	46	▲		●					
9.1 9.2	Weathered Shale: Georgian Bay Formation, Grey No further progress due to auger and sampler refusal on possible bedrock Borehole terminated at 9.2 m.	89.70 89.60		S11	SPT	50	▲		●					

Upon completion of drilling
 Cave at 7.8 m
 No free water


2021 G2S GEOTECH BOREHOLE LOG G2S24018 BOREHOLE LOGS.GPJ G2S 2021 BH DATA TEMPLATE.GDT 24-4-16

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-12 **COMPLETED** 24-3-12 **GROUND ELEVATION** 98.5 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger+ Rock Coring **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
0.16	ASPHALT: ~160 mm	98.34		S1	SPT	12	▲					Flushmount protective casing set in concrete
0.24	GRANULAR: ~80 mm	98.26		S2A	SPT	13	▲					
1.5	FILL: Clayey silt, dark grey, organics, trace sand, moist	97.00		S2B	SPT	13	▲					
2.3	SILTY SAND TILL: Grey, some clay, some gravel, moist, compact	96.20		S3	SPT	12	▲					
3.0	SANDY SILT TILL: Grey, some clay, some gravel, moist, compact	95.50		S4	SPT	20	▲					
4.0	CLAYEY SILT TILL: Grey, some sand, some gravel, shale fragments, moist, hard			S5	SPT	30	▲					Bentonite seal
5.0	BEDROCK: Grey shale. Refer to Log of Rock Core for details of bedrock coring	93.50		S6	SPT	50			●			
				S7	SPT	50			●			
				S8	RC							
				S9	RC							
				S10	RC							
8.0				S11	RC							Filter sand
9.0				S12	RC							Slotted screen
10.7		87.76										

Borehole terminated at 10.7 m.

2021 G2S GEOTECH BOREHOLE LOG G2S24018 BOREHOLE LOGS.GPJ G2S 2021 BH DATA TEMPLATE.GDT 24-4-16



CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-12 **COMPLETED** 24-3-12 **GROUND ELEVATION** 98.5 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
0.10	ASPHALT: ~100 mm	98.40										
0.21	GRANULAR: ~110 mm	98.29										
0.80	FILL: Sand, brown, trace silt, very moist	97.70		S1	SPT	9	▲					
1.5	becoming clayey silt, dark grey to grey, some sand, trace organics, very moist	97.00		S2	SPT	9	▲					
2.0				S3	SPT	12	▲					
3.0	SILTY SAND/SANDY SILT: Grey, trace gravel, moist, compact to dense			S4	SPT	18	▲					
3.8		94.70		S5	SPT	31	▲					
4.8	SILTY CLAY TILL: Grey, some sand, some gravel, shale fragments, moist, very stiff to hard	93.70		S6	SPT	23	▲					
4.8		93.60		S7	SPT	50	▲					
4.9	Weathered Shale: Georgian Bay Formation, Grey	93.60		S8	SPT	50	▲					

No further progress due to auger and sampler refusal on possible bedrock Borehole terminated at 4.9 m.

Upon completion of drilling
No cave
Free water at 4.8 m

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-13 **COMPLETED** 24-3-13 **GROUND ELEVATION** 98.0 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
							Undrained Shear Strength (kPa)					
							Pocket Penetrometer X	Vane +	PL	MC	LL	
							40 80 120 160		10 20 30			
0.09	ASPHALT: ~90 mm	97.91		S1A								
0.20	GRANULAR: ~110 mm	97.80		S1B	SPT	6	▲					
0.30	FILL: Silty sand, brown, moist	97.70		S2A								
1.5	becoming silt, dark grey, organics, some sand, moist			S2B	SPT	10	▲					
2	SILTY SAND: Brown, trace gravel, moist, compact	96.50		S3	SPT	20	▲					
3				S4	SPT	18	▲					
4				S5	SPT	19	▲					
5				S6	SPT	23	▲					
4.9	SILTY CLAY TILL: Grey, some sand, some gravel, shale fragments, moist, very stiff to hard	93.10		S7A								
				S7B	SPT	20	▲					
6												
7				S8	SPT	50						
8												
9				S9	SPT	74						
9.1		88.90										
9.2	Weathered Shale: Georgian Bay Formation, Grey	88.80		S10	SPT	50						

Upon completion of drilling
Wet cave at 4.3 m

No further progress due to auger and sampler refusal on possible bedrock
Borehole terminated at 9.2 m.

2021 G2S GEOTECH BOREHOLE LOG G2S24018 BOREHOLE LOGS.GPJ G2S 2021 BH DATA TEMPLATE.GDT 24-4-16


CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-14 **COMPLETED** 24-3-14 **GROUND ELEVATION** 98.1 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger+ Rock Coring **NOTES** _____

2021 G2S GEOTECH BOREHOLE LOG G2S24018 BOREHOLE LOGS.GPJ G2S 2021 BH DATA TEMPLATE.GDT 24-4-16

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
							Undrained Shear Strength (kPa)		PL MC LL			
							Pocket Penetrometer X	Vane +	10	20	30	
							40	80	120	160		
0.12	ASPHALT: ~120 mm	97.98										
0.24	GRANULAR: ~120 mm	97.86										
0.80	FILL: Silty sand, dark brown to brown, trace gravel, moist	97.30		S1	SPT	5	▲					
	SILTY SAND: Brown, trace gravel, reworked appearance at top portion, moist, compact			S2	SPT	13	▲				79.4	
				S3	SPT	18	▲					
				S4	SPT	18	▲					
				S5	SPT	19	▲					
				S6	SPT	18	▲				91.7	
				S7	SPT	22	▲					
5.3	SILTY SAND TILL: Grey, some gravel, moist, very dense	92.80		S8	SPT	58	>>▲					
				S9	SPT	54	>>▲					
7.6	SILTY CLAY TILL: Grey, some sand, some gravel, shale fragments, moist, hard	90.50		S10	SPT	50	▲		50/125 mm			
				S11	SPT	50	▲		50/150 mm			
10.7	Weathered Shale: Georgian Bay Formation, Grey	87.40		S12	SPT	50	▲		50/25 mm			
11.0	BEDROCK: Grey shale, Refer to Log of Rock Core for details of bedrock coring	87.10		S13	RC							
				S14	RC							
				S15	RC							

(Continued Next Page)

CLIENT Forest Glen Shopping Centre Ltd. PROJECT NAME Proposed Mixed Use Development
 PROJECT NUMBER G2S24018 PROJECT LOCATION 3403-3445 Fieldgate Dr, Mississauga, ON

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
15.2		82.86										

Borehole terminated at 15.2 m.

Cave-in material and free water were not measured due to drilling/coring method













CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Proposed Mixed Use Development
PROJECT NUMBER G2S24018 **PROJECT LOCATION** 3403-3445 Fieldgate Dr, Mississauga, ON
DATE STARTED 24-3-13 **COMPLETED** 24-3-13 **GROUND ELEVATION** 97.6 m
DRILLING CONTRACTOR Davis Drilling Ltd. **LOGGED BY** DB **CHECKED BY** AA
DRILLING METHOD Continuous Flight Hollow Stem Auger **NOTES** _____

2021 G2S GEOTECH BOREHOLE LOG G2S24018 BOREHOLE LOGS.GPJ G2S 2021 BH DATA TEMPLATE.GDT 24-4-16

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	N VALUE	SPT N VALUES		MOISTURE / PLASTICITY	SOIL GAS READINGS HEX/IBL (ppm)	WELL CONSTRUCTION	GRAIN SIZE DISTRIBUTION % GR SA SI & CL
							N values ▲	CPT values △				
							Undrained Shear Strength (kPa)					
							Pocket Penetrometer X	Vane +	PL	MC	LL	
							40 80 120 160		10 20 30			
0.12	ASPHALT: ~120 mm	97.48										
0.28	GRANULAR: ~160 mm	97.32										
0.60	FILL: Sand and gravel, brown, some silt, moist	97.00		S1	SPT	7	▲		●			
1.5	becoming sandy silt, dark grey, organics, moist	96.10		S2A	SPT	11	▲		●			
				S2B	SPT	11						
				S3	SPT	19	▲		●			
				S4	SPT	21	▲		●			
				S5	SPT	24	▲		●			
				S6	SPT	18	▲		●			
				S7	SPT	20	▲		●			
6.1	SILTY SAND TILL: Grey, some gravel, moist, dense to very dense	91.50		S8	SPT	31	▲		●			
				S9	SPT	50			●			
									50/75 mm			
9.1	SILTY CLAY TILL: Grey, some sand, some gravel, shale fragments, moist, hard	88.50		S10	SPT	37	▲		●			
				S11	SPT	46	▲		●			
12.2	WEATHERED SHALE: Grey, very dense	85.40		S12	SPT	50	▲		●			
									50/125 mm			
13.3	No further progress due to auger and sampler refusal on possible bedrock Borehole terminated at 13.3 m.	84.30		S13	SPT	50	▲		●			
									50/50 mm			

Upon completion of drilling
Cave a 4.5 m
Free water at 4.3 m







CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Phase Two ESA
PROJECT NUMBER G2S24018B **PROJECT LOCATION** 3403-3445 Fieldgate Drive, Mississauga, ON
DATE STARTED 24-4-29 **COMPLETED** 24-4-29 **GROUND ELEVATION** 135.53 m
DRILLING CONTRACTOR Ace Environmental Drilling Ltd. **LOGGED BY** HP **CHECKED BY** WB/SC
DRILLING METHOD Geoprobe - Direct Push **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	SOIL GAS READINGS HEX/IBL (ppm)	WELL DIAGRAM
0.2	GRANULAR: ~175 mm FILL: Clayey silt, brown, trace sand, reworked appearance, moist	135.36		S1	DP	0/0	 Flushmount protective casing set in concrete Bentonite seal Filter sand
1				NR		0/0	
1.5	SILTY SAND: Brown, some gravel, reworked appearance, moist	134.01		S2	DP	0/0	 1.55 Slotted screen
2				S3		0/0	
2.4	becoming grey	133.09					
3	SILT: Grey, till-like, moist	132.49		S4	DP	0/0	 4.55
4				S5		0/0	
4.4	WEATHERED SHALE	131.11		S6	DP	0/0	
4.9		130.65					

No further progress due to sampler refusal on possible bedrock
Borehole terminated at 4.9 m.

Water Level Readings:		
Date	Depth (m)	Elev. (m)
2024-05-06	1.58	133.95
2024-05-13	1.60	133.93






CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Phase Two ESA
PROJECT NUMBER G2S24018B **PROJECT LOCATION** 3403-3445 Fieldgate Drive, Mississauga, ON
DATE STARTED 24-4-29 **COMPLETED** 24-4-29 **GROUND ELEVATION** 135.39 m
DRILLING CONTRACTOR Ace Environmental Drilling Ltd. **LOGGED BY** HP **CHECKED BY** WB/SC
DRILLING METHOD Geoprobe - Direct Push **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	SOIL GAS READINGS HEX/IBL (ppm)	WELL DIAGRAM
0.1	GRANULAR: ~125 mm SILTY SAND: Brown, moist to very moist	135.27		S1	DP	25/0	 Flushmount protective casing set in concrete Bentonite seal Filter sand 1.57 Slotted screen 4.57
1				NR			
2	2.1 SANDY SILT: Brown, very moist to wet	133.26		S2	DP	15/0	
3				S3			
3	3.0 becoming grey, wet	132.35		S4	DP	25/0	
4				NR			
4.6	4.6 SHALE / TILL COMPLEX: Grey, moist	130.82		S5	DP	0/0	
4.9	4.9	130.51		S5	DP	0/0	

No further progress due to sampler refusal on possible bedrock
Borehole terminated at 4.9 m.

Water Level Readings:		
Date	Depth (m)	Elev. (m)
2024-05-06	1.63	133.76
2024-05-13	1.65	133.74









CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Phase Two ESA
PROJECT NUMBER G2S24018B **PROJECT LOCATION** 3403-3445 Fieldgate Drive, Mississauga, ON
DATE STARTED 24-4-29 **COMPLETED** 24-4-29 **GROUND ELEVATION** 135.13 m
DRILLING CONTRACTOR Ace Environmental Drilling Ltd. **LOGGED BY** HP **CHECKED BY** WB/SC
DRILLING METHOD Geoprobe - Direct Push **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	SOIL GAS READINGS HEX/IBL (ppm)	WELL DIAGRAM
0.1	GRANULAR: ~125 mm FILL: Silty sand, brown, trace gravel, moist to very moist	135.01		S1	DP	0/0	Flushmount protective casing set in concrete
1				NR			Bentonite seal
1.5	becoming grey, wet	133.61		S2	DP	0/0	Filter sand
2				S3			1.80
2.9				S4			
3	SANDY SILT: Grey, wet	132.24		S5	DP	0/0	Slotted screen
4				S6			5/0
4.0	SHALE / TILL COMPLEX: Grey, moist	131.18		NR	DP	10/0	
4.9		130.25		NR	DP		4.80

No further progress due to sampler refusal on possible bedrock
Borehole terminated at 4.9 m.

Water Level Readings:		
Date	Depth (m)	Elev. (m)
2024-05-06	2.08	133.05


CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Phase Two ESA
PROJECT NUMBER G2S24018B **PROJECT LOCATION** 3403-3445 Fieldgate Drive, Mississauga, ON
DATE STARTED 24-4-29 **COMPLETED** 24-4-29 **GROUND ELEVATION** 135.39 m
DRILLING CONTRACTOR Ace Environmental Drilling Ltd. **LOGGED BY** HP **CHECKED BY** WB/SC
DRILLING METHOD Geoprobe - Direct Push **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	SOIL GAS READINGS HEX/IBL (ppm)	WELL DIAGRAM
0.1	ASPHALT: ~50 mm	135.34		S1	DP	0/0	
0.1	GRANULAR: ~75 mm	135.27		S2		0/0	
0.3	FILL: Silty sand, brown, trace gravel, moist becoming dark brown, odour noted	135.09		NR			
1.5	SILTY SAND: Dark brown, reworked appearance, moist	133.87		S3	DP	0/0	
2.1	becoming light brown	133.26		S4		0/0	
3.0	SANDY SILT: Grey, moist	132.35		S5	DP	0/0	
4.1	SHALE / TILL COMPLEX: Grey, moist	131.29		S6		0/0	
4.9		130.51		S7		0/0	
				S8	DP	0/0	

No further progress due to sampler refusal on possible bedrock
Borehole terminated at 4.9 m.

Upon completion of drilling
No cave
No free water

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Phase Two ESA
PROJECT NUMBER G2S24018B **PROJECT LOCATION** 3403-3445 Fieldgate Drive, Mississauga, ON
DATE STARTED 24-4-29 **COMPLETED** 24-4-29 **GROUND ELEVATION** 135.28 m
DRILLING CONTRACTOR Ace Environmental Drilling Ltd. **LOGGED BY** HP **CHECKED BY** WB/SC
DRILLING METHOD Geoprobe - Direct Push **NOTES** _____

DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	SOIL GAS READINGS HEX/IBL (ppm)	WELL DIAGRAM
0.1	ASPHALT: ~75 mm	135.21		S1	DP	0/0	
0.1	GRANULAR: ~50 mm	135.16		NR			
	FILL: Silty sand, brown, trace gravel, moist			S2			
1				S3			
2				S4			
3				S5			
3.0	SANDY SILT: Brown, trace gravel, moist	132.24		S6			
4			S7				
4.6	becoming wet	130.71					
5							
5.5	becoming grey	129.80					
6							
6.1		129.19					

Borehole terminated at 6.1 m.

Upon completion of drilling
No cave
No free water

CLIENT Forest Glen Shopping Centre Ltd. **PROJECT NAME** Phase Two ESA
PROJECT NUMBER G2S24018B **PROJECT LOCATION** 3403-3445 Fieldgate Drive, Mississauga, ON
DATE STARTED 24-4-29 **COMPLETED** 24-4-29 **GROUND ELEVATION** 134.44 m
DRILLING CONTRACTOR Ace Environmental Drilling Ltd. **LOGGED BY** HP **CHECKED BY** WB/SC
DRILLING METHOD Geoprobe - Direct Push **NOTES** _____


DEPTH (m)	MATERIAL DESCRIPTION	ELEVATION (m)	GRAPHIC LOG	NUMBER	TYPE	SOIL GAS READINGS HEX/IBL (ppm)	WELL DIAGRAM
0.1	ASPHALT: ~75 mm	134.37		S1	DP	0/0	
0.2	GRANULAR: ~100 mm	134.27		S2		0/0	
0.3	FILL: Silty sand, light brown, moist	134.14		S3		0/0	
0.6	becoming silty clay, dark brown, moist	133.84		NR			
1.5	becoming sand, light brown, moist	132.92		S4	DP	0/0	
2	SILTY SAND: Light brown, reworked appearance, moist			S5		0/0	
3				S6	DP	0/0	
4				S7		0/0	
4.6	becoming wet	129.87		S8	DP	0/0	
5.8		128.66				0/0	
6.1	SANDY SILT: Brown, wet	128.35					

Borehole terminated at 6.1 m.

Upon completion of drilling
No cave
No free water

Appendix D: Hydraulic Testing

BH/MW101
Slug Test Analysis
 3403 - 3445 Fieldgate Drive, Mississauga, Ontario

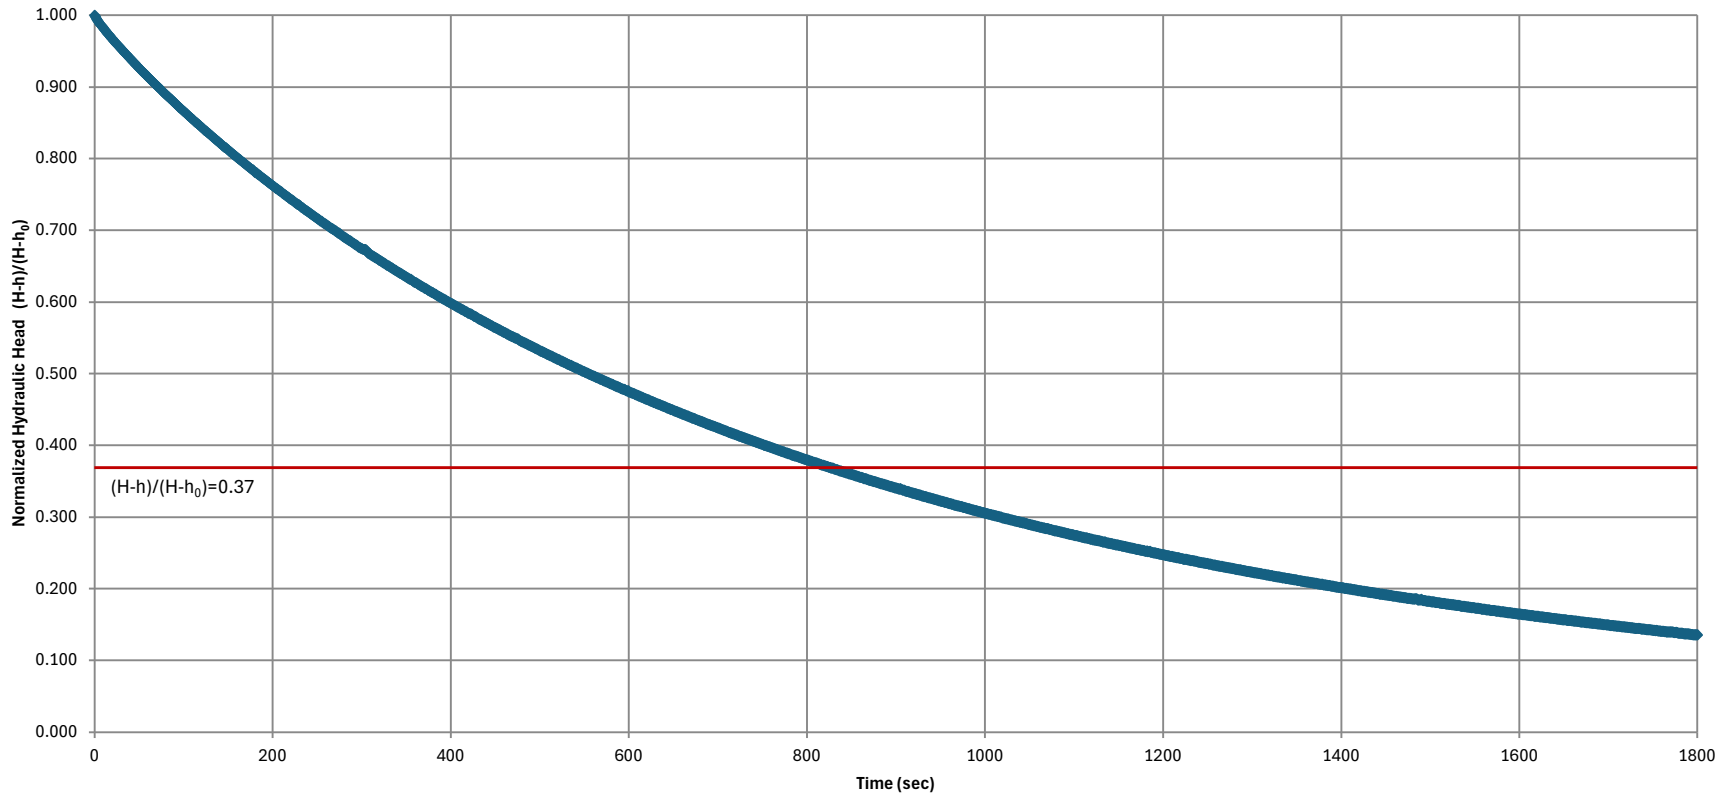


Hvorslev Method for Slug Test Analysis

stickup= NA	m	casing stickup from ground surface
SWL=	1.69 m	Static Water Level (mBTOP)
r =	0.025 m	casing radius
L =	1.5 m	screen length
R =	0.076 m	borehole radius
H-h ₀ =	1.66 m	Water level change at T=0
T _{0.37} =	823 sec	T at (H-h)/(H-h ₀)=0.37

$$k = \frac{r^2 \ln(L/R)}{2LT_{0.37}}$$

k= 7.5E-07 m/sec

BH/MW106
Slug Test Analysis
 3403 - 3445 Fieldgate Drive, Hamilton, Ontario

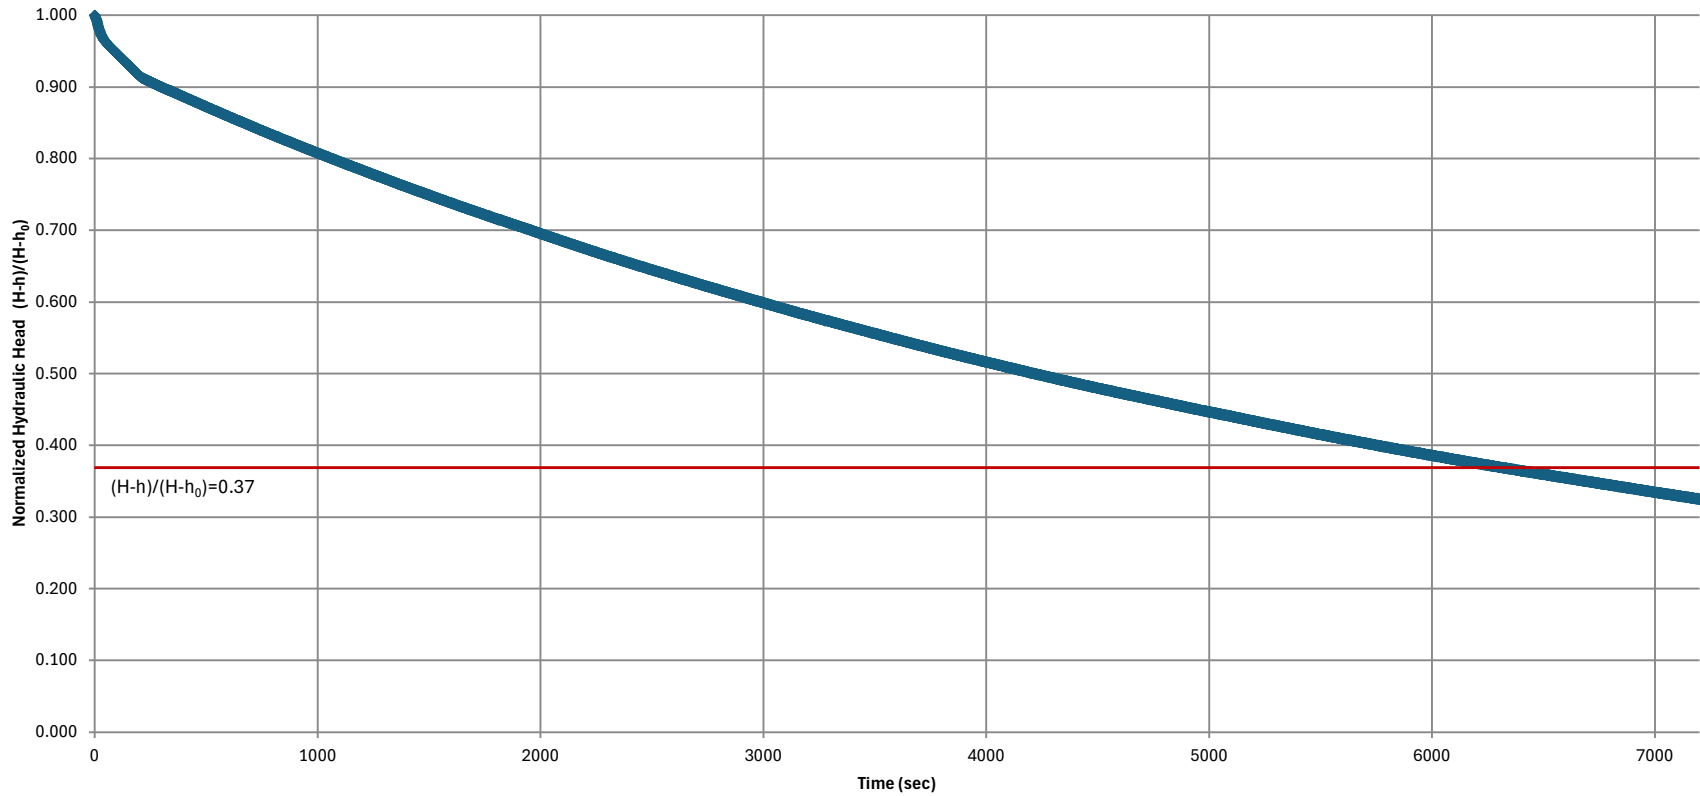


Hvorslev Method for Slug Test Analysis

stickup= NA	m	casing stickup from ground surface
SWL=	2.60 m	Static Water Level (mBTOP)
r =	0.025 m	casing radius
L =	3.1 m	screen length
R =	0.076 m	borehole radius
H-h ₀ =	2.60 m	Water level change at T=0
T _{0.37} =	6289 sec	T at (H-h)/(H-h ₀)=0.37

$$k = \frac{r^2 \ln(L/R)}{2LT_{0.37}}$$

k= 5.9E-08 m/sec

MW2
Slug Test Analysis
 3403-3455 Fieldgate Drive, Hamilton, Ontario

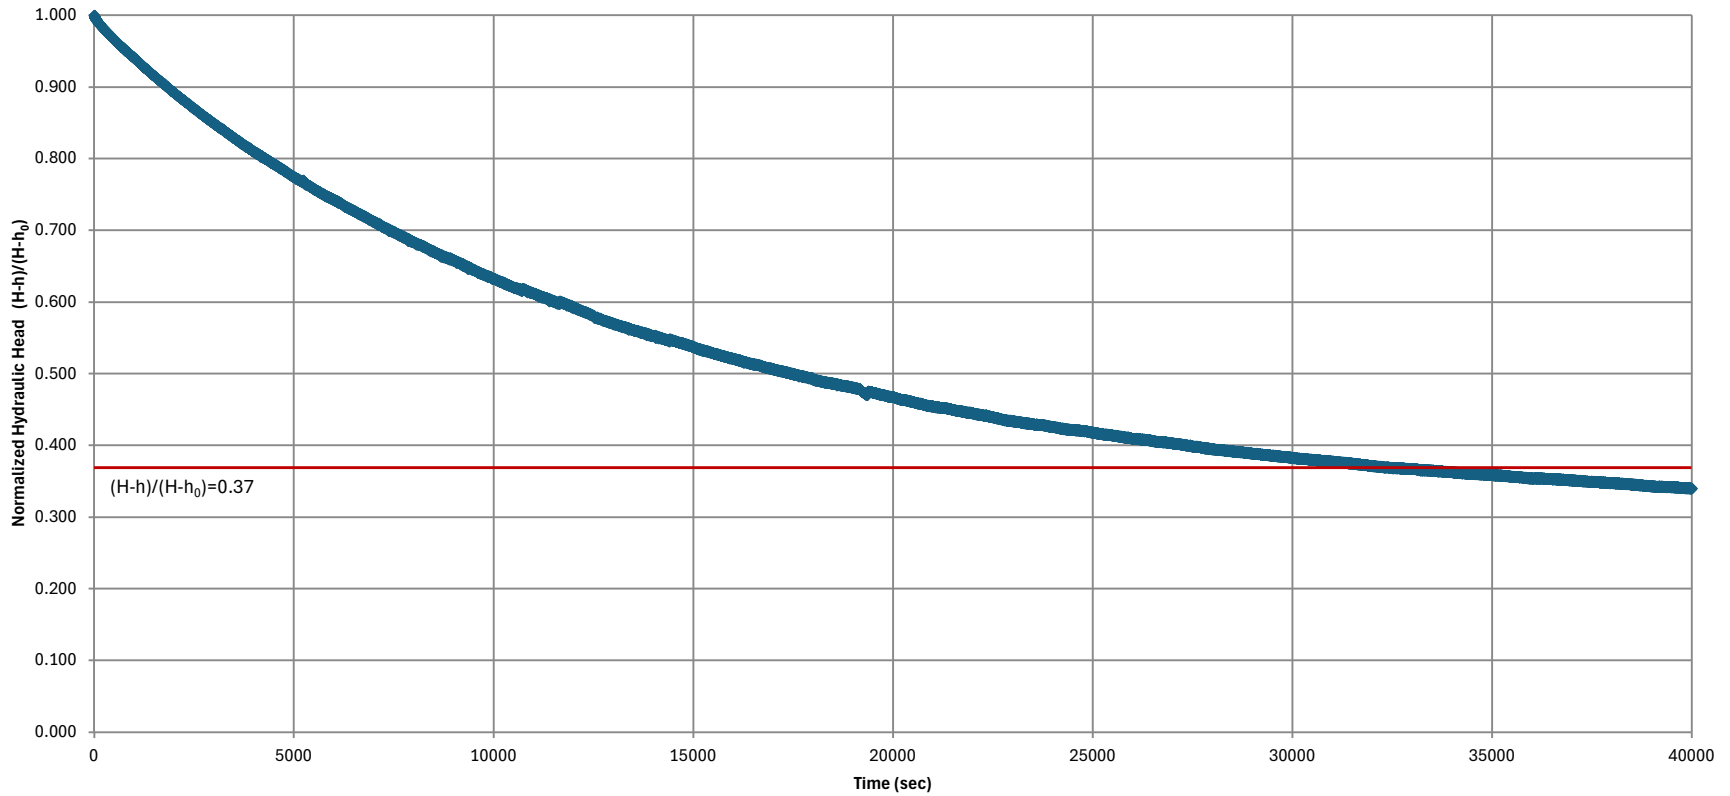

Hvorslev Method for Slug Test Analysis

stickup= NA	m	casing stickup from ground surface
SWL=	3.59 m	Static Water Level (mBTOP)
r =	0.025 m	casing radius
L =	3.1 m	screen length
R =	0.076 m	borehole radius
H-h ₀ =	3.40 m	Water level change at T=0
T _{0.37} =	470 sec	T at (H-h)/(H-h ₀)=0.37

$$k = \frac{r^2 \ln(L/R)}{2LT_{0.37}}$$

k= 8.0E-07 m/sec

**Appendix E:
Grain Size Analyses**

Project No.: G2S24018C

Lab No.: 24027A


Project Name: Proposed Mixed Use Development - Fieldgate Dr., Mississauga

Borehole/Sample No.: BH101-S5

ISSMGE SOIL CLASSIFICATION

CLAY	SILT			SAND			GRAVEL		
	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE

SIEVE SIZE: 1 2 6 20 60#200 #100 #50 #16 #8 #4 3/8" 3/4" 2-1/2"

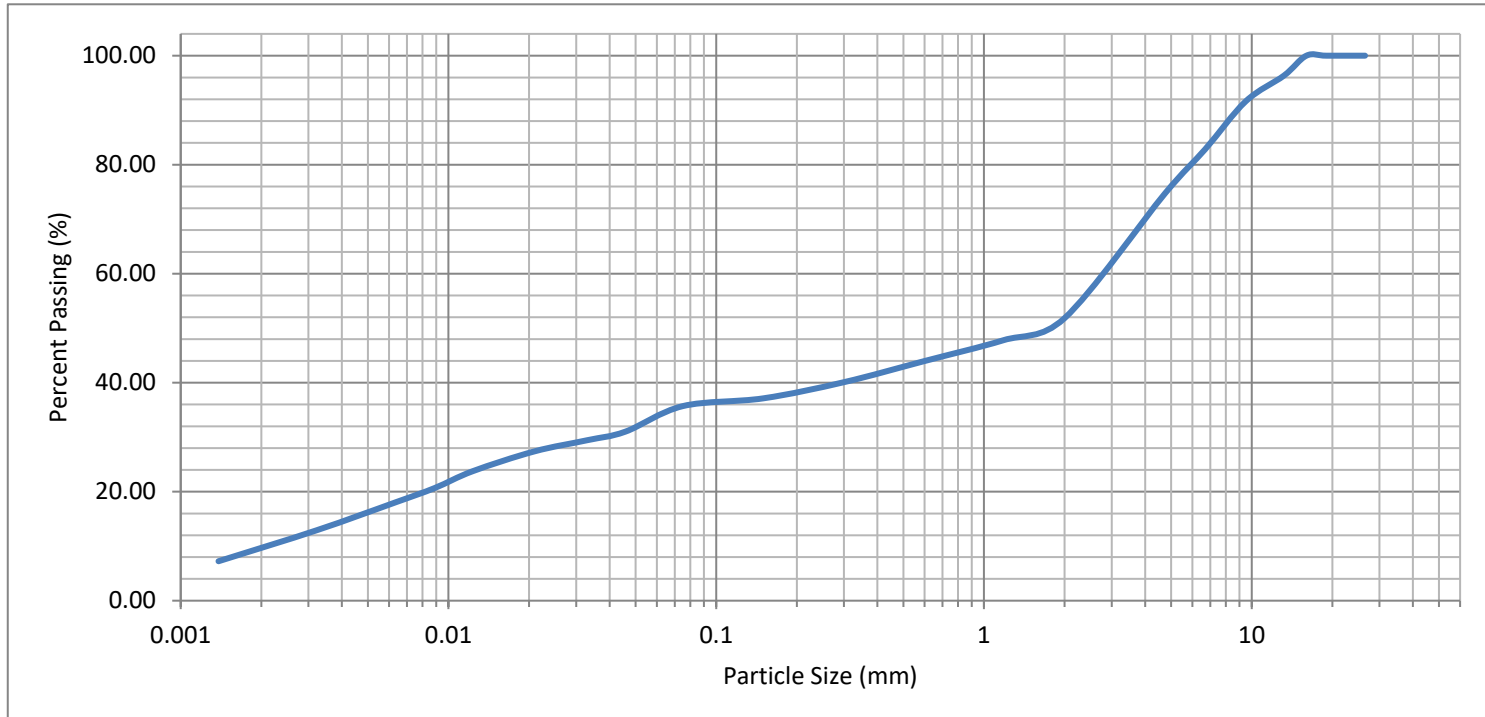

Project No.: G2S24018C

Lab No.: 24027B


Project Name: Proposed Mixed Use Development - Fieldgate Dr., Mississauga

Borehole/Sample No.: BH105-S8

ISSMGE SOIL CLASSIFICATION

CLAY	SILT			SAND			GRAVEL		
	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE

SIEVE SIZE: 1 2 6 20 60#200 #100 #50 #16 #8 #4 3/8" 3/4" 2-1/2"

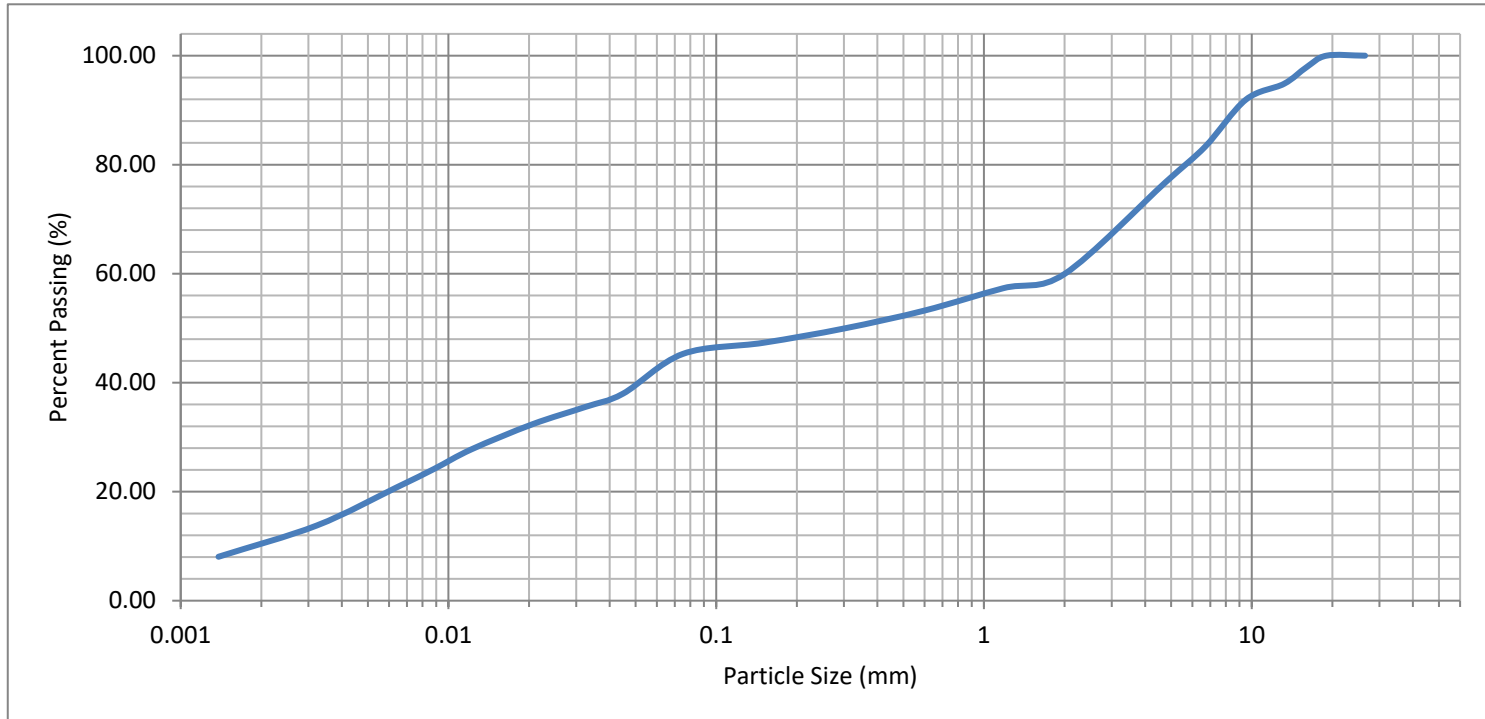

Project No.: G2S24018C

Lab No.: 24027C


Project Name: Proposed Mixed Use Development - Fieldgate Dr., Mississauga

Borehole/Sample No.: BH109-S10

ISSMGE SOIL CLASSIFICATION

CLAY	SILT			SAND			GRAVEL		
	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE

SIEVE SIZE: 1 2 6 20 60#200 #100 #50 #16 #8 #4 3/8" 3/4" 2-1/2"

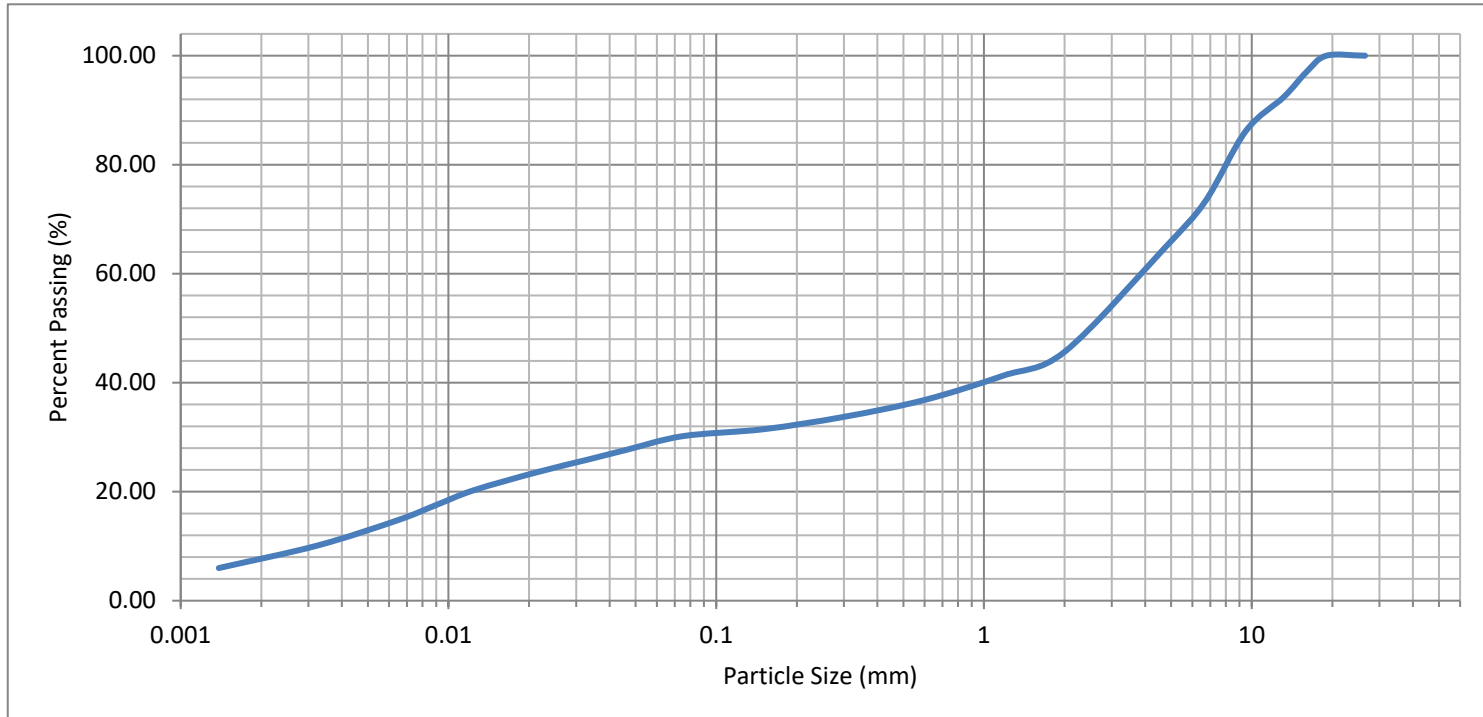

**Appendix F:
Laboratory Certificates of Analysis**



Subcontracted Analysis

G2S Environmental Consulting Inc. (Burlington)

4361 Harvester Rd, Unit 12
Burlington, ON L7L 5M4
Attn: Jacob Pinter

Paracel Report No. **2420104**
Client Project(s): **Fieldgate**
Client PO: **G2S24018**
Reference: **#24-345 Mississauga - Peel Sewer By-Law**
CoC Number: **66341**

Order Date: 13-May-24
Report Date: 24-May-24

Sample(s) from this project were subcontracted for the listed parameters. A copy of the subcontractor's report is attached

Paracel ID	Client ID	Analysis
2420104-01	BH/MW106-UF	Peel - Sanitary: Nonylphenols & Ethoxylates



SGS Canada Inc.

P.O. Box 4300 - 185 Concession St.
Lakefield - Ontario - KOL 2H0
Phone: 705-652-2000 FAX: 705-652-6365

23-May-2024

Paracel Laboratories

Attn : Dale Robertson

300-2319 St.Laurent Blvd.
Ottawa, ON
K1G 4K6, Canada

Phone: 613-731-9577
Fax:613-731-9064

Date Rec. : 16 May 2024
LR Report: CA12482-MAY24
Reference: Project#: 2420104

Copy: #1

CERTIFICATE OF ANALYSIS

Final Report

Sample ID	Sample Date & Time	Temperature Upon Receipt °C	Nonylphenol µg/L	Nonylphenol Ethoxylates µg/L	Nonylphenol monoethoxylate µg/L	Nonylphenol diethoxylate µg/L
1: Analysis Start Date		---	21-May-24	21-May-24	21-May-24	21-May-24
2: Analysis Start Time		---	11:12	11:12	11:12	11:12
3: Analysis Completed Date		---	22-May-24	22-May-24	22-May-24	22-May-24
4: Analysis Completed Time		---	15:15	15:15	15:15	15:15
5: RL		---	1	10	10	10
6: BH/MW106 - UF	13-May-24 13:00	8.0	< 1	< 10	< 10	< 10

RL - SGS Reporting Limit

Nonyl phenol Ethoxylates is the sum of nonyl phenol monoethoxylate and nonyl phenol diethoxylate.

Kimberley Didsbury
Project Specialist,
Environment, Health & Safety



SGS Canada Inc.

P.O. Box 4300 - 185 Concession St.

Lakefield - Ontario - KOL 2H0

Phone: 705-652-2000 FAX: 705-652-6365

LR Report :

CA12482-MAY24

Quality Control Report

Organic Analysis													
Parameter	Reporting Limit	Unit	Method Blank	Duplicate				LCS / Spike Blank			Matrix Spike / Reference Material		
				Result 1	Result 2	RPD	Acceptance Criteria	Spike Recovery (%)	Recovery Limits (%)		Spike Recovery (%)	Recovery Limits (%)	
									Low	High		Low	High
<i>Nonylphenol and Ethoxylates - QCBatchID: GCM0307-MAY24</i>													
Nonylphenol	1.0	µg/L	<1					55	55	120			
Nonylphenol diethoxylate	10	µg/L	<10					73	55	120			
Nonylphenol Ethoxylates	10	µg/L	<10										
Nonylphenol monoethoxylate	10	µg/L	<10					67	55	120			



vd.
J8
com

Parcel Order Number
(Lab Use Only)

2420104

Chain Of Custody
(Lab Use Only)

No 66341

Client Name: <u>Gas</u>	Project Ref: <u>Fieldgate</u>	Page <u>1</u> of <u>1</u>
Contact Name: <u>Jacob Pinter + Whitney Bowden</u>	Quote #: <u>standing offer</u>	Turnaround Time <input type="checkbox"/> 1 day <input type="checkbox"/> 3 day <input type="checkbox"/> 2 day <input checked="" type="checkbox"/> Regular Date Required: _____
Address: <u>Burlington</u>	PO #: <u>Gas24018</u>	
Telephone: <u>905 719 5253</u>	E-mail: <u>jacob.p@gasconsulting.com</u> <u>whitney.b@gasconsulting.com</u>	

<input type="checkbox"/> REG 153/04 <input type="checkbox"/> REG 406/19 Other Regulation		Matrix Type: S (Soil/Sed.) GW (Ground Water) SW (Surface Water) SS (Storm/Sanitary Sewer) P (Paint) A (Air) O (Other)		Required Analysis													
<input type="checkbox"/> Table 1 <input type="checkbox"/> Res/Park <input type="checkbox"/> Med/Fine <input type="checkbox"/> Table 2 <input type="checkbox"/> Ind/Comm <input type="checkbox"/> Coarse <input type="checkbox"/> Table 3 <input type="checkbox"/> Agri/Other <input type="checkbox"/> Table _____	<input type="checkbox"/> REG 558 <input type="checkbox"/> PWQO <input type="checkbox"/> CCME <input type="checkbox"/> MISA <input checked="" type="checkbox"/> SU - Sani <input type="checkbox"/> SU - Storm Mun: <u> Peel Region </u> <input type="checkbox"/> Other:	Matrix	Air Volume	# of Containers	Sample Taken												
For RSC: <input type="checkbox"/> Yes <input type="checkbox"/> No					Date	Time											
Sample ID/Location Name																	
1	<u>BH/mw 106-UF</u>	<u>GW</u>		<u>14</u>	<u>May 13/24</u>	<u>1pm</u>	<u>X</u>										
2																	
3																	
4																	
5																	
6																	
7																	
8																	
9																	
10																	

Peel Region Sanitary Sewer Package

Comments:			Method of Delivery: <u>Hand Delivered</u>		
Relinquished By (Sign): <u>Jacob Pinter</u>	Received By Driver/Depot: <u>JH</u>	Received at Lab: <u>SO</u>	Verified By: <u>SO</u>		
Relinquished By (Print): <u>Jacob Pinter</u>	Date/Time: <u>May 13/24 17:00</u>	Date/Time: <u>May 15, 2024 9:26</u>	Date/Time: <u>May 15, 2024 4:44</u>		
Date/Time: <u>May 13/24 (4:40pm)</u>	Temperature: <u>17.7 °C</u>	Temperature: <u>16.7 °C</u>	pH Verified: <input type="checkbox"/>	By: <u>SO</u>	

Certificate of Analysis

G2S Environmental Consulting Inc. (Burlington)

4361 Harvester Rd, Unit 12

Burlington, ON L7L 5M4

Attn: Jacob Pinter

Client PO: G2S24018

Project: Fieldgate

Custody: 66343

Report Date: 16-May-2024

Order Date: 13-May-2024

Order #: 2420107

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

Parcel ID	Client ID
2420107-01	BH/MW106-F

Approved By:



Mark Foto, M.Sc.

Lab Supervisor

Certificate of Analysis

Report Date: 16-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Analysis Summary Table

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Metals, ICP-MS	EPA 200.8 - ICP-MS	15-May-24	15-May-24
Total Suspended Solids	SM 2540D - Gravimetric	15-May-24	16-May-24

Certificate of Analysis

Report Date: 16-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Summary of Criteria Exceedances

(If this page is blank then there are no exceedances)

Only those criteria that a sample exceeds will be highlighted in red

Regulatory Comparison:

Paracel Laboratories has provided regulatory guidelines on this report for informational purposes only and makes no representations or warranties that the data is accurate or reflects the current regulatory values. The user is advised to consult with the appropriate official regulations to evaluate compliance. Sample results that are highlighted have exceeded the selected regulatory limit. Calculated uncertainty estimations have not been applied for determining regulatory exceedances.

Sample	Analyte	MDL / Units	Result	Sewer Use - Peel: San/Comb	Sewer Use - Mississauga: Storm
--------	---------	-------------	--------	-------------------------------	-----------------------------------

Certificate of Analysis

Report Date: 16-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Client ID:	BH/MW106-F	-	-	-	Criteria:	
Sample Date:	13-May-24 09:00	-	-	-	Sewer Use - Peel:	Sewer Use -
Sample ID:	2420107-01	-	-	-	San/Comb	Mississauga: Storm
Matrix:	Groundwater	-	-	-		
MDL/Units						

General Inorganics

Total Suspended Solids	2 mg/L	9	-	-	-	350 mg/L	15 mg/L
------------------------	--------	---	---	---	---	----------	---------

Metals - Total

Aluminum	0.01 mg/L	<0.01	-	-	-	50 mg/L	1 mg/L
Antimony	0.001 mg/L	<0.001	-	-	-	5 mg/L	-
Arsenic	0.01 mg/L	<0.01	-	-	-	1 mg/L	0.02 mg/L
Bismuth	0.005 mg/L	<0.005	-	-	-	-	-
Boron	0.05 mg/L	3.61	-	-	-	-	-
Cadmium	0.001 mg/L	<0.001	-	-	-	0.7 mg/L	0.008 mg/L
Chromium	0.05 mg/L	<0.05	-	-	-	5 mg/L	0.08 mg/L
Cobalt	0.001 mg/L	0.002	-	-	-	5 mg/L	-
Copper	0.005 mg/L	<0.005	-	-	-	3 mg/L	0.04 mg/L
Lead	0.001 mg/L	<0.001	-	-	-	3 mg/L	0.12 mg/L
Manganese	0.05 mg/L	0.44	-	-	-	5 mg/L	2 mg/L
Molybdenum	0.005 mg/L	0.010	-	-	-	5 mg/L	-
Nickel	0.005 mg/L	<0.005	-	-	-	3 mg/L	0.08 mg/L
Selenium	0.005 mg/L	<0.005	-	-	-	1 mg/L	0.02 mg/L
Silver	0.001 mg/L	<0.001	-	-	-	5 mg/L	0.12 mg/L
Tin	0.01 mg/L	<0.01	-	-	-	5 mg/L	-
Titanium	0.01 mg/L	<0.01	-	-	-	5 mg/L	-
Vanadium	0.001 mg/L	<0.001	-	-	-	-	-
Zinc	0.02 mg/L	<0.02	-	-	-	3 mg/L	0.2 mg/L

Certificate of Analysis

Report Date: 16-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Blank

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
General Inorganics								
Total Suspended Solids	ND	2	mg/L					
Metals - Total								
Aluminum	ND	0.01	mg/L					
Antimony	ND	0.001	mg/L					
Arsenic	ND	0.01	mg/L					
Bismuth	ND	0.005	mg/L					
Boron	ND	0.05	mg/L					
Cadmium	ND	0.001	mg/L					
Chromium	ND	0.05	mg/L					
Cobalt	ND	0.001	mg/L					
Copper	ND	0.005	mg/L					
Lead	ND	0.001	mg/L					
Manganese	ND	0.05	mg/L					
Molybdenum	ND	0.005	mg/L					
Nickel	ND	0.005	mg/L					
Selenium	ND	0.005	mg/L					
Silver	ND	0.001	mg/L					
Tin	ND	0.01	mg/L					
Titanium	ND	0.01	mg/L					
Vanadium	ND	0.001	mg/L					
Zinc	ND	0.02	mg/L					

Certificate of Analysis

Report Date: 16-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Duplicate

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
General Inorganics									
Total Suspended Solids	40.0	2	mg/L	43.0			7.2	10	
Metals - Total									
Aluminum	4.53	0.01	mg/L	4.47			1.4	20	
Antimony	ND	0.001	mg/L	ND			NC	20	
Arsenic	ND	0.01	mg/L	ND			NC	20	
Bismuth	ND	0.005	mg/L	ND			NC	20	
Boron	3.47	0.05	mg/L	3.43			1.3	20	
Cadmium	ND	0.001	mg/L	ND			NC	20	
Chromium	ND	0.05	mg/L	ND			NC	20	
Cobalt	0.006	0.001	mg/L	0.005			7.4	20	
Copper	0.008	0.005	mg/L	0.007			7.1	20	
Lead	0.002	0.001	mg/L	0.002			5.3	20	
Manganese	0.571	0.05	mg/L	0.549			3.9	20	
Molybdenum	0.009	0.005	mg/L	0.009			1.0	20	
Nickel	0.010	0.005	mg/L	0.010			2.1	20	
Selenium	ND	0.005	mg/L	ND			NC	20	
Silver	ND	0.001	mg/L	ND			NC	20	
Tin	ND	0.01	mg/L	ND			NC	20	
Titanium	0.060	0.01	mg/L	0.062			4.4	20	
Vanadium	0.011	0.001	mg/L	0.011			1.2	20	
Zinc	ND	0.02	mg/L	ND			NC	20	

Certificate of Analysis

Report Date: 16-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Spike

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
General Inorganics									
Total Suspended Solids	23.0	2	mg/L	ND	107	75-125			
Metals - Total									
Aluminum	59.1	0.01	mg/L	ND	118	80-120			
Arsenic	54.6	0.01	mg/L	0.436	108	80-120			
Bismuth	52.7	0.005	mg/L	0.168	105	80-120			
Boron	395	0.05	mg/L	343	105	80-120			
Cadmium	53.7	0.001	mg/L	0.003	107	80-120			
Chromium	65.5	0.05	mg/L	0.799	129	80-120			QM-07
Cobalt	61.7	0.001	mg/L	0.528	122	80-120			QM-07
Copper	56.2	0.005	mg/L	0.717	111	80-120			
Lead	50.2	0.001	mg/L	0.193	100	80-120			
Manganese	122	0.05	mg/L	54.9	134	80-120			QM-07
Molybdenum	59.4	0.005	mg/L	0.866	117	80-120			
Nickel	59.5	0.005	mg/L	0.986	117	80-120			
Selenium	45.6	0.005	mg/L	0.095	91.1	80-120			
Silver	52.6	0.001	mg/L	0.062	105	80-120			
Tin	54.4	0.01	mg/L	0.145	109	80-120			
Titanium	73.7	0.01	mg/L	6.24	135	80-120			QM-07
Vanadium	66.7	0.001	mg/L	1.11	131	80-120			QM-07
Zinc	51.0	0.02	mg/L	1.75	98.4	80-120			

Certificate of Analysis

Report Date: 16-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Qualifier Notes:

QC Qualifiers:

QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

Sample Data Revisions:

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.



Parcel Order Number (Lab Use Only) 2420107	Chain Of Custody (Lab Use Only) Nº 66343
---	---

Client Name: G2S	Project Ref: Fieldgate	Page 1 of 1
Contact Name: Jacob Pinter + Whitney Bader	Quote #: Standing Offer	Turnaround Time <input type="checkbox"/> 1 day <input type="checkbox"/> 3 day <input type="checkbox"/> 2 day <input checked="" type="checkbox"/> Regular Date Required: _____
Address: Burlington	PO #: G2S24018	
Telephone: 705 719 5253	E-mail: jacobp@g2sconsulting.com whitneyb@g2sconsulting.com	

<input type="checkbox"/> REG 153/04 <input type="checkbox"/> REG 406/19 Other Regulation <input type="checkbox"/> Table 1 <input type="checkbox"/> Res/Park <input type="checkbox"/> Med/Fine <input type="checkbox"/> REG 558 <input type="checkbox"/> PWQO <input type="checkbox"/> Table 2 <input type="checkbox"/> Ind/Comm <input type="checkbox"/> Coarse <input type="checkbox"/> CCME <input type="checkbox"/> MISA <input type="checkbox"/> Table 3 <input type="checkbox"/> Agri/Other <input checked="" type="checkbox"/> SU - San <input checked="" type="checkbox"/> SU - Storm <input type="checkbox"/> Table _____ <input type="checkbox"/> Other: _____ For RSC: <input type="checkbox"/> Yes <input type="checkbox"/> No		Matrix Type: S (Soil/Sed.) GW (Ground Water) SW (Surface Water) SS (Storm/Sanitary Sewer) P (Paint) A (Air) O (Other)	Required Analysis																	
Sample ID/Location Name	Matrix	Air Volume	# of Containers	Sample Taken		Metals	TSS													
1 BH/MW 106 - F	GW		2	May 13/24	1:45pm	X	X													
2																				
3																				
4																				
5																				
6																				
7																				
8																				
9																				
10																				

Comments:			Method of Delivery:		
Relinquished By (Sign): [Signature]	Received By Driver/Depot: [Signature]	Received at Lab: SO	Verified By: [Signature]		
Relinquished By (Print): Jacob Pinter	Date/Time: May 13/24 17:00	Date/Time: May 15, 2024 9:20am	Date/Time: May 15, 2024 9:43am		
Date/Time: May 13/24 (4:45pm)	Temperature: 16.1 °C	Temperature: 16.7 °C	pH Verified: 5.0		

Certificate of Analysis

G2S Environmental Consulting Inc. (Burlington)

4361 Harvester Rd, Unit 12

Burlington, ON L7L 5M4

Attn: Jacob Pinter

Client PO: G2S24018

Project: Fieldgate

Custody: 66342

Report Date: 24-May-2024

Order Date: 13-May-2024

Order #: 2420105

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

Parcel ID	Client ID
2420105-01	BH/MW106-UF

Approved By:



Dale Robertson, BSc

Laboratory Director

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Analysis Summary Table

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Biochemical Oxygen Demand	SM 5210B - DO Probe	16-May-24	16-May-24
Chlorine, total	HACH - DPD Colourimetric	15-May-24	15-May-24
Chromium, hexavalent - water	MOE E3056 - colourimetric	15-May-24	15-May-24
Cyanide, total	MOE E3015 - Auto Colour	16-May-24	16-May-24
E. coli	MOE E3407	15-May-24	15-May-24
Mercury by CVAA	EPA 245.2 - Cold Vapour AA	16-May-24	16-May-24
Metals, ICP-MS	EPA 200.8 - ICP-MS	15-May-24	15-May-24
Mississauga - Storm: VOCs	EPA 624 - P&T GC-MS	23-May-24	23-May-24
PAHs by GC-MS, Sewer Use	based on EPA 8270 - GC-MS, extraction	23-May-24	24-May-24
PCBs, total	EPA 608 - GC-ECD	17-May-24	17-May-24
pH	EPA 150.1 - pH probe @25 °C	16-May-24	16-May-24
Phenolics	EPA 420.2 - Auto Colour, 4AAP	16-May-24	16-May-24
Phosphorus, total, water	EPA 365.4 - Auto Colour, digestion	16-May-24	16-May-24
Total Suspended Solids	SM 2540D - Gravimetric	15-May-24	16-May-24

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Summary of Criteria Exceedances

(If this page is blank then there are no exceedances)

Only those criteria that a sample exceeds will be highlighted in

Regulatory Comparison:

Paracel Laboratories has provided regulatory guidelines on this report for informational purposes only and makes no representations or warranties that the data is accurate or reflects the current regulatory values. The user is advised to consult with the appropriate official regulations to evaluate compliance. Sample results that are highlighted have exceeded the selected regulatory limit. Calculated uncertainty estimations have not been applied for determining regulatory exceedances.

Sample	Analyte	MDL / Units	Result	Sewer Use - Mississauga: Storm	-
BH/MW106-UF	Total Suspended Solids	2 mg/L	153	15 mg/L	-
BH/MW106-UF	Aluminum	0.01 mg/L	4.04	1 mg/L	-

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Client ID:	BH/MW106-UF	-	-	-	Criteria:
Sample Date:	13-May-24 13:30	-	-	-	Sewer Use -
Sample ID:	2420105-01	-	-	-	Mississauga: Storm
Matrix:	Groundwater	-	-	-	
MDL/Units					

Microbiological Parameters

E. coli	1 CFU/100mL	54 [2]	-	-	-	200 CFU/100mL	-
---------	-------------	--------	---	---	---	---------------	---

General Inorganics

BOD	2 mg/L	8	-	-	-	15 mg/L	-
Chlorine, total	0.01 mg/L	<0.01 [3]	-	-	-	1 mg/L	-
Cyanide, total	0.01 mg/L	<0.01	-	-	-	0.02 mg/L	-
pH	0.1 pH Units	7.7	-	-	-	6.00 - 9.00 pH Units	-
Phenolics	0.001 mg/L	<0.001	-	-	-	0.008 mg/L	-
Phosphorus, total	0.01 mg/L	0.09	-	-	-	0.4 mg/L	-
Total Suspended Solids	2 mg/L	153	-	-	-	15 mg/L	-

Metals

Chromium (VI)	10 ug/L	<10	-	-	-	0.04 mg/L	-
---------------	---------	-----	---	---	---	-----------	---

Metals - Total

Aluminum	0.01 mg/L	4.04	-	-	-	1 mg/L	-
Arsenic	0.01 mg/L	<0.01	-	-	-	0.02 mg/L	-
Cadmium	0.001 mg/L	<0.001	-	-	-	0.008 mg/L	-
Chromium	0.05 mg/L	<0.05	-	-	-	0.08 mg/L	-
Copper	0.005 mg/L	0.007	-	-	-	0.04 mg/L	-
Lead	0.001 mg/L	0.002	-	-	-	0.12 mg/L	-
Manganese	0.05 mg/L	0.50	-	-	-	2 mg/L	-
Mercury	0.0001 mg/L	<0.0001	-	-	-	0.0004 mg/L	-
Nickel	0.005 mg/L	0.010	-	-	-	0.08 mg/L	-
Selenium	0.005 mg/L	<0.005	-	-	-	0.02 mg/L	-
Silver	0.001 mg/L	<0.001	-	-	-	0.12 mg/L	-
Zinc	0.02 mg/L	<0.02	-	-	-	0.2 mg/L	-

Volatiles

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Client ID:	BH/MW106-UF	-	-	-	Criteria:
Sample Date:	13-May-24 13:30	-	-	-	Sewer Use -
Sample ID:	2420105-01	-	-	-	Mississauga: Storm
Matrix:	Groundwater	-	-	-	
MDL/Units					

Volatiles

Benzene	0.5 ug/L	<0.5	-	-	-	0.002 mg/L	-
1,2-Dichlorobenzene	0.5 ug/L	<0.5	-	-	-	0.0056 mg/L	-
1,4-Dichlorobenzene	0.5 ug/L	<0.5	-	-	-	0.0068 mg/L	-
Ethylbenzene	0.5 ug/L	<0.5	-	-	-	0.002 mg/L	-
Methylene Chloride	5.0 ug/L	<5.0	-	-	-	0.0052 mg/L	-
1,1,2,2-Tetrachloroethane	0.5 ug/L	<0.5	-	-	-	0.017 mg/L	-
1,1,2,2-Tetrachloroethane	0.5 ug/L	<0.5	-	-	-	0.0044 mg/L	-
Tetrachloroethylene	0.5 ug/L	<0.5	-	-	-	0.0044 mg/L	-
Toluene	0.5 ug/L	<0.5	-	-	-	0.002 mg/L	-
Trichloroethylene	0.5 ug/L	<0.5	-	-	-	0.0076 mg/L	-
m,p-Xylenes	0.5 ug/L	<0.5	-	-	-	-	-
o-Xylene	0.5 ug/L	<0.5	-	-	-	-	-
Xylenes, total	0.5 ug/L	<0.5	-	-	-	0.0044 mg/L	-
4-Bromofluorobenzene	Surrogate	109%	-	-	-	-	-
Dibromofluoromethane	Surrogate	114%	-	-	-	-	-
Toluene-d8	Surrogate	110%	-	-	-	-	-

Semi-Volatiles

1-Methylnaphthalene	0.00005 mg/L	<0.00005	-	-	-	-	-
2-Methylnaphthalene	0.00005 mg/L	<0.00005	-	-	-	-	-
Acenaphthene	0.00005 mg/L	<0.00005	-	-	-	-	-
Acenaphthylene	0.00005 mg/L	<0.00005	-	-	-	-	-
Anthracene	0.00001 mg/L	<0.00001	-	-	-	-	-
Benzo [a] anthracene	0.00001 mg/L	<0.00001	-	-	-	-	-
Benzo [a] pyrene	0.00001 mg/L	<0.00001	-	-	-	-	-
Benzo [b] fluoranthene	0.00005 mg/L	<0.00005	-	-	-	-	-

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Client ID:	BH/MW106-UF	-	-	-	Criteria: Sewer Use - Mississauga: Storm
Sample Date:	13-May-24 13:30	-	-	-	
Sample ID:	2420105-01	-	-	-	
Matrix:	Groundwater	-	-	-	
MDL/Units					

Semi-Volatiles

Benzo [g,h,i] perylene	0.00005 mg/L	<0.00005	-	-	-	-
Benzo [k] fluoranthene	0.00005 mg/L	<0.00005	-	-	-	-
Chrysene	0.00005 mg/L	<0.00005	-	-	-	-
Dibenzo [a,h] anthracene	0.00005 mg/L	<0.00005	-	-	-	-
Fluoranthene	0.00001 mg/L	<0.00001	-	-	-	-
Fluorene	0.00005 mg/L	<0.00005	-	-	-	-
Indeno [1,2,3-cd] pyrene	0.00005 mg/L	<0.00005	-	-	-	-
Naphthalene	0.00005 mg/L	<0.00005	-	-	-	-
Phenanthrene	0.00005 mg/L	<0.00005	-	-	-	-
Pyrene	0.00001 mg/L	<0.00001	-	-	-	-
PAHs, Total	0.0034 mg/L	<0.0007	-	-	-	0.002 mg/L
2-Fluorobiphenyl	Surrogate	72.4%	-	-	-	-
Terphenyl-d14	Surrogate	94.8%	-	-	-	-

PCBs

PCBs, total	0.0001 mg/L	<0.0001	-	-	-	0.0004 mg/L
Decachlorobiphenyl	Surrogate	63.7%	-	-	-	-

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Blank

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
General Inorganics								
BOD	ND	2	mg/L					
Chlorine, total	ND	0.01	mg/L					
Cyanide, total	ND	0.01	mg/L					
Phenolics	ND	0.001	mg/L					
Phosphorus, total	ND	0.01	mg/L					
Total Suspended Solids	ND	2	mg/L					
Metals								
Chromium (VI)	ND	10	ug/L					
Metals - Total								
Aluminum	ND	0.01	mg/L					
Arsenic	ND	0.01	mg/L					
Cadmium	ND	0.001	mg/L					
Chromium	ND	0.05	mg/L					
Copper	ND	0.005	mg/L					
Lead	ND	0.001	mg/L					
Mercury	ND	0.0001	mg/L					
Manganese	ND	0.05	mg/L					
Nickel	ND	0.005	mg/L					
Selenium	ND	0.005	mg/L					
Silver	ND	0.001	mg/L					
Zinc	ND	0.02	mg/L					
Microbiological Parameters								
E. coli	ND	1	CFU/100mL					
PCBs								
PCBs, total	ND	0.0001	mg/L					
Surrogate: Decachlorobiphenyl	1.00042		%	84.7	60-140			
Semi-Volatiles								
1-Methylnaphthalene	ND	0.00005	mg/L					
2-Methylnaphthalene	ND	0.00005	mg/L					
Acenaphthene	ND	0.00005	mg/L					
Acenaphthylene	ND	0.00005	mg/L					
Anthracene	ND	0.00001	mg/L					

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Blank

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
Benzo [a] anthracene	ND	0.00001	mg/L					
Benzo [a] pyrene	ND	0.00001	mg/L					
Benzo [b] fluoranthene	ND	0.00005	mg/L					
Benzo [g,h,i] perylene	ND	0.00005	mg/L					
Benzo [k] fluoranthene	ND	0.00005	mg/L					
Chrysene	ND	0.00005	mg/L					
Dibenzo [a,h] anthracene	ND	0.00005	mg/L					
Fluoranthene	ND	0.00001	mg/L					
Fluorene	ND	0.00005	mg/L					
Indeno [1,2,3-cd] pyrene	ND	0.00005	mg/L					
Naphthalene	ND	0.00005	mg/L					
Phenanthrene	ND	0.00005	mg/L					
Pyrene	ND	0.00001	mg/L					
<i>Surrogate: 2-Fluorobiphenyl</i>	<i>0.0126</i>		%	<i>62.8</i>	<i>31-154</i>			
<i>Surrogate: Terphenyl-d14</i>	<i>0.0158</i>		%	<i>79.2</i>	<i>37-156</i>			
Volatiles								
Benzene	ND	0.5	ug/L					
1,2-Dichlorobenzene	ND	0.5	ug/L					
1,4-Dichlorobenzene	ND	0.5	ug/L					
Ethylbenzene	ND	0.5	ug/L					
Methylene Chloride	ND	5.0	ug/L					
1,1,1,2-Tetrachloroethane	ND	0.5	ug/L					
Tetrachloroethylene	ND	0.5	ug/L					
Toluene	ND	0.5	ug/L					
Trichloroethylene	ND	0.5	ug/L					
m,p-Xylenes	ND	0.5	ug/L					
o-Xylene	ND	0.5	ug/L					
Xylenes, total	ND	0.5	ug/L					
<i>Surrogate: 4-Bromofluorobenzene</i>	<i>78.2</i>		%	<i>97.8</i>	<i>50-140</i>			
<i>Surrogate: Dibromofluoromethane</i>	<i>62.8</i>		%	<i>78.5</i>	<i>50-140</i>			
<i>Surrogate: Toluene-d8</i>	<i>81.9</i>		%	<i>102</i>	<i>50-140</i>			

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Duplicate

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
General Inorganics									
BOD	508	2	mg/L	ND			NC	20	
Chlorine, total	ND	0.01	mg/L	ND			NC	13	INOG15
Cyanide, total	ND	0.01	mg/L	ND			NC	20	
pH	8.1	0.1	pH Units	8.1			0.1	3.3	
Phenolics	ND	0.001	mg/L	ND			NC	10	
Phosphorus, total	0.016	0.01	mg/L	0.018			13.5	15	
Total Suspended Solids	40.0	2	mg/L	43.0			7.2	10	
Metals									
Chromium (VI)	ND	10	ug/L	ND			NC	20	
Metals - Total									
Aluminum	4.53	0.01	mg/L	4.47			1.4	20	
Arsenic	ND	0.01	mg/L	ND			NC	20	
Cadmium	ND	0.001	mg/L	ND			NC	20	
Chromium	ND	0.05	mg/L	ND			NC	20	
Copper	0.008	0.005	mg/L	0.007			7.1	20	
Lead	0.002	0.001	mg/L	0.002			5.3	20	
Mercury	ND	0.0001	mg/L	ND			NC	20	
Manganese	0.571	0.05	mg/L	0.549			3.9	20	
Nickel	0.010	0.005	mg/L	0.010			2.1	20	
Selenium	ND	0.005	mg/L	ND			NC	20	
Silver	ND	0.001	mg/L	ND			NC	20	
Zinc	ND	0.02	mg/L	ND			NC	20	
Microbiological Parameters									
E. coli	22	1	CFU/100mL	30			30.8	30	BAC04, BAC12
Volatiles									
Benzene	ND	0.5	ug/L	ND			NC	30	
1,2-Dichlorobenzene	ND	0.5	ug/L	ND			NC	30	
1,4-Dichlorobenzene	ND	0.5	ug/L	ND			NC	30	
Ethylbenzene	ND	0.5	ug/L	ND			NC	30	
Methylene Chloride	ND	5.0	ug/L	ND			NC	30	

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Duplicate

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
1,1,2,2-Tetrachloroethane	ND	0.5	ug/L	ND			NC	30	
Tetrachloroethylene	ND	0.5	ug/L	ND			NC	30	
Toluene	ND	0.5	ug/L	ND			NC	30	
Trichloroethylene	ND	0.5	ug/L	ND			NC	30	
m,p-Xylenes	ND	0.5	ug/L	ND			NC	30	
o-Xylene	ND	0.5	ug/L	ND			NC	30	
Surrogate: 4-Bromofluorobenzene	75.6		%		94.5	50-140			
Surrogate: Dibromofluoromethane	78.8		%		98.5	50-140			
Surrogate: Toluene-d8	80.5		%		101	50-140			

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Spike

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
General Inorganics									
BOD	234	2	mg/L	ND	117	71-121			
Cyanide, total	0.049	0.01	mg/L	ND	97.5	64-136			
Phenolics	0.025	0.001	mg/L	ND	100	67-133			
Phosphorus, total	0.998	0.01	mg/L	0.018	98.0	80-120			
Total Suspended Solids	23.0	2	mg/L	ND	107	75-125			
Metals									
Chromium (VI)	200	10	ug/L	ND	100	70-130			
Metals - Total									
Aluminum	59.1	0.01	mg/L	ND	118	80-120			
Arsenic	54.6	0.01	mg/L	0.436	108	80-120			
Cadmium	53.7	0.001	mg/L	0.003	107	80-120			
Chromium	65.5	0.05	mg/L	0.799	129	80-120			QM-07
Copper	56.2	0.005	mg/L	0.717	111	80-120			
Lead	50.2	0.001	mg/L	0.193	100	80-120			
Mercury	0.0029	0.0001	mg/L	ND	95.3	70-130			
Manganese	122	0.05	mg/L	54.9	134	80-120			QM-07
Nickel	59.5	0.005	mg/L	0.986	117	80-120			
Selenium	45.6	0.005	mg/L	0.095	91.1	80-120			
Silver	52.6	0.001	mg/L	0.062	105	80-120			
Zinc	51.0	0.02	mg/L	1.75	98.4	80-120			
PCBs									
PCBs, total	0.001	0.0001	mg/L	ND	124	60-140			
Surrogate: Decachlorobiphenyl	0.000450		%		90.0	60-140			
Semi-Volatiles									
1-Methylnaphthalene	0.00388	0.00005	mg/L	ND	77.6	25-127			
2-Methylnaphthalene	0.00379	0.00005	mg/L	ND	75.8	21-119			
Acenaphthene	0.00350	0.00005	mg/L	ND	70.0	50-140			
Acenaphthylene	0.00327	0.00005	mg/L	ND	65.4	50-140			
Anthracene	0.00311	0.00001	mg/L	ND	62.3	29-126			
Benzo [a] anthracene	0.00338	0.00001	mg/L	ND	67.6	29-126			

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Spike

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Benzo [a] pyrene	0.00387	0.00001	mg/L	ND	77.4	29-111			
Benzo [b] fluoranthene	0.00428	0.00005	mg/L	ND	85.6	26-111			
Benzo [g,h,i] perylene	0.00391	0.00005	mg/L	ND	78.1	23-128			
Benzo [k] fluoranthene	0.00394	0.00005	mg/L	ND	78.8	23-135			
Chrysene	0.00388	0.00005	mg/L	ND	77.7	29-137			
Dibenzo [a,h] anthracene	0.00395	0.00005	mg/L	ND	79.1	20-131			
Fluoranthene	0.00364	0.00001	mg/L	ND	72.7	24-131			
Fluorene	0.00333	0.00005	mg/L	ND	66.7	28-123			
Indeno [1,2,3-cd] pyrene	0.00371	0.00005	mg/L	ND	74.1	20-128			
Naphthalene	0.00343	0.00005	mg/L	ND	68.6	29-118			
Phenanthrene	0.00370	0.00005	mg/L	ND	74.1	34-108			
Pyrene	0.00403	0.00001	mg/L	ND	80.5	29-131			
<i>Surrogate: 2-Fluorobiphenyl</i>	<i>0.0120</i>		%		<i>60.2</i>	<i>31-154</i>			
<i>Surrogate: Terphenyl-d14</i>	<i>0.0141</i>		%		<i>70.4</i>	<i>37-156</i>			
Volatiles									
Benzene	42.2	0.5	ug/L	ND	105	60-130			
1,2-Dichlorobenzene	34.9	0.5	ug/L	ND	87.3	60-130			
1,4-Dichlorobenzene	36.6	0.5	ug/L	ND	91.4	60-130			
Ethylbenzene	38.4	0.5	ug/L	ND	96.0	60-130			
Methylene Chloride	40.6	5.0	ug/L	ND	102	60-130			
1,1,2,2-Tetrachloroethane	32.4	0.5	ug/L	ND	81.0	60-130			
Tetrachloroethylene	35.6	0.5	ug/L	ND	89.0	60-130			
Toluene	40.2	0.5	ug/L	ND	100	60-130			
Trichloroethylene	39.8	0.5	ug/L	ND	99.6	60-130			
m,p-Xylenes	73.0	0.5	ug/L	ND	91.2	60-130			
o-Xylene	35.7	0.5	ug/L	ND	89.4	60-130			
<i>Surrogate: 4-Bromofluorobenzene</i>	<i>78.3</i>		%		<i>97.9</i>	<i>50-140</i>			
<i>Surrogate: Dibromofluoromethane</i>	<i>89.2</i>		%		<i>111</i>	<i>50-140</i>			
<i>Surrogate: Toluene-d8</i>	<i>81.9</i>		%		<i>102</i>	<i>50-140</i>			

Certificate of Analysis

Report Date: 24-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Qualifier Notes:

Sample Qualifiers :

- 2: Confluent background colonies on filter: may interfere with target reactions and the analysts' ability to count E. coli & Total Coliform. The target colonies may be under-represented.
Applies to Samples: BH/MW106-UF
- 3: Chlorine in aqueous solutions is not stable and should be analyzed immediately after sampling (field measurement). This sample was analyzed after delivery to the lab.
Applies to Samples: BH/MW106-UF

QC Qualifiers:

- BAC04 Duplicate QC data falls within method prescribed 95% confidence limits.
- BAC12 Confluent background colonies on filter: may interfere with target reactions and the analysts' ability to count E. coli & Total Coliform. The target colonies may be under-represented.
- INOG15 Chlorine in aqueous solutions is not stable and should be analyzed immediately after sampling (field measurement). This sample was analyzed after delivery to the lab.
- QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

Sample Data Revisions:

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.



Parcel Order Number (Lab Use Only) 2420105	Chain Of Custody (Lab Use Only) No 66342
---	---

Client Name: G2S	Project Ref: Fieldgate	Page <u>1</u> of <u>1</u>
Contact Name: Jacob Pinter + Whitney Boudan	Quote #: Standing Offer	Turnaround Time <input type="checkbox"/> 1 day <input type="checkbox"/> 3 day <input type="checkbox"/> 2 day <input checked="" type="checkbox"/> Regular
Address: Burlington	PO #: G2S24018	
Telephone: 905 719 5253	E-mail: jacob.p@g2sconsulting.com whitney.b@g2sconsulting.com	Date Required: _____

<input type="checkbox"/> REG 153/04 <input type="checkbox"/> REG 406/19 Other Regulation <input type="checkbox"/> Table 1 <input type="checkbox"/> Res/Park <input type="checkbox"/> Med/Fine <input type="checkbox"/> REG 558 <input type="checkbox"/> PWQO <input type="checkbox"/> Table 2 <input type="checkbox"/> Ind/Comm <input type="checkbox"/> Coarse <input type="checkbox"/> CCME <input type="checkbox"/> MISA <input type="checkbox"/> Table 3 <input type="checkbox"/> Agri/Other <input type="checkbox"/> SU - Sani <input checked="" type="checkbox"/> SU - Storm <input type="checkbox"/> Table _____ For RSC: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Other: _____ Mun: Mississauga		Matrix Type: S (Soil/Sed.) GW (Ground Water) SW (Surface Water) SS (Storm/Sanitary Sewer) P (Paint) A (Air) O (Other)	Required Analysis																
Sample ID/Location Name	Matrix	Air Volume	# of Containers	Sample Taken	Date	Time													
BH/MW 106 - UF	GW		15	CITY OF MISSISSAUGA STORM SEWER DISCHARGE															
2																			
3																			
4																			
5																			
6																			
7																			
8																			
9																			
10																			

Comments:		Method of Delivery: Drop Box	
Relinquished By (Sign): [Signature]	Received By Driver/Depot: [Signature]	Received at Lab: SO	Verified By: SO
Relinquished By (Print): Jacob Pinter	Date/Time: May 13/24 17:00	Date/Time: May 15, 2024 9:20a	Date/Time: May 15, 2024 9:44a
Date/Time: May 13/24 (4:40pm)	Temperature: 17.9 °C	Temperature: 16.7 °C	pH Verified: <input checked="" type="checkbox"/> By: SO

Certificate of Analysis

G2S Environmental Consulting Inc. (Burlington)

4361 Harvester Rd, Unit 12

Burlington, ON L7L 5M4

Attn: Jacob Pinter

Client PO: G2S24018

Project: Fieldgate

Custody: 66341

Report Date: 27-May-2024

Order Date: 13-May-2024

Order #: 2420104

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

Parcel ID	Client ID
2420104-01	BH/MW106-UF

Approved By:



Mark Foto, M.Sc.

Lab Supervisor

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Analysis Summary Table

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Anions	EPA 300.1 - IC	15-May-24	15-May-24
CBOD	SM 5210B - DO Probe	16-May-24	21-May-24
Cyanide, total	MOE E3015 - Auto Colour	16-May-24	16-May-24
Mercury by CVAA	EPA 245.2 - Cold Vapour AA	16-May-24	16-May-24
Metals, ICP-MS	EPA 200.8 - ICP-MS	15-May-24	15-May-24
Oil & Grease, mineral/synthetic	SM5520F - Gravimetric	24-May-24	24-May-24
Oil & Grease, total	SM5520B - Gravimetric, hexane soluble	24-May-24	24-May-24
PCBs, total	EPA 608 - GC-ECD	17-May-24	17-May-24
Oil & Grease, animal/vegetable	SM5520 - Gravimetric	24-May-24	24-May-24
Peel - Sanitary: Phthalates	EPA 625	27-May-24	27-May-24
Peel - Sanitary: VOCs	EPA 624 - P&T GC-MS	15-May-24	15-May-24
pH	EPA 150.1 - pH probe @25 °C	16-May-24	16-May-24
Phenolics	EPA 420.2 - Auto Colour, 4AAP	16-May-24	16-May-24
Phosphorus, total, water	EPA 365.4 - Auto Colour, digestion	16-May-24	16-May-24
Total Kjeldahl Nitrogen	EPA 351.2 - Auto Colour, digestion	16-May-24	16-May-24
Total Suspended Solids	SM 2540D - Gravimetric	15-May-24	16-May-24

Certificate of Analysis

Report Date: 27-May-2024

Client: **G2S Environmental Consulting Inc. (Burlington)**

Order Date: 13-May-2024

Client PO: **G2S24018**

Project Description: **Fieldgate**

Summary of Criteria Exceedances

(If this page is blank then there are no exceedances)

Only those criteria that a sample exceeds will be highlighted in red

Regulatory Comparison:

Paracel Laboratories has provided regulatory guidelines on this report for informational purposes only and makes no representations or warranties that the data is accurate or reflects the current regulatory values. The user is advised to consult with the appropriate official regulations to evaluate compliance. Sample results that are highlighted have exceeded the selected regulatory limit. Calculated uncertainty estimations have not been applied for determining regulatory exceedances.

Sample	Analyte	MDL / Units	Result	Sewer Use - Peel: San/Comb	-
--------	---------	-------------	--------	-------------------------------	---

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Client ID:	BH/MW106-UF	-	-	-	Criteria:
Sample Date:	13-May-24 13:00	-	-	-	Sewer Use - Peel:
Sample ID:	2420104-01	-	-	-	San/Comb
Matrix:	Groundwater	-	-	-	-
MDL/Units					

General Inorganics

CBOD	2 mg/L	17	-	-	-	300 mg/L	-
Cyanide, total	0.01 mg/L	<0.01	-	-	-	2 mg/L	-
pH	0.1 pH Units	7.6	-	-	-	5.50 - 10.00 pH Units	-
Phenolics	0.001 mg/L	<0.001	-	-	-	1 mg/L	-
Phosphorus, total	0.01 mg/L	0.10	-	-	-	10 mg/L	-
Total Suspended Solids	2 mg/L	205	-	-	-	350 mg/L	-
Total Kjeldahl Nitrogen	0.1 mg/L	6.4	-	-	-	100 mg/L	-

Anions

Fluoride	0.1 mg/L	0.3	-	-	-	10 mg/L	-
Sulphate	1 mg/L	242	-	-	-	1500 mg/L	-

Metals - Total

Aluminum	0.01 mg/L	4.47	-	-	-	50 mg/L	-
Antimony	0.001 mg/L	<0.001	-	-	-	5 mg/L	-
Arsenic	0.01 mg/L	<0.01	-	-	-	1 mg/L	-
Cadmium	0.001 mg/L	<0.001	-	-	-	0.7 mg/L	-
Chromium	0.05 mg/L	<0.05	-	-	-	5 mg/L	-
Cobalt	0.001 mg/L	0.005	-	-	-	5 mg/L	-
Copper	0.005 mg/L	0.007	-	-	-	3 mg/L	-
Lead	0.001 mg/L	0.002	-	-	-	3 mg/L	-
Mercury	0.0001 mg/L	<0.0001	-	-	-	0.01 mg/L	-
Manganese	0.05 mg/L	0.55	-	-	-	5 mg/L	-
Molybdenum	0.005 mg/L	0.009	-	-	-	5 mg/L	-
Nickel	0.005 mg/L	0.010	-	-	-	3 mg/L	-
Selenium	0.005 mg/L	<0.005	-	-	-	1 mg/L	-
Silver	0.001 mg/L	<0.001	-	-	-	5 mg/L	-

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Client ID:	BH/MW106-UF	-	-	-	Criteria:
Sample Date:	13-May-24 13:00	-	-	-	Sewer Use - Peel:
Sample ID:	2420104-01	-	-	-	San/Comb
Matrix:	Groundwater	-	-	-	-
MDL/Units					

Metals - Total

Tin	0.01 mg/L	<0.01	-	-	-	5 mg/L	-
Titanium	0.01 mg/L	0.06	-	-	-	5 mg/L	-
Zinc	0.02 mg/L	<0.02	-	-	-	3 mg/L	-

Volatiles

Benzene	0.0005 mg/L	<0.0005	-	-	-	0.01 mg/L	-
Chloroform	0.0005 mg/L	<0.0005	-	-	-	0.04 mg/L	-
1,2-Dichlorobenzene	0.0005 mg/L	<0.0005	-	-	-	0.05 mg/L	-
1,4-Dichlorobenzene	0.0005 mg/L	<0.0005	-	-	-	0.08 mg/L	-
cis-1,2-Dichloroethylene	0.0005 mg/L	<0.0005	-	-	-	4 mg/L	-
trans-1,3-Dichloropropylene	0.0005 mg/L	<0.0005	-	-	-	0.14 mg/L	-
Ethylbenzene	0.0005 mg/L	<0.0005	-	-	-	0.16 mg/L	-
Methyl Ethyl Ketone (2-Butanone)	0.0050 mg/L	<0.0050	-	-	-	8 mg/L	-
Methylene Chloride	0.0050 mg/L	<0.0050	-	-	-	2 mg/L	-
Styrene	0.0005 mg/L	<0.0005	-	-	-	8 mg/L	-
1,1,2,2-Tetrachloroethane	0.0005 mg/L	<0.0005	-	-	-	1.4 mg/L	-
Tetrachloroethylene	0.0005 mg/L	<0.0005	-	-	-	1 mg/L	-
Toluene	0.0005 mg/L	<0.0005	-	-	-	0.27 mg/L	-
Trichloroethylene	0.0005 mg/L	<0.0005	-	-	-	0.4 mg/L	-
Xylenes, total	0.0005 mg/L	<0.0005	-	-	-	1.4 mg/L	-
Dibromofluoromethane	Surrogate	116%	-	-	-	-	-
Toluene-d8	Surrogate	112%	-	-	-	-	-
4-Bromofluorobenzene	Surrogate	115%	-	-	-	-	-

Hydrocarbons

Oil & Grease, animal/vegetable	0.5 mg/L	<0.5	-	-	-	150 mg/L	-
Oil & Grease, mineral/synthetic	0.5 mg/L	<0.5	-	-	-	15 mg/L	-

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Client ID:	BH/MW106-UF	-	-	-	Criteria:
Sample Date:	13-May-24 13:00	-	-	-	Sewer Use - Peel:
Sample ID:	2420104-01	-	-	-	San/Comb
Matrix:	Groundwater	-	-	-	-
MDL/Units					

Hydrocarbons

Oil & Grease, total	0.5 mg/L	<0.5	-	-	-	-
---------------------	----------	------	---	---	---	---

Semi-Volatiles

Bis(2-ethylhexyl)phthalate	0.001 mg/L	<0.001	-	-	-	0.012 mg/L	-
Di-n-butylphthalate	0.001 mg/L	<0.001	-	-	-	0.08 mg/L	-
Terphenyl-d14	Surrogate	90.8%	-	-	-	-	-

PCBs

PCBs, total	0.05 ug/L	<0.05	-	-	-	0.001 mg/L	-
Decachlorobiphenyl	Surrogate	71.7%	-	-	-	-	-

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Blank

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
Anions								
Fluoride	ND	0.1	mg/L					
Sulphate	ND	1	mg/L					
General Inorganics								
CBOD	ND	2	mg/L					
Cyanide, total	ND	0.01	mg/L					
Phenolics	ND	0.001	mg/L					
Phosphorus, total	ND	0.01	mg/L					
Total Suspended Solids	ND	2	mg/L					
Total Kjeldahl Nitrogen	ND	0.1	mg/L					
Hydrocarbons								
Oil & Grease, mineral/synthetic	ND	0.5	mg/L					
Oil & Grease, total	ND	0.5	mg/L					
Metals - Total								
Aluminum	ND	0.01	mg/L					
Antimony	ND	0.001	mg/L					
Arsenic	ND	0.01	mg/L					
Cadmium	ND	0.001	mg/L					
Chromium	ND	0.05	mg/L					
Cobalt	ND	0.001	mg/L					
Copper	ND	0.005	mg/L					
Lead	ND	0.001	mg/L					
Mercury	ND	0.0001	mg/L					
Manganese	ND	0.05	mg/L					
Molybdenum	ND	0.005	mg/L					
Nickel	ND	0.005	mg/L					
Selenium	ND	0.005	mg/L					
Silver	ND	0.001	mg/L					
Tin	ND	0.01	mg/L					
Titanium	ND	0.01	mg/L					
Zinc	ND	0.02	mg/L					
PCBs								
PCBs, total	ND	0.05	ug/L					

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Blank

Analyte	Result	Reporting Limit	Units	%REC	%REC Limit	RPD	RPD Limit	Notes
<i>Surrogate: Decachlorobiphenyl</i>	0.424		%	84.7	60-140			
Semi-Volatiles								
Bis(2-ethylhexyl)phthalate	ND	0.001	mg/L					
Di-n-butylphthalate	ND	0.001	mg/L					
<i>Surrogate: 2-Fluorobiphenyl</i>	0.0152		%	76.0	76-125			
<i>Surrogate: Nitrobenzene-d5</i>	0.0140		%	70.0	68-125			
<i>Surrogate: Terphenyl-d14</i>	0.0172		%	85.8	70-125			
Volatiles								
Benzene	ND	0.0005	mg/L					
Chloroform	ND	0.0005	mg/L					
1,2-Dichlorobenzene	ND	0.0005	mg/L					
1,4-Dichlorobenzene	ND	0.0005	mg/L					
cis-1,2-Dichloroethylene	ND	0.0005	mg/L					
trans-1,3-Dichloropropylene	ND	0.0005	mg/L					
Ethylbenzene	ND	0.0005	mg/L					
Methyl Ethyl Ketone (2-Butanone)	ND	0.0050	mg/L					
Methylene Chloride	ND	0.0050	mg/L					
Styrene	ND	0.0005	mg/L					
1,1,2,2-Tetrachloroethane	ND	0.0005	mg/L					
Tetrachloroethylene	ND	0.0005	mg/L					
Toluene	ND	0.0005	mg/L					
Trichloroethylene	ND	0.0005	mg/L					
Xylenes, total	ND	0.0005	mg/L					
<i>Surrogate: 4-Bromofluorobenzene</i>	0.0908		%	113	50-140			
<i>Surrogate: Dibromofluoromethane</i>	0.0936		%	117	50-140			
<i>Surrogate: Toluene-d8</i>	0.0880		%	110	50-140			

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Duplicate

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Anions									
Fluoride	ND	0.1	mg/L	ND			NC	20	
Sulphate	4.70	1	mg/L	4.56			3.0	10	
General Inorganics									
CBOD	3940	2	mg/L	4260			7.7	20	
Cyanide, total	ND	0.01	mg/L	ND			NC	20	
pH	8.1	0.1	pH Units	8.1			0.1	3.3	
Phenolics	ND	0.001	mg/L	ND			NC	10	
Phosphorus, total	0.016	0.01	mg/L	0.018			13.5	15	
Total Suspended Solids	40.0	2	mg/L	43.0			7.2	10	
Total Kjeldahl Nitrogen	0.75	0.1	mg/L	0.88			15.9	16	
Metals - Total									
Aluminum	4.53	0.01	mg/L	4.47			1.4	20	
Antimony	ND	0.001	mg/L	ND			NC	20	
Arsenic	ND	0.01	mg/L	ND			NC	20	
Cadmium	ND	0.001	mg/L	ND			NC	20	
Chromium	ND	0.05	mg/L	ND			NC	20	
Cobalt	0.006	0.001	mg/L	0.005			7.4	20	
Copper	0.008	0.005	mg/L	0.007			7.1	20	
Lead	0.002	0.001	mg/L	0.002			5.3	20	
Mercury	ND	0.0001	mg/L	ND			NC	20	
Manganese	0.571	0.05	mg/L	0.549			3.9	20	
Molybdenum	0.009	0.005	mg/L	0.009			1.0	20	
Nickel	0.010	0.005	mg/L	0.010			2.1	20	
Selenium	ND	0.005	mg/L	ND			NC	20	
Silver	ND	0.001	mg/L	ND			NC	20	
Tin	ND	0.01	mg/L	ND			NC	20	
Titanium	0.060	0.01	mg/L	0.062			4.4	20	
Zinc	ND	0.02	mg/L	ND			NC	20	
Volatiles									
Benzene	ND	0.0005	mg/L	ND			NC	30	

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Duplicate

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Chloroform	ND	0.0005	mg/L	ND			NC	30	
1,2-Dichlorobenzene	ND	0.0005	mg/L	ND			NC	30	
1,4-Dichlorobenzene	ND	0.0005	mg/L	ND			NC	30	
cis-1,2-Dichloroethylene	ND	0.0005	mg/L	ND			NC	30	
trans-1,3-Dichloropropylene	ND	0.0005	mg/L	ND			NC	30	
Ethylbenzene	ND	0.0005	mg/L	ND			NC	30	
Methyl Ethyl Ketone (2-Butanone)	ND	0.0050	mg/L	ND			NC	30	
Methylene Chloride	ND	0.0050	mg/L	ND			NC	30	
Styrene	ND	0.0005	mg/L	ND			NC	30	
1,1,2,2-Tetrachloroethane	ND	0.0005	mg/L	ND			NC	30	
Tetrachloroethylene	ND	0.0005	mg/L	ND			NC	30	
Toluene	ND	0.0005	mg/L	ND			NC	30	
Trichloroethylene	ND	0.0005	mg/L	ND			NC	30	
m,p-Xylenes	ND	0.0005	mg/L	ND			NC	30	
o-Xylene	ND	0.0005	mg/L	ND			NC	30	
Surrogate: 4-Bromofluorobenzene	0.0911		%		114	50-140			
Surrogate: Dibromofluoromethane	0.0949		%		119	50-140			
Surrogate: Toluene-d8	0.0892		%		112	50-140			

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Spike

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Anions									
Fluoride	1.01	0.1	mg/L	ND	101	70-130			
Sulphate	15.0	1	mg/L	4.56	104	74-126			
General Inorganics									
CBOD	274	2	mg/L	ND	137	62-129			QS-02
Cyanide, total	0.049	0.01	mg/L	ND	97.5	64-136			
Phenolics	0.025	0.001	mg/L	ND	100	67-133			
Phosphorus, total	0.998	0.01	mg/L	0.018	98.0	80-120			
Total Suspended Solids	23.0	2	mg/L	ND	107	75-125			
Total Kjeldahl Nitrogen	1.85	0.1	mg/L	0.88	96.7	81-126			
Hydrocarbons									
Oil & Grease, mineral/synthetic	6.60	0.5	mg/L	ND	66.0	65-110			
Oil & Grease, total	19.0	0.5	mg/L	ND	95.0	85-110			
Metals - Total									
Aluminum	59.1	0.01	mg/L	ND	118	80-120			
Arsenic	54.6	0.01	mg/L	0.436	108	80-120			
Cadmium	53.7	0.001	mg/L	0.003	107	80-120			
Chromium	65.5	0.05	mg/L	0.799	129	80-120			QM-07
Cobalt	61.7	0.001	mg/L	0.528	122	80-120			QM-07
Copper	56.2	0.005	mg/L	0.717	111	80-120			
Lead	50.2	0.001	mg/L	0.193	100	80-120			
Mercury	0.0029	0.0001	mg/L	ND	95.3	70-130			
Manganese	122	0.05	mg/L	54.9	134	80-120			QM-07
Molybdenum	59.4	0.005	mg/L	0.866	117	80-120			
Nickel	59.5	0.005	mg/L	0.986	117	80-120			
Selenium	45.6	0.005	mg/L	0.095	91.1	80-120			
Silver	52.6	0.001	mg/L	0.062	105	80-120			
Tin	54.4	0.01	mg/L	0.145	109	80-120			
Titanium	73.7	0.01	mg/L	6.24	135	80-120			QM-07
Zinc	51.0	0.02	mg/L	1.75	98.4	80-120			

PCBs

Certificate of Analysis

Report Date: 27-May-2024

Client: G2S Environmental Consulting Inc. (Burlington)

Order Date: 13-May-2024

Client PO: G2S24018

Project Description: Fieldgate

Method Quality Control: Spike

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
PCBs, total	1.24	0.05	ug/L	ND	124	65-135			
<i>Surrogate: Decachlorobiphenyl</i>	<i>0.450</i>		%		<i>90.0</i>	<i>60-140</i>			
Semi-Volatiles									
Bis(2-ethylhexyl)phthalate	0.0084	0.001	mg/L	ND	84.0	50-140			
Di-n-butylphthalate	0.0083	0.001	mg/L	ND	83.1	50-140			
<i>Surrogate: 2-Fluorobiphenyl</i>	<i>0.0152</i>		%		<i>76.0</i>	<i>76-125</i>			
<i>Surrogate: Nitrobenzene-d5</i>	<i>0.0140</i>		%		<i>70.0</i>	<i>68-125</i>			
<i>Surrogate: Terphenyl-d14</i>	<i>0.0164</i>		%		<i>82.2</i>	<i>70-125</i>			
Volatiles									
Benzene	0.0420	0.0005	mg/L	ND	105	60-130			
Chloroform	0.0439	0.0005	mg/L	ND	110	60-130			
1,2-Dichlorobenzene	0.0381	0.0005	mg/L	ND	95.2	60-130			
1,4-Dichlorobenzene	0.0389	0.0005	mg/L	ND	97.3	60-130			
cis-1,2-Dichloroethylene	0.0364	0.0005	mg/L	ND	91.1	60-130			
trans-1,3-Dichloropropylene	0.0417	0.0005	mg/L	ND	104	60-130			
Ethylbenzene	0.0367	0.0005	mg/L	ND	91.6	60-130			
Methyl Ethyl Ketone (2-Butanone)	0.0797	0.0050	mg/L	ND	79.7	50-140			
Methylene Chloride	0.0305	0.0050	mg/L	ND	76.3	60-130			
Styrene	0.0346	0.0005	mg/L	ND	86.4	60-130			
1,1,2,2-Tetrachloroethane	0.0378	0.0005	mg/L	ND	94.5	60-130			
Tetrachloroethylene	0.0332	0.0005	mg/L	ND	83.0	60-130			
Toluene	0.0368	0.0005	mg/L	ND	91.9	60-130			
Trichloroethylene	0.0416	0.0005	mg/L	ND	104	60-130			
m,p-Xylenes	0.0735	0.0005	mg/L	ND	91.8	60-130			
o-Xylene	0.0385	0.0005	mg/L	ND	96.4	60-130			
<i>Surrogate: 4-Bromofluorobenzene</i>	<i>0.0804</i>		%		<i>100</i>	<i>50-140</i>			
<i>Surrogate: Dibromofluoromethane</i>	<i>0.0915</i>		%		<i>114</i>	<i>50-140</i>			
<i>Surrogate: Toluene-d8</i>	<i>0.0759</i>		%		<i>94.9</i>	<i>50-140</i>			

Certificate of Analysis

Report Date: 27-May-2024

Client: **G2S Environmental Consulting Inc. (Burlington)**

Order Date: 13-May-2024

Client PO: **G2S24018**

Project Description: Fieldgate

Qualifier Notes:

QC Qualifiers:

- QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.
- QS-02 Spike level outside of control limits. Analysis batch accepted based on other QC included in the batch.

Sample Data Revisions:

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.



Parcel ID: 2420104



vd. J8 com	Parcel Order Number (Lab Use Only) 2420104	Chain Of Custody (Lab Use Only) No 66341
----------------------	--	--

Client Name: <u>GAS</u>	Project Ref: <u>Fieldgate</u>	Page <u>1</u> of <u>1</u>
Contact Name: <u>Jacob Pinter + Whitney Bowden</u>	Quote #: <u>standing offer</u>	Turnaround Time <input type="checkbox"/> 1 day <input type="checkbox"/> 3 day <input type="checkbox"/> 2 day <input checked="" type="checkbox"/> Regular
Address: <u>Burlington</u>	PO #: <u>EAS24018</u>	
Telephone: <u>905 719 5253</u>	E-mail: <u>jacob.p@gasconsulting.com</u> <u>whitney.b@gasconsulting.com</u>	
Date Required: _____		

<input type="checkbox"/> REG 153/04 <input type="checkbox"/> REG 406/19 Other Regulation <input type="checkbox"/> Table 1 <input type="checkbox"/> Res/Park <input type="checkbox"/> Med/Fine <input type="checkbox"/> REG 558 <input type="checkbox"/> PWQO <input type="checkbox"/> Table 2 <input type="checkbox"/> Ind/Comm <input type="checkbox"/> Coarse <input type="checkbox"/> CCME <input type="checkbox"/> MISA <input type="checkbox"/> Table 3 <input type="checkbox"/> Agri/Other <input checked="" type="checkbox"/> SU - Sani <input type="checkbox"/> SU - Storm <input type="checkbox"/> Table _____ For RSC: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Other: _____		Matrix Type: S (Soil/Sed.) GW (Ground Water) SW (Surface Water) SS (Storm/Sanitary Sewer) P (Paint) A (Air) O (Other)	Required Analysis
Sample ID/Location Name	Matrix Air Volume # of Containers	Sample Taken Date Time	(Vertical column for analysis results)
1 <u>BH/MW 106-UF</u>	<u>GW</u> <u>14</u>	<u>May 13/24</u> <u>1pm</u>	<u>X</u>
2			
3			
4			
5			
6			
7			
8			
9			
10			

Comments:		Method of Delivery: <u>Hand Delivered</u>	
Relinquished By (Sign): <u>Jacob Pinter</u>	Received By Driver/Depot: <u>JH</u>	Received at Lab: <u>SO</u>	Verified By: <u>SO</u>
Relinquished By (Print): <u>Jacob Pinter</u>	Date/Time: <u>May 13/24 17:00</u>	Date/Time: <u>May 15, 2024 9:26</u>	Date/Time: <u>May 15, 2024 4:44</u>
Date/Time: <u>May 13/24 (4:40pm)</u>	Temperature: <u>17.1 °C</u>	Temperature: <u>16.7 °C</u>	pH Verified: <input checked="" type="checkbox"/> By <u>SO</u>