



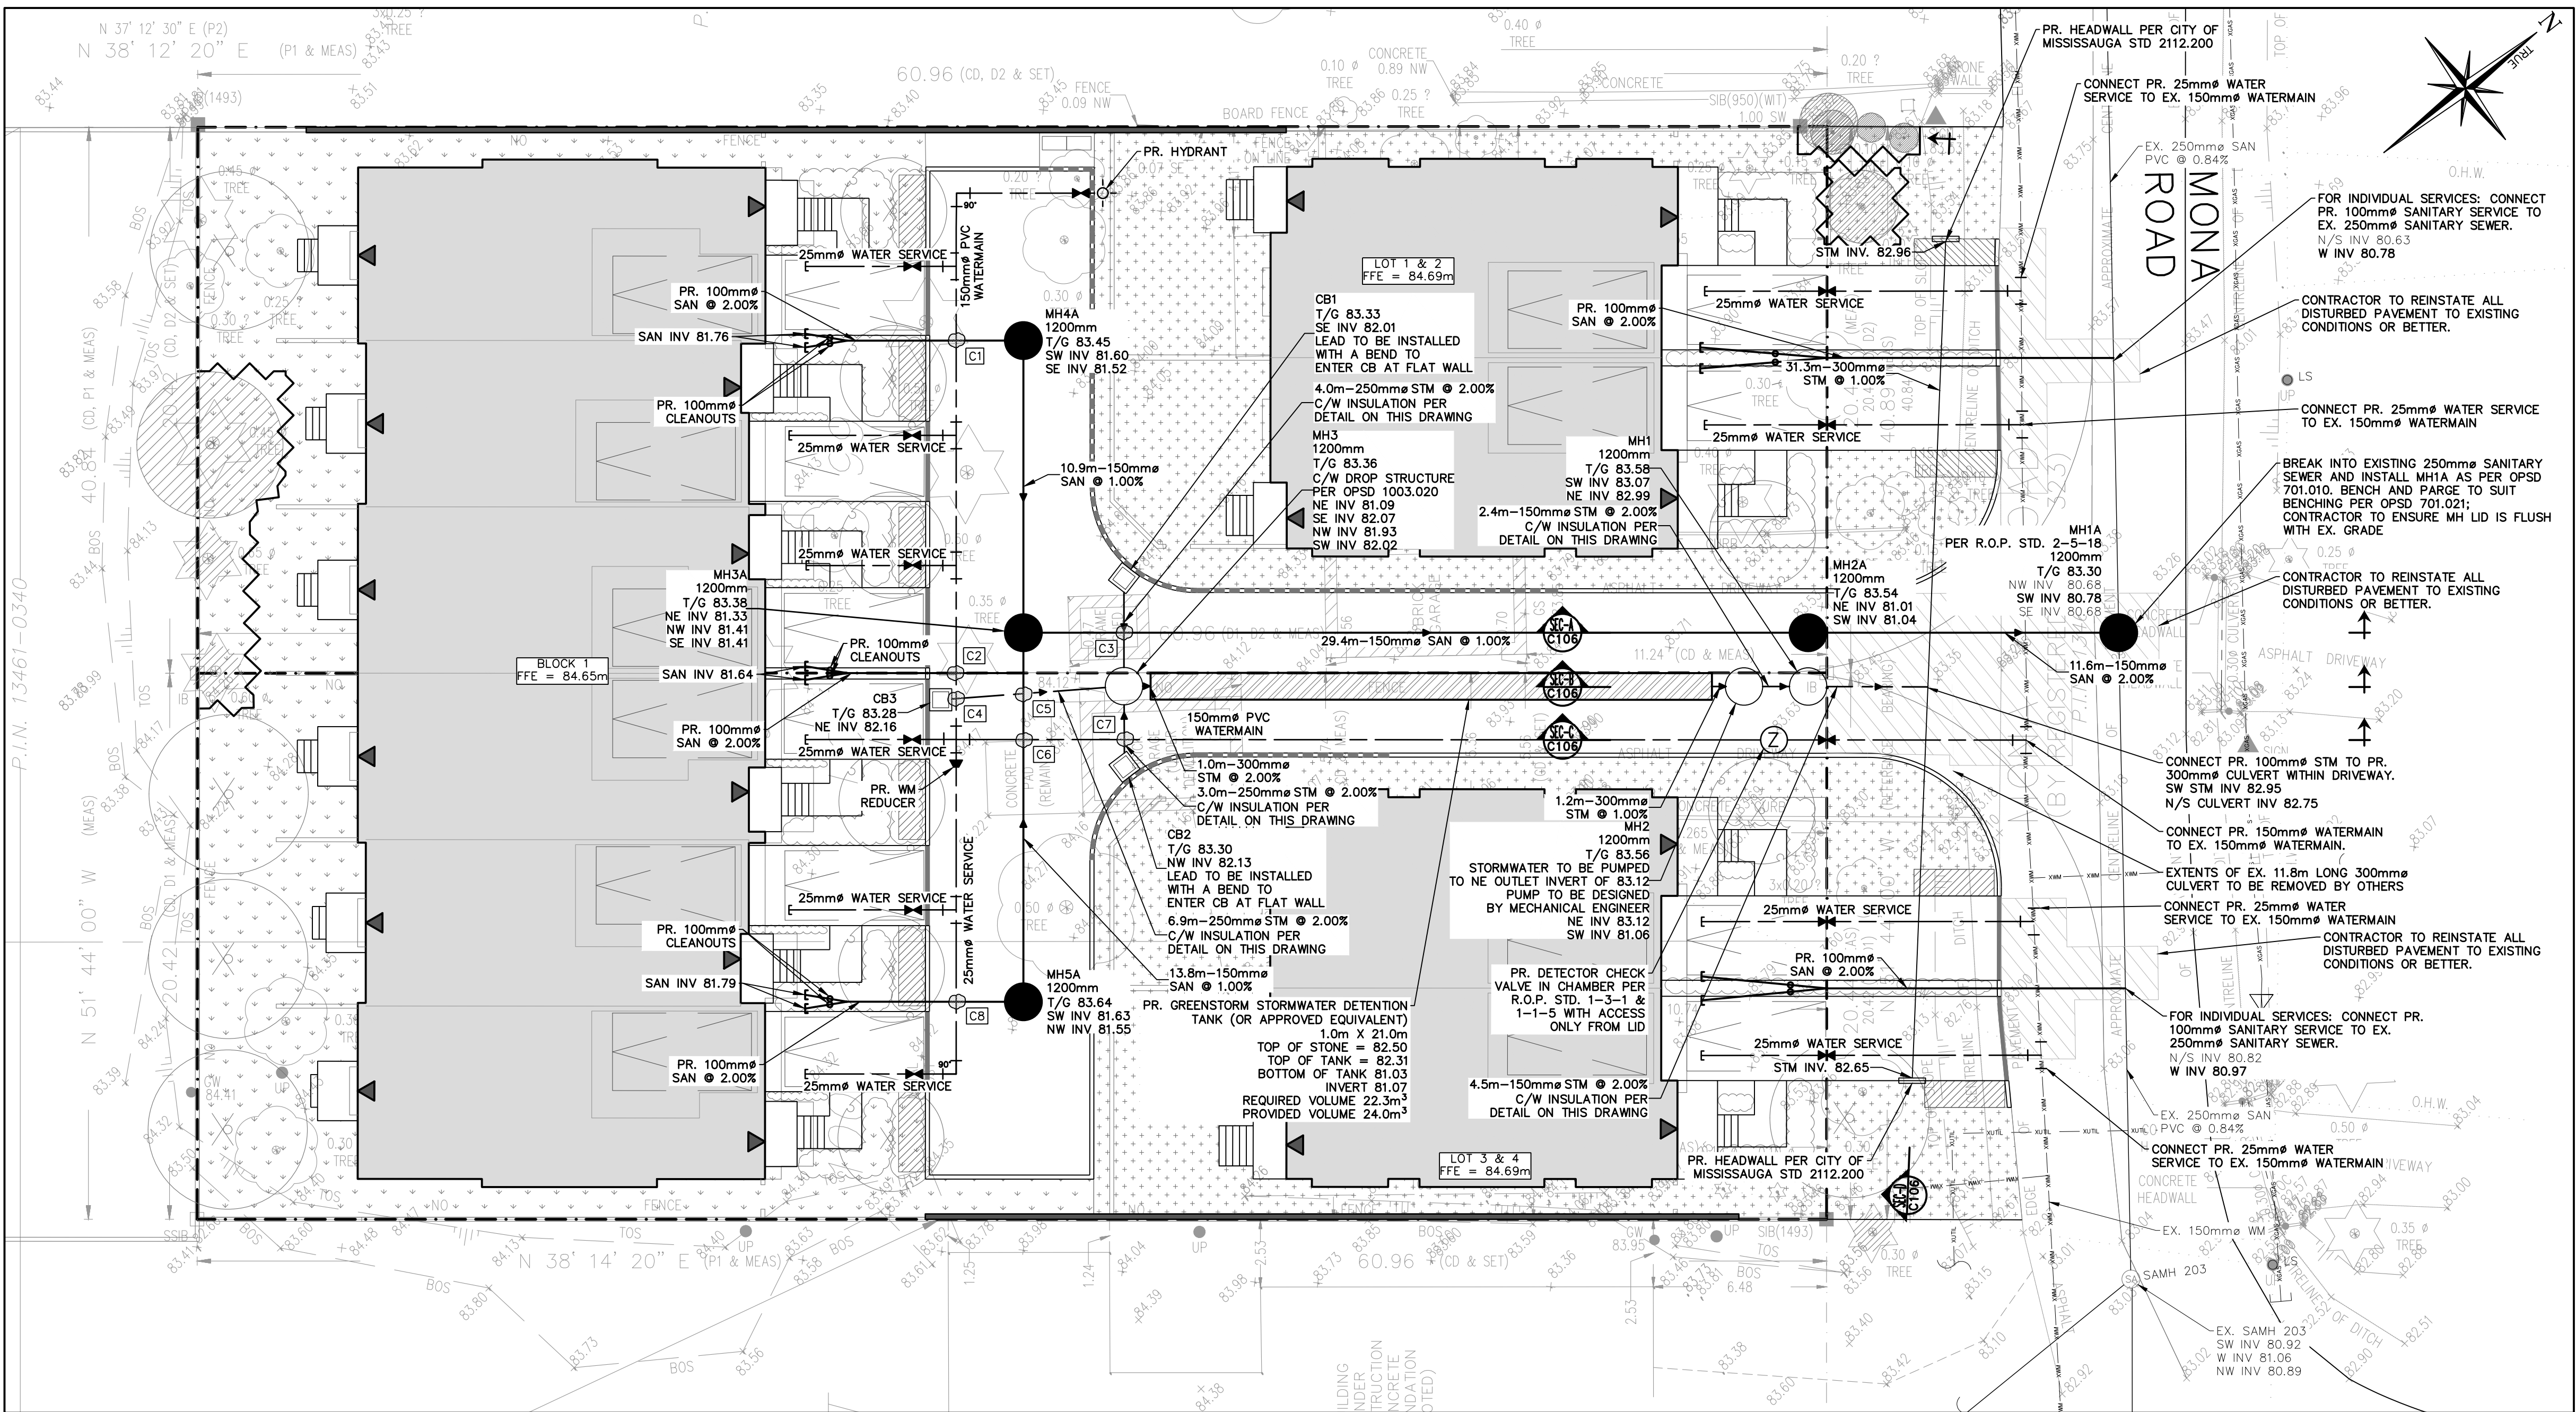


LEGEND	
	PROPERTY LINE
	EXISTING WATERMAIN & GATE VALVE
	EXISTING STORM SEWER & MANHOLE
	EXISTING SINGLE / DOUBLE CATCHBASIN
	EXISTING SANITARY SEWER & MANHOLE
	PROPOSED WATERMAIN & GATE VALVE
	PROPOSED FIRE HYDRANT & GATE VALVE
	PROPOSED SIAMESE CONNECTION
	PROPOSED WATER METER
	PROPOSED STORM SEWER & MANHOLE
	PROPOSED STORMWATER TANK
	PROPOSED SANITARY SEWER & MANHOLE
	PROPOSED SANITARY CLEANOUT
	TREE PROTECTION ZONE (PER DRAWING BY ALEXANDER BUDREVICS AND ASSOCIATES LIMITED)
	PROPOSED RETAINING WALL
	PROPOSED PAVEMENT REINSTATEMENT
	PROPOSED GARBAGE PADS
	SERVICING CROSSING LOCATION

REGION OF PEEL NOTES:

- ALL MATERIALS AND CONSTRUCTION METHODS MUST CORRESPOND TO THE CURRENT PEEL PUBLIC WORKS STANDARDS AND SPECIFICATIONS.
- WATERMAIN AND / OR WATER SERVICE MATERIALS 100 MM (4") AND LARGER MUST BE PVC DR18 CONSTRUCTED AS PER AWWA C900-16, SIZE 50 MM (2") AND SMALLER MUST BE TYPE K SOFT COPPER CONSTRUCTED AS PER ASTM B88-49 OR POLYETHYLENE CONSTRUCTED AS PER AWWA C901 AND CSA B.137.10 (CHOOSE ONLY ONE MATERIAL).
- WATERMAINS AND / OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 1.7 M (5'6") WITH A MINIMUM HORIZONTAL SPACING OF 1.2 M (4") FROM THEMSELVES AND ALL OTHER UTILITIES.
- PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING, ETC. MUST BE PROVIDED WITH AT LEAST A 50 MM (2") OUTLET ON 100 MM (4") AND LARGER LINES. COPPER LINES ARE TO HAVE FLUSHING POINTS AT THE END, THE SAME SIZE AS THE LINE. THEY MUST ALSO BE HOSED OR PIPED TO ALLOW THE WATER TO DRAIN ONTO A PARKING LOT OR DOWN A DRAIN. ON FIRE LINES, FLUSHING OUTLET TO BE 100 MM (4") DIAMETER MINIMUM ON A HYDRANT.
- ALL CURB STOPS TO BE 3.0 M (10') OFF THE FACE OF THE BUILDING UNLESS OTHERWISE NOTED.
- HYDRANT AND VALVE SET TO REGION STANDARD 1 - 6 - 1 DIMENSION A AND B, 0.7 M (2') AND 0.9 M (3') AND TO HAVE PUMPER NOZZLE.
- WATERMAINS TO BE INSTALLED TO GRADES AS SHOWN ON APPROVED SITE PLAN. COPY OF GRADE SHEET MUST BE SUPPLIED TO INSPECTOR PRIOR TO COMMENCEMENT OF WORK, WHERE REQUESTED BY INSPECTOR.
- WATERMAINS MUST HAVE A MINIMUM VERTICAL CLEARANCE OF 0.3 M (12") OVER / 0.5 M (20") UNDER SEWERS AND ALL OTHER UTILITIES WHEN CROSSING.
- ALL PROPOSED WATER PIPING MUST BE ISOLATED FROM EXISTING LINES IN ORDER TO ALLOW INDEPENDENT PRESSURE TESTING AND CHLORINATING FROM EXISTING SYSTEMS.
- ALL LIVE TAPPING AND OPERATION OF REGION WATER VALVES SHALL BE ARRANGED THROUGH THE REGIONAL INSPECTOR ASSIGNED OR BY CONTACTING THE OPERATIONS AND MAINTENANCE DIVISION.
- LOCATION OF ALL EXISTING UTILITIES IN THE FIELD TO BE ESTABLISHED BY THE CONTRACTOR.
- THE CONTRACTOR(S) SHALL BE SOLELY RESPONSIBLE FOR LOCATES, EXPOSING, SUPPORTING AND PROTECTING OF ALL UNDERGROUND AND OVERHEAD UTILITIES AND STRUCTURES EXISTING AT THE TIME OF CONSTRUCTION IN THE AREA OF THEIR WORK. WHETHER SHOWN ON THE PLANS OR NOT AND FOR ALL REPAIRS AND CONSEQUENCES RESULTING FROM DAMAGE TO SAME.
- THE CONTRACTOR(S) SHALL BE SOLELY RESPONSIBLE TO GIVE 72 HOURS WRITTEN NOTICE TO THE UTILITIES PRIOR TO CROSSING SUCH UTILITIES, FOR THE PURPOSE OF INSPECTION BY THE CONCERNED UTILITY. THIS INSPECTION WILL BE FOR THE DURATION OF THE CONSTRUCTION, WITH THE CONTRACTOR RESPONSIBLE FOR ALL COSTS ARISING FROM SUCH INSPECTION.
- ALL PROPOSED WATER PIPING MUST BE ISOLATED THROUGH A TEMPORARY CONNECTION THAT SHALL INCLUDE AN APPROPRIATE CROSS-CONNECTION CONTROL DEVICE, CONSISTENT WITH THE DEGREE OF HAZARD, FOR BACKFLOW PREVENTION OF THE ACTIVE DISTRIBUTION SYSTEM, CONFORMING TO REGION OF PEEL STANDARDS 1-7-7 OR 1-7-8.
- ALL WATER METERS MUST BE INSTALLED IN HEATED AND ACCESSIBLE SPACE.

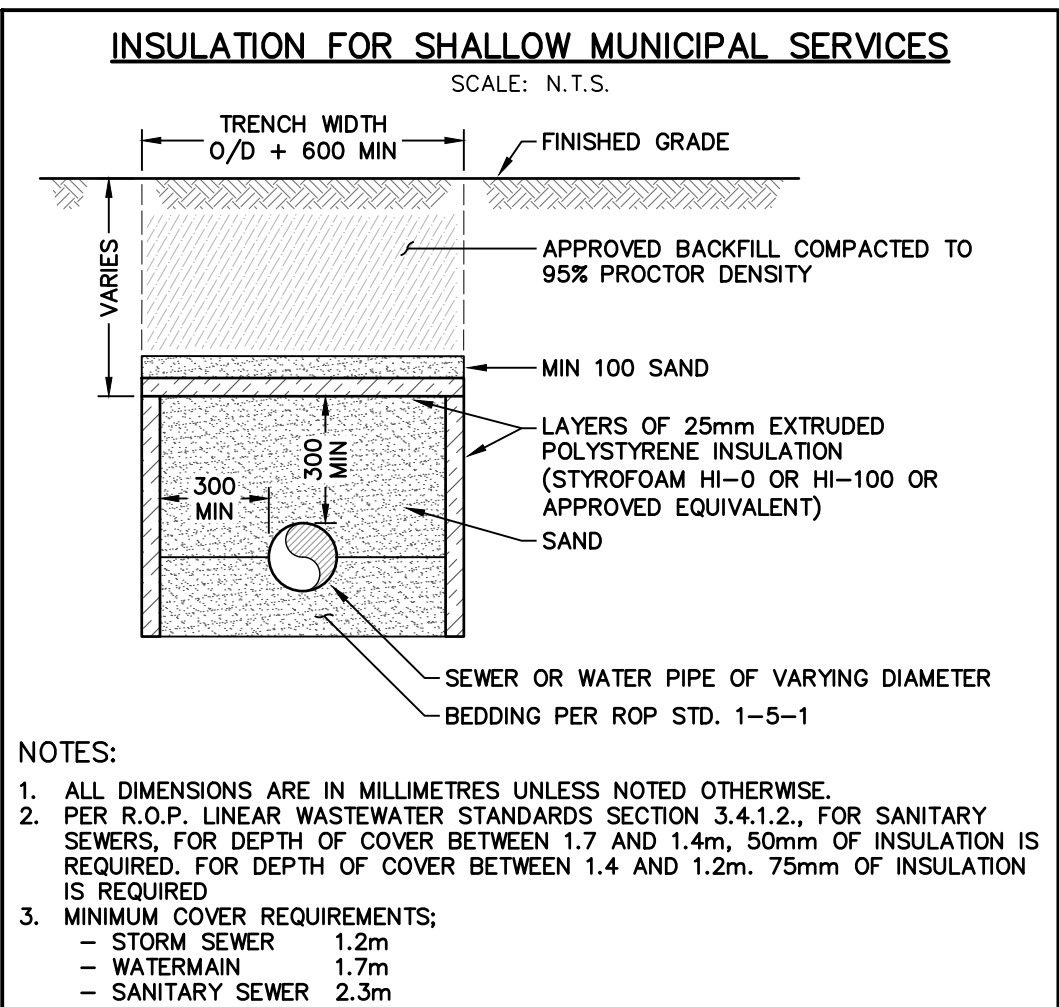

PROPOSED SERVICING CROSSING TABLE		
C1	WM OBVERT 80.95 SAN INVERT 81.45	WM VERTICAL BEND REQUIRED CLEARANCE = 0.50m
C2	WM OBVERT 81.03 SAN INVERT 81.53	WM VERTICAL BEND REQUIRED CLEARANCE = 0.50m
C3	SAN OBVERT 81.45 STM INVERT 81.97	CLEARANCE = 0.52m
C4	WM OBVERT 81.61 STM INVERT 82.15	CLEARANCE = 0.54m
C5	SAN OBVERT 81.59 STM INVERT 82.09	CLEARANCE = 0.50m
C6	WM OBVERT 80.95 SAN INVERT 81.45	WM VERTICAL BEND REQUIRED CLEARANCE = 0.50m
C7	WM OBVERT 81.61 STM INVERT 82.11	CLEARANCE = 0.50m
C8	WM OBVERT 81.18 SAN INVERT 81.68	WM VERTICAL BEND REQUIRED CLEARANCE = 0.50m



Stamp

Stamp



1	ISSUED FOR OPA/ZBA	2025/MAR/25
0	ISSUED FOR OPA/ZBA	2024/NOV/21
No.	ISSUE / REVISION	YYYY/MM/DD

ELEVATION NOTE:

ELEVATIONS ARE GEODETIC AND ARE REFERRED TO CITY OF MISSISSAUGA BENCHMARK N° 757 WITH A PUBLISHED ELEVATION OF 83.725 METERS (CGVD-1928)

SURVEY NOTES:

SURVEY COMPLETED BY GENESIS LAND SURVEYING INC. DATED MARCH 30, 2023
PROJECT No. GLS-1640

DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

BEARING NOTES:

BEARINGS ARE ASTROMONIC AND ARE REFERRED TO THE SOUTHWESTERLY LIMIT OF MONA ROAD HAVING A BEARING OF N 51° 44' 00" W AS SHOWN ON REGISTERED PLAN 323

DRAWING NOTES:

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF C.F. CROZIER & ASSOCIATES INC. AND THE REPRODUCTION OF ANY PART OF IT WITHOUT PRIOR WRITTEN CONSENT OF THIS OFFICE IS STRICTLY PROHIBITED.

THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, LEVELS, AND DATUMS ON SITE AND REPORT ANY DISCREPANCIES OR OMISSIONS TO THIS OFFICE PRIOR TO CONSTRUCTION. THIS DRAWING IS TO BE READ AND UNDERSTOOD IN CONJUNCTION WITH ALL OTHER PLANS AND DOCUMENTS APPLICABLE TO THIS PROJECT. DO NOT SCALE THIS DRAWING. ALL EXISTING UNDERGROUND UTILITIES TO BE VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO CONSTRUCTION.

Project

1148 & 1154 MONA ROAD
CITY OF MISSISSAUGA

Drawing

SERVICING PLAN

		Design	K.W./J.S.	Project No.	1113-7066
Drawn	A.A./L.E.	Check	J.S.	Scale	1:150
				DWG.	C102